


Date Saved: 27/01/2023
Document Path: \\uk.wspgroup.com\central_data\Projects\70078xxx\70078098 - LT193 Dunoon to Whistfield EIA\105 Drawings\GIS\MXDs\Planning EIA Figure2.mxd



Key

- Existing OHL
- Proposed OHL Alignment
- Proposed Tower Position
- Temporary Diversion
- Temporary Diversion Structure
- Borrow Pit Search Area
- Proposed Conductor Pulling Area (EPZ)
- Proposed Retained Access Track
- Proposed Access – Temporary
- Existing Track (No Upgrades Required - Good Condition)
- Existing Track (Upgrades Required - Fair Condition)
- Existing Track (Upgrades Required - Poor Condition)
- Existing Track (Upgrades Required - Very Poor Condition)
- ▲ Existing Bellmouth - Minimal Work Required
- ▲ Proposed Bellmouth Required - Temporary
- ▲ Proposed Bellmouth Required - Permanent
- Planning Authority Boundary




Client:  **Scottish & Southern**
Electricity Networks
TRANSMISSION

Project: **Dunoon to Loch Long 132kV OHL Rebuild**


Title: **Figure 2
Site Layout
Sheet 1 of 4**

Date: 02/02/2023 Scale: 15,000 @ A3
Drawn: AS Checked: IM Approved: SM

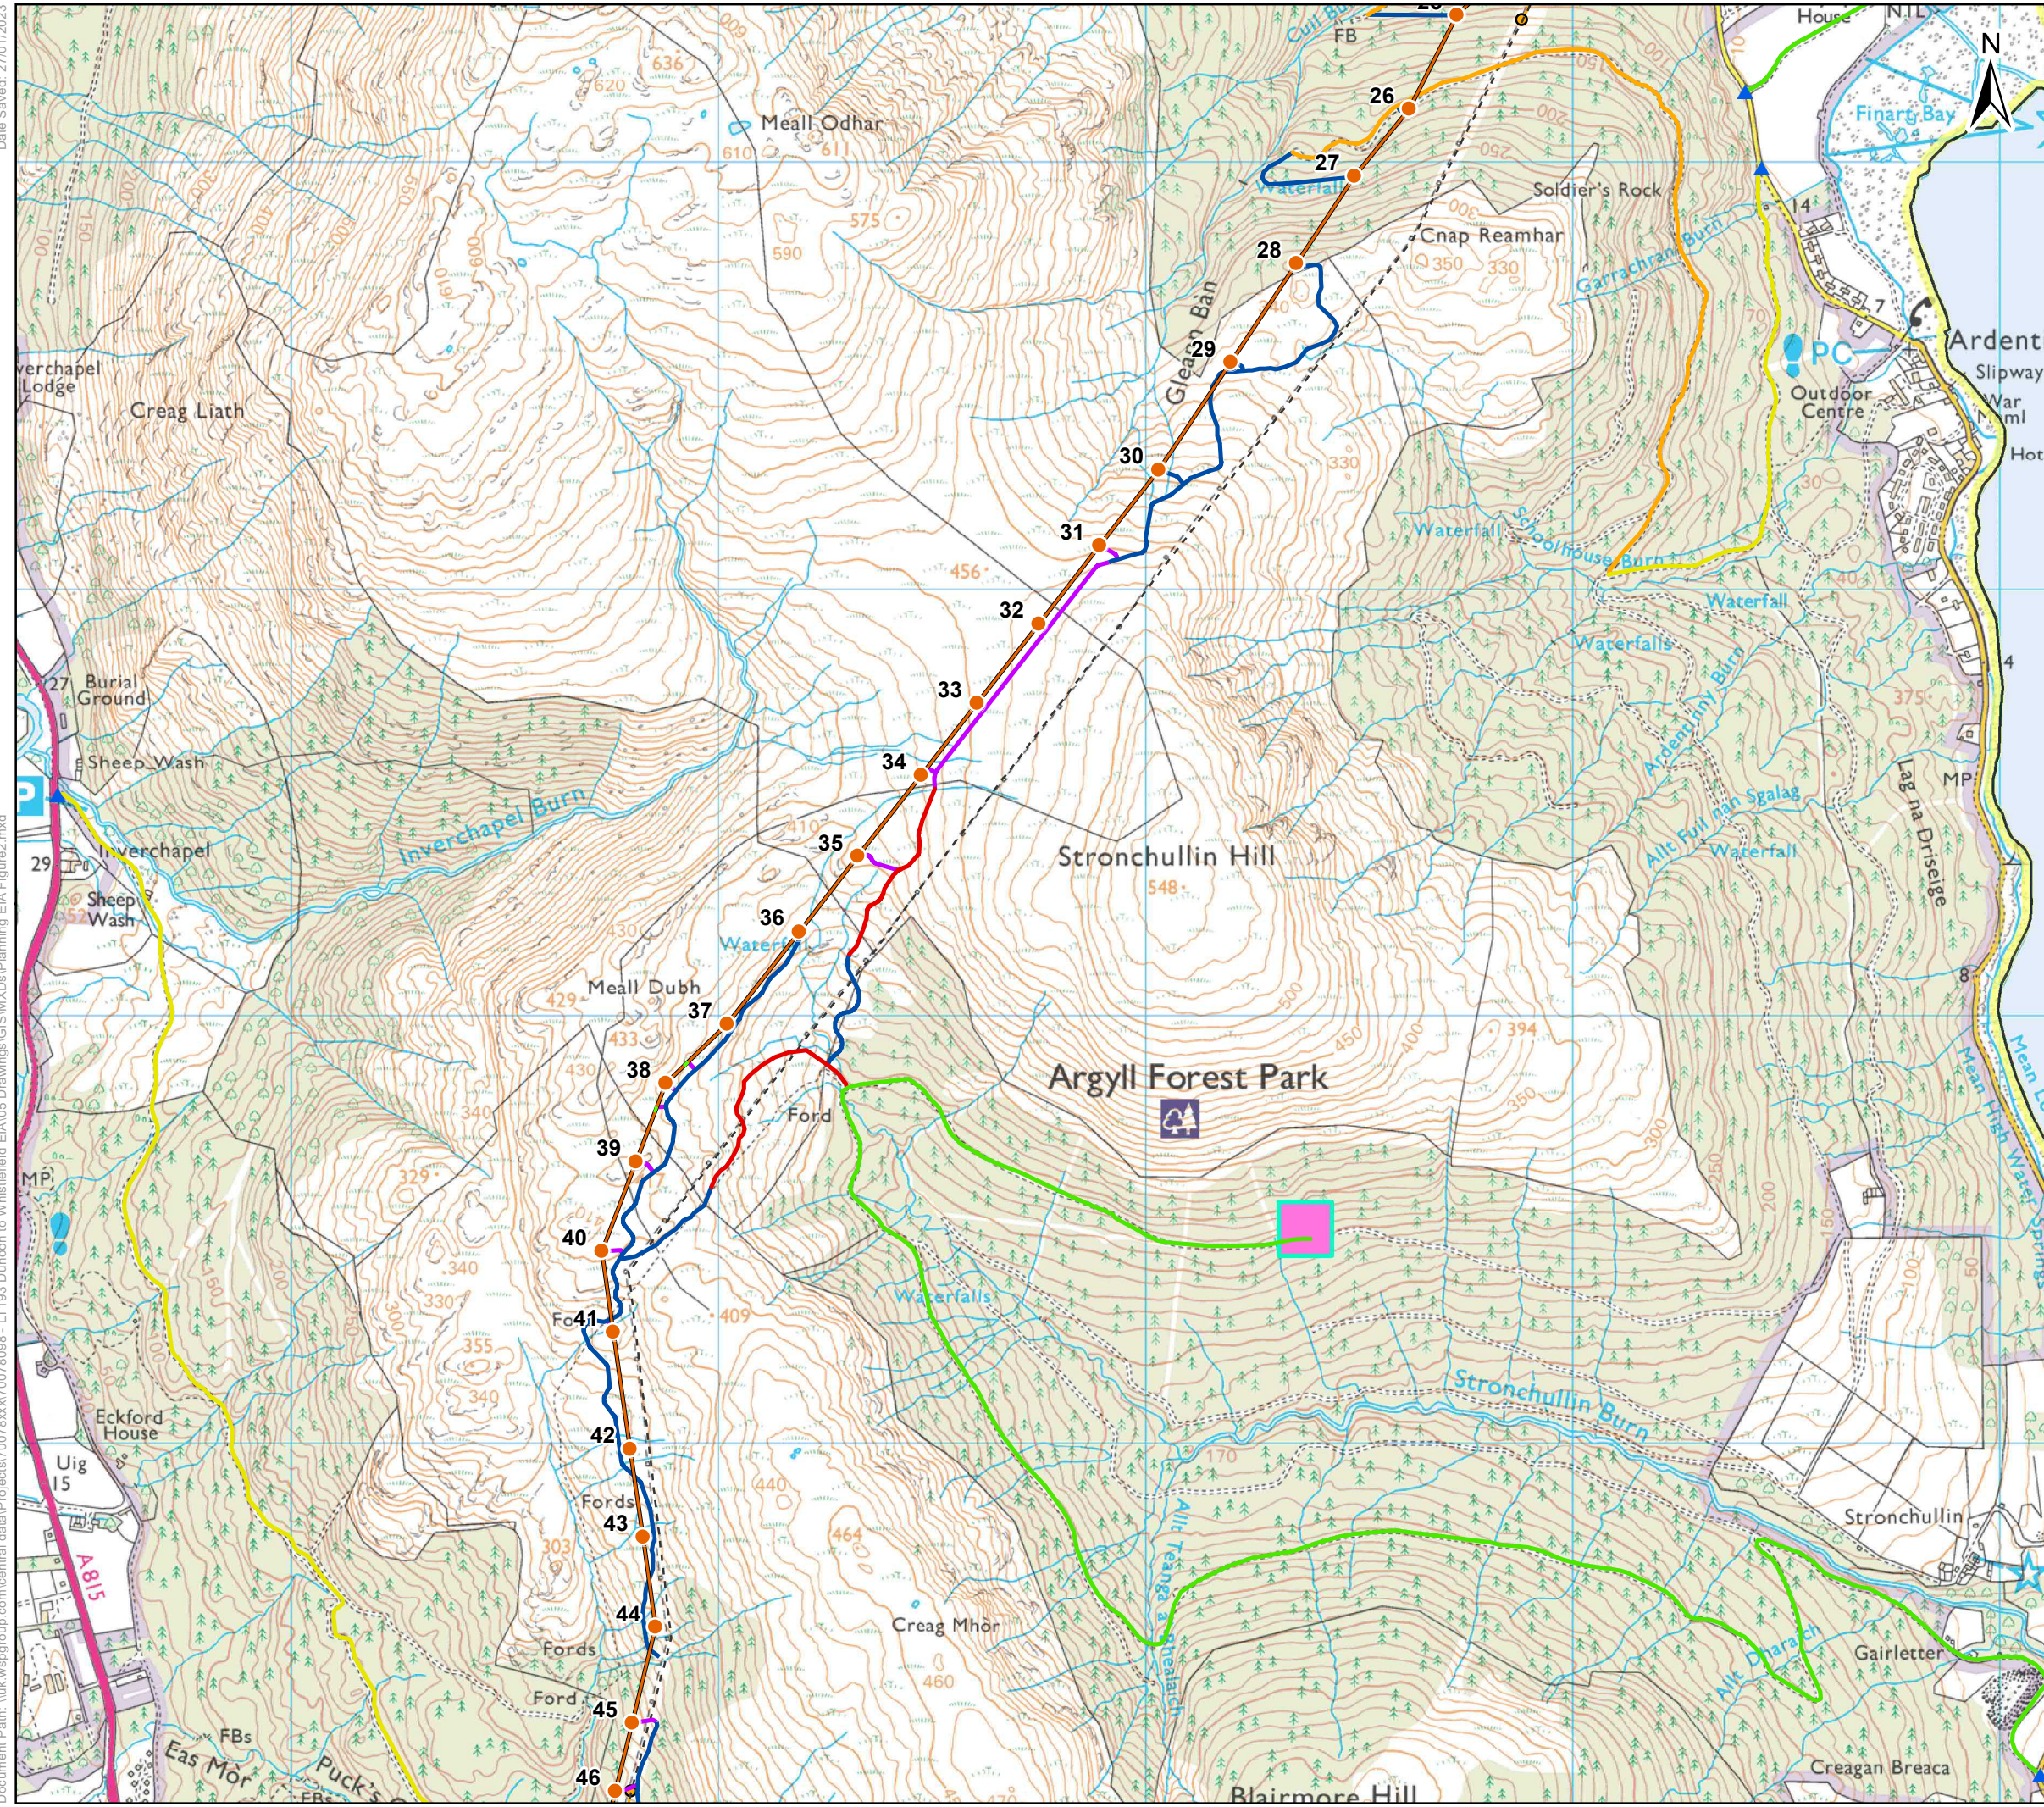

Key

- Existing OHL
- Proposed OHL Alignment
- Proposed Tower Position
- Temporary Diversion
- Temporary Diversion Structure
- Borrow Pit Search Area
- Proposed Conductor Pulling Area (EPZ)
- Proposed Retained Access Track
- Proposed Access - Temporary
- Existing Track (No Upgrades Required - Good Condition)
- Existing Track (Upgrades Required - Fair Condition)
- Existing Track (Upgrades Required - Poor Condition)
- Existing Track (Upgrades Required - Very Poor Condition)
- Existing Bellmouth - Minimal Work Required
- Proposed Bellmouth Required - Temporary
- Proposed Bellmouth Required - Permanent
- Planning Authority Boundary



Client: **Scottish & Southern**
Electricity Networks
TRANSMISSION

Project: **Dunoon to Loch Long 132kV OHL Rebuild**

Title: **Figure 2
Site Layout
Sheet 2 of 4**


Date: 02/02/2023 Scale: 15,000 @ A3
Drawn: AS Checked: IM Approved: SM


Date Saved: 27/01/2023
Document Path: \\uk.wspgroup.com\central_data\Projects\70078xxx\70078098 - LT193 Dunoon to Whistfield EIA\105 Drawings\GIS\MXDs\Planning EIA Figure2.mxd



Key

- Existing OHL
- Proposed OHL Alignment
- Proposed Tower Position
- Temporary Diversion
- Temporary Diversion Structure
- Borrow Pit Search Area
- Proposed Conductor Pulling Area (EPZ)
- Proposed Retained Access Track
- Proposed Access – Temporary
- Existing Track (No Upgrades Required - Good Condition)
- Existing Track (Upgrades Required - Fair Condition)
- Existing Track (Upgrades Required - Poor Condition)
- Existing Track (Upgrades Required - Very Poor Condition)
- ▲ Existing Bellmouth - Minimal Work Required
- ▲ Proposed Bellmouth Required - Temporary
- ▲ Proposed Bellmouth Required - Permanent
- Planning Authority Boundary




Client:  **Scottish & Southern**
Electricity Networks

TRANSMISSION

Project: **Dunoon to Loch Long 132kV OHL Rebuild**

Title: **Figure 2
Site Layout
Sheet 3 of 4**

Date: 02/02/2023 Scale: 15,000 @ A3
Drawn: AS Checked: IM Approved: SM

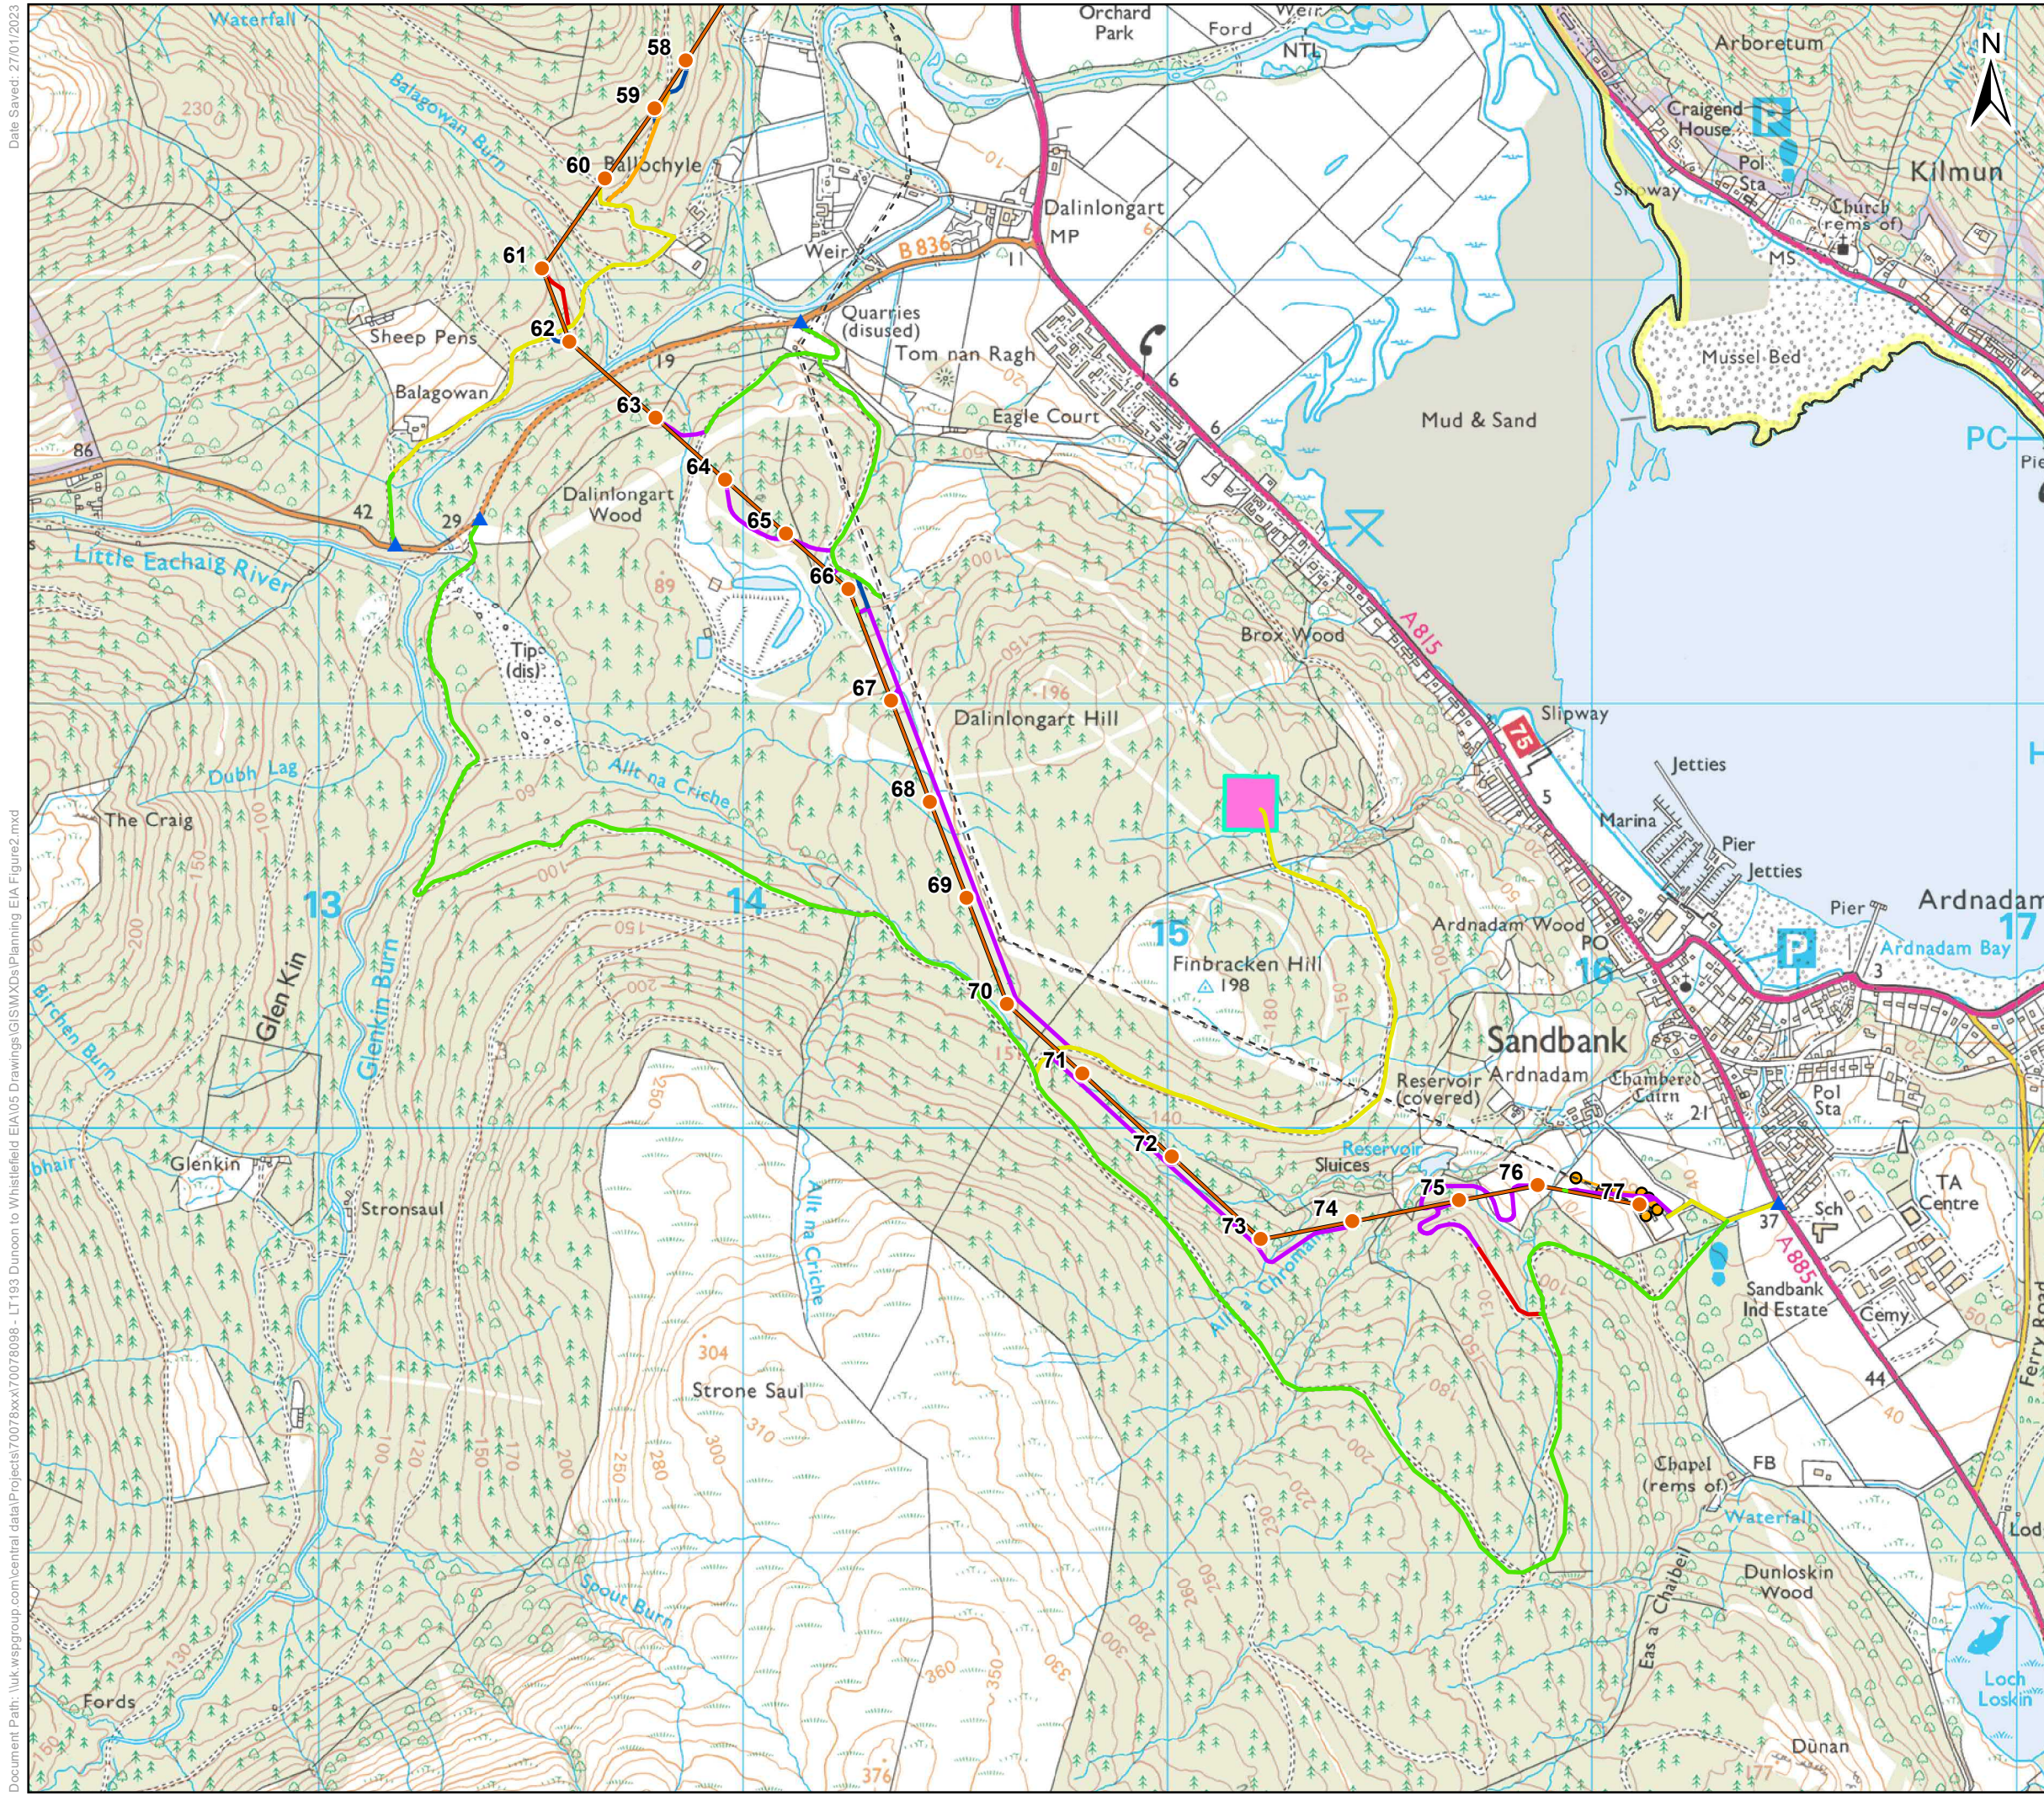

Key

- Existing OHL
- Proposed OHL Alignment
- Proposed Tower Position
- Temporary Diversion
- Temporary Diversion Structure
- Borrow Pit Search Area
- Proposed Conductor Pulling Area (EPZ)
- Proposed Retained Access Track
- Proposed Access – Temporary
- Existing Track (No Upgrades Required - Good Condition)
- Existing Track (Upgrades Required - Fair Condition)
- Existing Track (Upgrades Required - Poor Condition)
- Existing Track (Upgrades Required - Very Poor Condition)
- ▲ Existing Bellmouth - Minimal Work Required
- ▲ Proposed Bellmouth Required - Temporary
- ▲ Proposed Bellmouth Required - Permanent
- Planning Authority Boundary

Client: **Scottish & Southern Electricity Networks**
TRANSMISSION

Project: **Dunoon to Loch Long 132kV OHL Rebuild**

Title: **Figure 2 Site Layout Sheet 4 of 4**

Date: 02/02/2023 Scale: 15,000 @ A3
 Drawn: AS Checked: IM Approved: SM