




Key

- Existing OHL
- Existing Tower Position
- Proposed Tower Position
- Proposed OHL Alignment
- Baseline Monitoring Location
- Noise Sensitive Receptor (NSR)
- NSR Assessed Qualitatively




Client: **Scottish & Southern Electricity Networks**
 TRANSMISSION


Project: **Dunoon to Loch Long 132kV OHL Rebuild**

Title: **Figure 11.1: Overhead Line Alignment, Baseline Monitoring and NSR Locations Sheet 1 of 4**

Date: 24/01/2023 Scale: 15,000 @ A3
 Drawn: HM Checked: AW Approved: SM

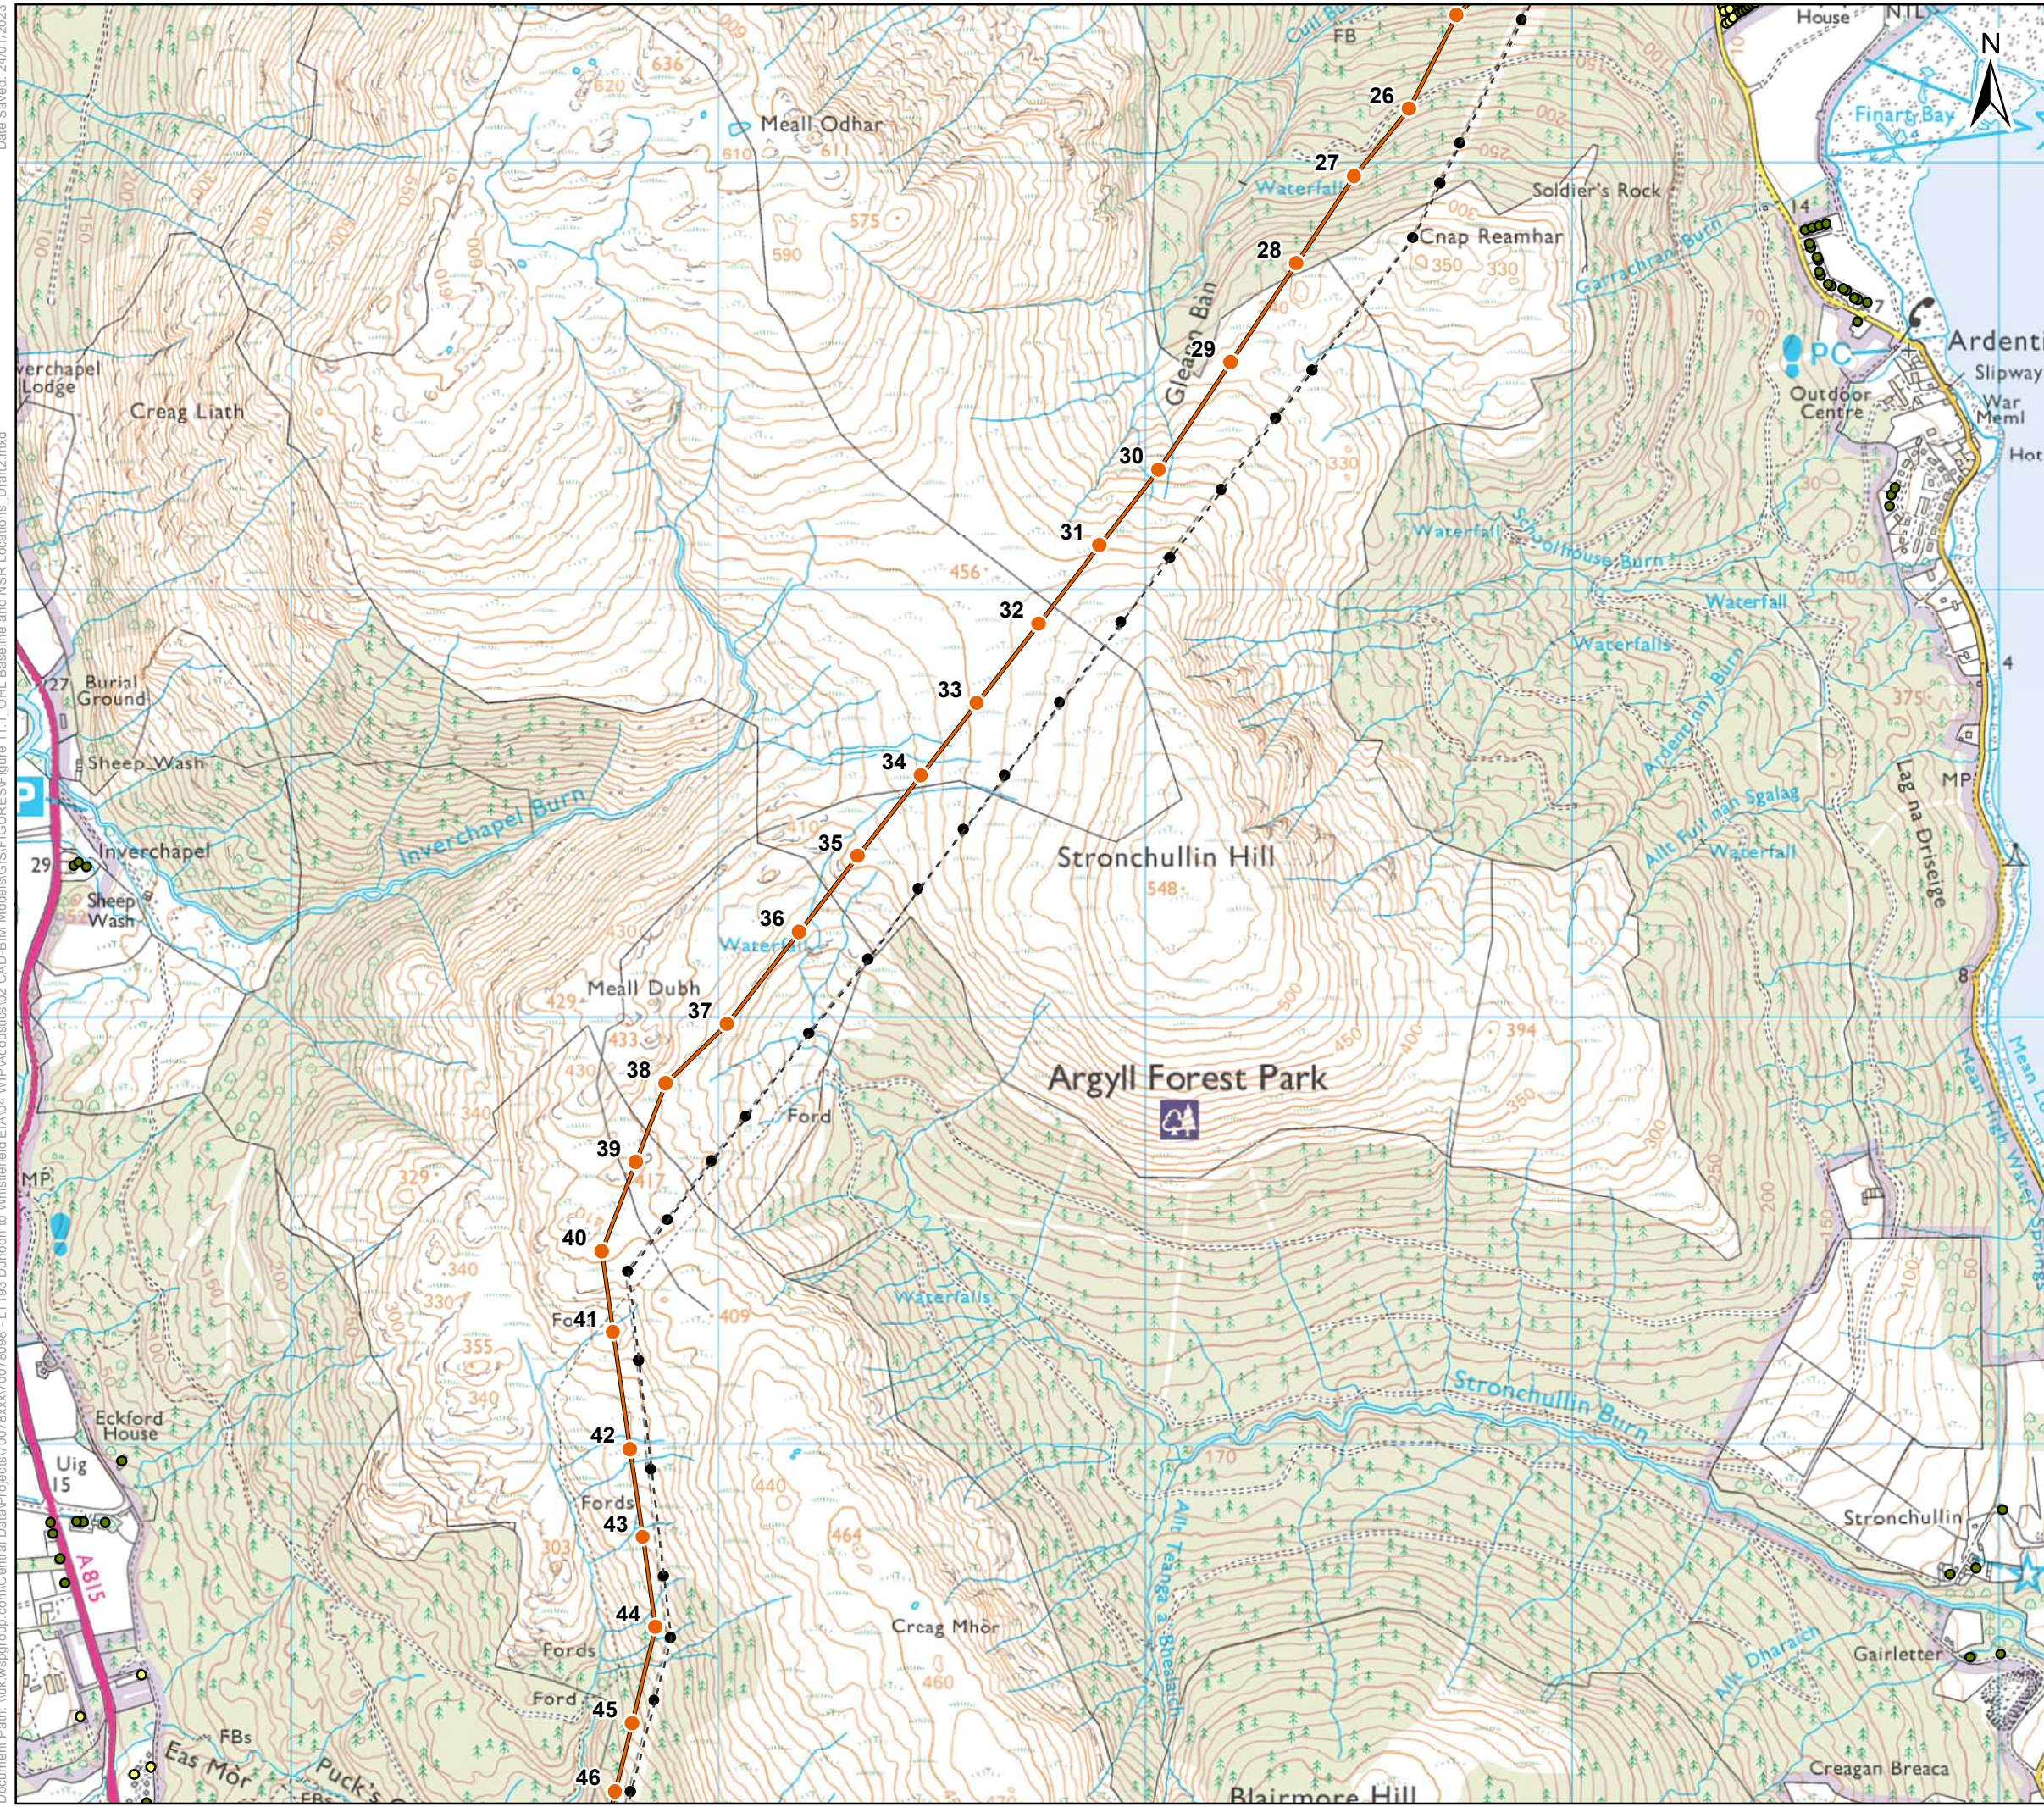

- Key**
- Existing OHL
 - Existing Tower Position
 - Proposed Tower Position
 - Proposed OHL Alignment
 - Baseline Monitoring Location
 - Noise Sensitive Receptor (NSR)
 - NSR Assessed Qualitatively




Project: **Dunoon to Loch Long 132kV OHL Rebuild**

Title: **Figure 11.1: Overhead Line Alignment, Baseline Monitoring and NSR Locations**
Sheet 2 of 4


Date: 24/01/2023 Scale: 15,000 @ A3
Drawn: HM Checked: AW Approved: SM

Date Saved: 24/01/2023
Document Path: \\uk.wspgroup.com\Central Data\Projects\70078xxx\70078098 - LT193 Dunoon to Whistlerfield EIA\04 WIP\Acoustics\02 CAD-BIM Models\GIS\FIGURES\Figure 11.1_OHL Baseline and NSR Locations_Dratt2.mxd

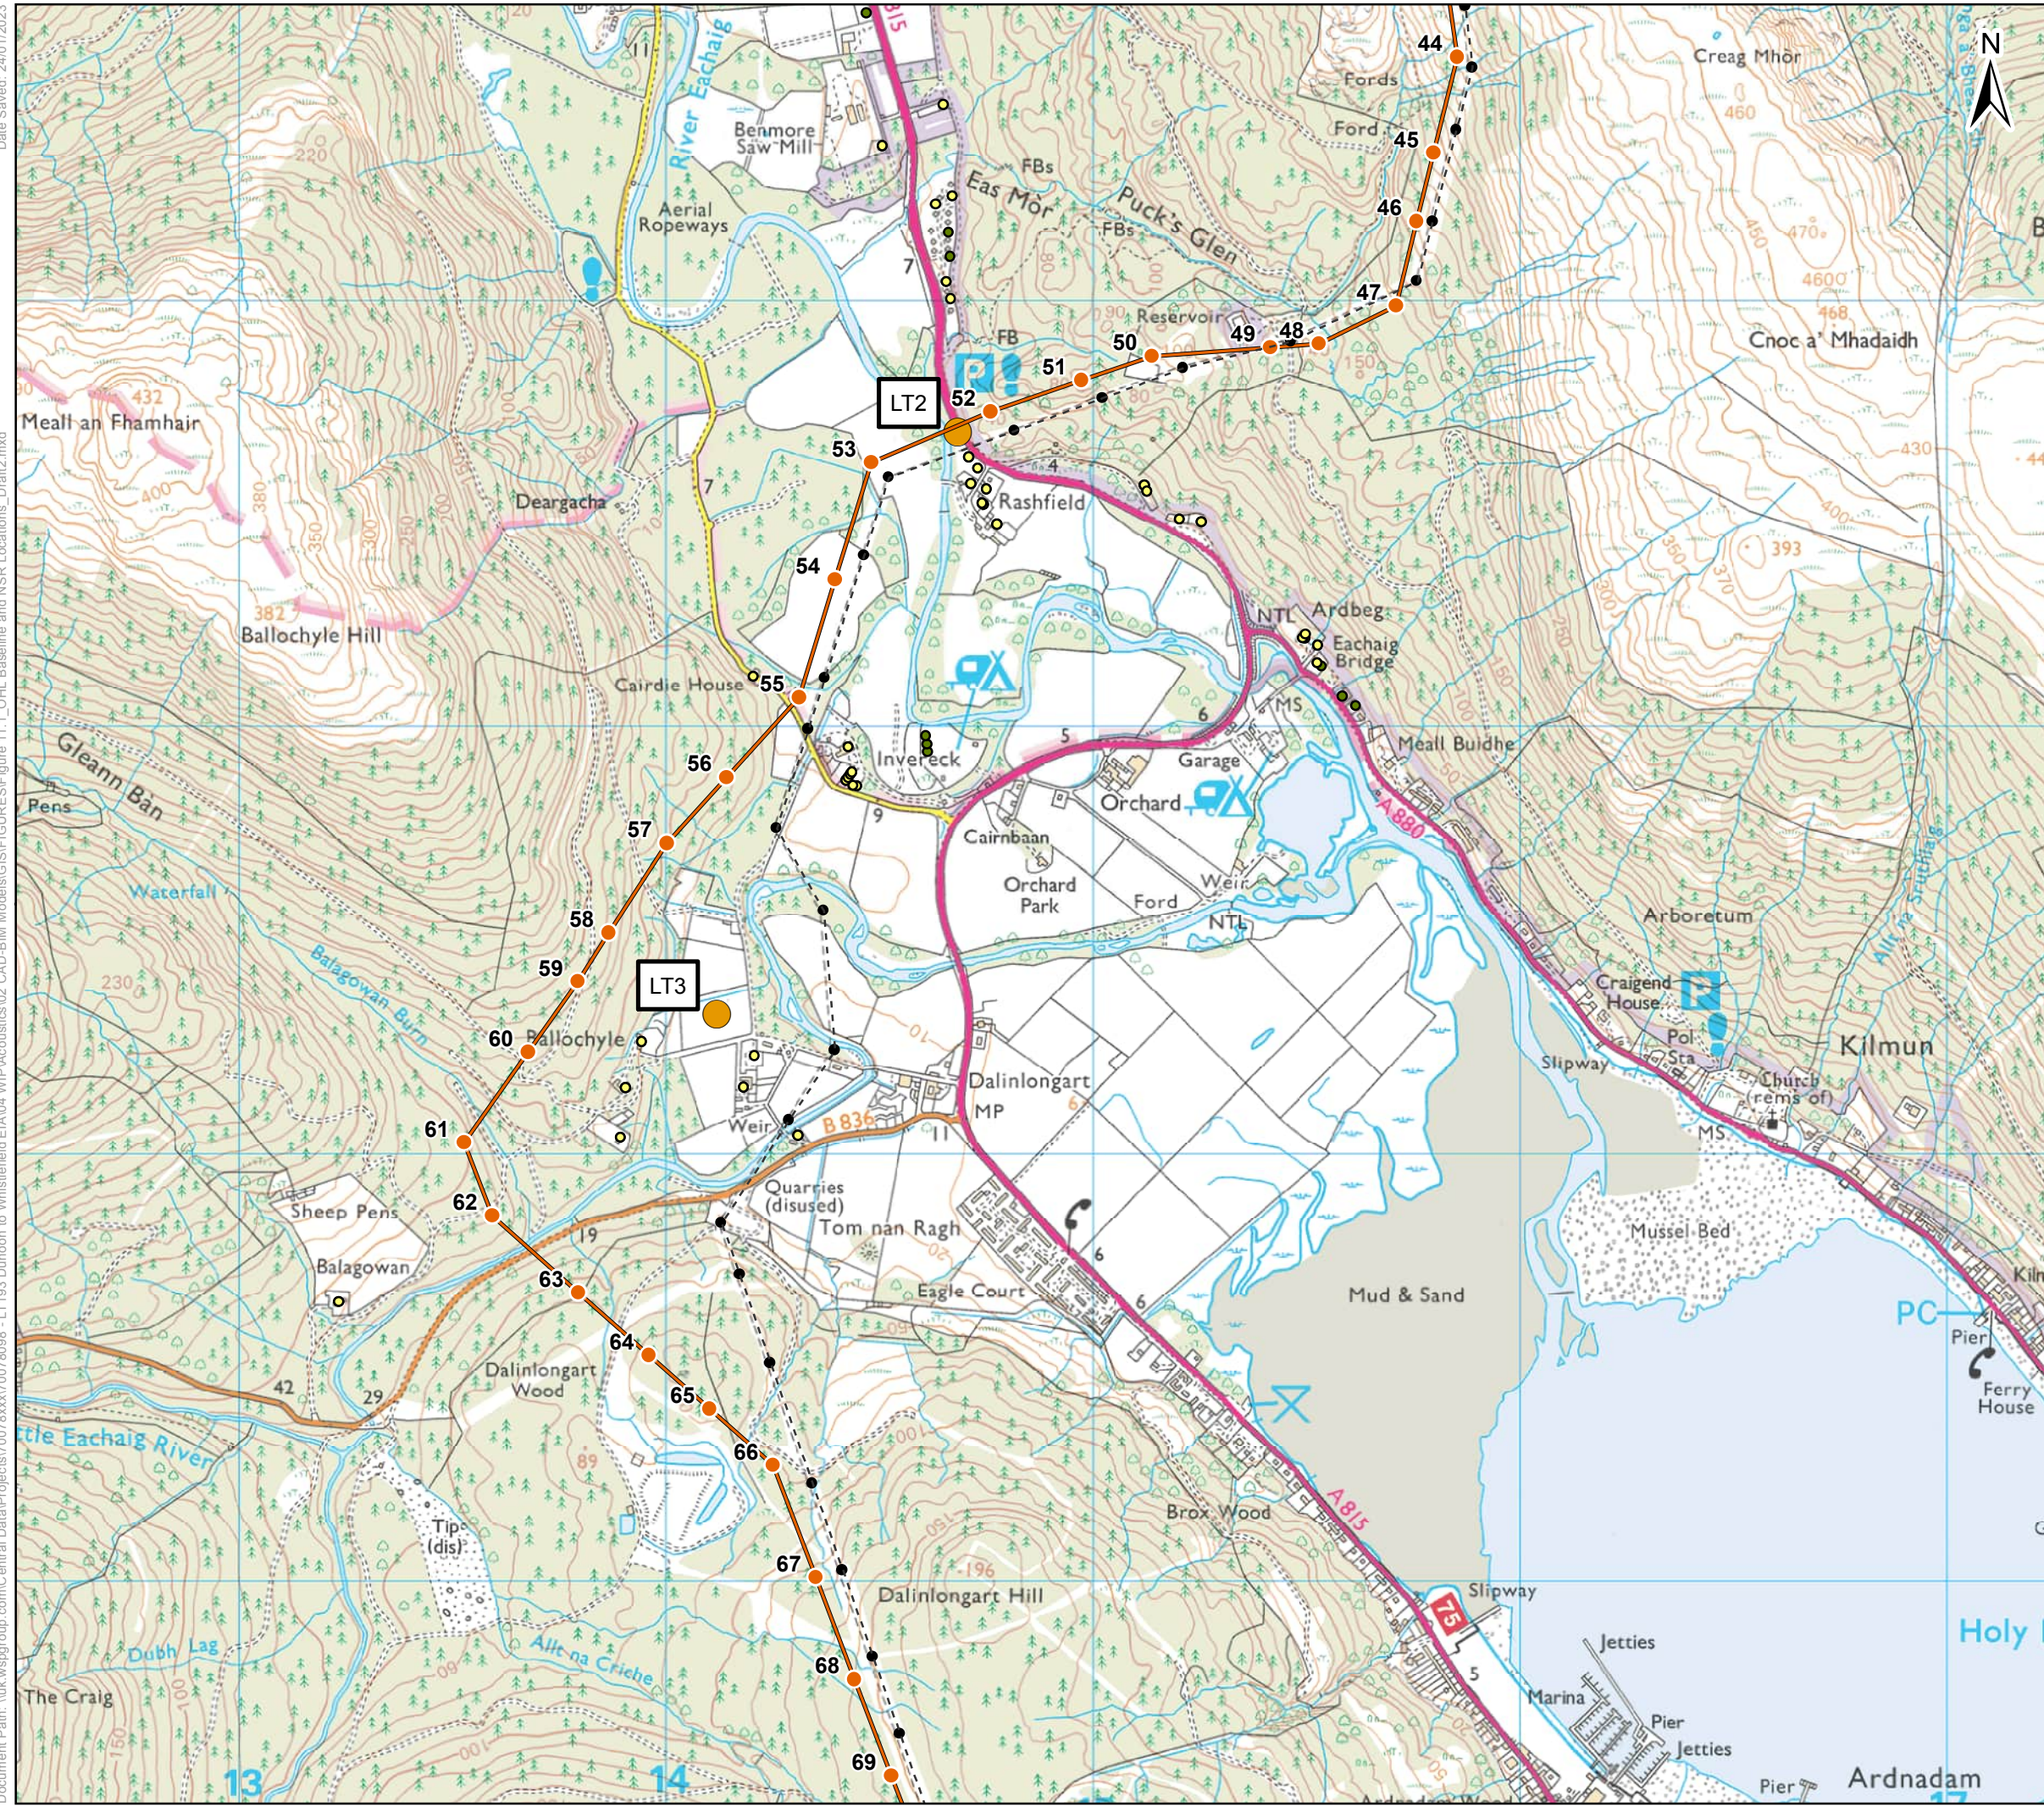

Key

- Existing OHL
- Existing Tower Position
- Proposed Tower Position
- Proposed OHL Alignment
- Baseline Monitoring Location
- Noise Sensitive Receptor (NSR)
- NSR Assessed Qualitatively




Client:  **Scottish & Southern**
Electricity Networks
TRANSMISSION


Project: Dunoon to Loch Long 132kV OHL Rebuild

Title: Figure 11.1: Overhead Line Alignment, Baseline Monitoring and NSR Locations
Sheet 3 of 4

Date: 24/01/2023 Scale: 15,000 @ A3
Drawn: HM Checked: AW Approved: SM

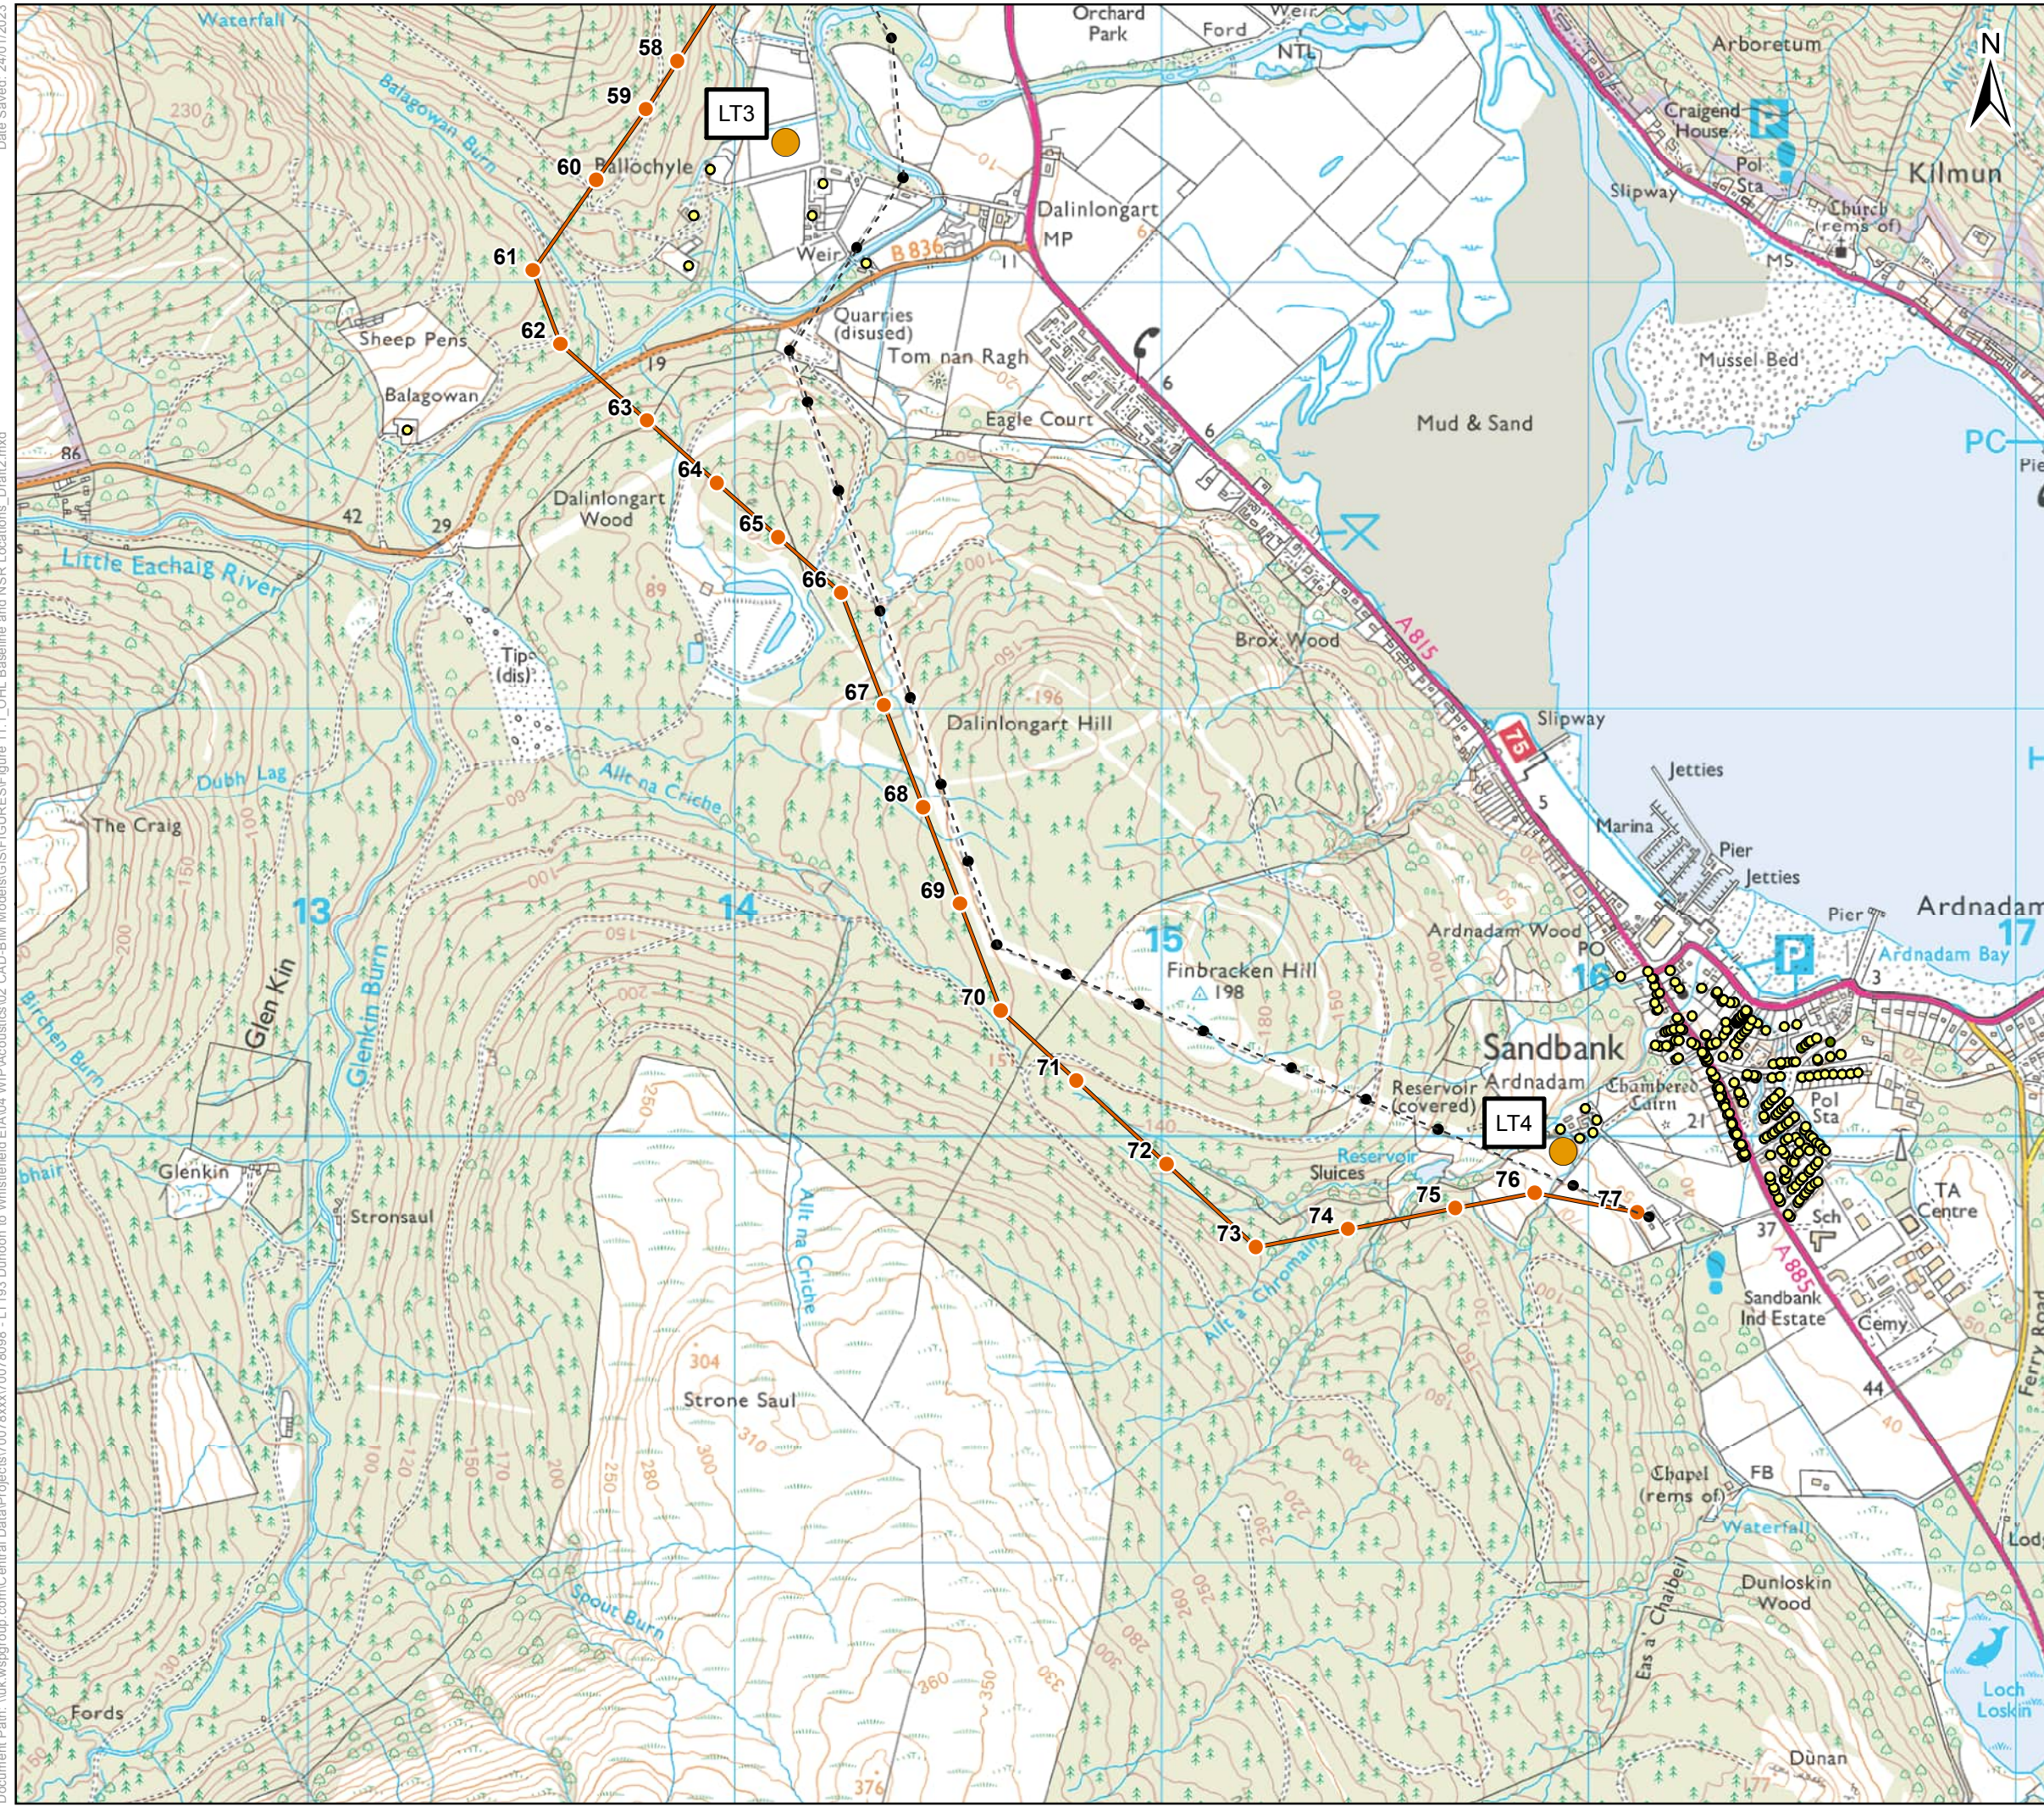

- Key**
- Existing OHL
 - Existing Tower Position
 - Proposed Tower Position
 - Proposed OHL Alignment
 - Baseline Monitoring Location
 - Noise Sensitive Receptor (NSR)
 - NSR Assessed Qualitatively



Client: Scottish & Southern Electricity Networks
 Project: Dunoon to Loch Long 132kV OHL Rebuild

Title: Figure 11.1: Overhead Line Alignment, Baseline Monitoring and NSR Locations
 Sheet 4 of 4

Date: 24/01/2023 Scale: 15,000 @ A3
 Drawn: HM Checked: AW Approved: SM