



**Key**

- Tower 15 on Whistlefield - Dunoon 132kV OHL
- Existing Dunoon Substation
- Existing OHL
- Proposed OHL Alignment
- Preferred OHL Alignment




Client:  **Scottish & Southern**  
Electricity Networks






Project: **Dunoon to Loch Long 132kV OHL Rebuild**

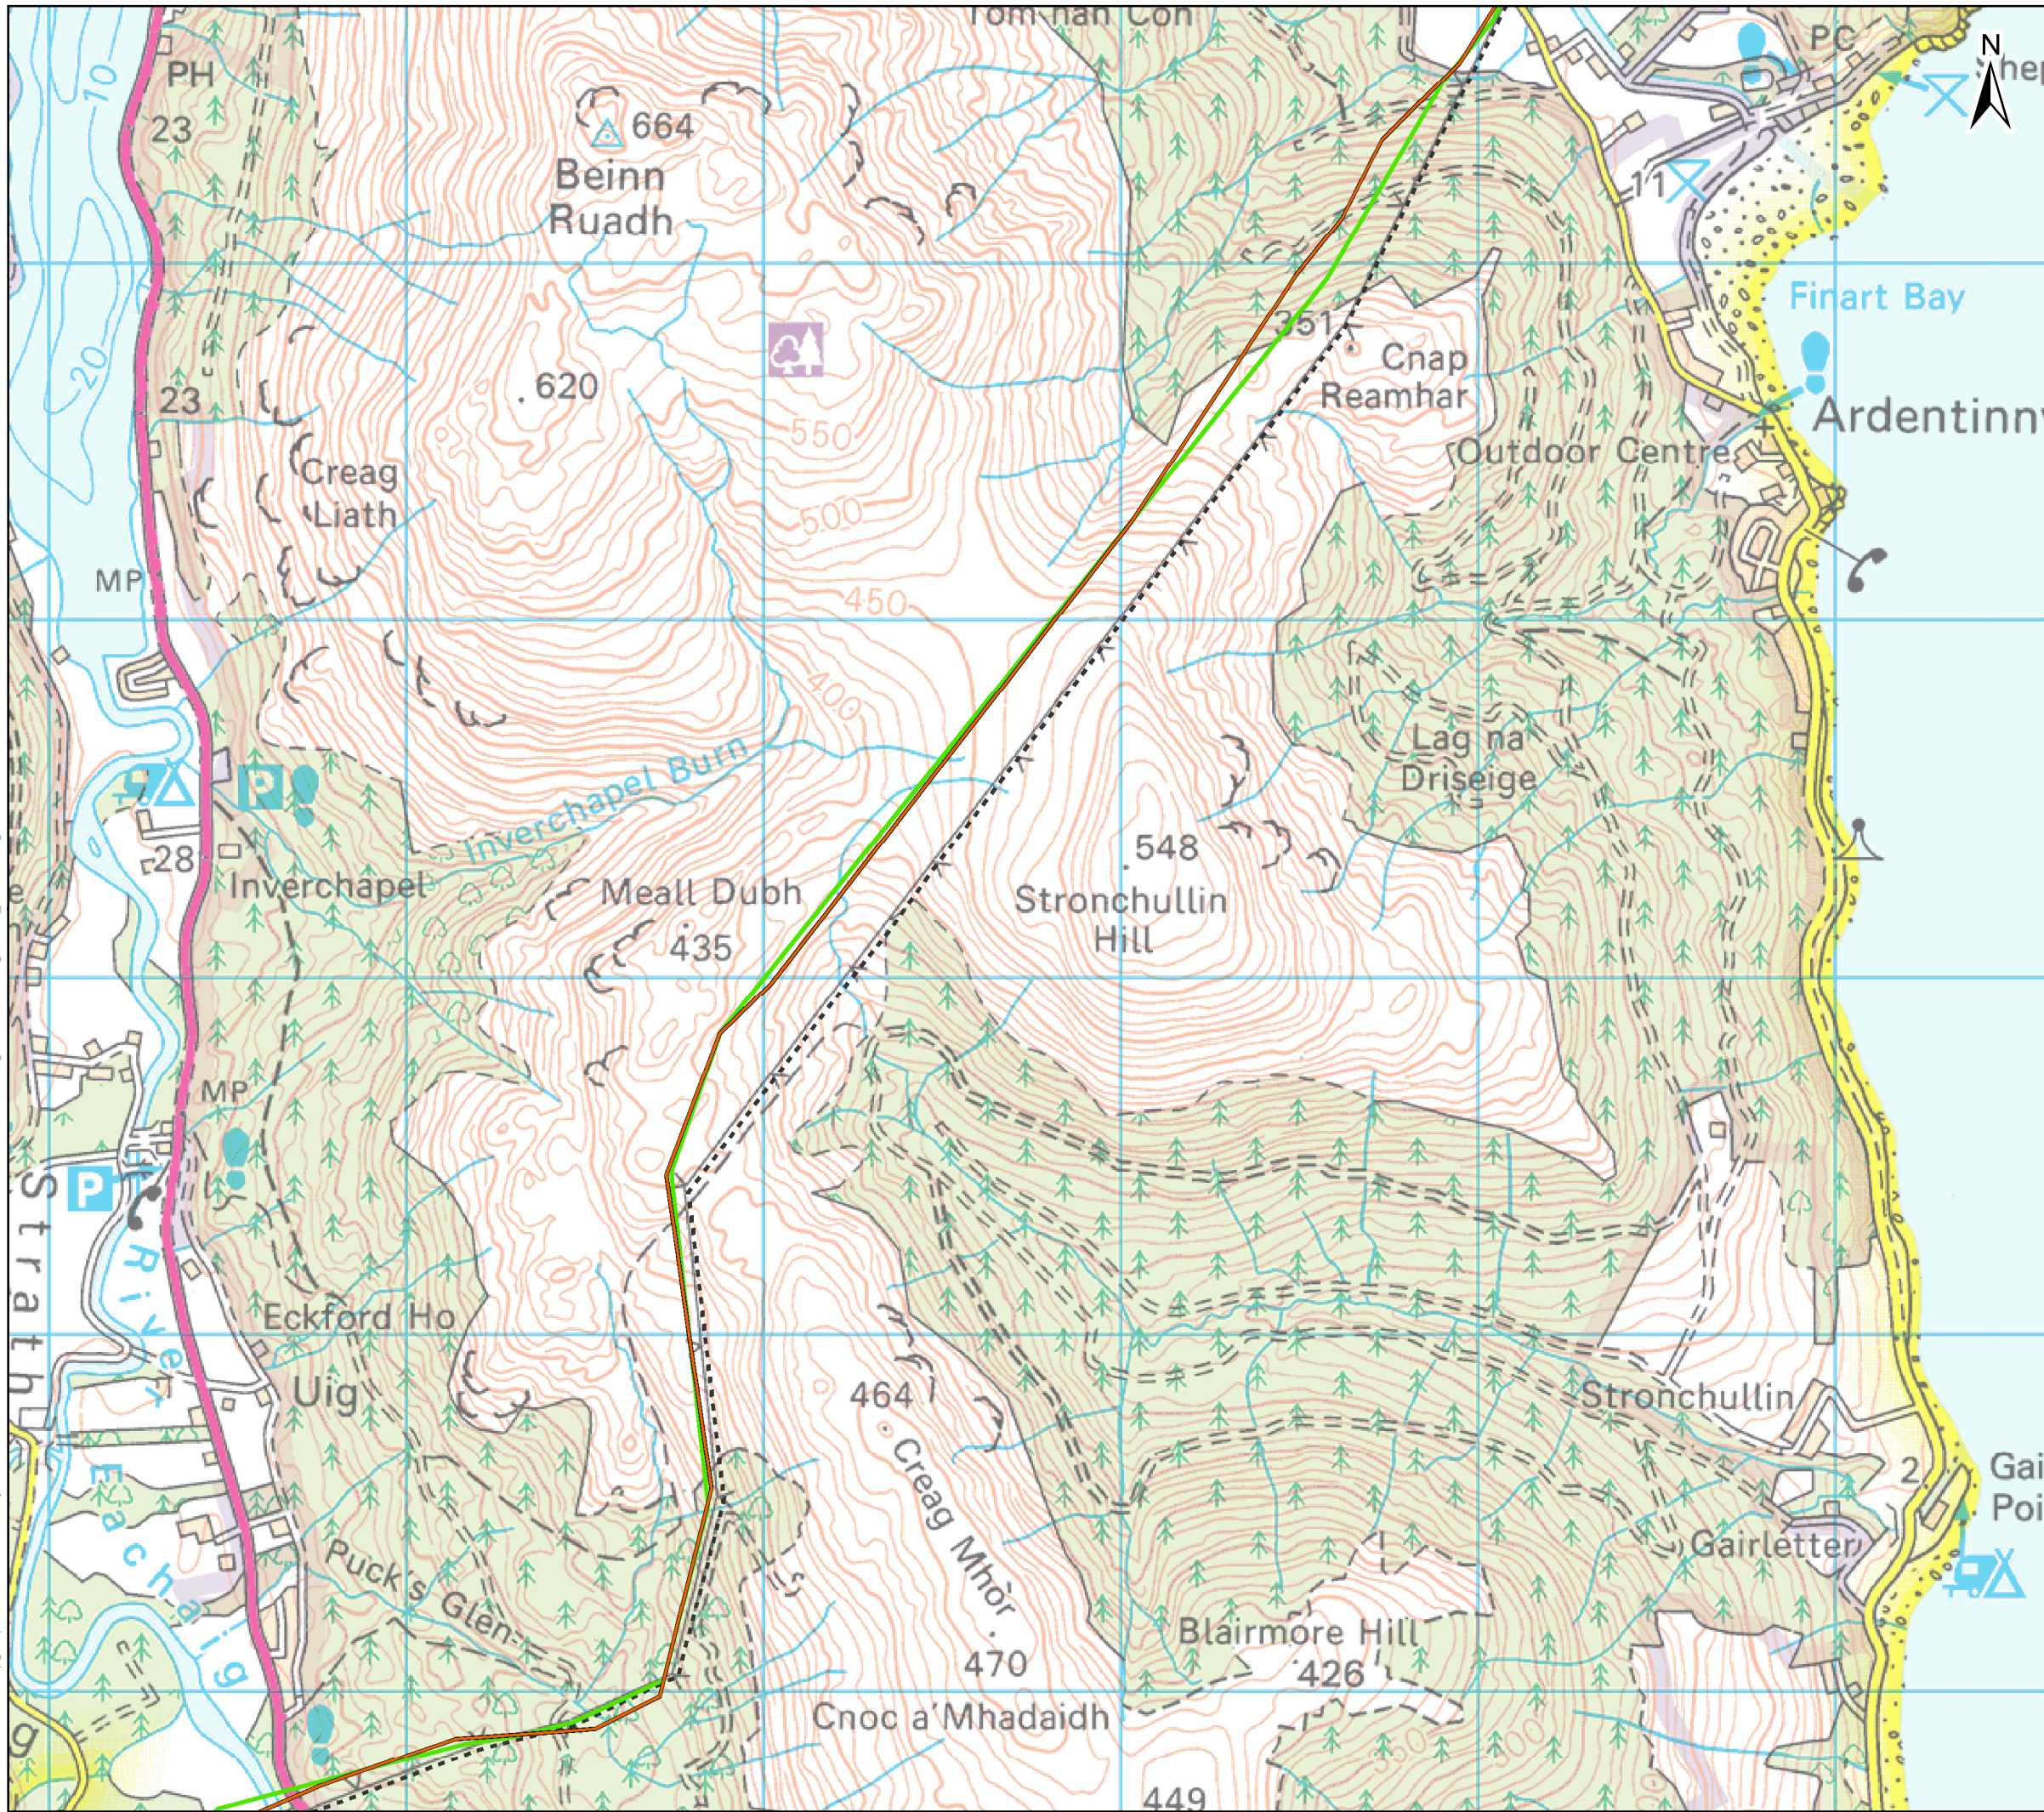
Title: **Figure 2.4  
Refined Alignment  
Sheet 1 of 4**

Date: Wednesday, November 16, 2022 scale: 18,000 @ A3  
Drawn: MAL Checked: JA Approved: SM



**Key**

-  Tower 15 on Whistlefield - Dunoon 132kV OHL
-  Existing Dunoon Substation
-  Existing OHL
-  Proposed OHL Alignment
-  Preferred OHL Alignment




Client:   
TRANSMISSION

Project: Dunoon to Loch Long 132kV OHL Rebuild


Title: Figure 2.4  
Refined Alignment  
Sheet 2 of 4

Date: Wednesday, November 16, 2022 scale: 18,000 @ A3  
Drawn: MAL Checked: JA Approved: SM

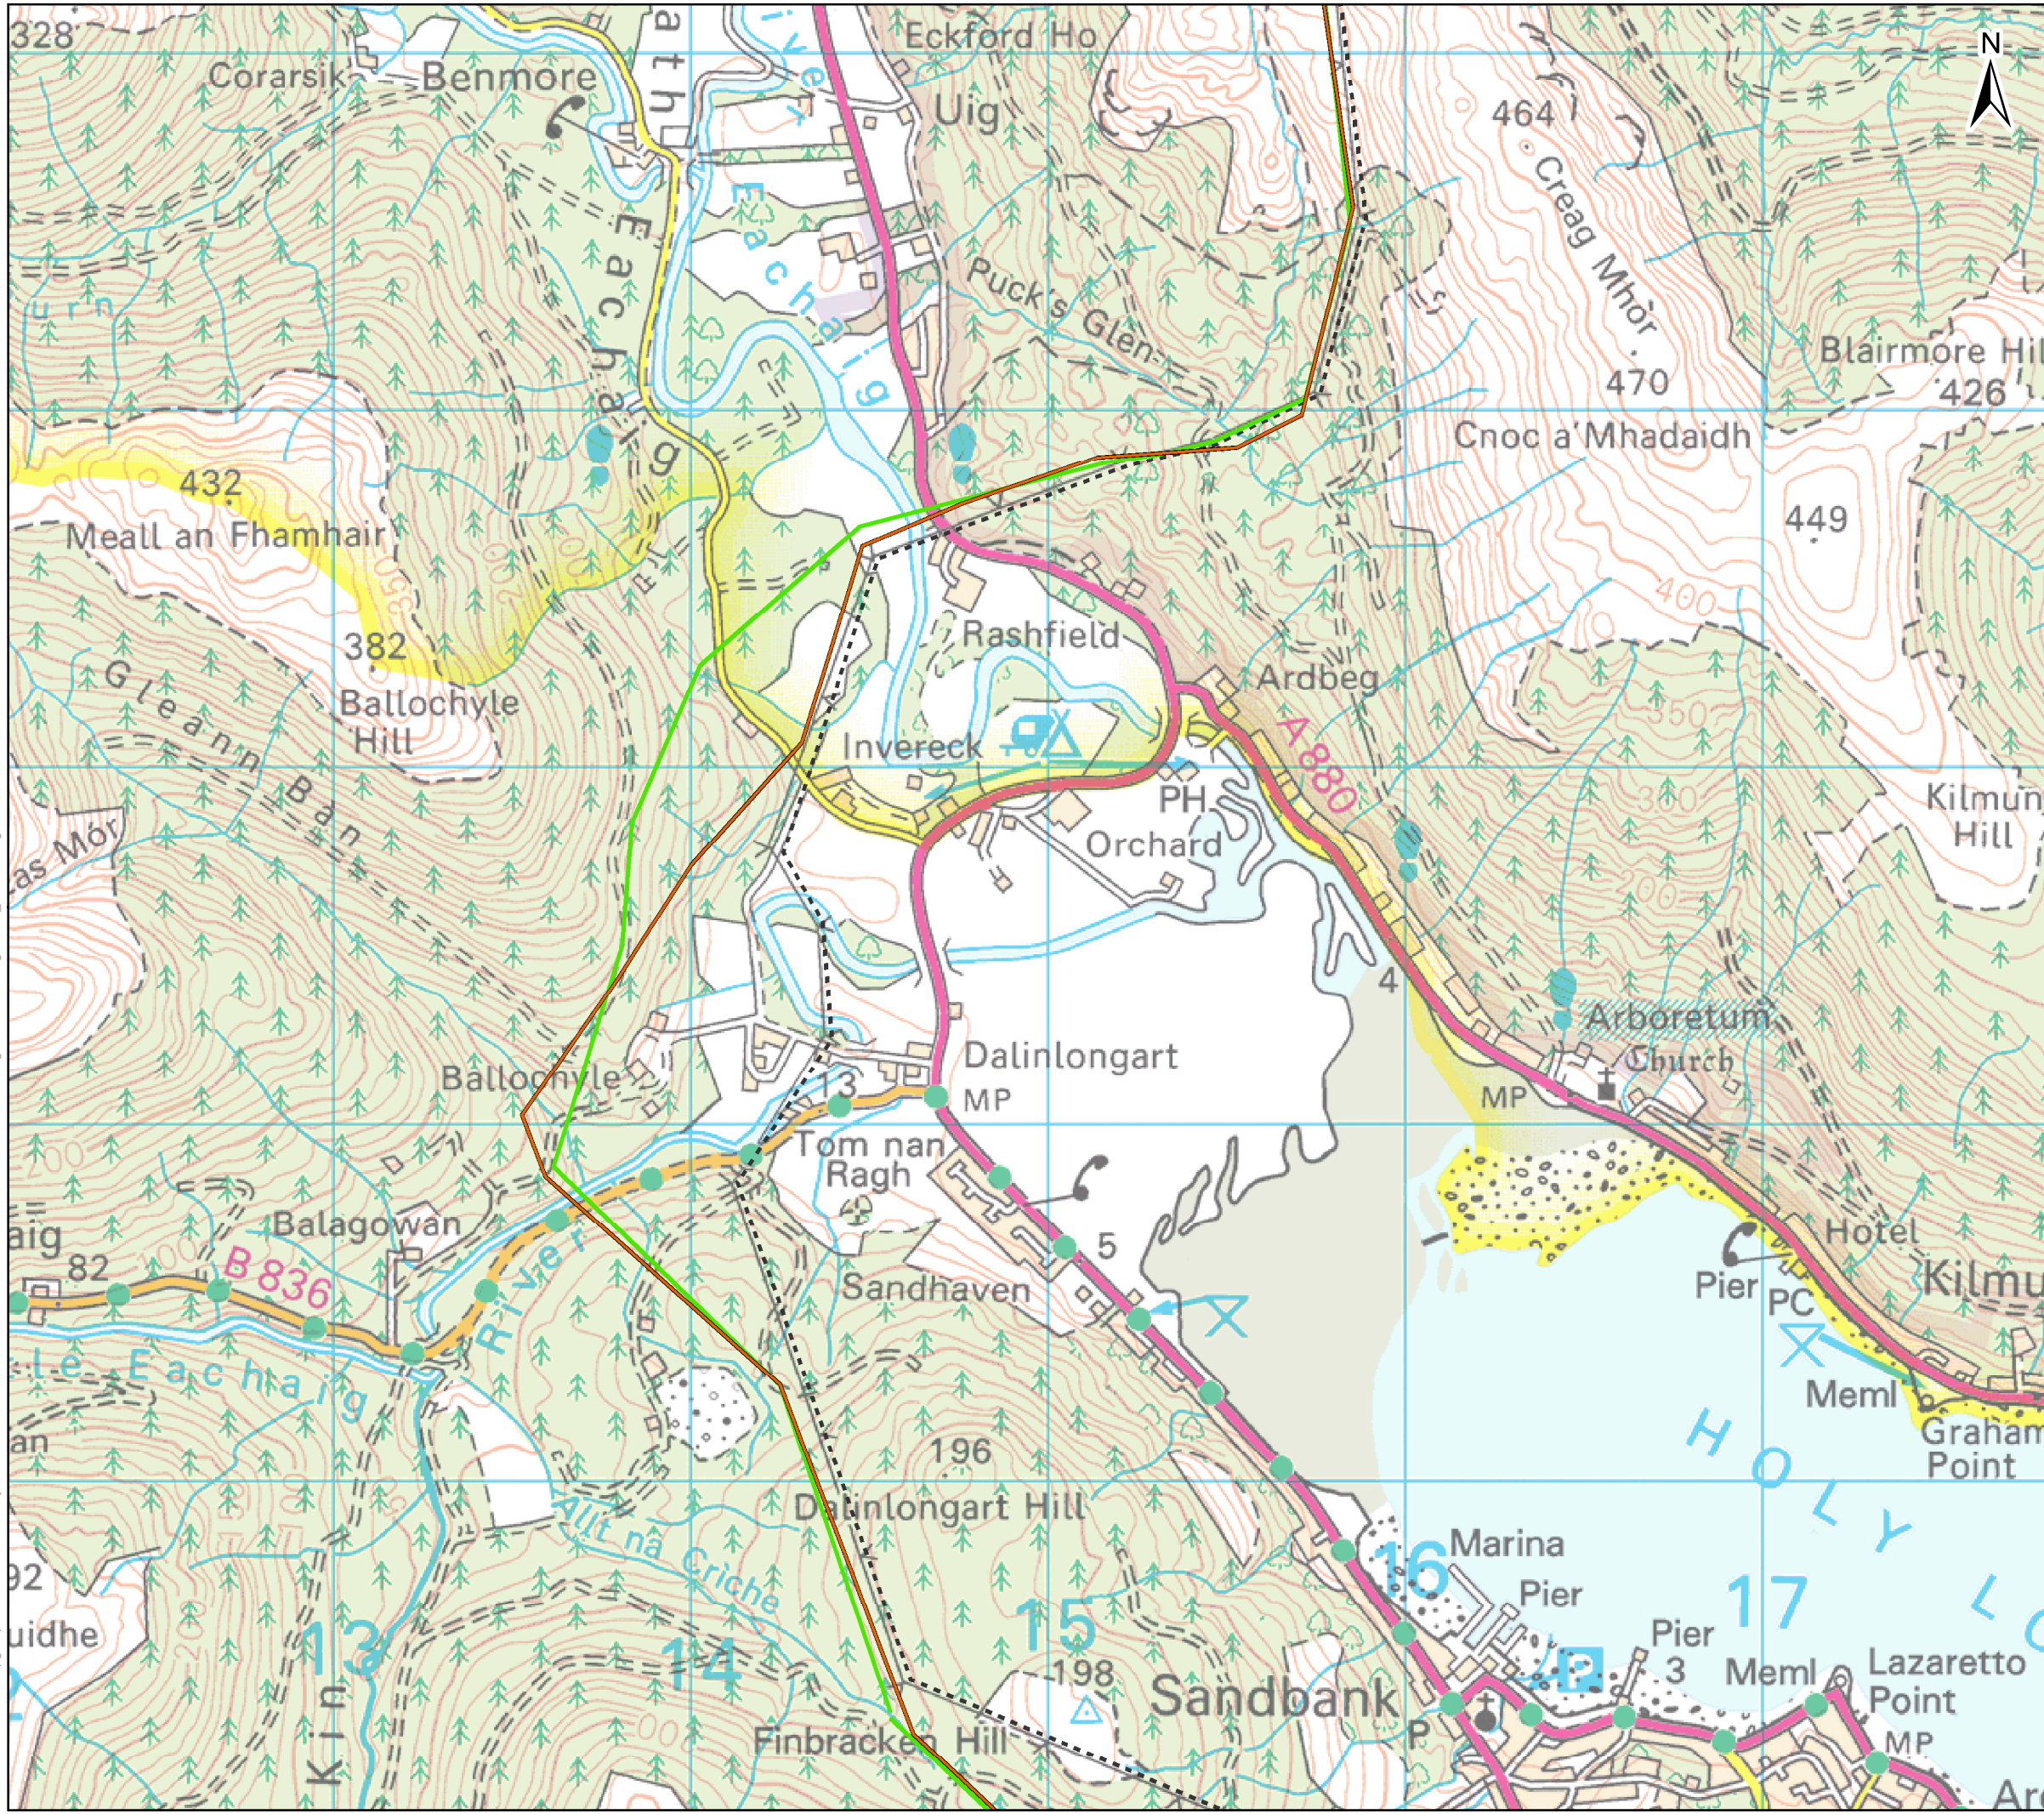

**Key**

- Tower 15 on Whistfield - Dunoon 132kV OHL
- Existing Dunoon Substation
- Existing OHL
- Proposed OHL Alignment
- Preferred OHL Alignment




Client: Scottish & Southern Electricity Networks

Project: Dunoon to Loch Long 132kV OHL Rebuild


Title: Figure 2.4 Refined Alignment Sheet 3 of 4


Date: Wednesday, November 16, 2022 scale: 18,000 @ A3  
 Drawn: MAL Checked: JA Approved: SM

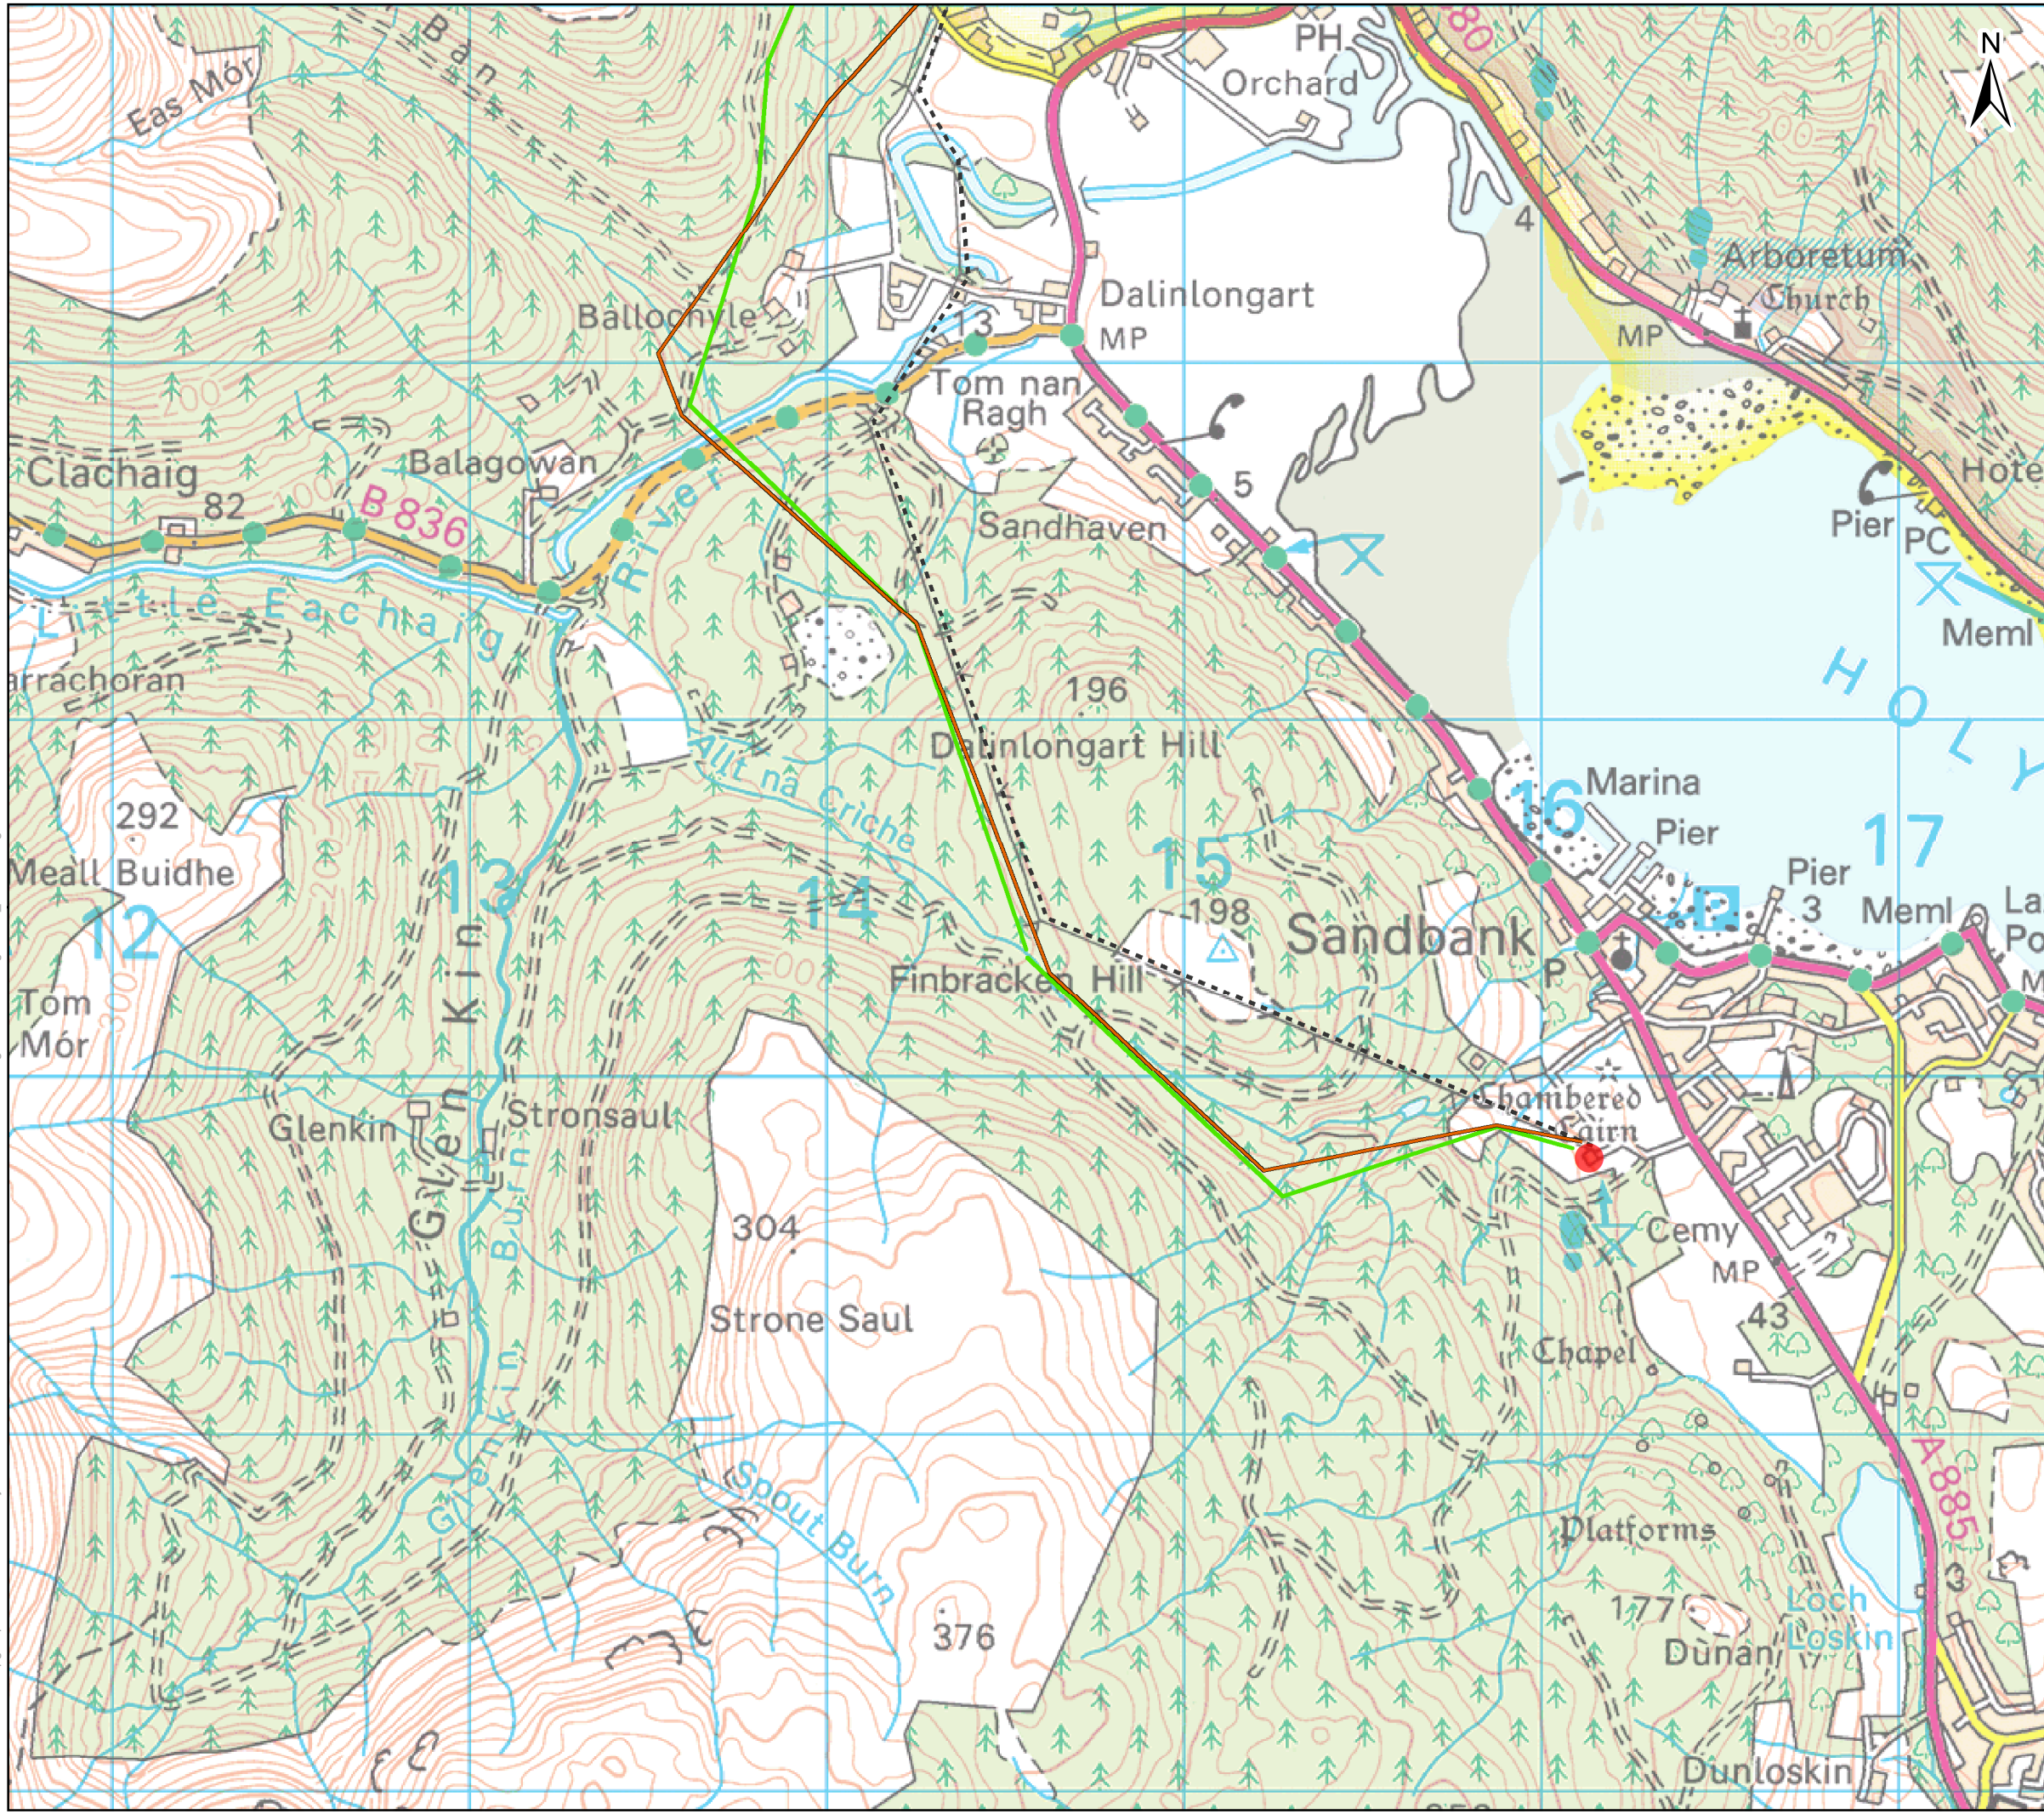

**Key**

- Tower 15 on Whistlefield - Dunoon 132kV OHL
- Existing Dunoon Substation
- - - Existing OHL
- Proposed OHL Alignment
- Preferred OHL Alignment



Client:  **Scottish & Southern**  
Electricity Networks

Project: **Dunoon to Loch Long 132kV OHL Rebuild**

Title: **Figure 2.4  
Refined Alignment  
Sheet 4 of 4**

Date: Wednesday, November 16, 2022 scale: 18,000 @ A3  
Drawn: MAL Checked: JA Approved: SM