



Date Saved: 1/16/2023  
 Document Path: \\uk-wspgroup.com\Central Data\Projects\70078xxx\70078098 - LT193 Dunoon to Whistlerfield EIA\05 Drawings\GIS\MXDs\Figure 3.1 - Site Layout\_20221116.mxd

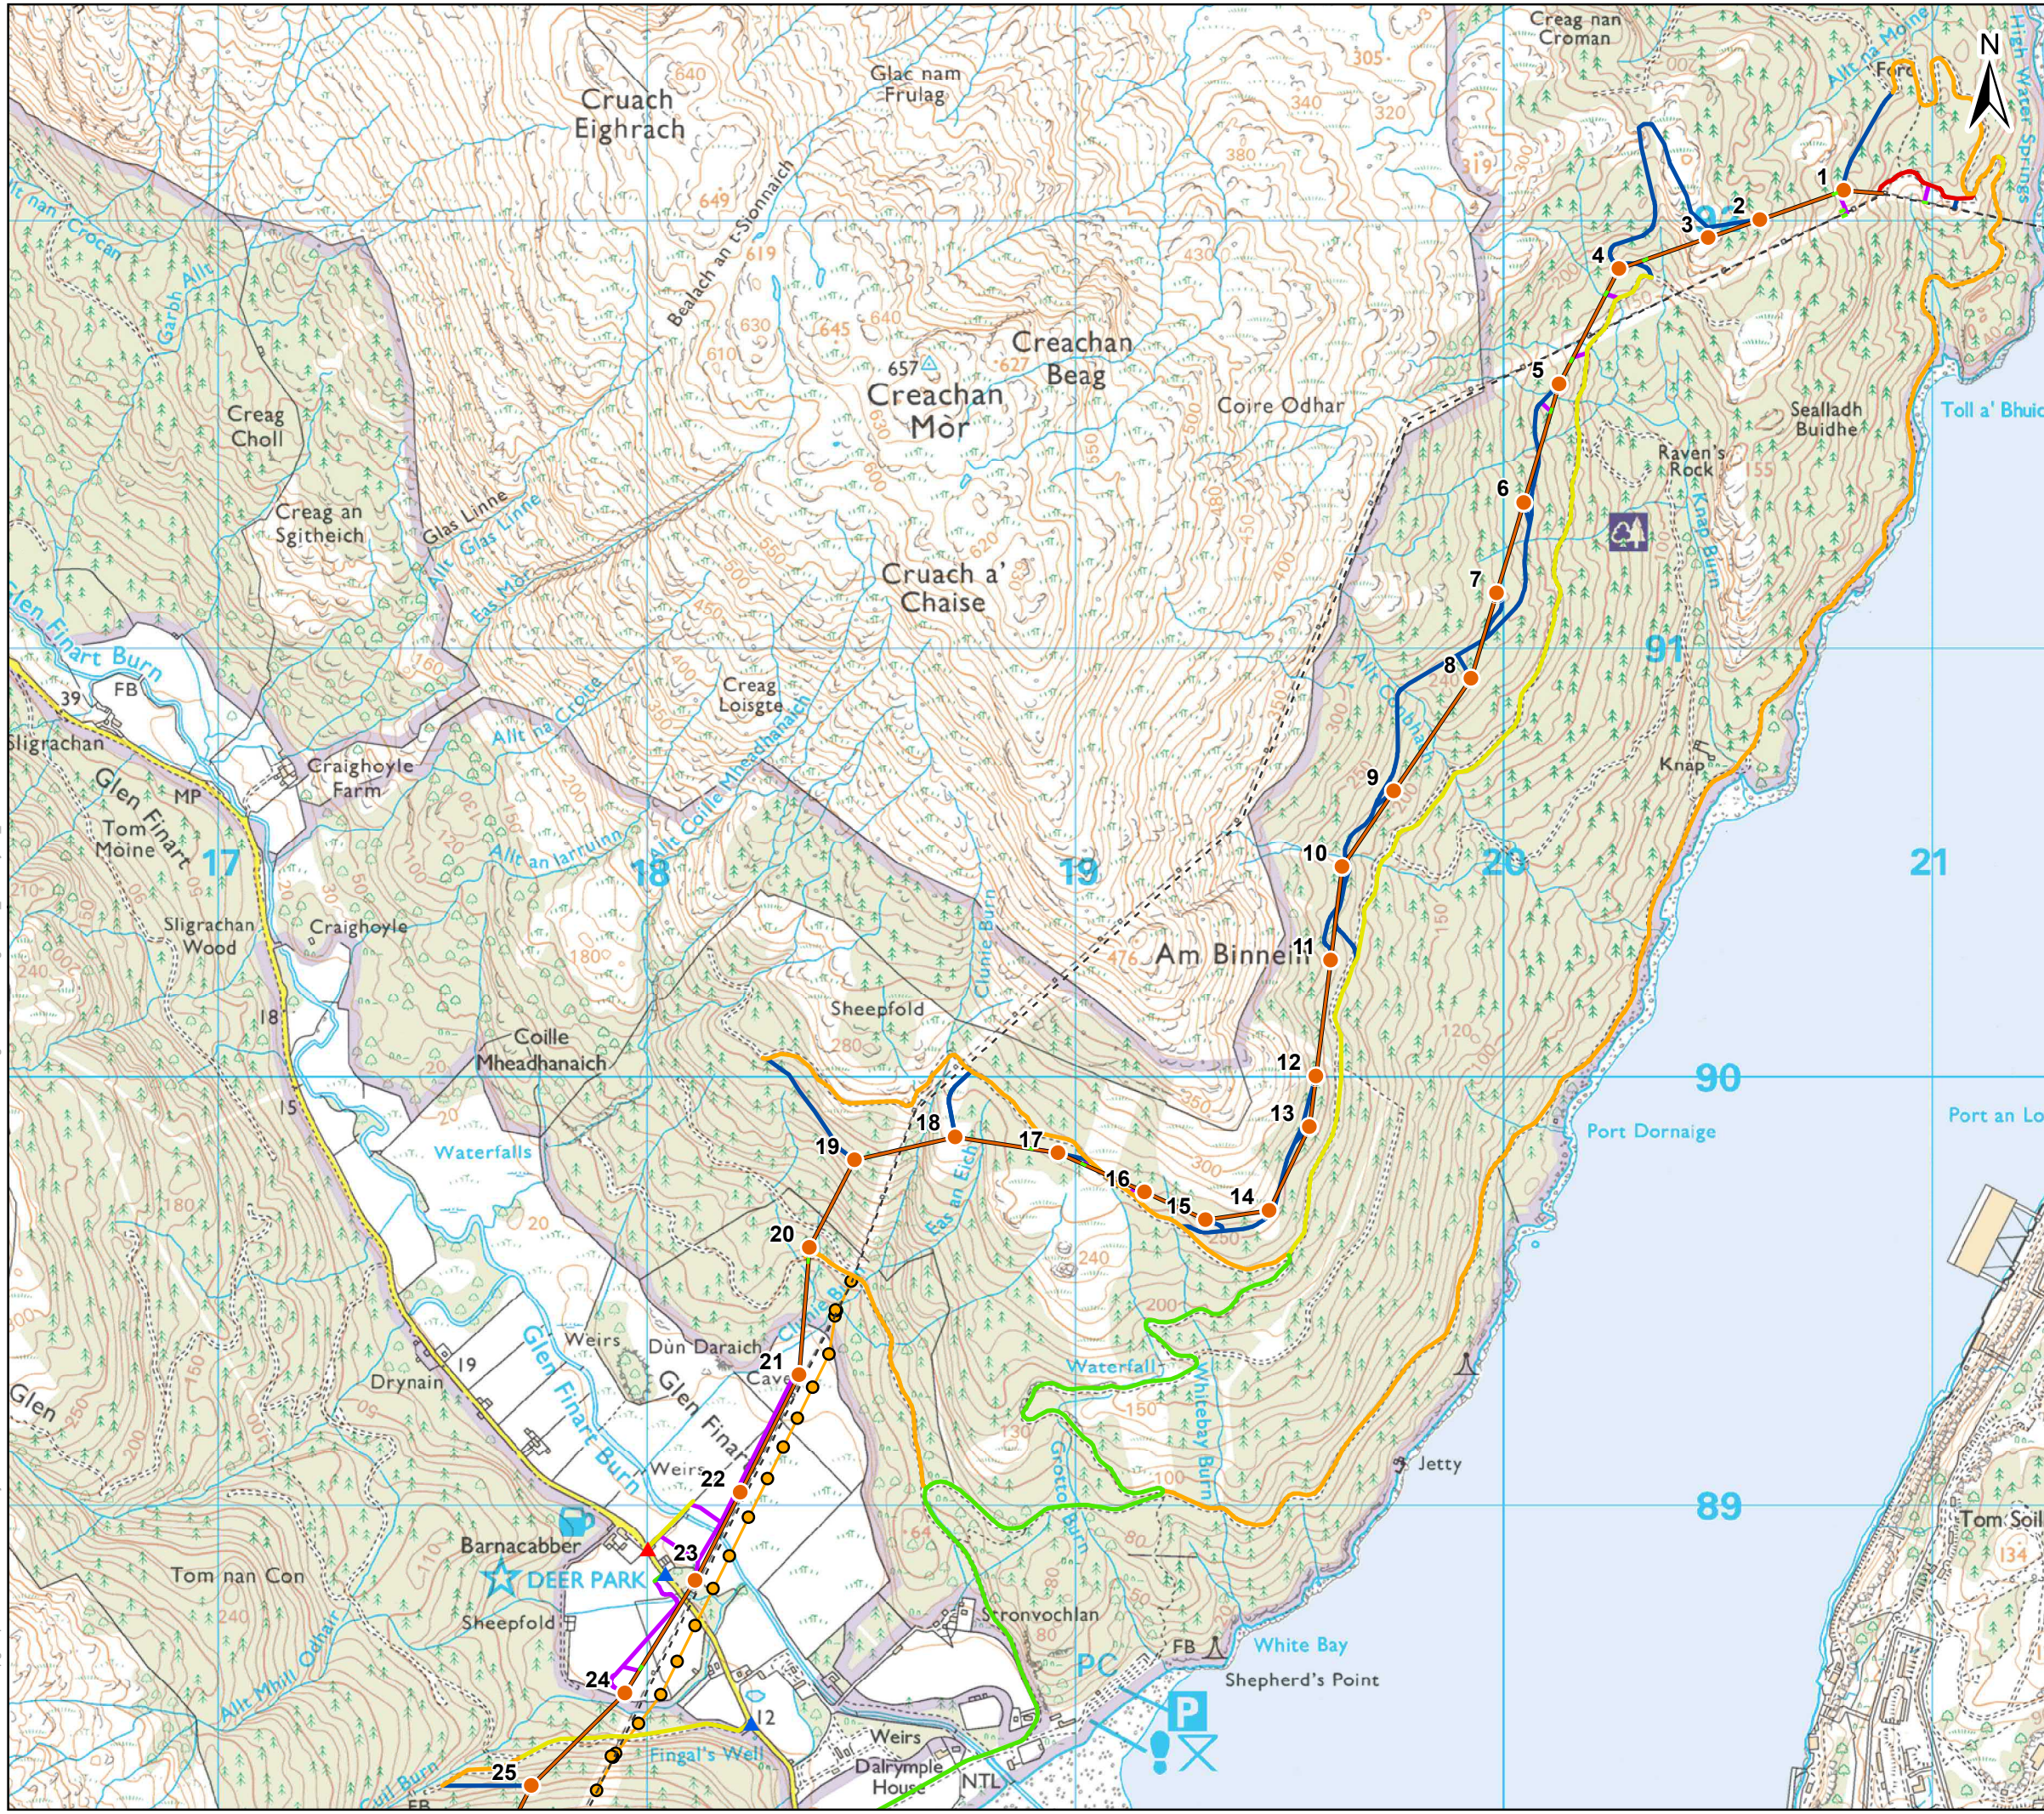

- ### Key
- Existing OHL
  - Proposed OHL Alignment
  - Proposed Tower Position
  - Proposed Tower Position
  - Temporary Diversion
  - Temporary Diversion Structure
  - █ Borrow Pit Search Area
  - █ Proposed Conductor Pulling Area (EPZ)
  - Proposed Retained Access Track
  - Proposed Access – Temporary
  - Existing Track (No Upgrades Required - Good Condition)
  - Existing Track (Upgrades Required - Fair Condition)
  - Existing Track (Upgrades Required - Poor Condition)
  - Existing Track (Upgrades Required - Very Poor Condition)
  - ▲ Existing Bellmouth - Minimal Work Required
  - ▲ Proposed Bellmouth Required - Temporary
  - ▲ Proposed Bellmouth Required - Permanent




Client: Scottish & Southern Electricity Networks  
 Project: Dunoon to Loch Long 132kV OHL Rebuild


Title: Figure 3.1 Site Layout Sheet 1 of 4

Date: 1/16/2023 Scale: 15,000 @ A3  
 Drawn: AS Checked: IM Approved: SM

Date Saved: 1/15/2023  
Document Path: \\uk.wspgroup.com\Central Data\Projects\70078xxx\70078098 - LT193 Dunoon to Whistlerfield EIA\05 Drawings\GIS\MXDs\Figure 3.1\_Site Layout\_20221116.mxd

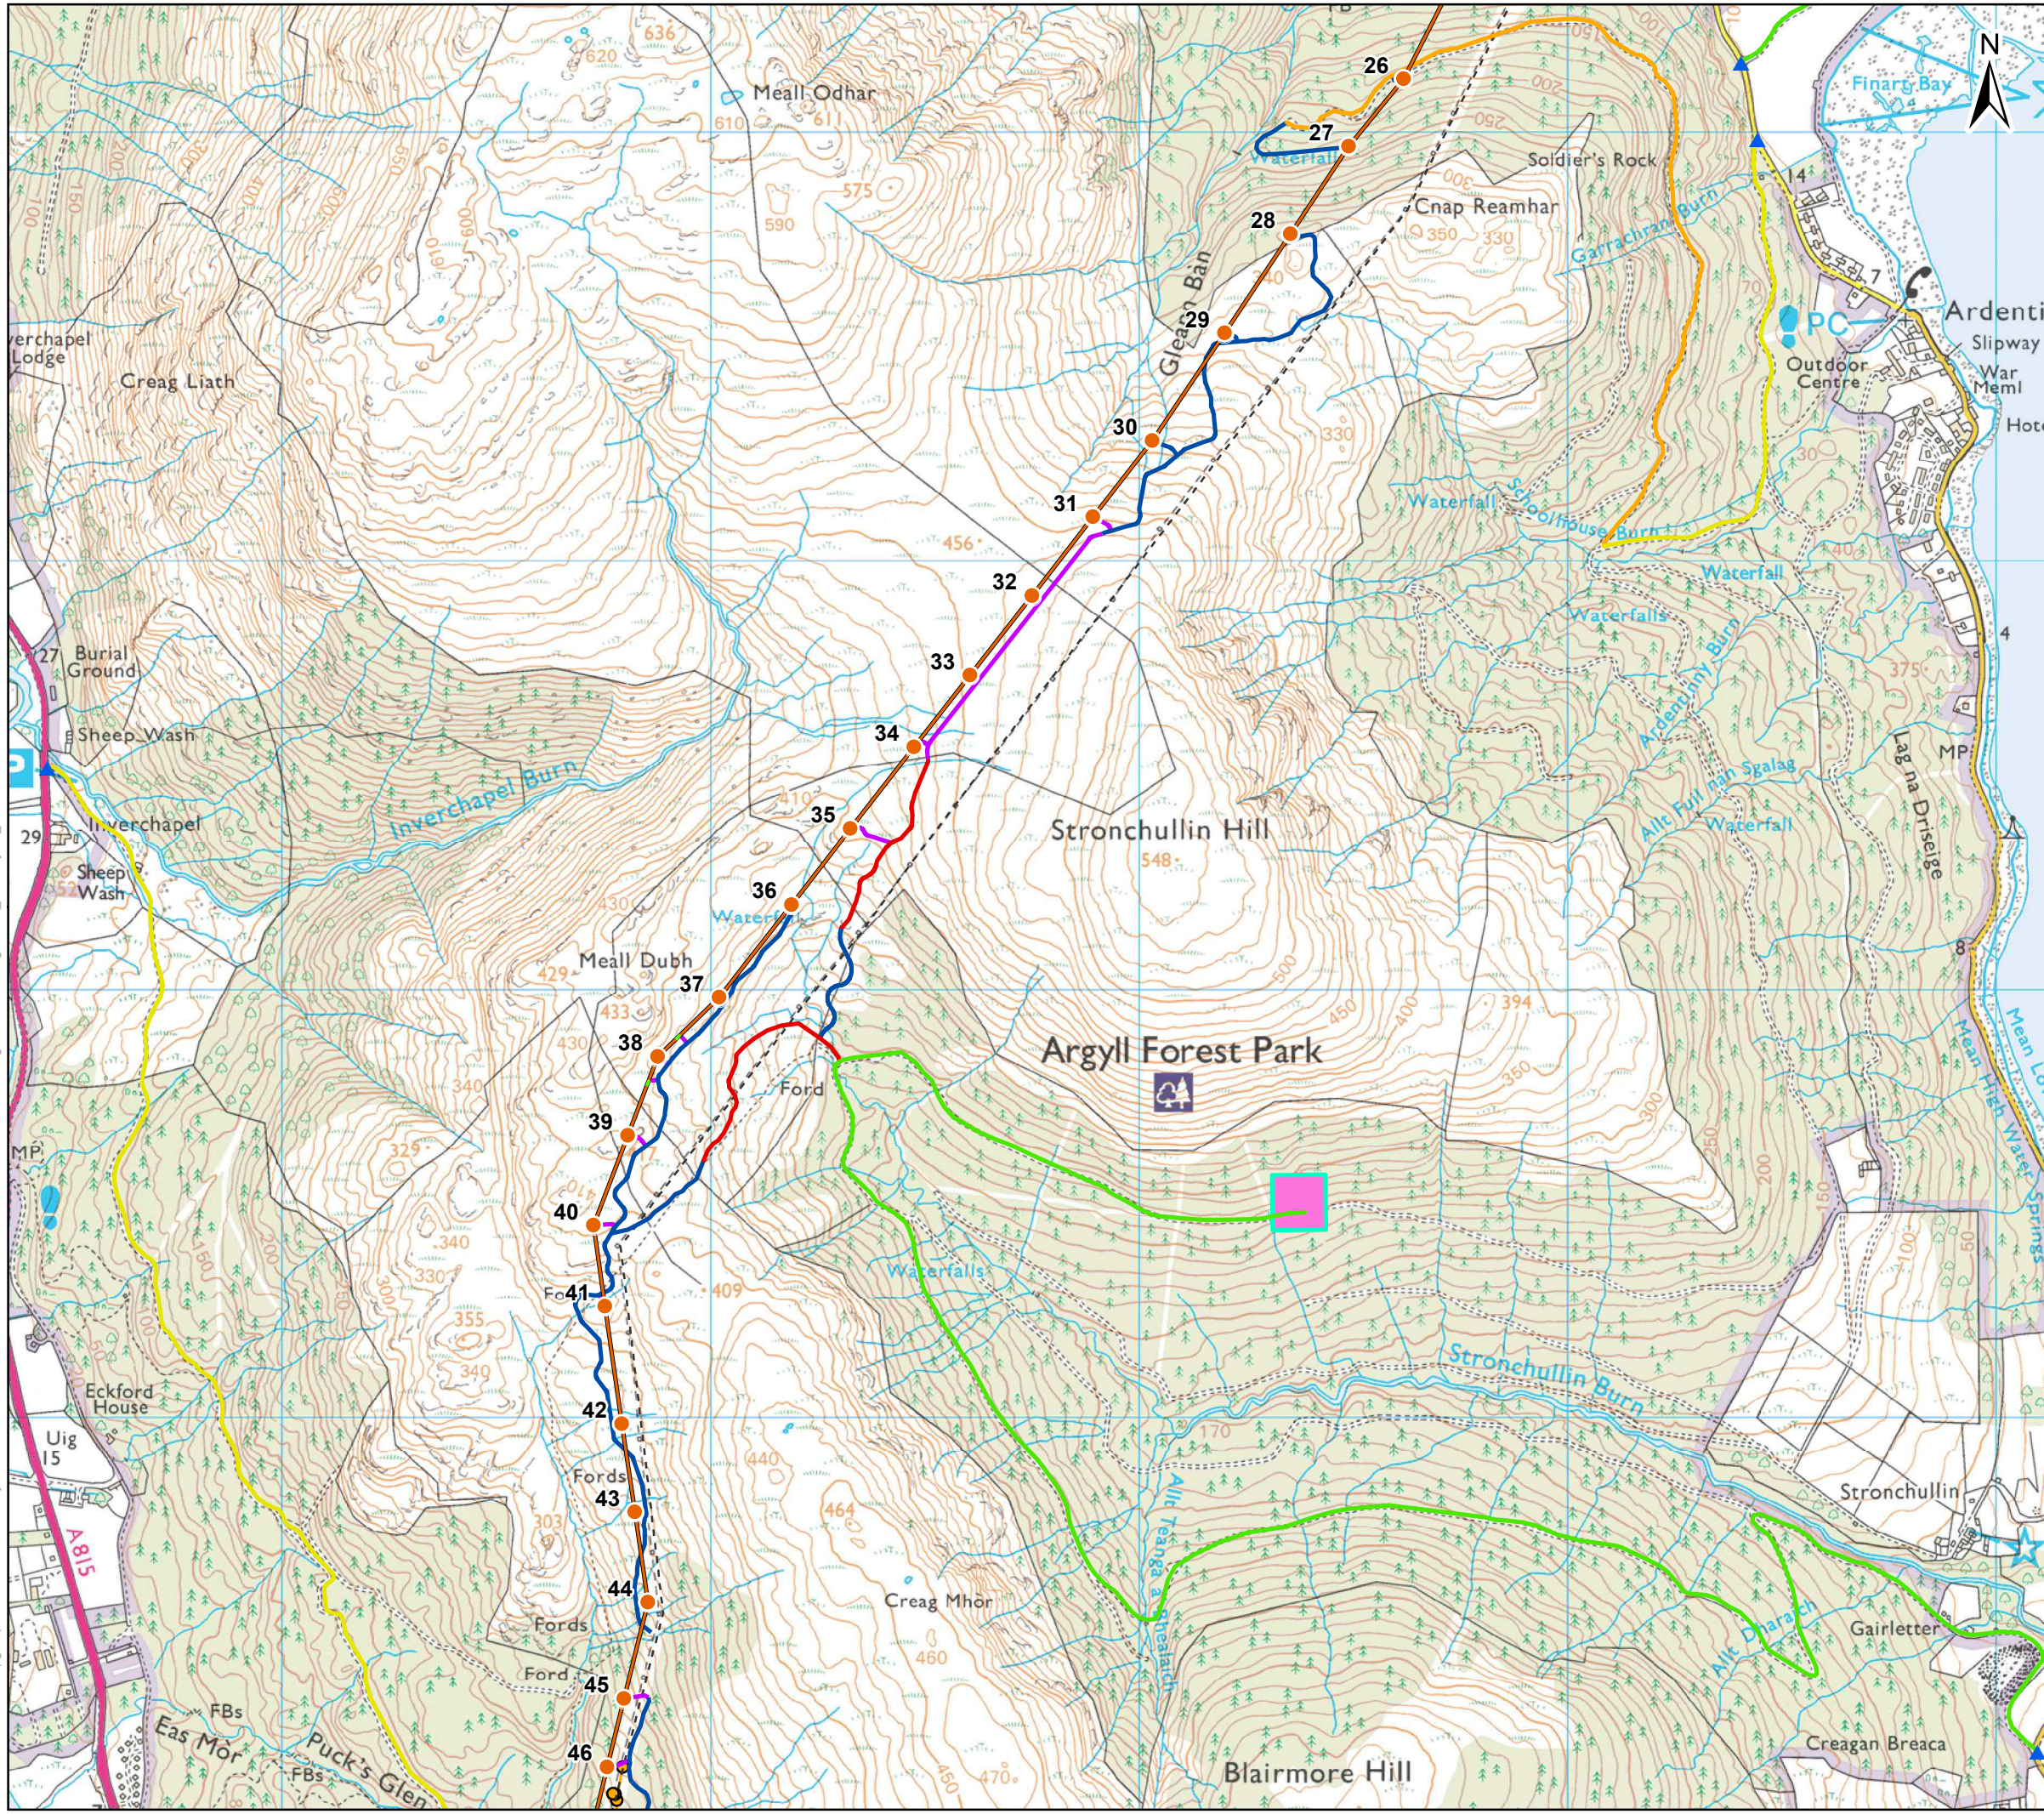

- ### Key
- Existing OHL
  - Proposed OHL Alignment
  - Proposed Tower Position
  - Proposed Tower Position
  - Temporary Diversion
  - Temporary Diversion Structure
  - Borrow Pit Search Area
  - Proposed Conductor Pulling Area (EPZ)
  - Proposed Retained Access Track
  - Proposed Access – Temporary
  - Existing Track (No Upgrades Required - Good Condition)
  - Existing Track (Upgrades Required - Fair Condition)
  - Existing Track (Upgrades Required - Poor Condition)
  - Existing Track (Upgrades Required - Very Poor Condition)
  - ▲ Existing Bellmouth - Minimal Work Required
  - ▲ Proposed Bellmouth Required - Temporary
  - ▲ Proposed Bellmouth Required - Permanent




Client:   
TRANSMISSION

Project: Dunoon to Loch Long 132kV OHL Rebuild


Title: Figure 3.1  
Site Layout  
Sheet 2 of 4

Date: 1/16/2023 Scale: 15,000 @ A3  
Drawn: AS Checked: IM Approved: SM

Date Saved: 1/15/2023  
 Document Path: \\uk.wspgroup.com\Central Data\Projects\70078xxx\70078098 - LT193 Dunoon to Whistlerfield EIA\05 Drawings\GIS\MXDs\Figure 3.1 - Site Layout\_20221116.mxd

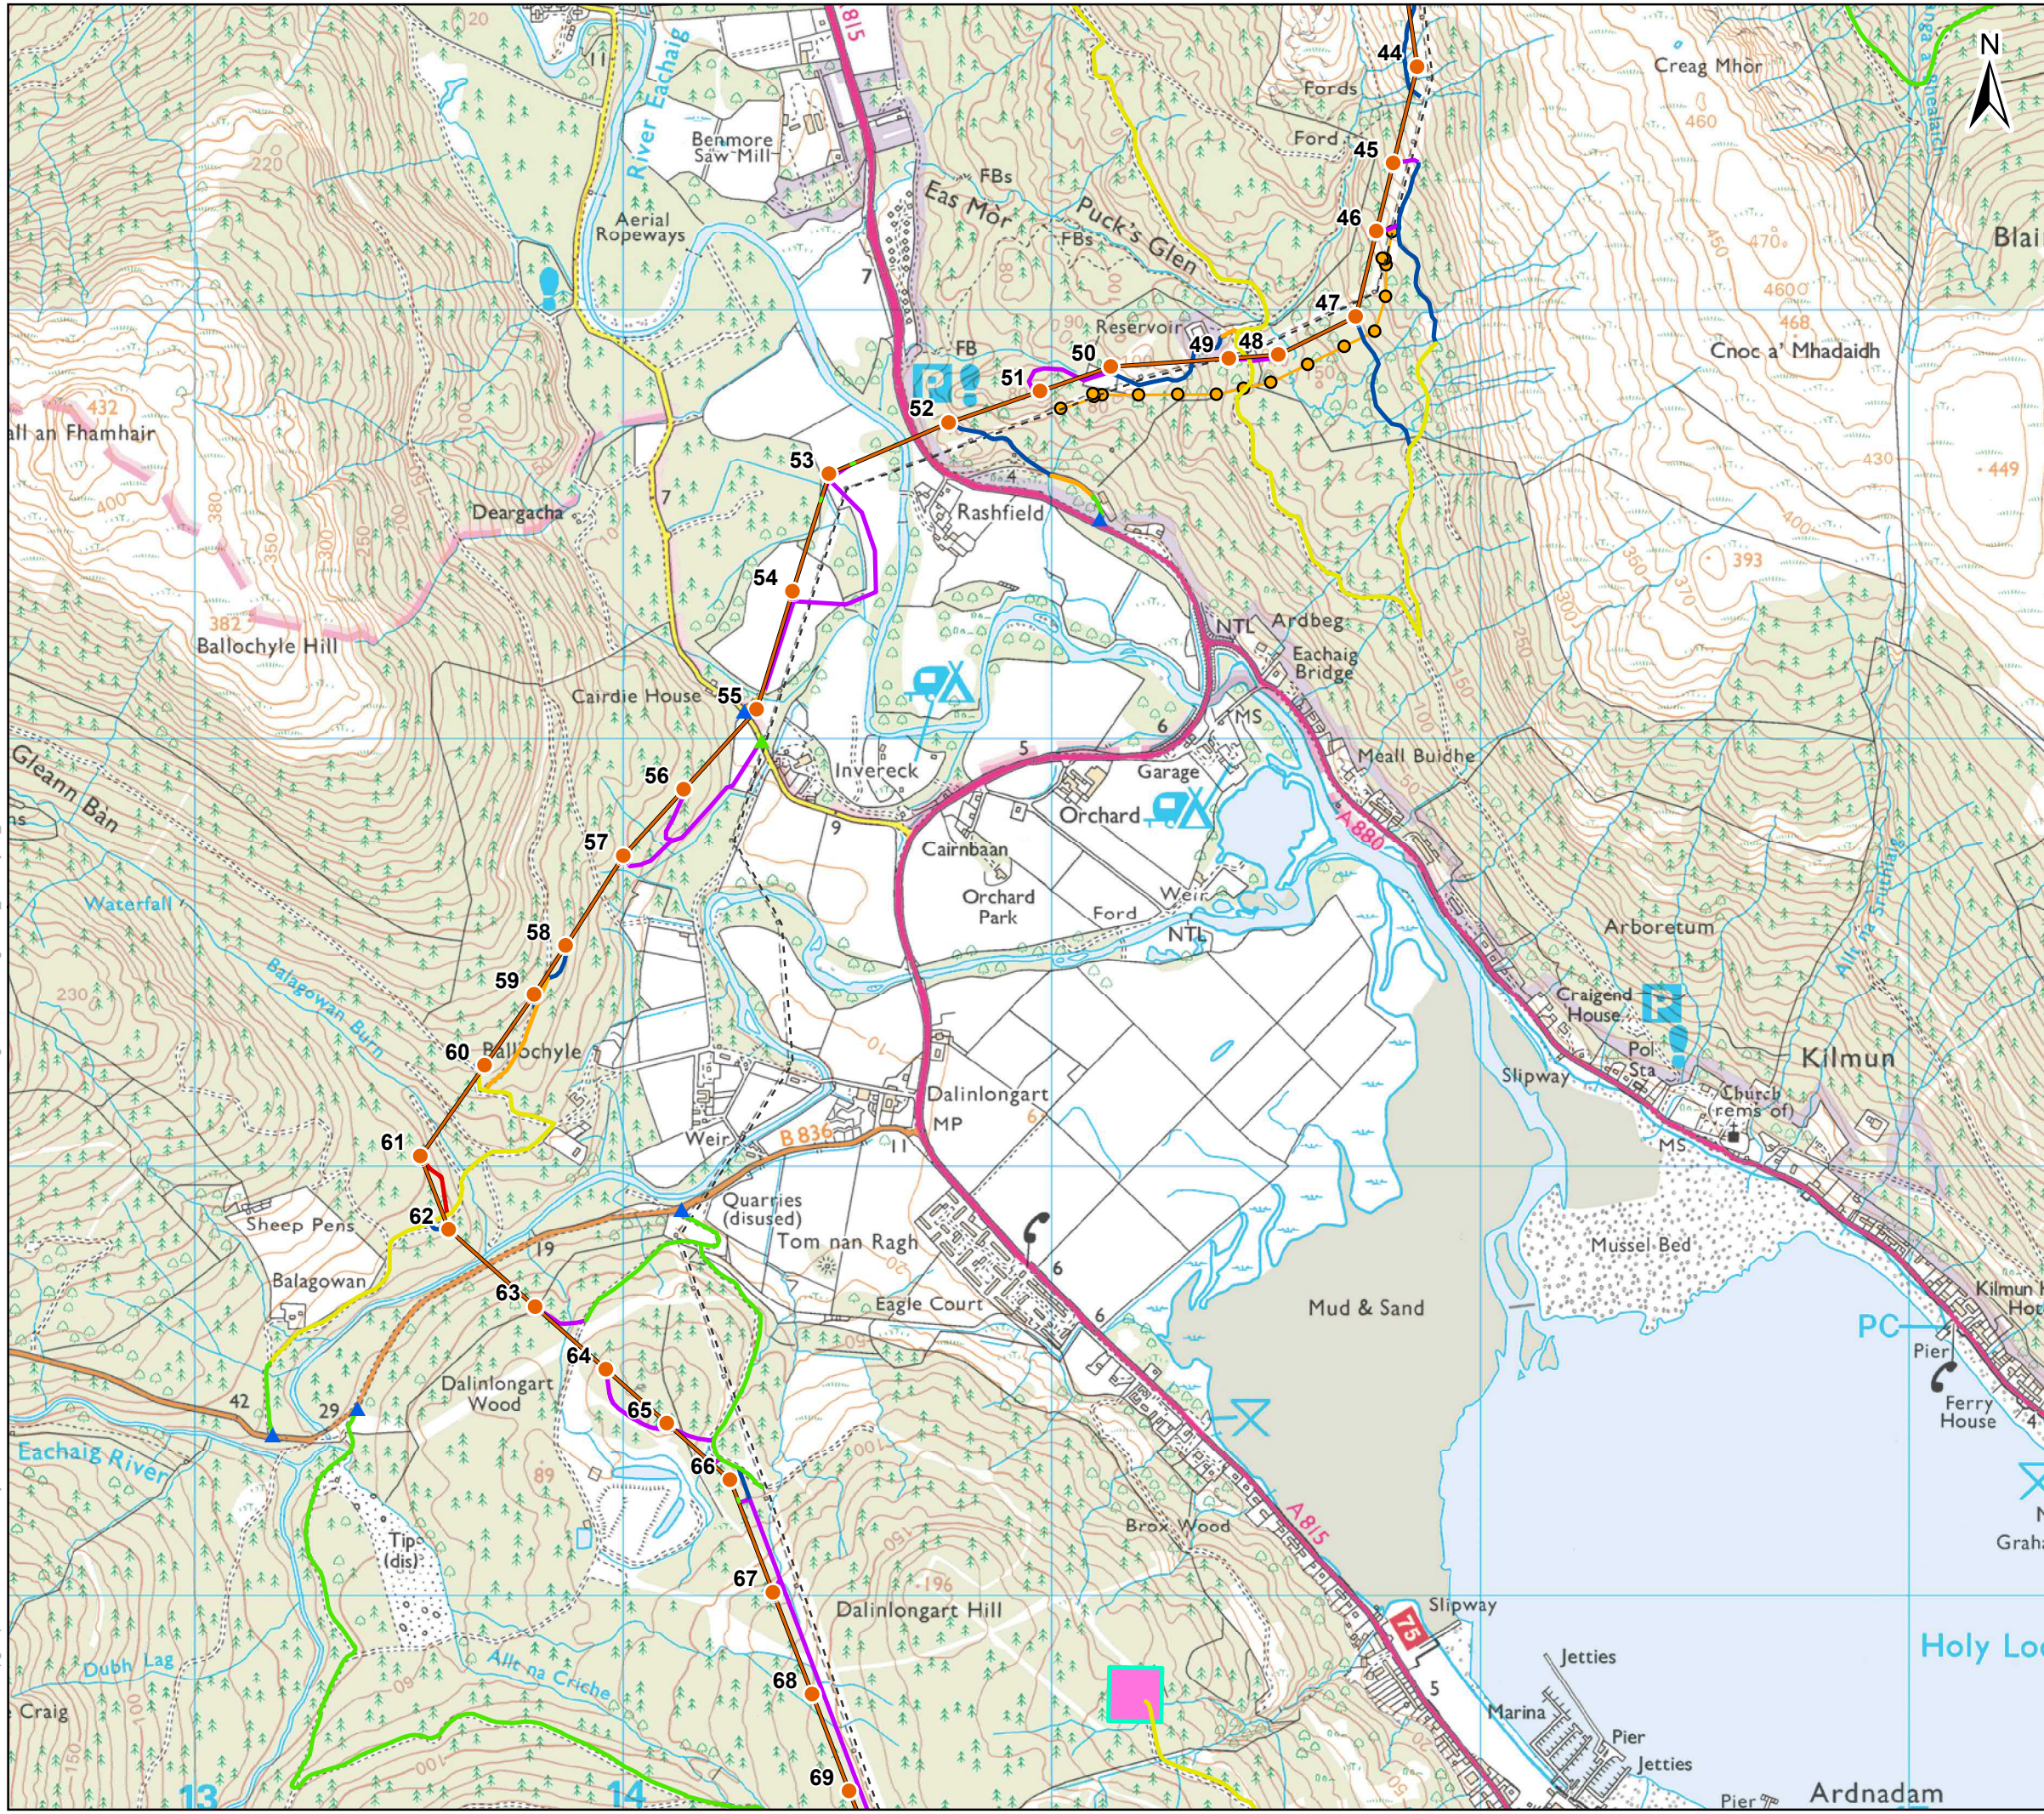

- Key**
- Existing OHL
  - Proposed OHL Alignment
  - Proposed Tower Position
  - Proposed Tower Position
  - Temporary Diversion
  - Temporary Diversion Structure
  - █ Borrow Pit Search Area
  - █ Proposed Conductor Pulling Area (EPZ)
  - Proposed Retained Access Track
  - Proposed Access – Temporary
  - Existing Track (No Upgrades Required - Good Condition)
  - Existing Track (Upgrades Required - Fair Condition)
  - Existing Track (Upgrades Required - Poor Condition)
  - Existing Track (Upgrades Required - Very Poor Condition)
  - ▲ Existing Bellmouth - Minimal Work Required
  - ▲ Proposed Bellmouth Required - Temporary
  - ▲ Proposed Bellmouth Required - Permanent




Client: Scottish & Southern Electricity Networks  
 Project: Dunoon to Loch Long 132kV OHL Rebuild

Title: Figure 3.1  
 Site Layout  
 Sheet 3 of 4

Date: 1/16/2023 Scale: 15,000 @ A3  
 Drawn: AS Checked: IM Approved: SM

Date Saved: 1/15/2023  
 Document Path: \\uk.wspgroup.com\Central Data\Projects\70078xxx\70078098 - LT193 Dunoon to Whistlerfield EIA\05 Drawings\GIS\MXDs\Figure 3.1 - Site Layout\_20221116.mxd

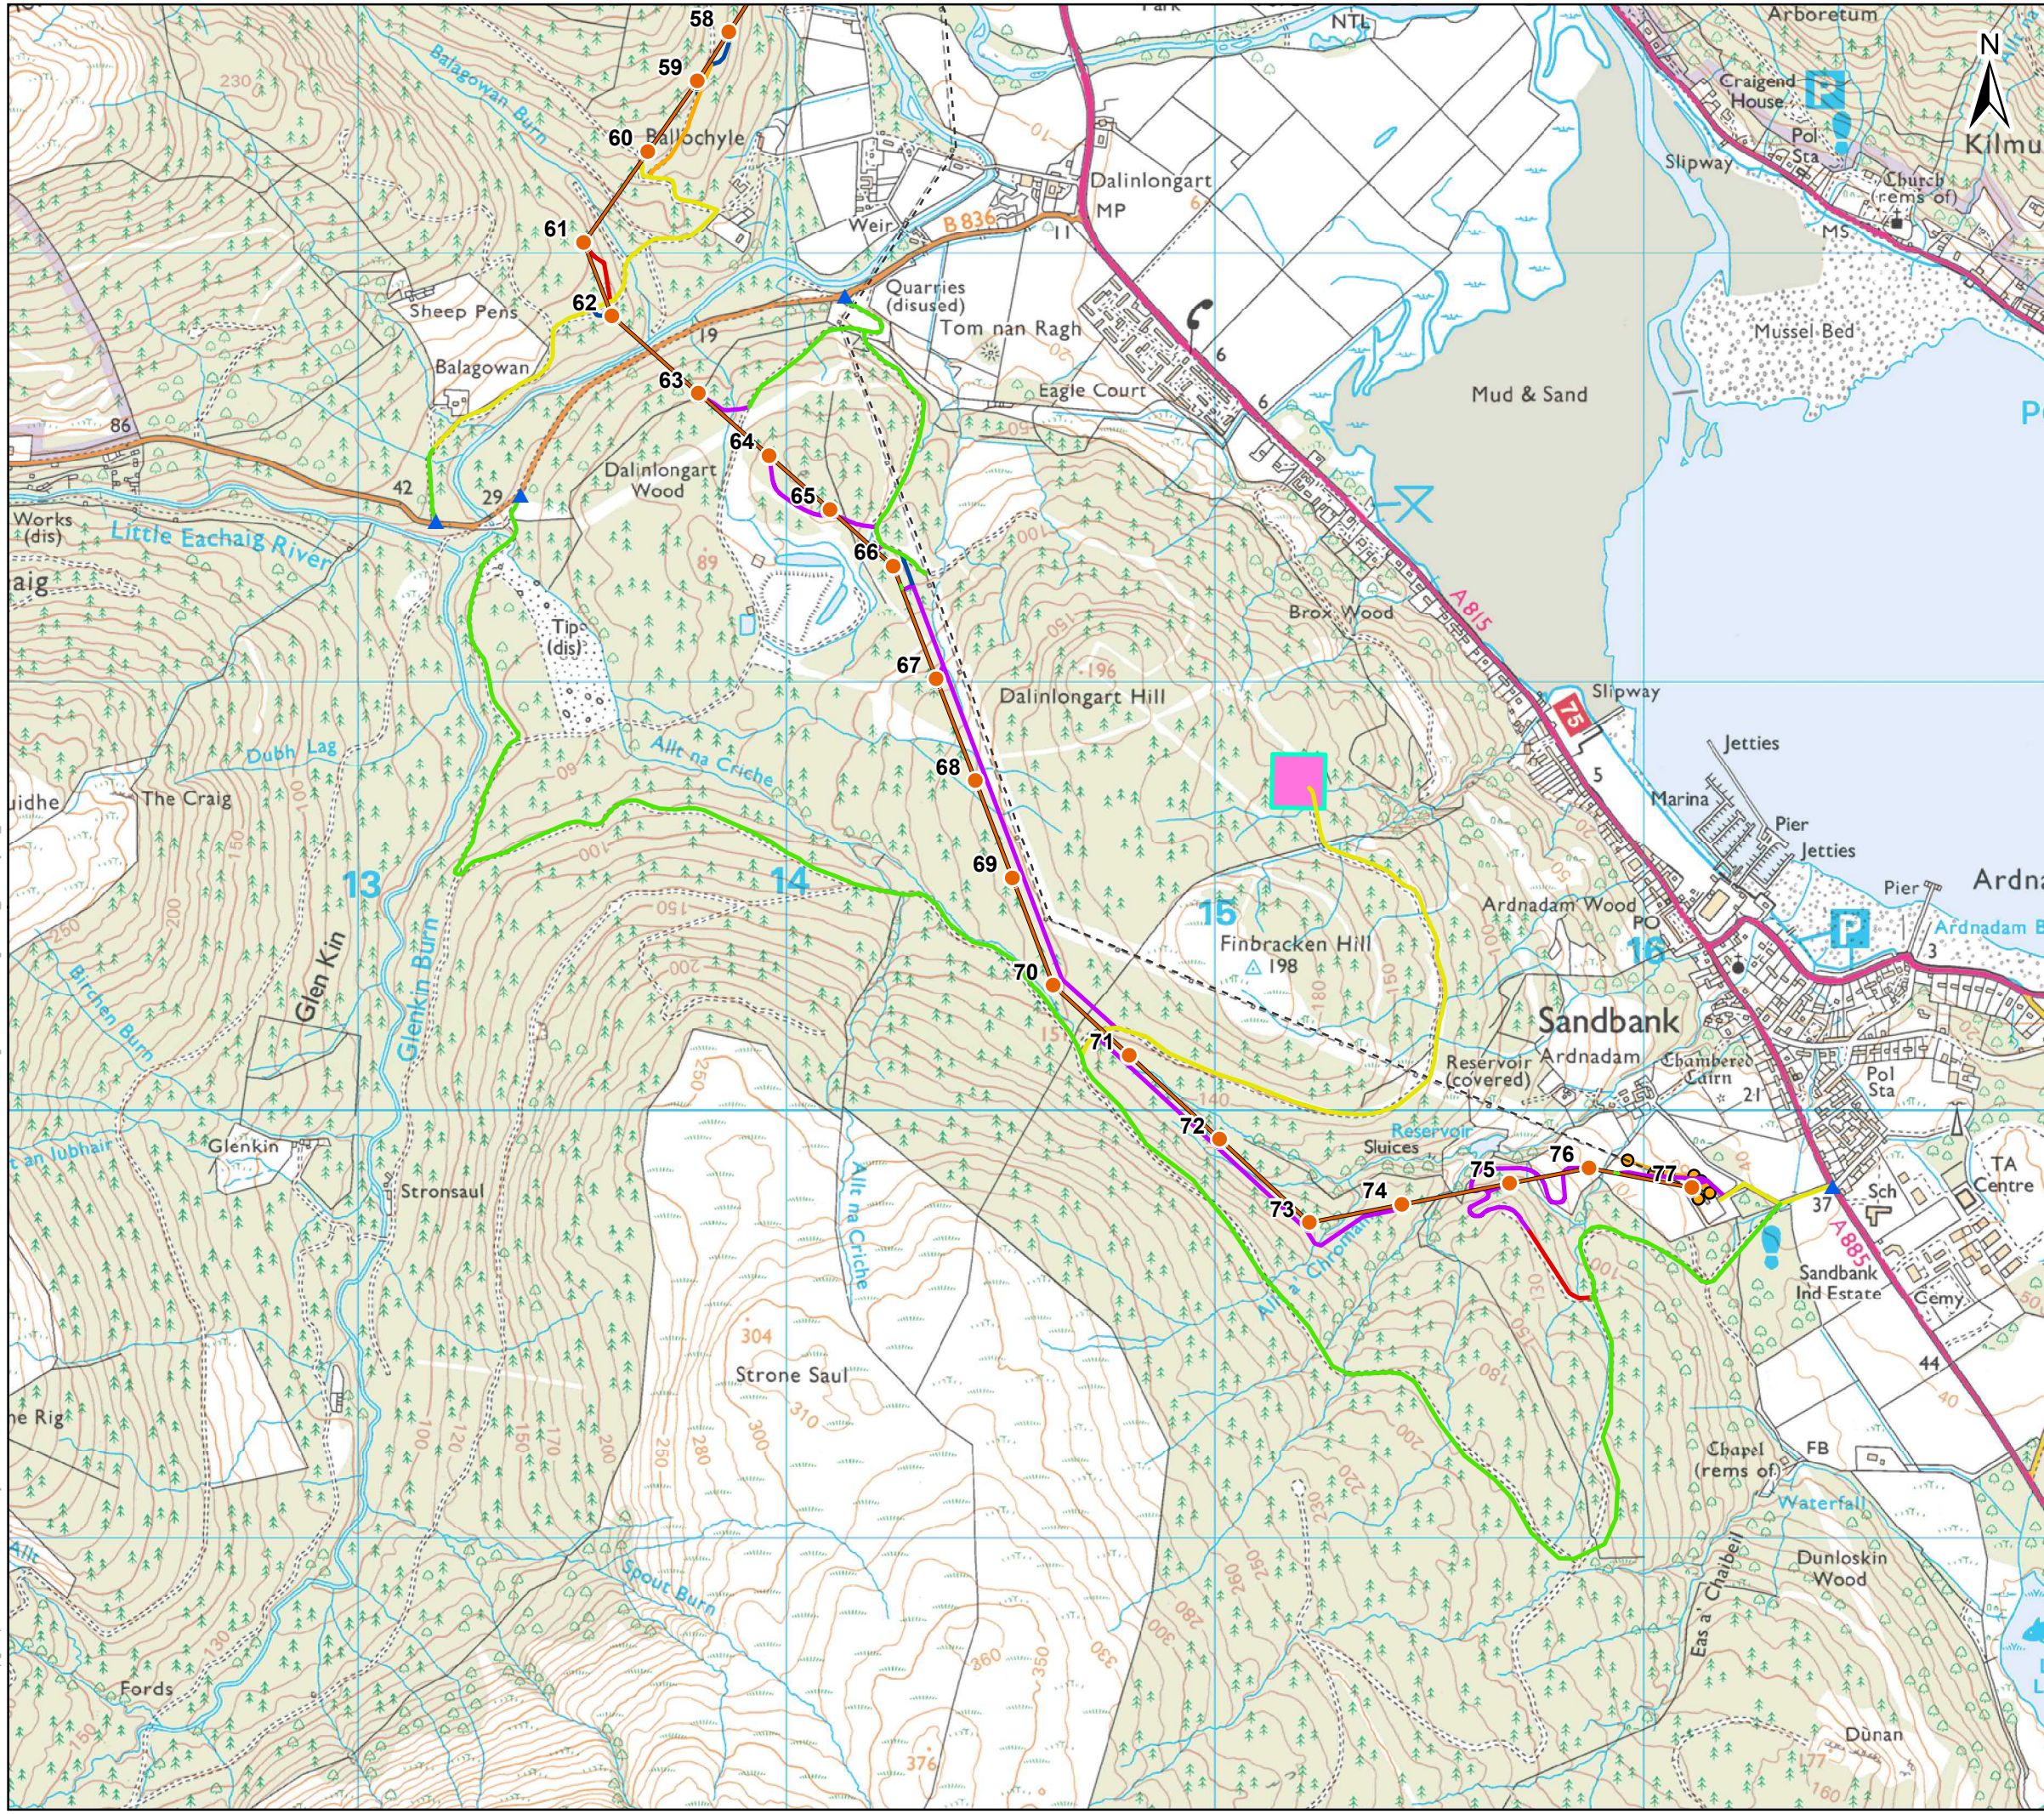

**Key**

- Existing OHL
- Proposed OHL Alignment
- Proposed Tower Position
- Proposed Tower Position
- Temporary Diversion
- Temporary Diversion Structure
- Borrow Pit Search Area
- Proposed Conductor Pulling Area (EPZ)
- Proposed Retained Access Track
- Proposed Access – Temporary
- Existing Track (No Upgrades Required - Good Condition)
- Existing Track (Upgrades Required - Fair Condition)
- Existing Track (Upgrades Required - Poor Condition)
- Existing Track (Upgrades Required - Very Poor Condition)
- ▲ Existing Bellmouth - Minimal Work Required
- ▲ Proposed Bellmouth Required - Temporary
- ▲ Proposed Bellmouth Required - Permanent

0    250    500  
Metres

Client: **Scottish & Southern Electricity Networks**  
 TRANSMISSION

Project: **Dunoon to Loch Long 132kV OHL Rebuild**

Title: **Figure 3.1 Site Layout Sheet 4 of 4**

Date: 1/16/2023      Scale: 15,000 @ A3  
 Drawn: AS      Checked: IM      Approved: SM