


- Key**
- Proposed Tower Position
 - Proposed OHL Alignment
 - Proposed Development - Other Infrastructure
 - - - Removal of Existing OHL - Conductor
 - Removal of Existing OHL - Tower
 - - - Loch Long Crossing - Conductor
 - Loch Long Crossing - Tower




TRANSMISSION


Project: **Dumoon to Loch Long 132kV OHL Rebuild**

Title: **Figure 5.1: Cumulative Developments Sheet 1 of 3**

Date: 05/01/2023 Scale: 30,000 @ A3
 Drawn: AS Checked: IM Approved: SB

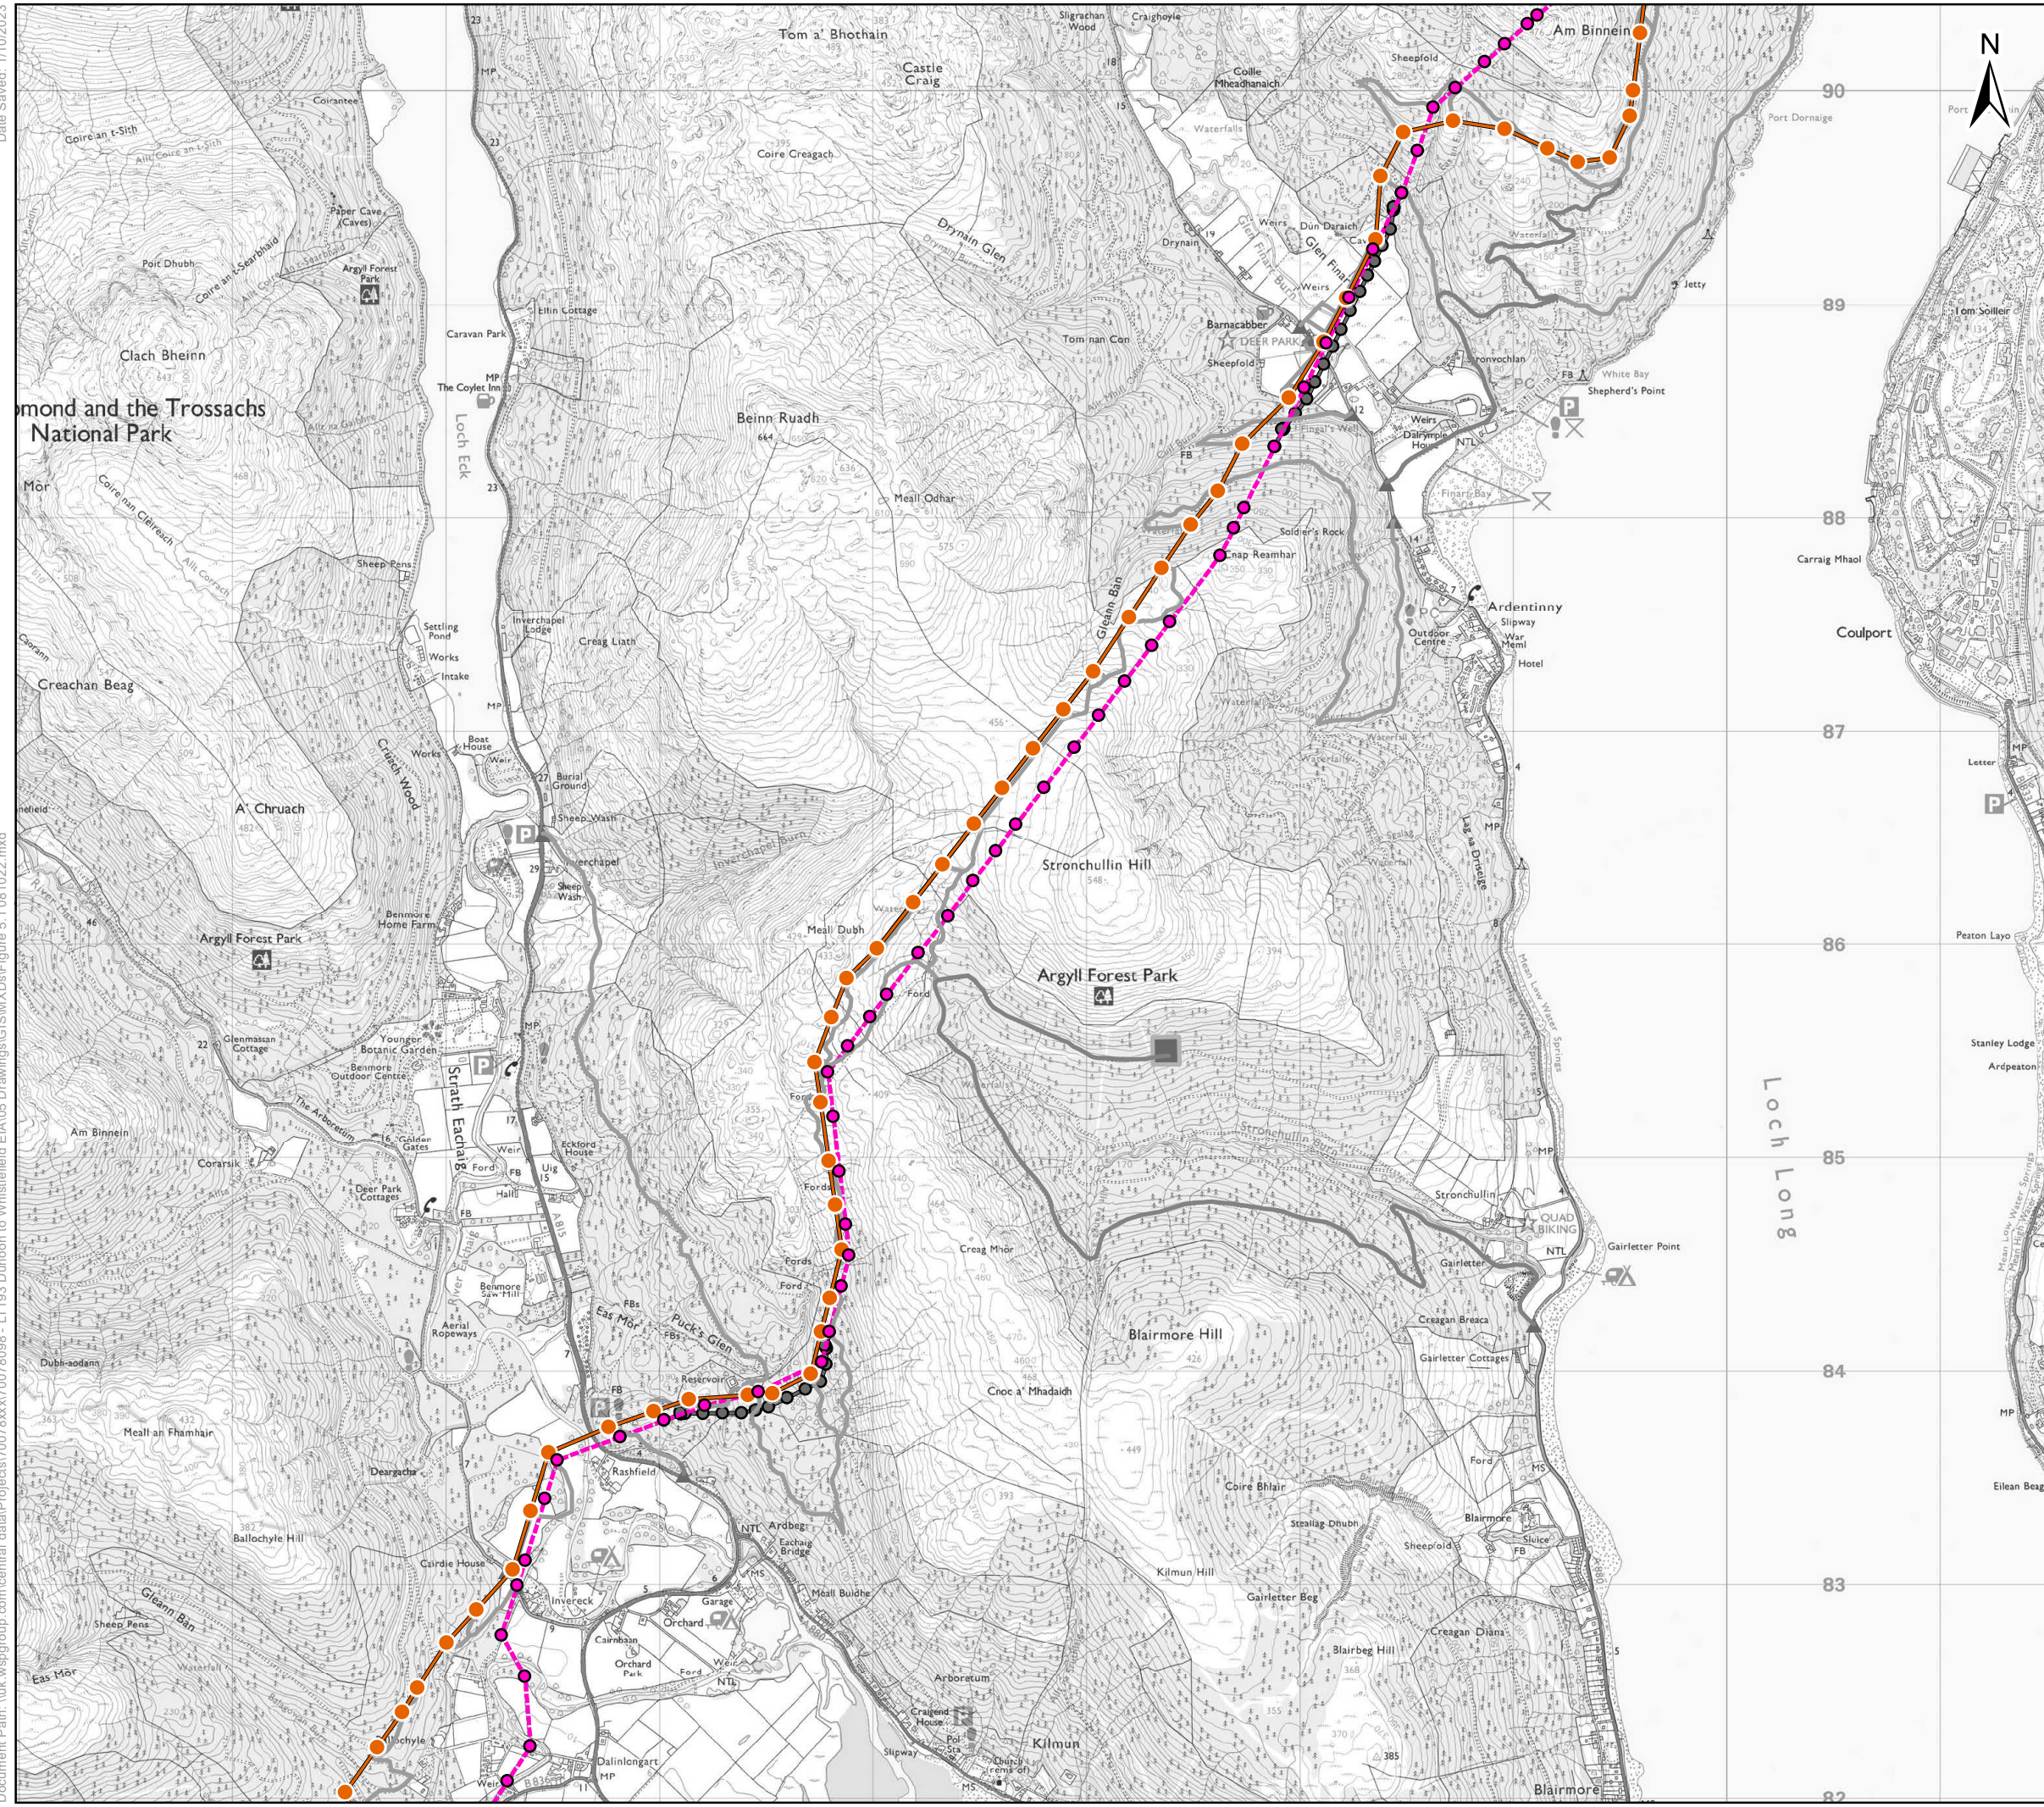

- Key**
- Proposed Tower Position
 - Proposed OHL Alignment
 - Proposed Development - Other Infrastructure
 - - - Removal of Existing OHL - Conductor
 - Removal of Existing OHL - Tower
 - - - Loch Long Crossing - Conductor
 - Loch Long Crossing - Tower




TRANSMISSION

Client: Scottish & Southern Electricity Networks


Project: Dumoon to Loch Long 132kV OHL Rebuild

Title: Figure 5.1: Cumulative Developments Sheet 2 of 3

Date: 05/01/2023 Scale: 30,000 @ A3
 Drawn: AS Checked: IM Approved: SB

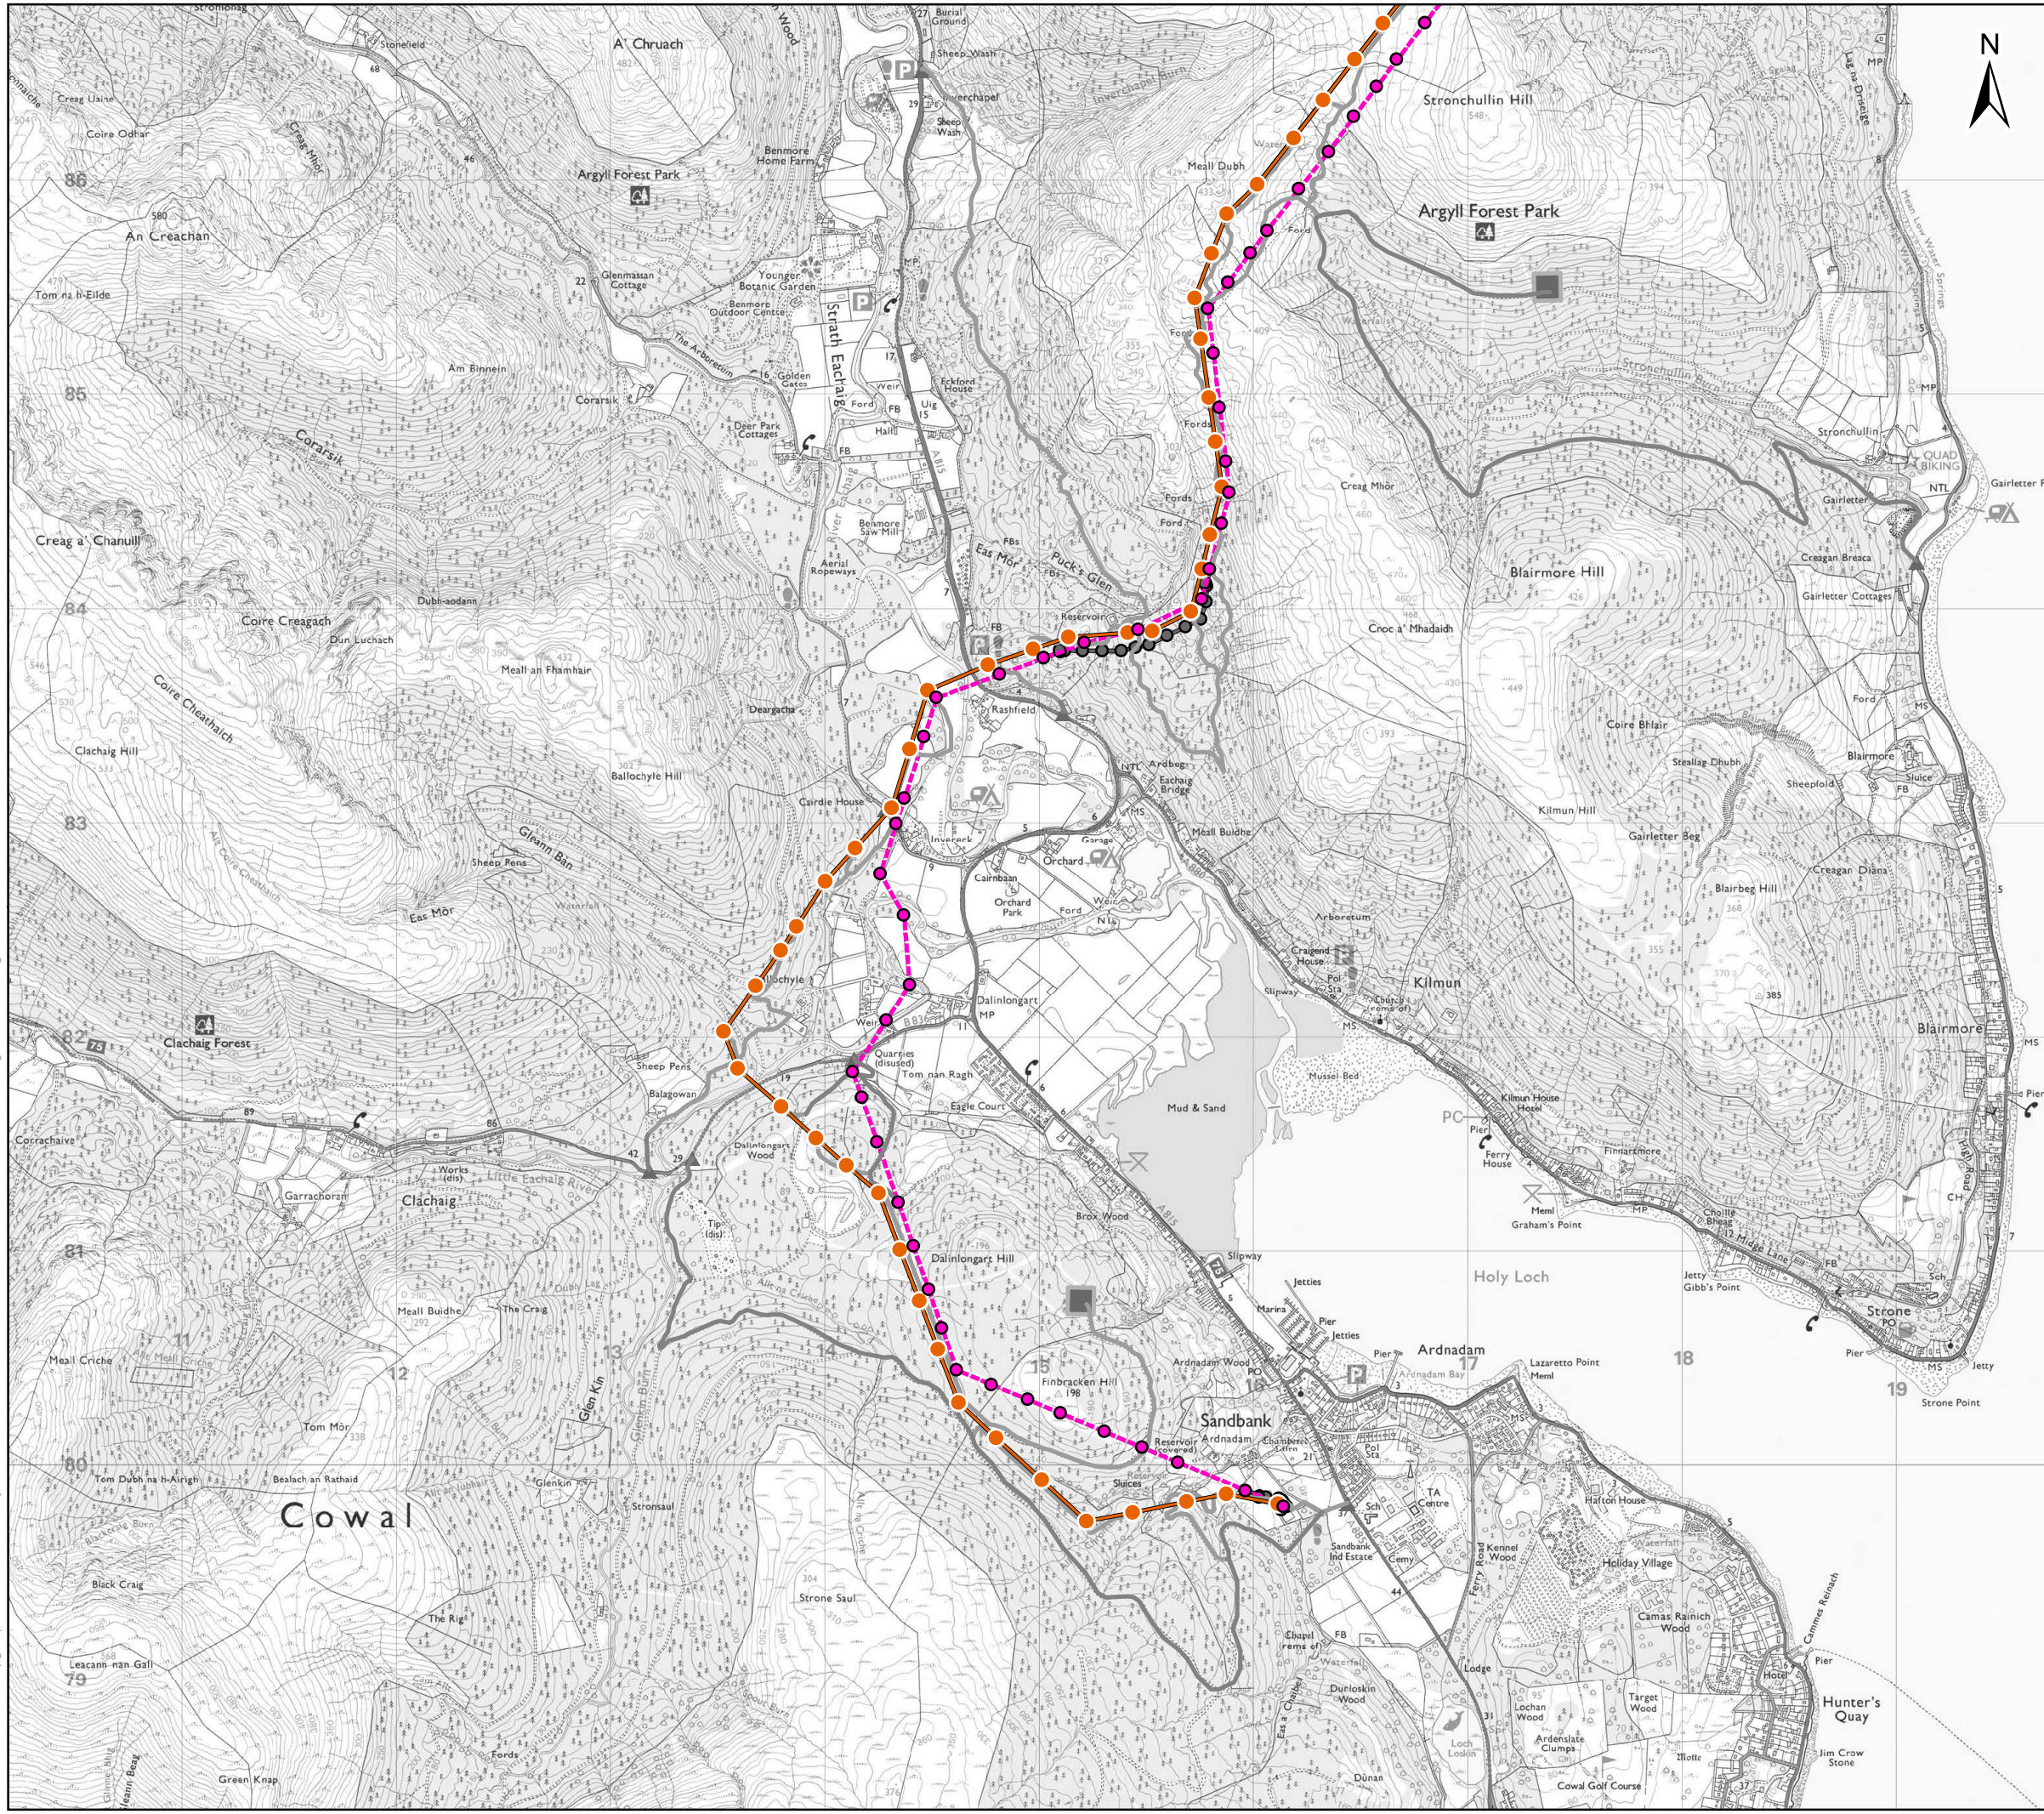

- Key**
- Proposed Tower Position
 - Proposed OHL Alignment
 - Proposed Development - Other Infrastructure
 - - - Removal of Existing OHL- Conductor
 - Removal of Existing OHL- Tower
 - - - Loch Long Crossing- Conductor
 - Loch Long Crossing- Tower



Client: **Scottish & Southern Electricity Networks**
TRANSMISSION

Project: **Dumoon to Loch Long 132kV OHL Rebuild**

Title: **Figure 5.1: Cumulative Developments Sheet 3 of 3**

Date: 05/01/2023 Scale: 30,000 @ A3
 Drawn: AS Checked: IM Approved: SB