


212700 212800 212900 213000 213100 213200 213300 213400 213500 213600 213700 213800 213900 214000 214100 214200 214300 214400 214500 214600 214700 214800 214900 215000 215100 215200 215300 215400 215500 215600 215700 215800 215900 216000 216100 216200 216300 216400 216500

683800 683700 683600 683500 683400 683300 683200 683100 683000 682900 682800 682700 682600 682500 682400 682300 682200 682100 682000 681900 681800 681700 681600 681500 681400 681300 681200 681100 681000 680900 680800 680700

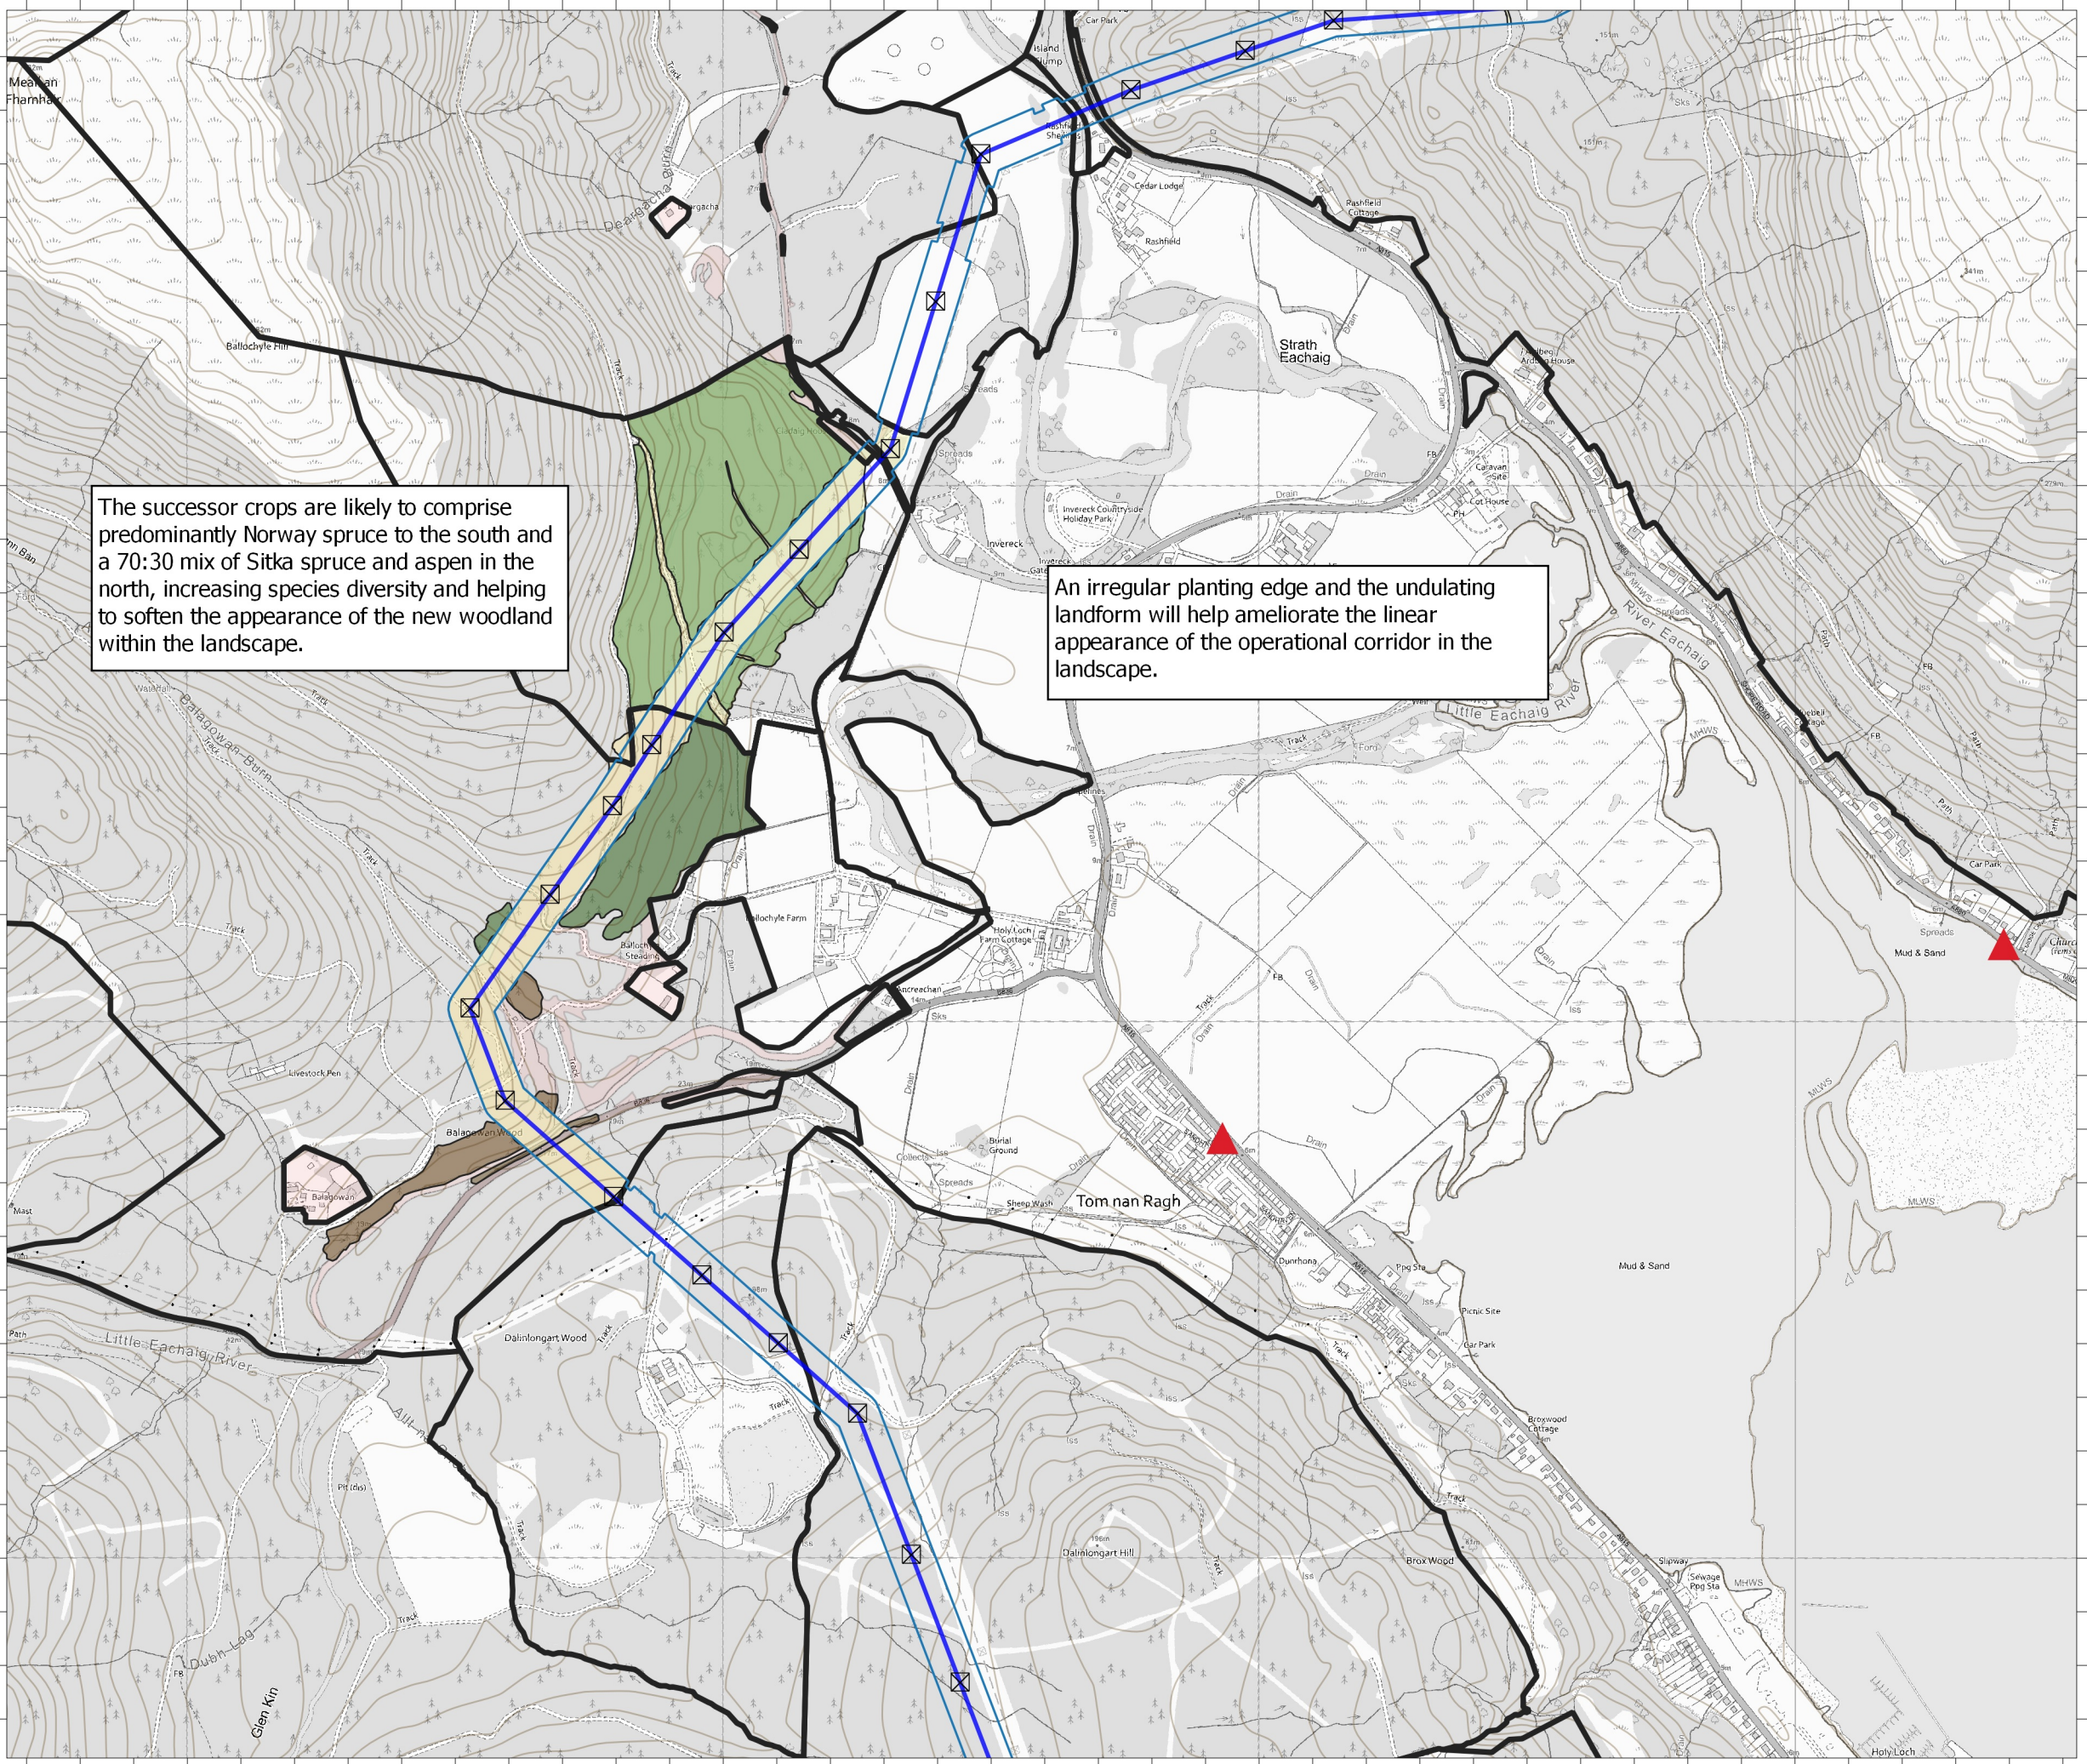

TRANSMISSION

Dunoon to Loch Long 132kV OHL Rebuild


Figure 12.2.5
Appraisal & Mitigation of Forestry Landscape Impacts
Ballochyle, Dunoon - Indicative Powerline Restocking

Key

- Property Boundary
- Proposed OHL Alignment
- Proposed Tower Position
- Operational Corridor
- Prominent Viewpoints

Indicative Restocking in Management Felling Area

- Sitka Spruce/Aspen 70:30 Mix
- Norway Spruce
- Native Broadleaves
- Open Ground

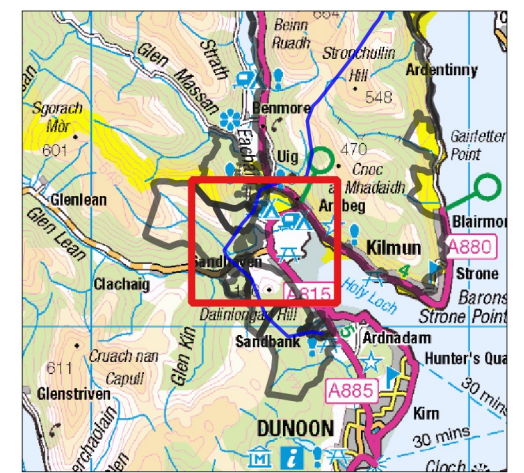

N 	Scale	1:12000		
	Size	A3	CRS	EPSG 27700 / British National Grid
© Crown copyright and database rights (2023) Ordnance Survey Licence No. 01100031673				

212700 212800 212900 213000 213100 213200 213300 213400 213500 213600 213700 213800 213900 214000 214100 214200 214300 214400 214500 214600 214700 214800 214900 215000 215100 215200 215300 215400 215500 215600 215700 215800 215900 216000 216100 216200 216300 216400 216500