

# **North Argyll 275 kV Upgrade: An Suidhe Substation Environmental Appraisal**

**November 2022**



## CONTENTS

<b>Glossary of Terms and Abbreviations</b>	<b>1-4</b>
<b>1. Introduction and Scope</b>	<b>1-8</b>
<b>1.1 Background to the Project</b>	<b>1-8</b>
<b>1.2 Consent Requirements</b>	<b>1-8</b>
<b>1.3 The Project</b>	<b>1-8</b>
<b>1.4 Environmental Appraisal</b>	<b>1-11</b>
<b>1.5 Environmental Appraisal Methodology</b>	<b>1-12</b>
<b>1.6 Mitigation</b>	<b>1-12</b>
<b>1.7 Cumulative Developments</b>	<b>1-13</b>
<b>1.8 Consultation</b>	<b>1-13</b>
<b>1.9 Structure of the Environmental Appraisal</b>	<b>1-15</b>
<b>2. Project Description</b>	<b>2-1</b>
<b>2.1 Introduction</b>	<b>2-1</b>
<b>2.2 Project Need</b>	<b>2-1</b>
<b>2.3 Location</b>	<b>2-1</b>
<b>2.4 Alternatives</b>	<b>2-2</b>
<b>2.5 The Project</b>	<b>2-5</b>
<b>2.6 Construction Works Programme</b>	<b>2-11</b>
<b>2.7 Description of Construction Works</b>	<b>2-12</b>
<b>2.8 Construction Environmental Management</b>	<b>2-16</b>
<b>2.9 Operational Phase</b>	<b>2-17</b>
<b>2.10 Decommissioning Phase</b>	<b>2-19</b>
<b>3. Landscape and Visual Appraisal</b>	<b>3-3</b>
<b>3.1 Introduction</b>	<b>3-3</b>
<b>3.2 Guidance and Methodology</b>	<b>3-3</b>
<b>3.3 Planning Policy Context</b>	<b>3-4</b>
<b>3.4 Landscape Baseline Environment</b>	<b>3-5</b>
<b>3.5 Visual Baseline and Receptors</b>	<b>3-7</b>
<b>3.6 Embedded Mitigation</b>	<b>3-8</b>
<b>3.7 ZTV and Viewpoint Analysis</b>	<b>3-8</b>
<b>3.8 Appraisal - Construction Effects</b>	<b>3-12</b>
<b>3.9 Appraisal - Operational Landscape Effects</b>	<b>3-13</b>
<b>3.10 Appraisal - Operational Visual Effects</b>	<b>3-17</b>
<b>3.11 Appraisal - Cumulative Effects</b>	<b>3-20</b>
<b>3.12 Summary of Effects</b>	<b>3-22</b>
<b>3.13 References</b>	<b>3-23</b>
<b>4. Ecology and Ornithology</b>	<b>4-2</b>
<b>4.1 Introduction</b>	<b>4-2</b>
<b>4.2 Methodology</b>	<b>4-2</b>
<b>4.3 Baseline</b>	<b>4-3</b>
<b>4.4 Appraisal – Construction Effects</b>	<b>4-12</b>
<b>4.5 Cumulative Assessment</b>	<b>4-16</b>
<b>4.6 Mitigation</b>	<b>4-19</b>
<b>4.7 Residual Impacts and Compensatory Habitat</b>	<b>4-19</b>
<b>4.8 Summary of Effects</b>	<b>4-22</b>
<b>5. Forestry</b>	<b>5-2</b>
<b>5.1 Introduction</b>	<b>5-2</b>
<b>5.2 Objectives</b>	<b>5-2</b>
<b>5.3 Guidance</b>	<b>5-2</b>
<b>5.4 Methodology</b>	<b>5-2</b>
<b>5.5 Results</b>	<b>5-5</b>
<b>5.6 Assessment of Effects</b>	<b>5-6</b>

<b>5.7</b>	<b>Mitigation</b>	<b>5-11</b>
<b>5.8</b>	<b>Appraisal Summary</b>	<b>5-12</b>
<b>5.9</b>	<b>Mitigation Proposals</b>	<b>5-13</b>
<b>6.</b>	<b>Geology, Hydrology and Hydrogeology</b>	<b>6-1</b>
<b>6.1</b>	<b>Study Area</b>	<b>6-2</b>
<b>6.2</b>	<b>Surface Hydrology</b>	<b>6-2</b>
<b>6.3</b>	<b>Coastal Waters</b>	<b>6-2</b>
<b>6.4</b>	<b>Hydrogeology</b>	<b>6-2</b>
<b>6.5</b>	<b>Flood Risk</b>	<b>6-3</b>
<b>6.6</b>	<b>Geology</b>	<b>6-3</b>
<b>6.7</b>	<b>Soils</b>	<b>6-3</b>
<b>6.8</b>	<b>Groundwater Dependent Terrestrial Ecosystems (GWDTes)</b>	<b>6-3</b>
<b>6.9</b>	<b>Public Water Supplies</b>	<b>6-4</b>
<b>6.10</b>	<b>Private Water Supplies</b>	<b>6-4</b>
<b>6.11</b>	<b>Designated Sites</b>	<b>6-5</b>
<b>6.12</b>	<b>Sensitivity of Receptors</b>	<b>6-5</b>
<b>6.13</b>	<b>Appraisal - Potential Construction Effects - Substation</b>	<b>6-7</b>
<b>6.14</b>	<b>Appraisal - Potential Construction Effects - OHL</b>	<b>6-9</b>
<b>6.15</b>	<b>Appraisal - Potential Operational Effects - Substation</b>	<b>6-10</b>
<b>6.16</b>	<b>Appraisal - Potential Operational Effects - OHL</b>	<b>6-11</b>
<b>6.17</b>	<b>Appraisal - Cumulative Effects</b>	<b>6-12</b>
<b>6.18</b>	<b>Summary of Impacts</b>	<b>6-14</b>
<b>7.</b>	<b>Archaeology and Cultural Heritage</b>	<b>7-1</b>
<b>7.1</b>	<b>Introduction</b>	<b>7-2</b>
<b>7.2</b>	<b>Appraisal Methodology</b>	<b>7-2</b>
<b>7.3</b>	<b>Baseline</b>	<b>7-2</b>
<b>7.4</b>	<b>Appraisal – Direct Effects</b>	<b>7-5</b>
<b>7.5</b>	<b>Mitigation</b>	<b>7-5</b>
<b>7.6</b>	<b>Appraisal – Indirect Effects</b>	<b>7-6</b>
<b>7.7</b>	<b>Summary of Effects</b>	<b>7-7</b>
<b>8.</b>	<b>Noise Assessment</b>	<b>8-1</b>
<b>8.1</b>	<b>Introduction</b>	<b>8-1</b>
<b>8.2</b>	<b>Site Descriptions</b>	<b>8-1</b>
<b>8.3</b>	<b>Development Proposals</b>	<b>8-1</b>
<b>8.4</b>	<b>Legislation and Guidance</b>	<b>8-2</b>
<b>8.5</b>	<b>Scope of the Assessment</b>	<b>8-2</b>
<b>8.6</b>	<b>Consultation</b>	<b>8-3</b>
<b>8.7</b>	<b>Policy</b>	<b>8-3</b>
<b>8.8</b>	<b>Criteria for Assessing Sensitivity of Receptors</b>	<b>8-5</b>
<b>8.9</b>	<b>Criteria for Assessing Magnitude of Change</b>	<b>8-5</b>
<b>8.10</b>	<b>Significance Criteria</b>	<b>8-6</b>
<b>8.11</b>	<b>Baseline Noise Survey</b>	<b>8-7</b>
<b>8.12</b>	<b>Measurement Locations</b>	<b>8-7</b>
<b>8.13</b>	<b>Meteorological Conditions</b>	<b>8-7</b>
<b>8.14</b>	<b>Measurement Equipment</b>	<b>8-7</b>
<b>8.15</b>	<b>Measurement Results</b>	<b>8-8</b>
<b>8.16</b>	<b>Noise emission data</b>	<b>8-8</b>
<b>8.17</b>	<b>Construction Noise</b>	<b>8-8</b>
<b>8.18</b>	<b>Construction Traffic Noise</b>	<b>8-10</b>
<b>8.19</b>	<b>Construction Vibration</b>	<b>8-11</b>
<b>8.20</b>	<b>Operational Substation Noise</b>	<b>8-11</b>
<b>8.21</b>	<b>Noise modelling</b>	<b>8-12</b>
<b>8.22</b>	<b>Assessment</b>	<b>8-12</b>
<b>8.23</b>	<b>Construction Noise</b>	<b>8-12</b>

<b>8.24</b>	<b>Operational Substation Noise</b>	<b>8-13</b>
<b>8.25</b>	<b>Cumulative impacts</b>	<b>8-13</b>
<b>8.26</b>	<b>Mitigation Measures</b>	<b>8-14</b>
<b>8.27</b>	<b>Summary</b>	<b>8-14</b>
<b>9.</b>	<b>Traffic and Transport</b>	<b>9-1</b>
<b>9.1</b>	<b>Introduction</b>	<b>9-1</b>
<b>9.2</b>	<b>Appraisal Methodology</b>	<b>9-1</b>
<b>9.3</b>	<b>Access</b>	<b>9-1</b>
<b>9.4</b>	<b>Baseline</b>	<b>9-2</b>
<b>9.5</b>	<b>Construction Traffic</b>	<b>9-2</b>
<b>9.6</b>	<b>Mitigation</b>	<b>9-6</b>
<b>9.7</b>	<b>Operational Traffic</b>	<b>9-8</b>
<b>9.8</b>	<b>Summary of Effects</b>	<b>9-9</b>
<b>10.</b>	<b>Mitigation Proposals</b>	<b>10-1</b>

**Annex A: General Environmental Management Plans**

**Annex B: EIA Screening Letter**

**Annex C: Landscape Assessment Methodology**

**Annex D: Landscape Character Sensitivity Table**

**Annex E: Photomontages and Landscape Figures**

**Annex F: Ornithology Consultation**

**Annex G: Extended Ecology Phase 1 Habitat Survey**

**Annex H: Species Protection Plans**

**Annex I: Forestry**

**Annex J: Drainage Strategy and Drainage Plans**

**Annex K: Hydrology Methodology**

**Annex L: Private Water Supply Risk Assessment**

**Annex M: Water Construction Management Plan**

**Annex N: Peat Management Plan**

**Annex O: Peat Slide Risk Assessment**

**Annex P: Transformer Delivery Route Report**

**Annex Q: Cultural Heritage Appraisal and Site Gazetteer**

**Annex R: Noise and Vibration**

## GLOSSARY OF TERMS AND ABBREVIATIONS

Term/Abbreviation	Expanded Term/Definition
ABC	Argyll and Bute Council
ACoW	Archaeological Clerk of Works
AOD	Above Ordnance Datum
APQ	Area of Panoramic Quality
Attenuation	The reduction of the impact or effect of something. E.g, Noise attenuation comprises the reduction in level of a sound between the source and a receiver due to any combination of effects including distance, atmospheric absorption, acoustic screening, the presence of a building façade, etc.
Backclothing	Where elements (such as a proposed development) are seen below the skyline/horizon, and against a backdrop, thereby making them less prominent (potentially).
Background Noise	The noise level rarely fallen below in any given location over any given time period, often classed according to day time, evening or night time periods. The LA90 indices is often used to represent the background noise level.
BAP	Biodiversity Action Plan
BGS	British Geological Survey
BNG	Biodiversity Net Gain
BOCC	Birds of Conservation Concern
CEMP	Construction Environmental Management Plan
CoWRP	Control of Woodland Removal Policy
CIRIA	Construction Industry Research and Information Association
CLG	Community Liaison Group
CTMP	Construction Traffic Management Plan
Cumulative Effects	Effects arising from the additional or combination of developments which are in construction, have been consented or are reasonably foreseeable. May be experienced in combination, concurrently or sequentially.
dB	Decibel. A unit of level derived from the logarithm of the ratio between a value and a reference value typically used to describe acoustic quantities. The scale used is the decibel (dB) scale which extends from 0 to 140 decibels corresponding to the intensity of the sound level.
dB(A)	A-weighted decibel. A frequency weighting applied to noise levels to mimic the human ear's response to sound.
Designated Landscape	Areas of landscape identified as being of importance at international, national or local levels, either defined by statute or identified in development plans or other documents.
EA	Environmental Appraisal
ECoW	Ecological Clerk of Works
EIA	Environmental Impact Assessment
EIA Report	Environmental Impact Assessment Report
Electricity Work EIA Regulations	Electricity Work (Environmental Impact Assessment) (Scotland) Regulations 2017

<b>Term/Abbreviation</b>	<b>Expanded Term/Definition</b>
ENVFOR	The Scottish Government's Environment and Forestry Department
ESQCR	Electricity Safety, Quality and Continuity Regulations
FCS	Forestry Commission Scotland
FISA	Forest Industry Safety Accord
FLS	Forestry and Land Scotland
FoS	Factors of Safety
FWM	Forestry Works Manager
GIS	Gas Insulated Switchgear
GIS mapping	Geographical Information System
GLVIA	Guidelines for Landscape and Visual Impact Assessment, Third Edition, published jointly by the Landscape Institute and Institute of Environmental Management and Assessment.
GSP	Grid Supply Point
GWDTE	Groundwater Dependent Terrestrial Ecosystem
Ha	Hectare
HER	Historic Environmental Record
Heritage Asset	Those parts of the historic environment that have significance and are worthy of consideration in planning matters are referred to as heritage assets. Heritage assets include standing, buried or submerged remains, buildings, parks and gardens and areas, sites and landscapes including designated sites and those identified by the local planning authority. World Heritage Sites, Scheduled Monuments, Listed Buildings, protected wreck sites, Inventory Gardens and Designed Landscapes, Inventory Battlefields and Conservation Areas are all heritage assets
HES	Historic Environment Scotland
HGV	Heavy Goods Vehicle
Hz	Hertz. Standard unit of measurement used for measuring frequency. Sound frequency refers to how quickly the air vibrates, or how close the sound waves are to each other (in cycles per second, or Hertz (Hz)).
IBA	Important Bird Area
IEMA	Institute of Environmental Management and Assessment
km	Kilometre
kV	Kilovolt
Landscape	Human perception of the land conditioned by knowledge and identity with a place
Landscape Character Type	A landscape type will have broadly similar patterns of geology, landform, soils, vegetation land use, settlement and field pattern discernible in maps and field survey records
Landscape Sensitivity (to a specific type of change)	The extent to which a landscape can accept change of a particular type and scale.
LCA	Landscape Character Assessment
LCT	Landscape Character Type
LGV	Light Goods Vehicles

<b>Term/Abbreviation</b>	<b>Expanded Term/Definition</b>
LTFP	Long-Term Forest Plan
m	Metre
Magnitude (of change)	A term that combines judgements about the size and scale of the effect, the extent of the area over which occurs, whether it is reversible or irreversible and whether it is short or long term in duration.
Methodology	The specific approach and techniques used for a given study.
Mitigation Measures	Measures including any process, activity or design process to avoid, reduce, remedy or compensate for adverse impacts of a development.
Mph	Miles per hour
MW	Megawatt
NETS SQSS	National Electricity Transmission System Security and Quality of Supply Standard
NGR	National Grid Reference
NHZ	Natural Heritage Zone
NS	Nature Scot
NS	NatureScot
OC	Operational Corridor
OHL	Overhead Line
PMP	Peat Management Plan
RAMSAR Site	Wetlands of International Importance designated under the Ramsar Convention.
Residual Effects	Effect of development after mitigation/embedded mitigation or design proposals are taken into account
RLB Site	Redline boundary site; the redline boundary site for the purpose of this planning application, comprising the Substation Site and additional land take to accommodate ancillary works
SAC	Special Area of Conservation
SEPA	Scottish Environment Protection Agency
Setting	Setting is more than the immediate surroundings of a site or building, and may be related to the function or use of a place, or how it was intended to fit into the landscape of townscape, the view from it or how it is seen from areas round about, or areas that are important to the protection of the place, site or building (SPP 2014).
Significance	A measure of importance or gravity of the environmental effect defined by significance criteria specific to the environmental topic
Skylining	The proposed development (or aspects of it) would be seen on the skyline. The contrast between the proposed development and the sky would generally render the proposed development more visible/prominent in views than if it were backclothed by topography.
SM	Scheduled Monument
SNH	Scottish Natural Heritage
SPA	Special Protection Area
SSEN Transmission	Scottish and Southern Electricity Networks Transmission plc

<b>Term/Abbreviation</b>	<b>Expanded Term/Definition</b>
SSSI	Site of Special Scientific Interest
Substation Platform	The level platform to be delivered within the Substation Site
Substation Site	The An Suidhe Substation Site
SUDS	Sustainable Urban Drainage System
Town and Country Planning EIA Regulations	Town and Country Planning (Environmental Impact Assessment) (Scotland) Regulations 2017
Visual Amenity	A particular composition of landscape elements that contribute to a view, or views.
Visualisation	A computer simulation, photomontage or other techniques illustrating the predicted appearance of a development from a known location
VP	View Point
Wireline	A computer-generated line drawing of the DTM (digital terrain model) and the proposed development from a known location.
WLA	Wild Land Area
WoSAS	West of Scotland Archaeology Service
ZTV	Zone of Theoretical Visibility. A map, usually digitally produced, showing areas of land within which a development is theoretically visible. Also known as a Viewshed.



## 1. INTRODUCTION AND SCOPE

### 1.1 Background to the Project

This Environmental Appraisal Report ("EA Report") has been prepared by Environmental Resources Management (ERM) on behalf of Scottish Hydro Electric Transmission plc ("the Applicant") who, operating and known as Scottish and Southern Electricity Networks Transmission ("SSEN Transmission"), own, operate and develop the high voltage electricity transmission system in the north of Scotland and remote islands. In this EA Report, the Applicant and SSEN Transmission are used interchangeably unless the context requires otherwise.

The Applicant has a statutory duty under Schedule 9 of the Electricity Act 1989 to develop and maintain an efficient co-ordinated and economical electrical transmission system in its licence area.

The Applicant proposes to construct a new 275 kV electricity substation, with associated overhead line works in the vicinity of the existing An Suidhe substation (located at Grid Ref 204861 705524). The new substation will connect into the recently completed overhead line between Inveraray and Crossaig which is capable of operation at 275kV but at present is routed into the existing substation, so the overhead line requires to be realigned to connect into the new substation. The substation and overhead line will support the export of renewable energy generated within the Argyll area.

### 1.2 Consent Requirements

The Applicant is seeking consent from Argyll and Bute Council under the Town and Country Planning (Scotland) Act 1997 (as amended) for construction and operation of the substation (hereby referred to as 'the Proposed Development').

The size of the grid transformers falls under the National Planning Framework 3 Annex 3 description of High Voltage Electricity Transmission Network and is therefore categorised as 'National Development' under the Town and Country Planning (Hierarchy of Development) (Scotland) Regulations 2009 (The Hierarchy Regulations).

The works to the overhead line (hereby referred to as 'the Associated Development') which comprise the construction of six steel lattice towers to support overhead line conductors will be the subject of an application to the Scottish Ministers under section 37 application of the Electricity Act 1989.

### 1.3 The Project

Although the Proposed Development and the Associated Development are being submitted under separate consenting regimes, both developments are integral to the development at An Suidhe and will therefore hereby be collectively referred to as 'the Project'.

The location and main components of the Project is shown on **Figure 1.1**.

The Proposed Development, which is the subject of an application under the Town and Country Planning Act comprises:

- A substation platform of 1.3 ha;
- A transformer building, control building and Gas Insulated Switchgear (GIS)<sup>1</sup> building;
- A temporary works area (TWA) adjacent to the Proposed Development site, of 0.69 ha;
- Access to the substation platform over an existing forestry access track, approximately 1.7 km in length, to the new access track being constructed for the new substation referred to below;
- Construction of a new access track from the existing forestry track to the substation, approximately 280 m long; and

---

<sup>1</sup> Within a GIS, live electrical equipment uses special gas as the insulating medium, usually sulphur hexafluoride (SF<sub>6</sub>) gas. The live electrical equipment is enclosed in a building, rather than exposed. The use of gas reduced the clearance distances required between electrical equipment, resulting in a small footprint, when compared to using an Air Insulated Switchgear (AIS) solution.

- Landscape planting to screen the Proposed Development and provide biodiversity enhancement.



In addition, tree felling and compensatory planting will be required, as described in Chapter 5 Forestry Appraisal and Appendix I.

Components of the Associated Development which is the subject of an application under section 37 of the Electricity Act 1989 are:


- Construction of six new steel lattice towers to support the realigned overhead line which will connect into the new substation;
- Construction of new permanent access tracks leading to three towers, 295 m long
- Approximately 465 m of temporary access tracks leading to the 3 southern-most towers;
- Temporary overhead line (OHL) diversions required during construction;
- Dismantling of seven redundant towers.

In addition, the proposed 33 kV interconnector cable as seen in **Figure 1.1** would be undergrounded to make way for the Associated Development and can be carried out under Permitted Development rights.

Further details on the Project Description can be found in **Chapter 2: Project Description**.

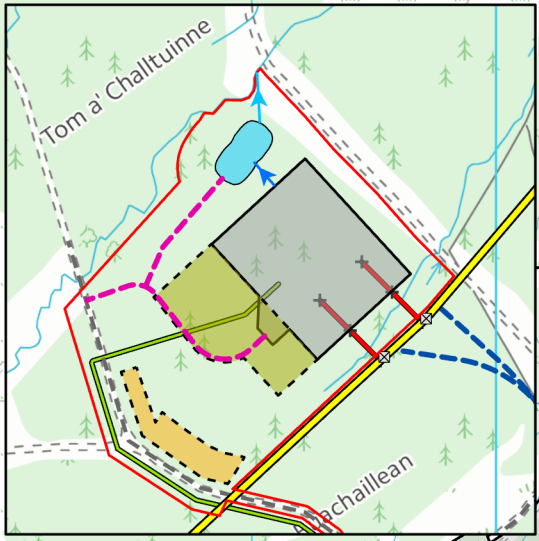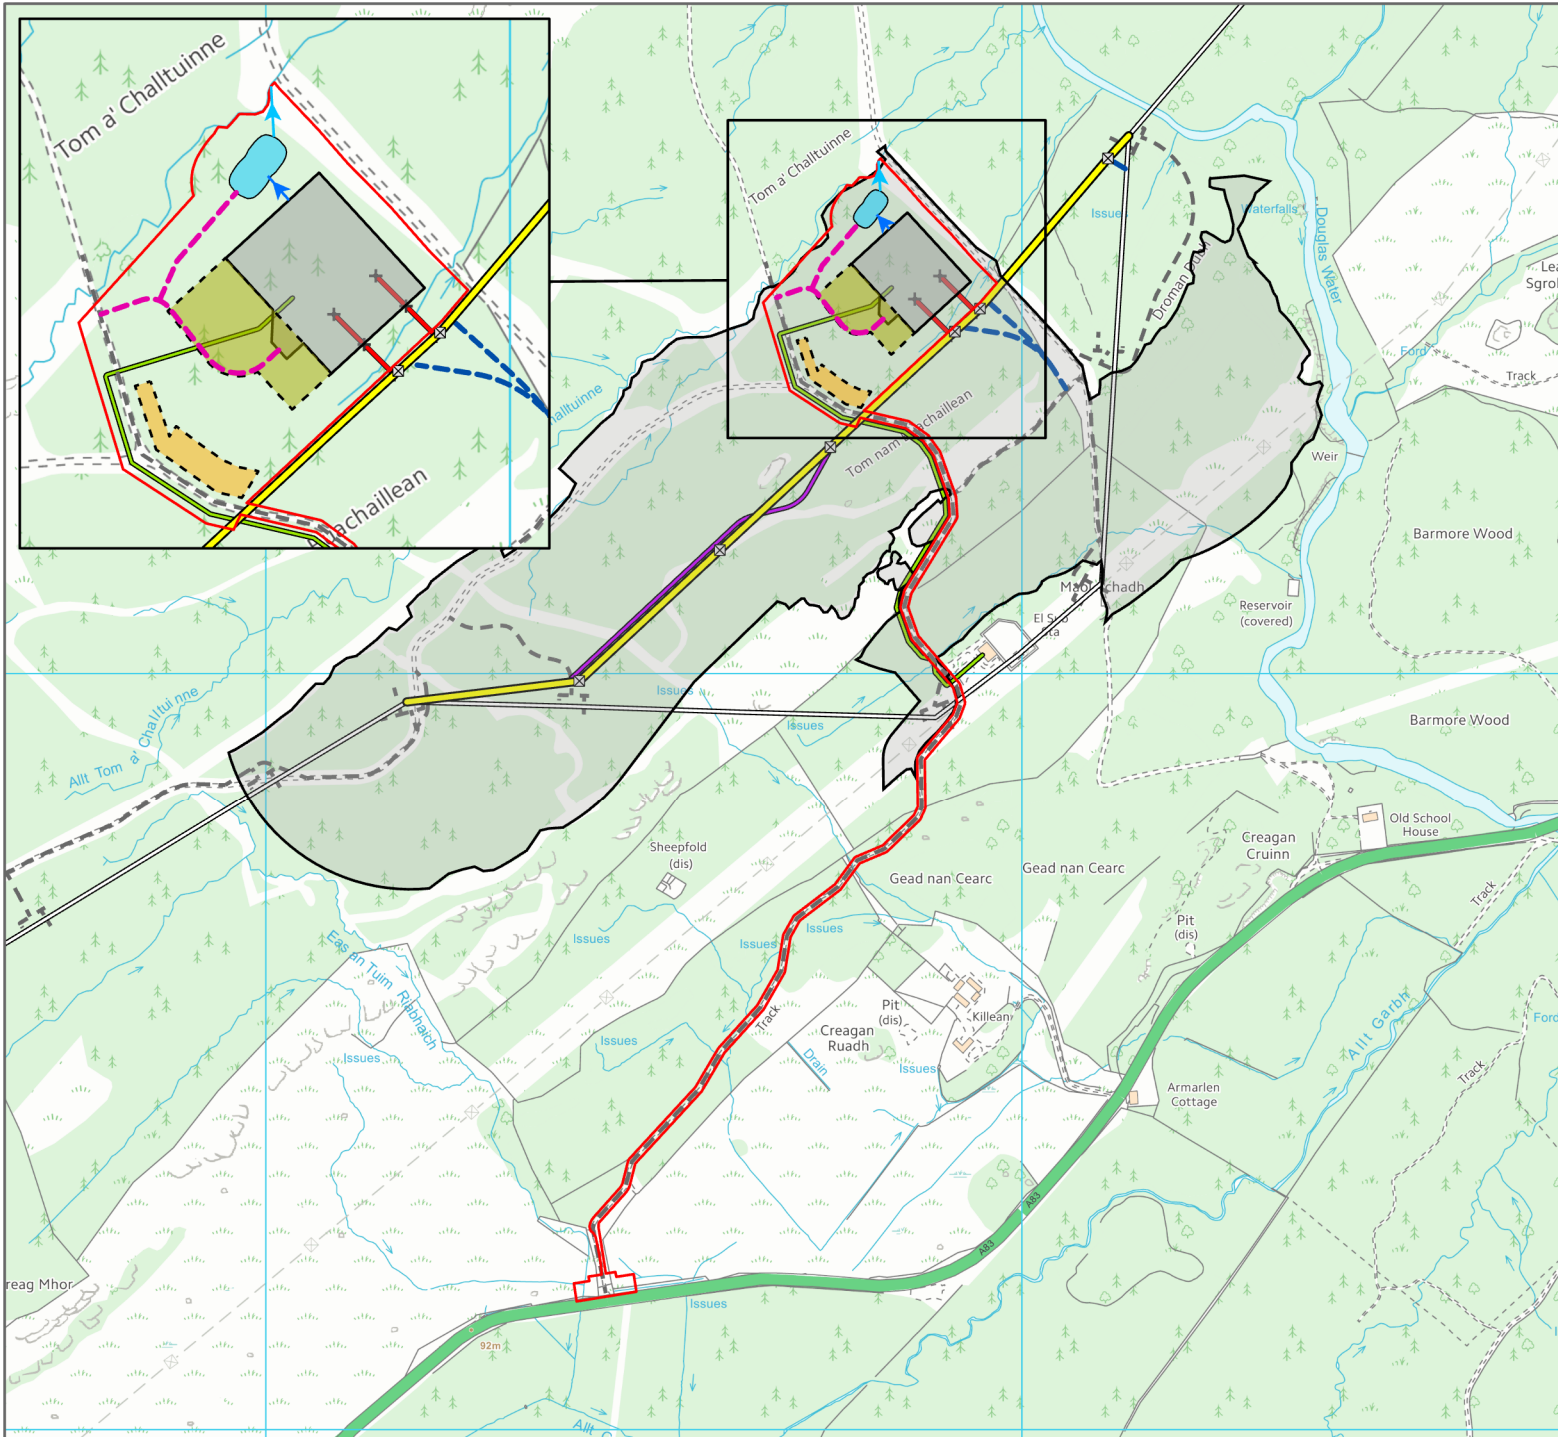

- Existing Inveraray to Crossaig Overhead Line
- - - Existing Access Track
- Proposed Development:**
- Proposed Permanent Access Track
- SUDs Inlet Pipeline
- SUDs Outfall Pipeline
- Town & Country Planning Boundary
- Proposed Substation Layout
- SUDs Pond
- Proposed Substation Temporary Works Area
- Temporary Peat Storage Area
- Potential Area for Peat Restoration
- Permitted Development:**
- 33kV Interconnector Cable Route
- Associated Development:**
- ⊗ Proposed Tower Location
- Proposed OHL Alignment
- OHL Downloads
- Proposed Permanent Access Track
- Temporary Access Track



SCALE: See Scale Bar  
 SIZE: A4  
 PROJECT: 0607366  
 DATE: 05/12/2022

VERSION: A02  
 DRAWN: DN  
 CHECKED: WB  
 APPROVED: SW

**Figure 1.1**  
**An Suidhe Substation Red Line Boundary**



PROJECTION: British National Grid

## 1.4 Environmental Appraisal

The Applicant recognises that the Project has the potential for effects on the environment. As such, a number of environmental studies have been carried out, the results of which are detailed in this Environmental Appraisal (EA).

This document considers the potential for environmental effects associated with the Proposed Development and the Associated Development (together referred to as the Project) to accompany their respective planning applications. Separate planning statements have been prepared that consider the Proposed Development and the Associated Development in the context of current planning policy.

### 1.4.1 Screening Request

A request for an EIA Screening Opinion for the Proposed Development was submitted to Argyll and Bute Council (ABC) in August 2021. ABC provided a Screening Opinion (see **Annex B**) for the Proposed Development on 22<sup>nd</sup> March 2022. ABC confirmed that an EIA is not required for the Proposed Development but stated that due to the scale and nature of the development, and the quality and sensitivity of its landscape setting, an EA should be submitted with any planning application. The EA should address the following topics:

- Landscape and Visual;
- Bare land Zone of Theoretical Visibility (ZTV);
- Land Use designations material to the proposal;
- Ecology and Nature Conservation surveys;
- Ornithology surveys;
- Cultural Heritage;
- Forestry;
- Proposed landscaping and screening to substation compound;
- Design of SuDS proposals to promote biodiversity;
- Traffic and Transport;
- Hydrology, Hydrogeology and Soils;
- Amenity and Health (Noise and Vibration and Electromagnetic Fields);
- Recreation and Tourism (footpaths and access for recreation users of the woodland);
- Construction methodology and waste plan to include noise assessment in respect of construction methodology should any protected species or sensitive receptors be identified within the locality of the proposal that could be adversely impacted by construction noise.

A request for an EIA Screening Opinion for the Associated Development was submitted to the Scottish Ministers via the Energy Consent Unit (ECU) in February 2022. However, immediately following this, further information was requested by the ECU regarding other Screening Requests for similar projects in the area. In line with their requests, additional information regarding the Project's characteristics was provided including indicative locations of the proposed substation and temporary works area, access tracks and indicative section of proposed temporary diversion OHL. Figures detailing proposed works in relation to ecological designations were also provided as part of the additional information, along with details of cumulative developments to be assessed within the EA.

The Scottish Ministers, via the ECU confirmed on 10<sup>th</sup> May 2022 that the Associated Development is unlikely to result in effects on the environment which are significant enough to require the submission of an EIA Report.

## 1.5 Environmental Appraisal Methodology

This EA considers the potential for environmental effects associated with the construction and operation of the Project and follows the recommendations of the local planning authority and statutory authorities regarding surveys and mitigation.

Whilst not a formal Environmental Impact Assessment (EIA), this appraisal has followed a similar approach of identifying the sensitivity of the receiving environment, assessing the magnitude of change or effect that the Project may have and the subsequent significance of this effect or change on the receiving environment. An illustration of the appraisal matrix is shown in **Table 1.1**.

Sensitivity may be physical, biological, cultural or human and refers to the capacity to accommodate change. Where the resource is physical (for example, a water body) its quality, sensitivity to change and importance (on a local, national and international scale) are considered. Where the resource/receptor is biological or cultural (for example, a bird population), its importance (for example, its local, regional, national or international importance) and its sensitivity to the specific type of impact are considered. Where the receptor is human, the vulnerability of the individual, community or wider societal group is considered.

Magnitude describes the degree of change that the impact is likely to impart upon the resource/receptor and is a function of the following impact characteristics:

- Extent;
- Duration;
- Scale;
- Frequency; and
- Likelihood (for unplanned events only).

**Table 1.1 Environmental Appraisal Matrix<sup>2</sup>**

		Sensitivity of Receptor/Receiving Environment to Change/Effect			
		High	Medium	Low	Negligible
Magnitude of Change/Effect	High	Major	Major	Moderate	Negligible
	Medium	Major	Moderate	Minor	Negligible
	Low	Moderate	Minor	Minor	Negligible
	Negligible	Negligible	Negligible	Negligible	Negligible

## 1.6 Mitigation

The findings of the technical environmental studies have been used to inform the design of the project, and hence achieve a 'best fit' with the environment. This approach has been adopted in respect of the Project; where potentially significant effects have been identified, their avoidance or minimisation has been prioritised at the design stage. This is referred to within this EA Report as 'embedded mitigation', i.e., mitigation that is embedded within the project design, and includes best practice as well as design features.

In line with the mitigation hierarchy identified in the updated PAN 1/2013 (V1.0, 2017)<sup>3</sup>, the strategy of avoidance, reduction, and remediation is a hierarchical one, which seeks to:

<sup>2</sup> This is the standard SSEN Transmission approach as applied on all Developments

<sup>3</sup> Planning Advice Note 1/2013: Environmental Impact Assessment, V1, Scottish Government, 2013

<https://www.gov.scot/publications/planning-advice-note-1-2013-environmental-impact-assessment/documents/>

- First to avoid potential effects;
- Then to reduce those which remain; and
- Lastly, where no other measures are possible, to propose compensatory measures.

Appropriate mitigation measures are discussed within each technical chapter as relevant.

## 1.7 Cumulative Developments

Each technical assessment considers the nature of effects and includes cumulative effects with other developments where appropriate. These are effects that result from incremental changes caused by past, present or reasonably foreseeable developments together with the Development being assessed. For the cumulative assessment, the combined effects of several developments in isolation may be insignificant but cumulatively when considered with other developments have a significant effect.

The extent of any cumulative assessment is defined in each technical assessment chapter and is undertaken for all technical assessments. Where no cumulative effects are likely, this is stated.

## 1.8 Consultation

### 1.8.1 Public Consultation

SSEN Transmission has carried out pre-application consultations to inform and engage with local communities and members of the public with an interest in the Project.

As a result of the Covid 19 pandemic and in line with Scottish Government guidance on pre-application consultations for major planning applications, during the Covid 19 emergency period, face to face events had to be cancelled. To ensure effective engagement on the Project, the Applicant developed an online consultation tool to enable the local community and stakeholders to experience the full exhibition at home on a PC, tablet or mobile device. It was designed to look and feel like a face-to-face consultation in a community hall, with exhibition boards, maps, interactive videos and the opportunity to share views on the proposals. A virtual consultation event was launched on 14<sup>th</sup> July 2021 and closed on 29<sup>th</sup> July 2021. In addition live chat sessions were held on 14<sup>th</sup>, 15<sup>th</sup>, and 29<sup>th</sup> of July 2021.

To comply with the formal pre-application process for major developments<sup>4</sup> SSEN Transmission carried out virtual Pre-Application Virtual Public Exhibitions to allow members of the public to obtain information and pass comment on the Proposed Development. These virtual events were held on 8<sup>th</sup> and 9<sup>th</sup> December 2021 to consult on the Project. In addition, SSEN Transmission hosted an invitation only webinar for the local community councils, councillors, MSP and MP held on 14<sup>th</sup> December 2021. This webinar allowed locally elected representatives to voice any further questions following SSEN Transmission's virtual exhibition. Details of these exhibitions, and other pre-application consultations, are included in a Pre-Application Consultation (PAC) Report which accompanies the planning application and are also available on the project website <https://www.ssen-transmission.co.uk/projects/argyll-and-kintyre-275kv-substations>.

### 1.8.2 Stakeholder Consultation

Consultation was sought from a range of stakeholders including:

- Argyll and Bute Council (ABC);
- Historic Environment Scotland (HES);
- NatureScot;
- Scottish Environmental Protection Agency (SEPA);

---

<sup>4</sup> Argyle and Bute Council. URL: [https://www.argyll-bute.gov.uk/sites/default/files/planning-and-environment/2\\_pac\\_general\\_guidance\\_note\\_2013.pdf](https://www.argyll-bute.gov.uk/sites/default/files/planning-and-environment/2_pac_general_guidance_note_2013.pdf)

- Scottish Forestry;
- Scottish Government (Energy Consents Unit);
- Scottish Water;
- Transport Scotland;
- Argyll District Salmon Fishery Board (ADSFB);
- Royal Society for the Protection of Birds (RSPB);
- Argyll Fisheries Trust; and
- ScotWays.

In October 2021, ABC were consulted on viewpoints and photomontage locations. ABC raised no objection to the viewpoints proposed and these have informed the assessment within **Chapter 3: Landscape and Visual Appraisal**.

Historic Environment Scotland (HES) advised that the Proposed Development may have the potential to result in indirect impacts resulting from changes to setting on assets within their remit, including the Inveraray Castle Garden and Designated Landscape. HES recommends that proposed impacts that are considered in the EA are informed through the use of Zone of Theoretical Visibility (ZTV) models and visualisations where appropriate. Photomontages are found in **Annex E** of this EA.

In September 2021, NatureScot were consulted on Ornithology and deemed the use of survey information dating from 2015/16 to be acceptable on the condition that the baseline habitat conditions have not changed since these initial surveys. They also advised that the Project is within golden eagle range LAE1B. This can be found in **Chapter 4: Ecology and Ornithology Appraisal** of this EA.

SEPA acknowledged that the Project appears to avoid areas of peat. Detailed peat probing was undertaken in November 2021 and February 2022, to ensure the Project was further designed to avoid deep areas of peat. A Peat Management Plan (PMP) is provided as **Annex N** of this EA.

Scottish Forestry advised the Project will impact commercial woodland to some extent with a main concern being the potential for removal or damage to semi-natural broadleaved woodland within the preferred site. In this case the woodland forms an important part of the riparian native woodland network. Comments have been considered in **Chapter 5: Forestry Appraisal**.

The RSPB noted that the Project contains an area of semi-natural woodland and which is of much higher biodiversity value than commercial forestry and should be protected from development. They recommended that for any area of woodland that is removed, native broadleaves such as oak, hazel and rowan are planted to compensate for this loss. Argyll District Salmon Fishery Board (ADSFB) responded they would not be providing a comment on the consultation.

Scottish Water advises that the Project falls into Drinking Water Catchments and may have various impacts on Scottish Water Assets. Further consultation with Scottish Water was undertaken to ensure potential impacts on the water environment were understood and assessed. This can be found in the **Chapter 6: Hydrology, Hydrogeology, and Geology Appraisal**.

A Private Water Supply Risk Assessment (PWSRA) has been undertaken for the Project and can be seen in **Annex L**. The PWSRA aims to identify all PWS within a 2 km radius of the Development and seeks to confirm the location of the source water for the supplies, through consultation with the Council's Environmental Health Officer (EHO) and residents, along with site visits. This process informs the risk assessment of the effects of the Project on the private water supply, source water and associated distribution infrastructure. A site visit to facilitate the PWSRA was undertaken on 14<sup>th</sup> and 15<sup>th</sup> February 2022.

Consultation was undertaken with the EHO at ABC to agree the survey and assessment methodology to be adopted for the noise impact assessment. This included agreement of the assessment criteria and that baseline

noise surveys were required, given the separation distance to the nearest noise sensitive receptor. The full noise impact assessment can be found in **Chapter 8: Noise Appraisal**.

Transport Scotland advised that although there will be no direct impact on the trunk road network, a threshold assessment of the potential impact of construction traffic will be required to see if there is a requirement for a detailed assessment of potential related environmental effects. An assessment of traffic and transport is provided in the **Chapter 9: Transport Appraisal** of this EA.

## 1.9 Structure of the Environmental Appraisal

The EA is structured as follows:

- Chapter 2 – Project Description
- Chapter 3 – Landscape and Visual
- Chapter 4 – Ecology and Ornithology
- Chapter 5 – Forestry
- Chapter 6 – Hydrology, Hydrogeology and Geology
- Chapter 7 – Archaeology and Cultural Heritage
- Chapter 8 – Noise
- Chapter 9 – Traffic and Transport
- Chapter 10 – Summary of Mitigation

The following supporting information is provided in the following Annexes:

- Annex A: General Environmental Management Plans
- Annex B: EIA Screening Opinion
- Annex C: Landscape Assessment Methodology
- Annex D: Landscape Character Sensitivity Table
- Annex E: Photomontages and Landscape Figures
- Annex F: Ornithology Consultation
- Annex G: Extended Ecology Phase 1 Habitat Survey
- Annex H: Species Protection Plans
- Annex I: Forestry
- Annex J: Drainage Strategy and Drainage Plans
- Annex K: Hydrology Methodology
- Annex L: Private Water Supply Risk Assessment
- Annex M: Water Construction Management Plan
- Annex N: Peat Management Plan
- Annex O: Peat Slide Risk Assessment
- Annex P: Transformer Delivery Route Report
- Annex Q: Cultural Heritage Appraisal and Site Gazetteer
- Annex R: Noise and Vibration