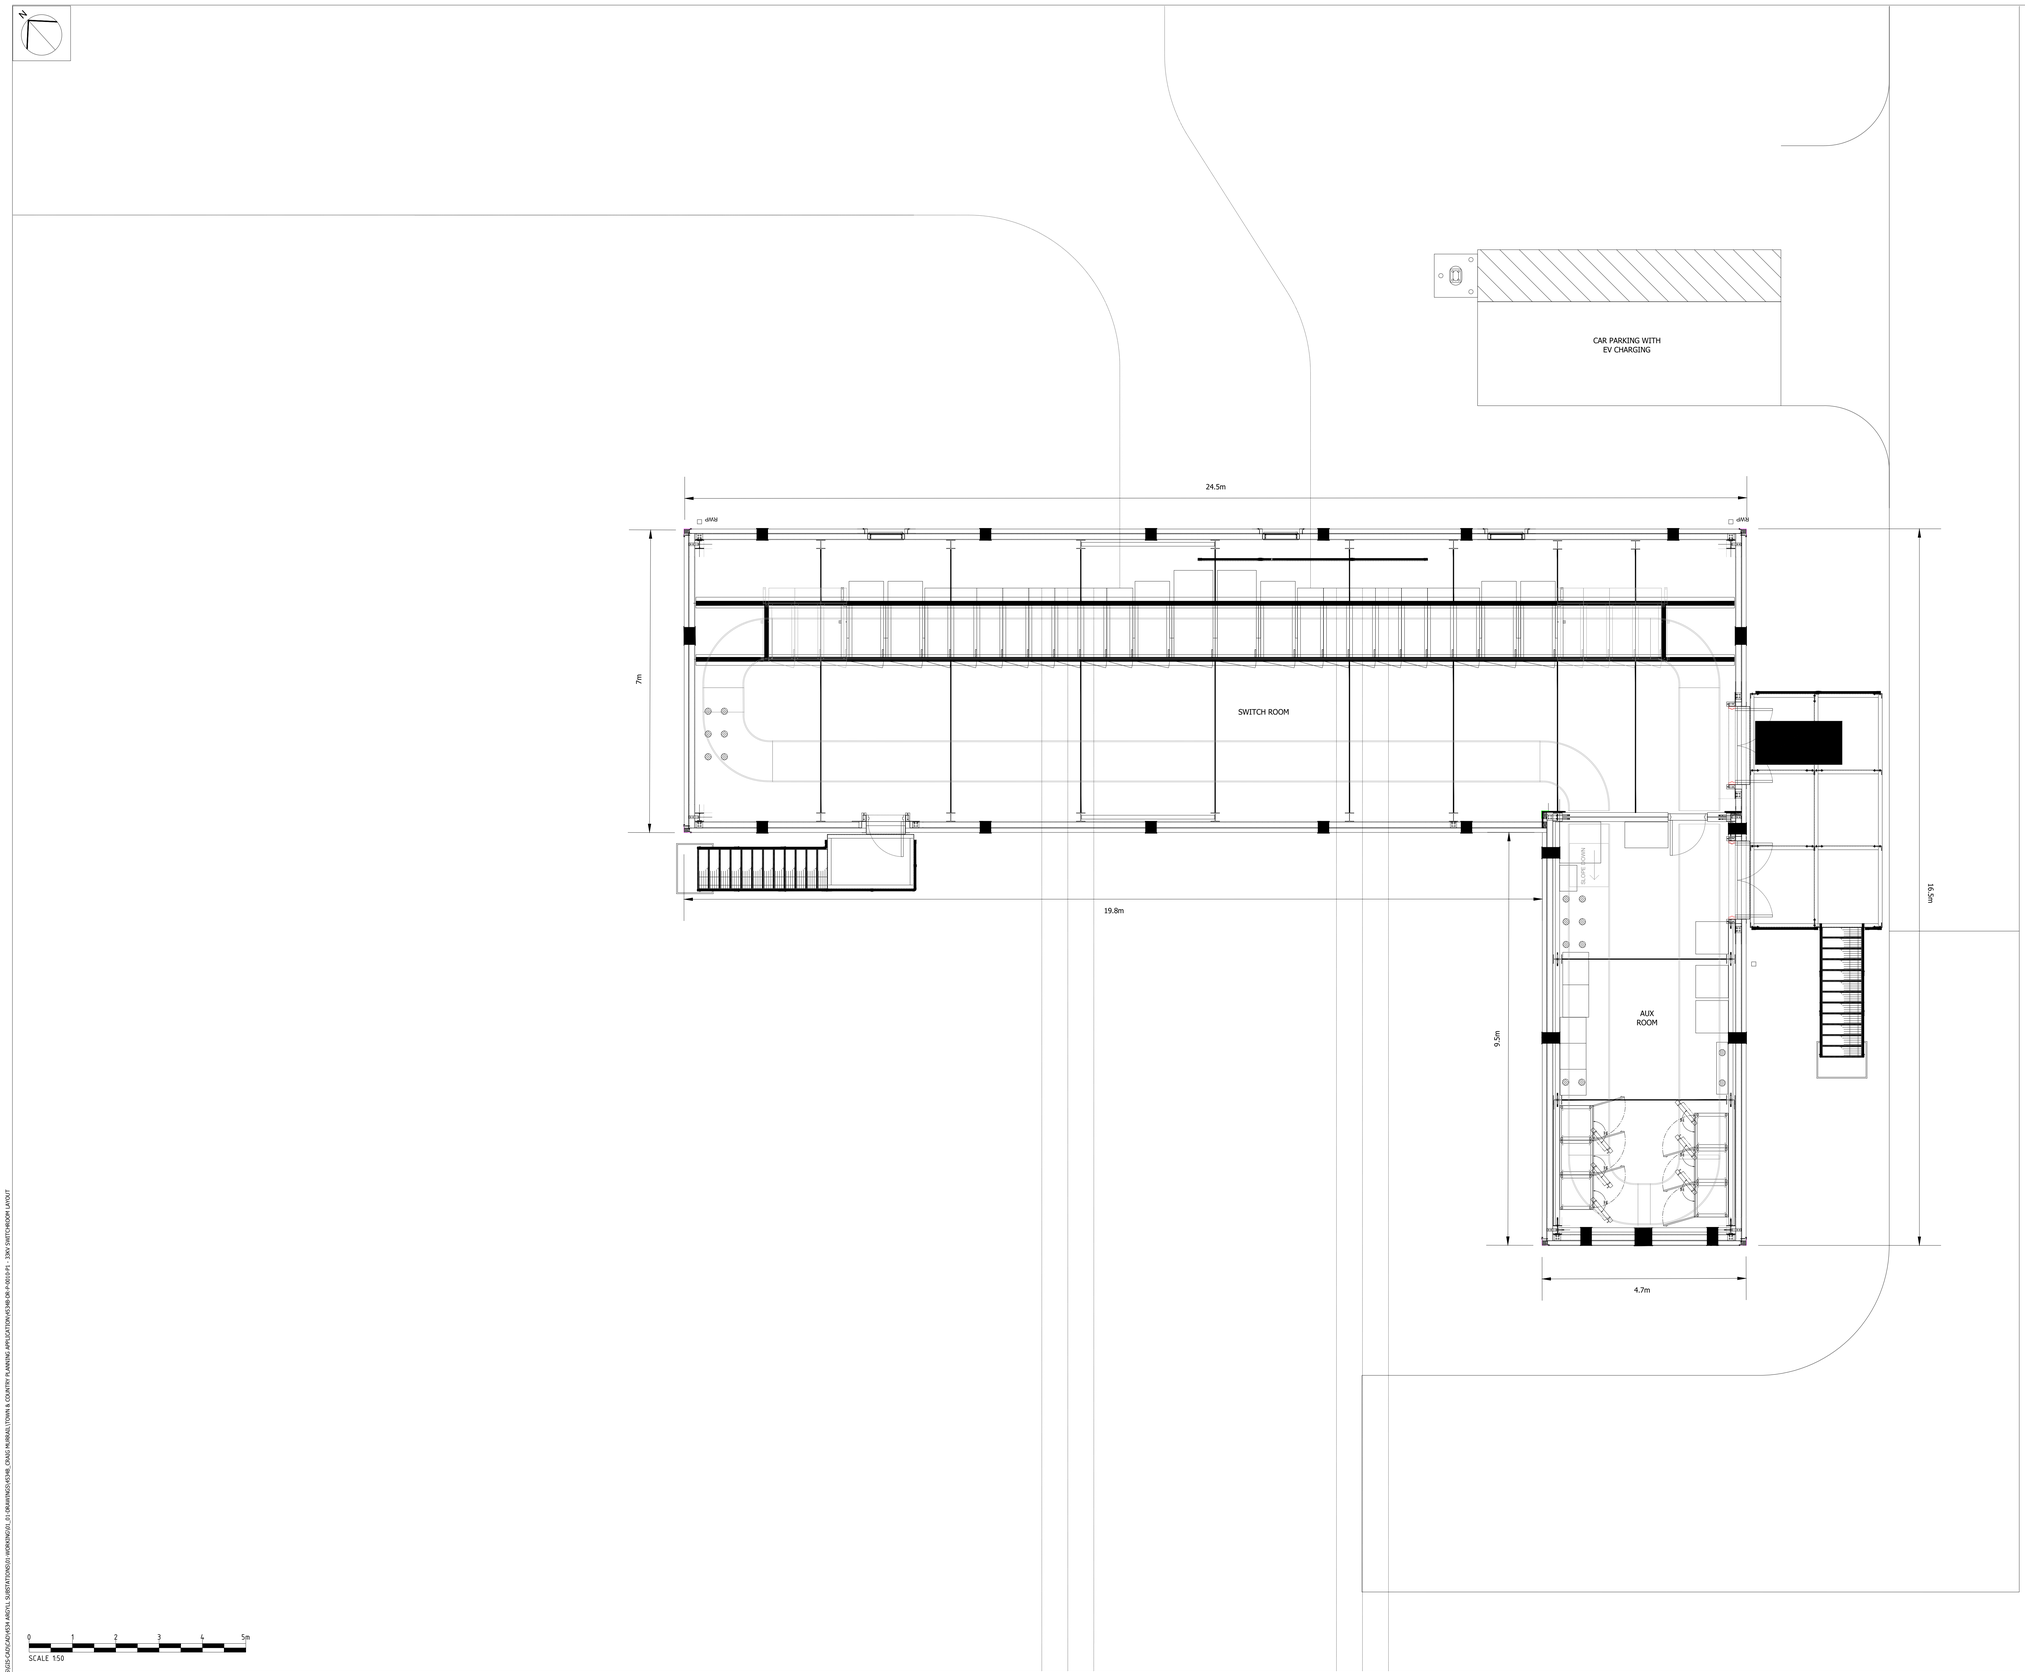


NOTES

1. THIS DRAWING IS TO BE READ IN CONJUNCTION WITH ALL OTHER RELEVANT DOCUMENTATION INCLUDING THE PROJECT HEALTH & SAFETY FILE FOR ANY IDENTIFIED POTENTIAL RISKS.
2. DO NOT SCALE FROM THIS DRAWING, USE ONLY PRINTED DIMENSIONS.

| Revision Details | By / Check | Date | Suffix |
|---|---|---|---|

Purpose of issue: PLANNING

THIS DRAWING IS TO BE USED ONLY FOR THE PURPOSE OF ISSUE THAT IT WAS ISSUED FOR AND IS SUBJECT TO AMENDMENT.

SAFETY, HEALTH AND ENVIRONMENTAL INFORMATION BOX

Client: Scottish & Southern Electricity Networks TRANSMISSION

Project Title: CRAIG MURRAIL SUBSTATION

Drawing Title: PLANNING FIGURE 004c CRAIG MURRAIL LOCAL 33kV SWITCHROOM LAYOUT

| Designed | Drawn | Checked | Approved |
|---|---|---|---|
| - | RC | DB | DB |

Arcus Internal Project No.: 4534

Date: 03/08/22

Scale @ A0: 1:50

THIS DOCUMENT HAS BEEN PREPARED IN ACCORDANCE WITH THE SCOPE OF ARCUS' APPOINTMENT WITH ITS CLIENT AND IS SUBJECT TO THE TERMS OF THAT APPOINTMENT. ARCUS ACCEPTS NO LIABILITY FOR ANY USE OF THIS DOCUMENT OTHER THAN BY ITS CLIENT AND ONLY FOR THE PURPOSES FOR WHICH IT WAS PREPARED AND PROVIDED.

Arcus Consultancy Services
7th Floor
144 West George Street
Glasgow, G2 2HG
Tel: ++44 (0)141 221 9997
Fax: ++44 (0)141 221 5619
www.arcusconsulting.co.uk

ARCUS

Drawing Number: 4534b-DR-P-0010

Rev: 1

Plot Date: 03/08/2022 12:16:31
File Name: S:\GIS\PROJECTS\FUTURE\SCEGS\CAN\CAD\4534 MIRFIELL SUBSTATION\01\WORKING\01_01\DRAWINGS\4534b_CRAIG MURRAIL TOWN & COUNTRY PLANNING APPLICATION\4534B-DR-P-0010-P1 - 33KV SWITCHROOM LAYOUT