

Legend


- Consented Rothes III Wind Farm On-Site Substation
- Blackhillock Substation
- ▲ Bellmouth Junction

Overhead Line Works

- Proposed Pole Location
- Proposed Overhead Line
- 100m Limit of Deviation (LOD) for Proposed Overhead Line (50 m either side of OHL alignment)
- Existing Access
- New Access
- Temporary Access
- Upgraded Access
- Proposed Cable Sealing End (CSE)


Underground Cable Works

- - - Proposed Underground Cable
- 100m Limit of Deviation (LOD) for Proposed Underground Cable (50m either side of UGC alignment)



Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2023 all rights reserved.
Ordnance Survey Licence number EL273236.

Project No:	LT122
Project:	Elchies (Rothes III) Wind Farm Grid Connection
Title:	Figure 3.1a - Proposed Development
Drawn by:	LV
Date:	09/03/2023
Drawing:	119012-D-EA3.1a-1.0.0

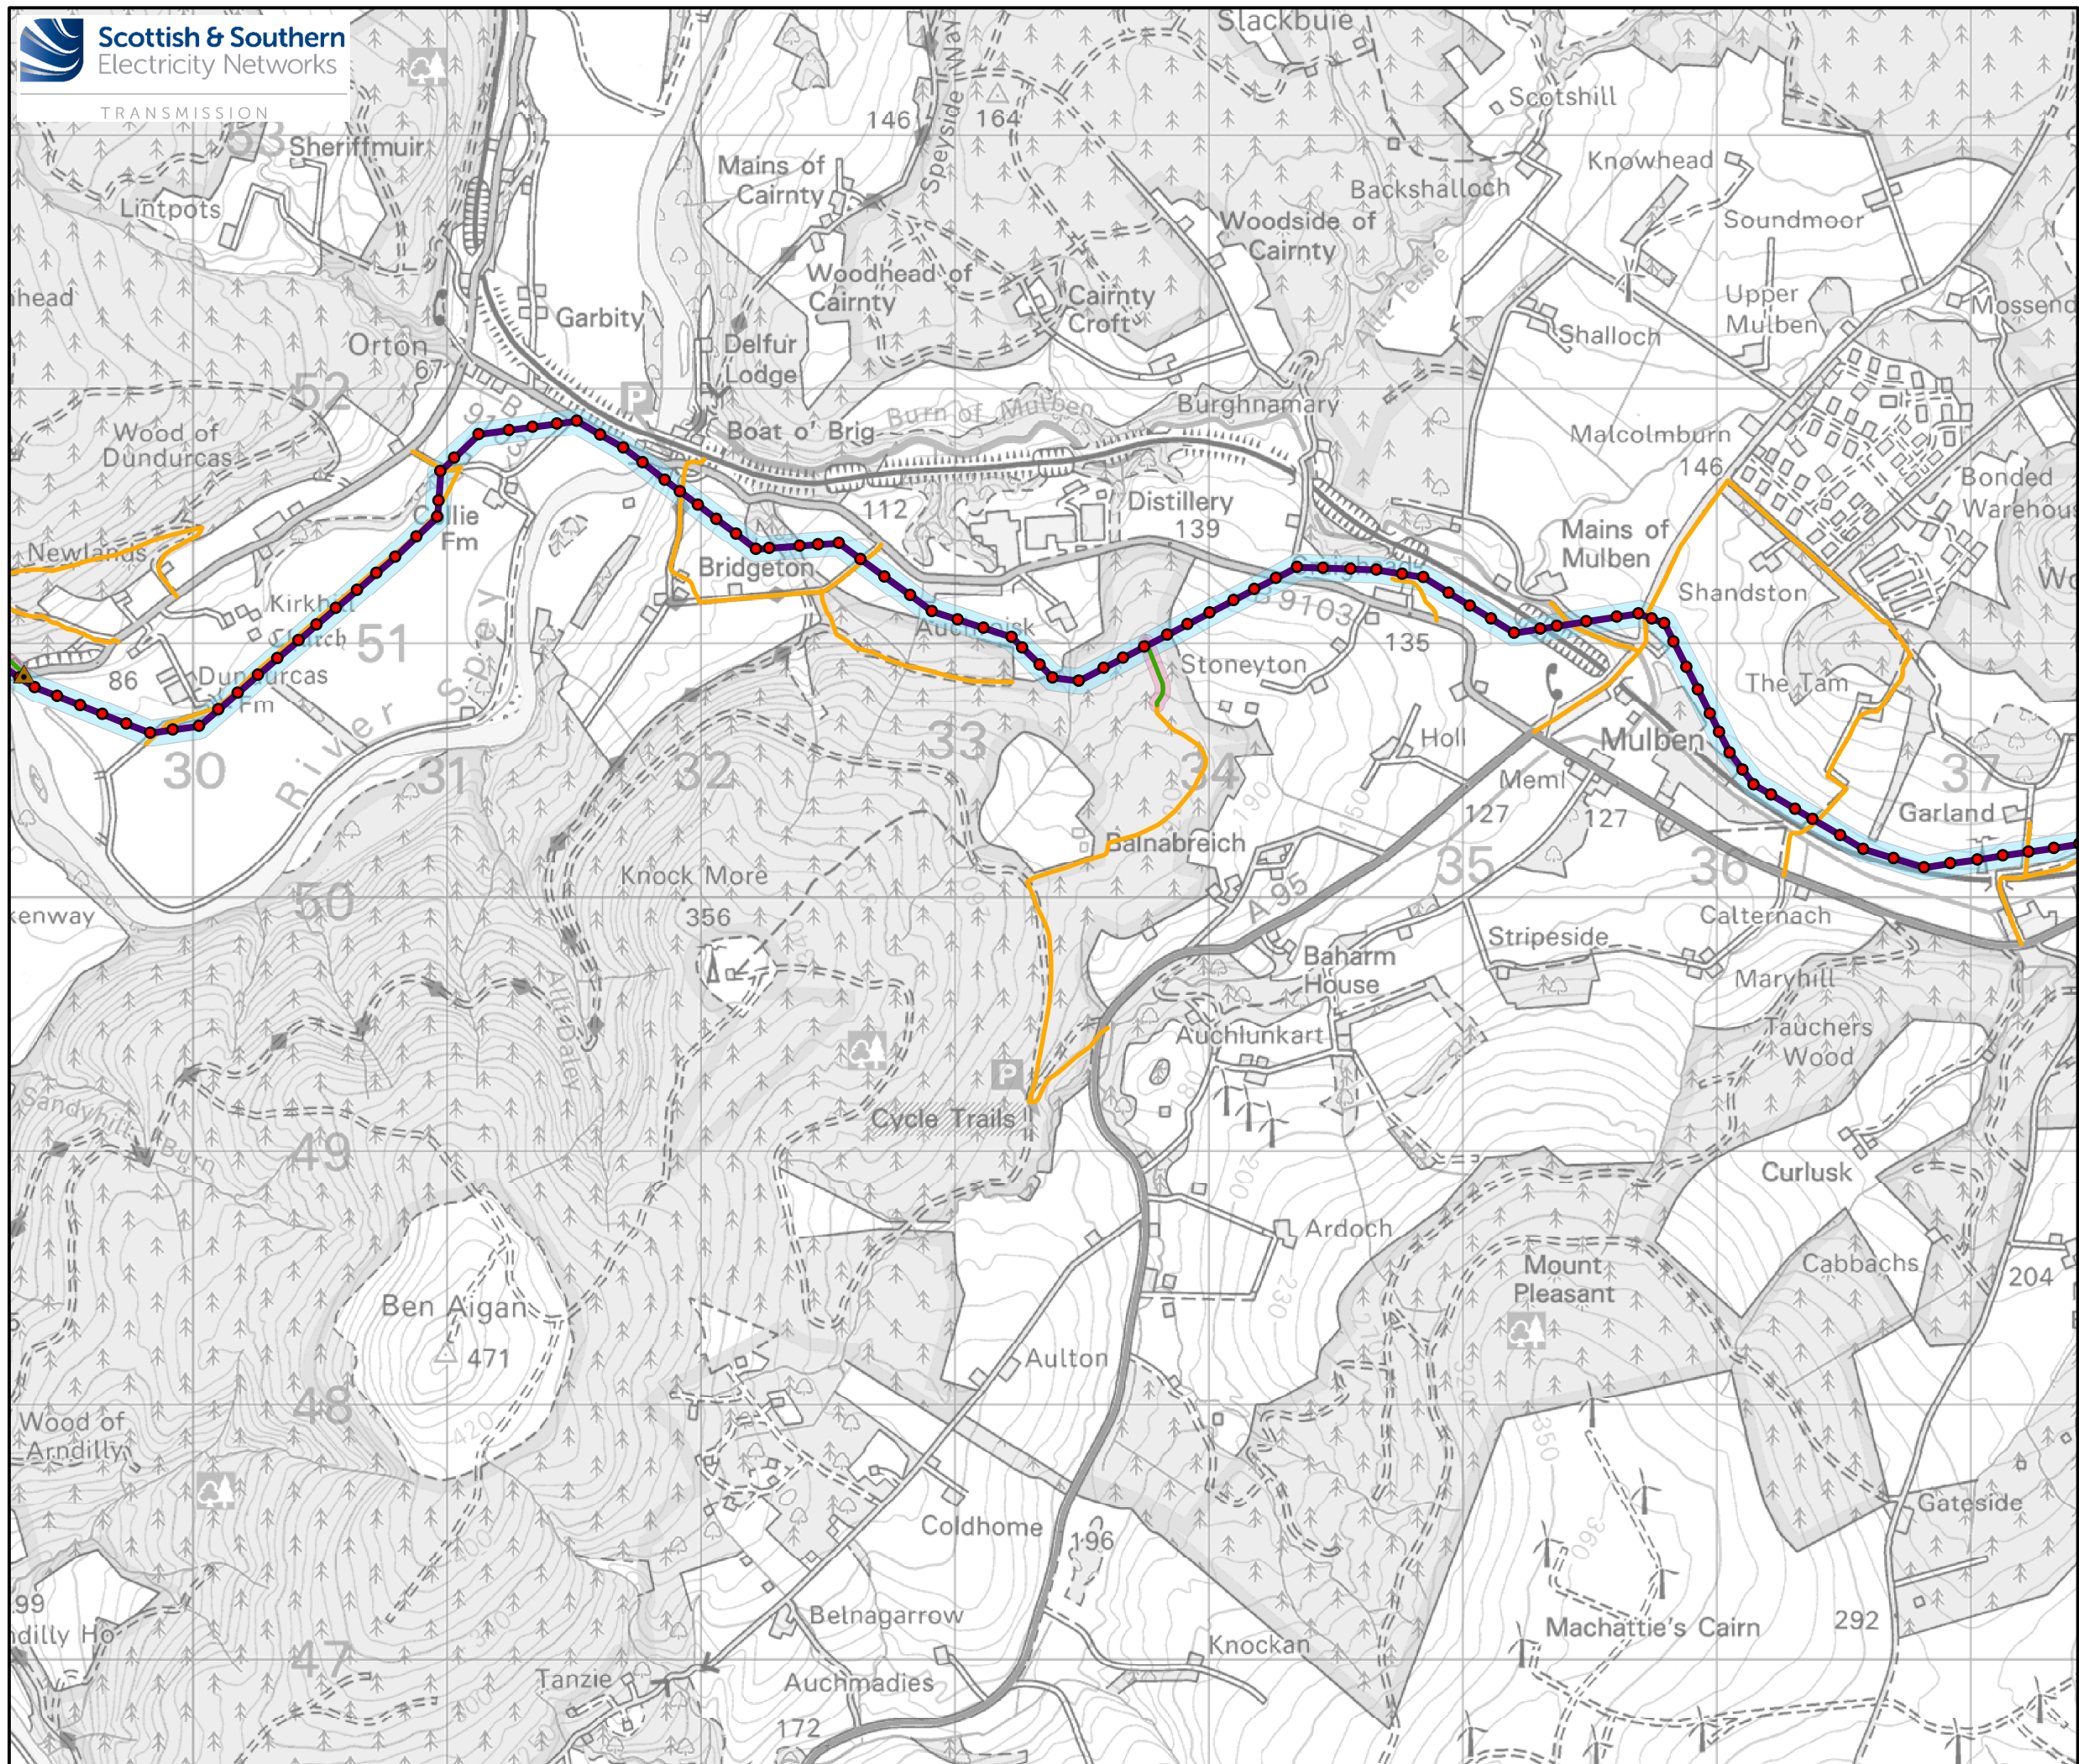

Legend

- Consented Rothes III Wind Farm On-Site Substation
- Blackhillock Substation
- ▲ Bellmouth Junction

Overhead Line Works

- Proposed Pole Location
- Proposed Overhead Line
- 100m Limit of Deviation (LOD) for Proposed Overhead Line (50 m either side of OHL alignment)
- Existing Access Track
- New Access Track
- Temporary Access Track
- Upgraded Access Track
- 30m Limit of Deviation (LOD) for New Access Tracks
- Proposed Cable Sealing End (CSE)

Underground Cable Works


- - - - Proposed Underground Cable
- 100m Limit of Deviation (LOD) for Proposed Underground Cable (50m either side of UGC alignment)

N
0 0.25 0.5 1 km
Scale - 1:25,000 @ A3

Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2023 all rights reserved.
Ordnance Survey Licence number EL273236.


Project No: LT122
Project: Elchies (Rothes III) Wind Farm Grid Connection
Title: Figure 3.1b - Proposed Development

Drawn by: LV Date: 09/03/2023
Drawing: 119012-D-EA3.1b-1.0.0

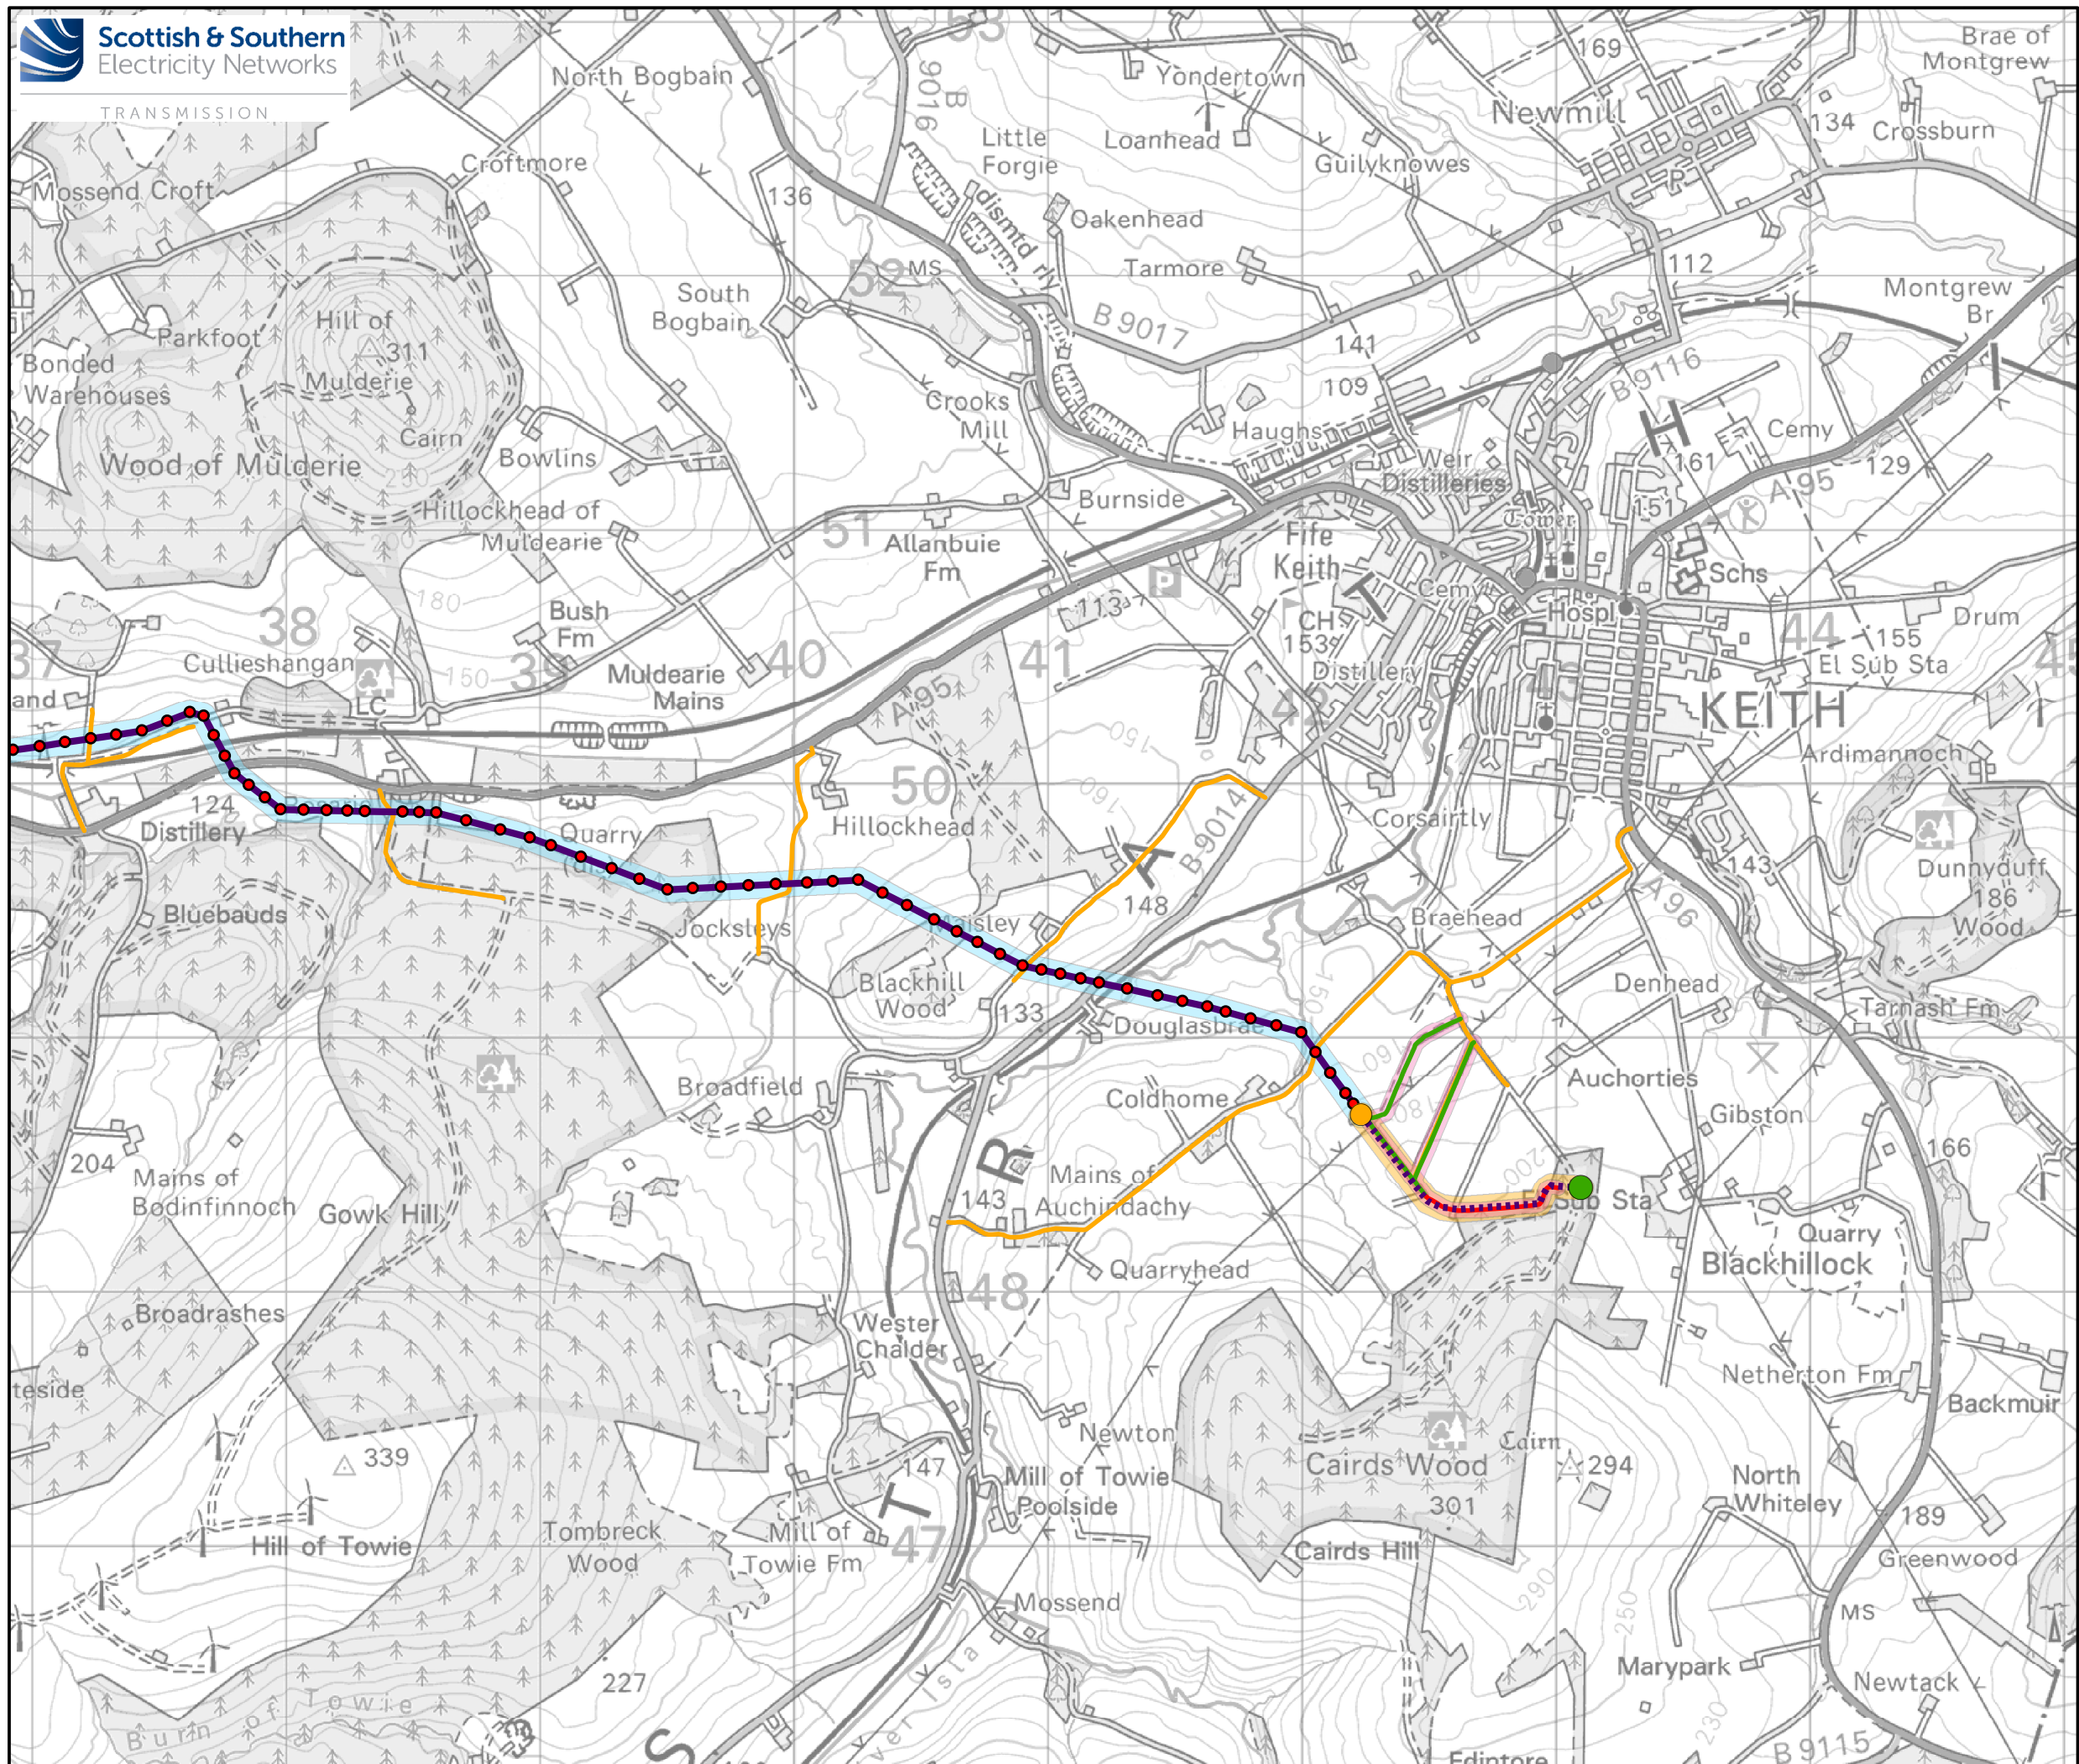

- Legend**
- Consented Rothes III Wind Farm On-Site Substation
 - Blackhillock Substation
- Overhead Line Works**
- Proposed Pole Location
 - Proposed Overhead Line
 - 100m Limit of Deviation (LOD) for Proposed Overhead Line (50 m either side of OHL alignment)
 - Existing Access Track
 - New Access Track
 - Temporary Access Track
 - Upgraded Access Track
 - 30m Limit of Deviation (LOD) for New Access Tracks
 - Proposed Cable Sealing End (CSE)

- Underground Cable Works**
- ⋯ Proposed Underground Cable
 - 100m Limit of Deviation (LOD) for Proposed Underground Cable (50m either side of UGC alignment)



Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2023 all rights reserved.
Ordnance Survey Licence number EL273236.

Project No: LT122
Project: Elchies (Rothes III) Wind Farm Grid Connection

Title: Figure 3.1c - Proposed Development

Drawn by: LV Date: 09/03/2023
Drawing: 119012-D-EA3.1c-1.0.0