




- NOTES**
- UNLESS NOTED OTHERWISE ALL DIMENSIONS ARE IN MILLIMETERS. LEVELS IN MILLIMETERS. ALL LEVELS ARE TO BE MEASURED RELATIVE TO THE TOP OF THE FOUNDATION.
 - ALL DIMENSIONS AND LEVELS TO BE CHECKED ON SITE AND THE ENGINEER NOTIFIED OF ANY DISCREPANCIES PRIOR TO THE COMMENCEMENT OF WORKS.
 - THIS DRAWING IS TO BE READ IN CONJUNCTION WITH ALL RELEVANT RPS DRAWINGS AND SPECIFICATIONS.
 - KINGSPAN QUADCORE KS1000 122 mm THICK WALL CLADDING AND KINGSPAN QUADCORE KS1000 146 mm THICK ROOF CLADDING TO BE BOTTLE GREEN RAL 6007.
 - LOUVRES FOR VENTILATION TBC / NOT INDICATED.
 - EQUIPMENT LAYOUT BASED ON DRAWING EMMO4-LT382-OMSI-EPD-CNT-GA-E-0001.
 - BATTERY ROOM WALLS SHOWN AS 140 mm BLOCKWORK. ALL OTHER WALLS SHOWN AS TIMBER STUD (100 x50 STUDS) WITH 2 x 12.5mm PLASTERBOARD EACH SIDE.
 - 600mm x 600mm COMPUTER FLOORING SHALL BE CAPABLE OF SUPPORTING EQUIPMENT PLUS 5kN/m² OR 12kN/m², WHICHEVER IS GREATER.

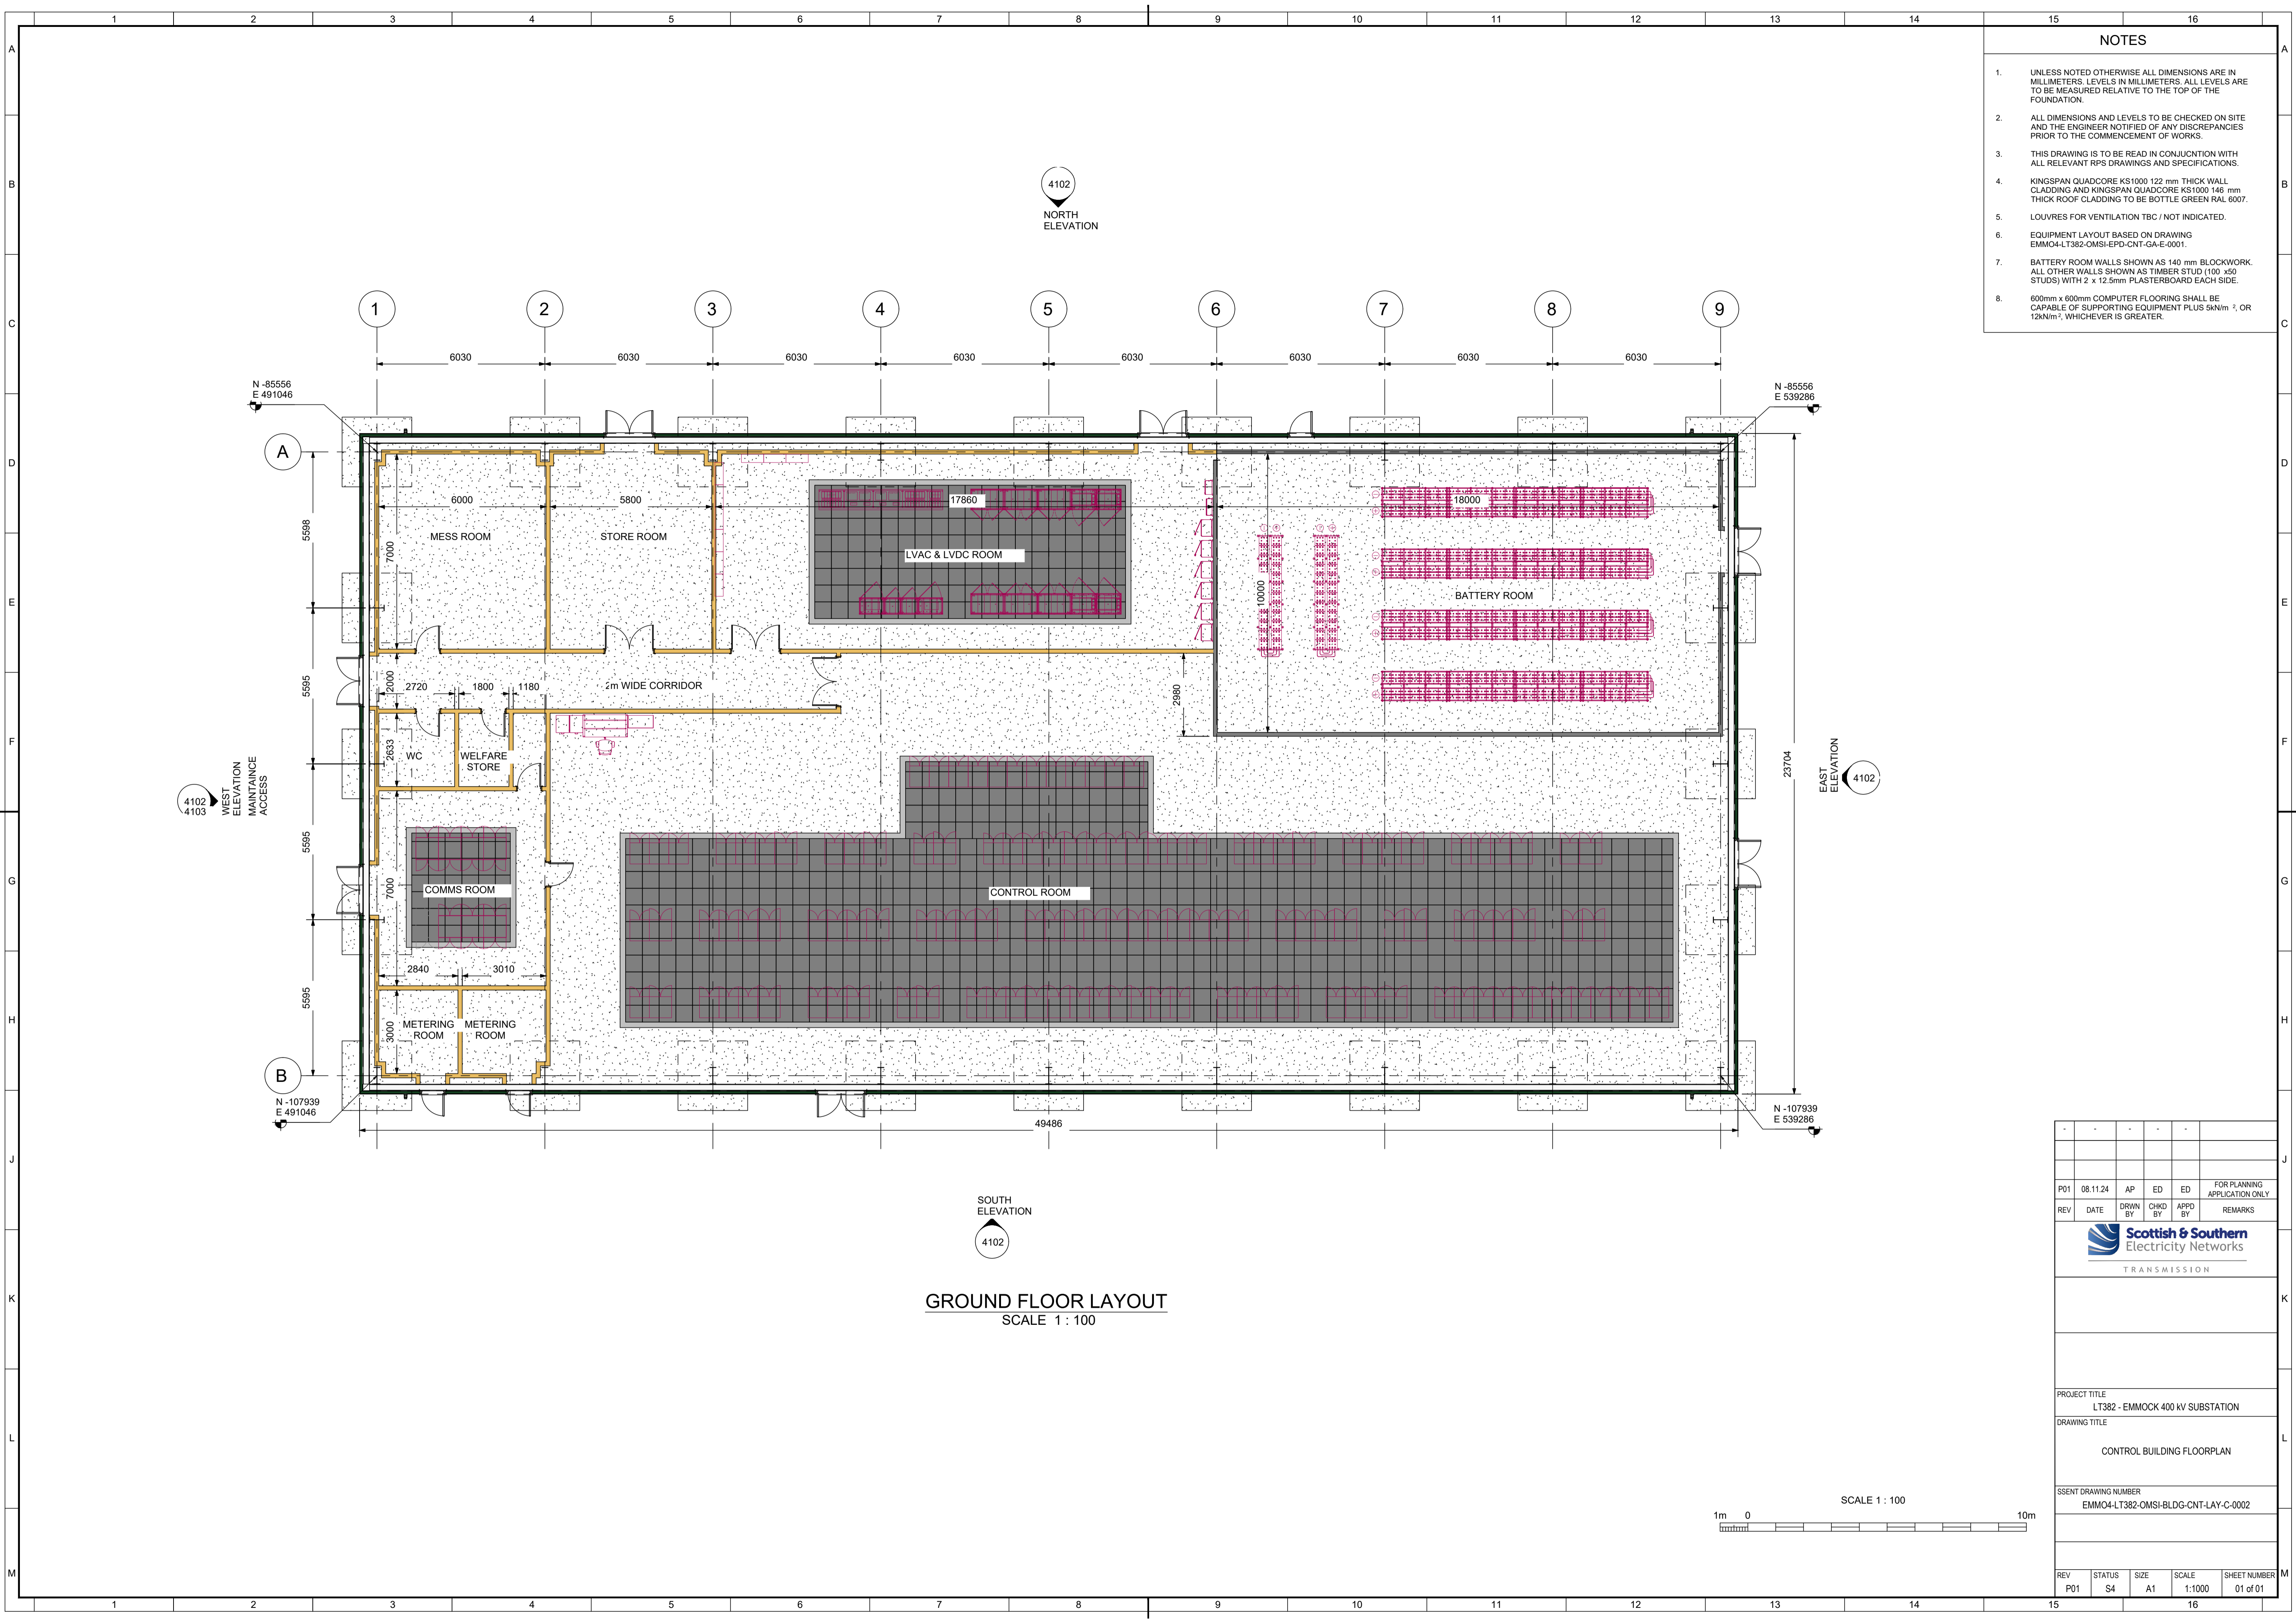

GROUND FLOOR LAYOUT
SCALE 1 : 100

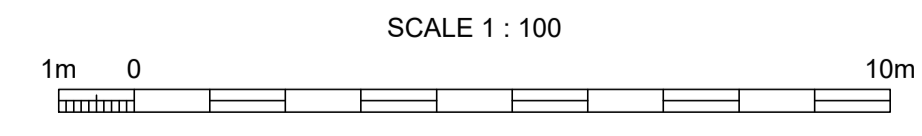

REV	DATE	DRWN BY	CHKD BY	APPD BY	REMARKS
P01	08.11.24	AP	ED	ED	FOR PLANNING APPLICATION ONLY

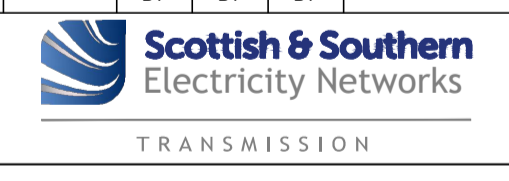

PROJECT TITLE
LT382 - EMMOCK 400 kV SUBSTATION

DRAWING TITLE
CONTROL BUILDING FLOORPLAN

ISSUE DRAWING NUMBER
EMMO4-LT382-OMSI-BLDG-CNT-LAY-C-0002

REV	STATUS	SIZE	SCALE	SHEET NUMBER
P01	S4	A1	1:1000	01 of 01