


| SUBSTATION MINIMUM ELECTRICAL CLEARANCES | | | | | |
|---|---|------------------------|-------|-------|------|
| REQUIREMENTS TO BE IN ACCORDANCE WITH SSE SUBSTATION DESIGN SPECIFICATIONS DOC NO. SP-NET-SST-501 | | | | | |
| REF | CLEARANCE (mm) | NOMINAL SYSTEM VOLTAGE | | | |
| | | 400kV | 275kV | 132kV | 33kV |
| E | PHASE TO EARTH | 2800 | 2100 | 1100 | 500 |
| Ph | PHASE TO PHASE | 3600 | 2400 | 1400 | 430 |
| S | DESIGN CLEARANCE FOR SAFETY | 5500 | 4800 | 3500 | 2900 |
| SD | SAFETY DISTANCE | 3100 | 2400 | 1400 | 800 |
| Ds | WORKING & ACCESS CLEARANCE (VERTICAL) | 5200 | 4500 | 3500 | 2900 |
| Dsh | WORKING & ACCESS CLEARANCE (HORIZONTAL) | 4600 | 3900 | 2900 | 2300 |
| IH | INSULATION HEIGHT (PEDESTRIAN ACCESS) | 2400 | 2400 | 2400 | 2400 |
| S+2 | MEWP DESIGN CLEARANCE FOR SAFETY | 7500 | 6800 | 5500 | 4900 |
| - | MEWP ACCESS CORRIDOR TO DEAD CIRCUIT | 3000 | 3000 | 3000 | 3000 |


- NOTES:**
- THIS DRAWING IS FOR PLANNING PURPOSES ONLY SUBJECT TO DETAILED DESIGN.
 - DIMENSION IS IN METRES UNLESS STATED OTHERWISE.
 - THE FOLLOWING FENCING REQUIREMENTS HAVE BEEN ASSUMED:
INTERNAL FENCE: 2.4m HIGH NON-ELECTRIC FENCE
EXTERNAL FENCE: 2.4m HIGH PHYSICAL MESH / PALISADE BARRIER WITH ELECTRIC PULSE FENCE.
 - REQUIREMENT FOR NOISE ENCLOSURE ON STGS AND SHUNT REACTORS SHALL BE CONFIRMED.
 - MAINTENANCE CLEARANCE CONSIDERED AS 25m RADIUS CIRCLE FROM TOWER CENTRE. CONSTRUCTION CLEARANCE CONSIDERED AS SQUARE WITH 70m SIDES CENTRED ON THE TERMINAL TOWER.

- KEY:**
- CSE - CABLE SEALING END
 - SA - SURGE ARRESTER
 - ES - EARTH SWITCH
 - PI - POST INSULATOR
 - MPI - MEDIUM LEVEL POST INSULATOR
 - HPI - HIGH LEVEL POST INSULATOR
 - CT - CURRENT TRANSFORMER
 - CVT - CAPACITIVE VOLTAGE TRANSFORMER
 - WVT - WOUND VOLTAGE TRANSFORMER
 - CB - CIRCUIT BREAKER
 - DISC.+2ES - DISCONNECTOR WITH TWO EARTH SWITCH
 - PD+ES - PANTOGRAPH WITH EARTH SWITCH
 - SHR - SHUNT REACTOR
 - PRR - PORTABLE RELAY ROOM
 - SGT - SUPERGRID TRANSFORMER
 - NER - NEUTRAL EARTHING RESISTOR
 - ET - EARTHING TRANSFORMER
 - AVR - AUTOMATIC VOLTAGE REGULATOR
 - MK - MARSHALLING KIOSK
 - CCC - CENTRAL CONTROL CUBICLE
 - LC - LIGHTING COLUMN

- LEGEND:**
- PROPOSED EQUIPMENT
 - PROPOSED EQUIPMENT - SCOPE TBD
 - FIRE DAMAGE ZONE
 - PROPOSED EQUIPMENT (BY OTHERS)
 - CABLE TRENCH
 - EXCLUSION ZONE
- REFERENCE DRAWINGS:**
- ELECTRICAL ELEVATIONS - 162507-BMD-PL-HR-DEL-TP-0001

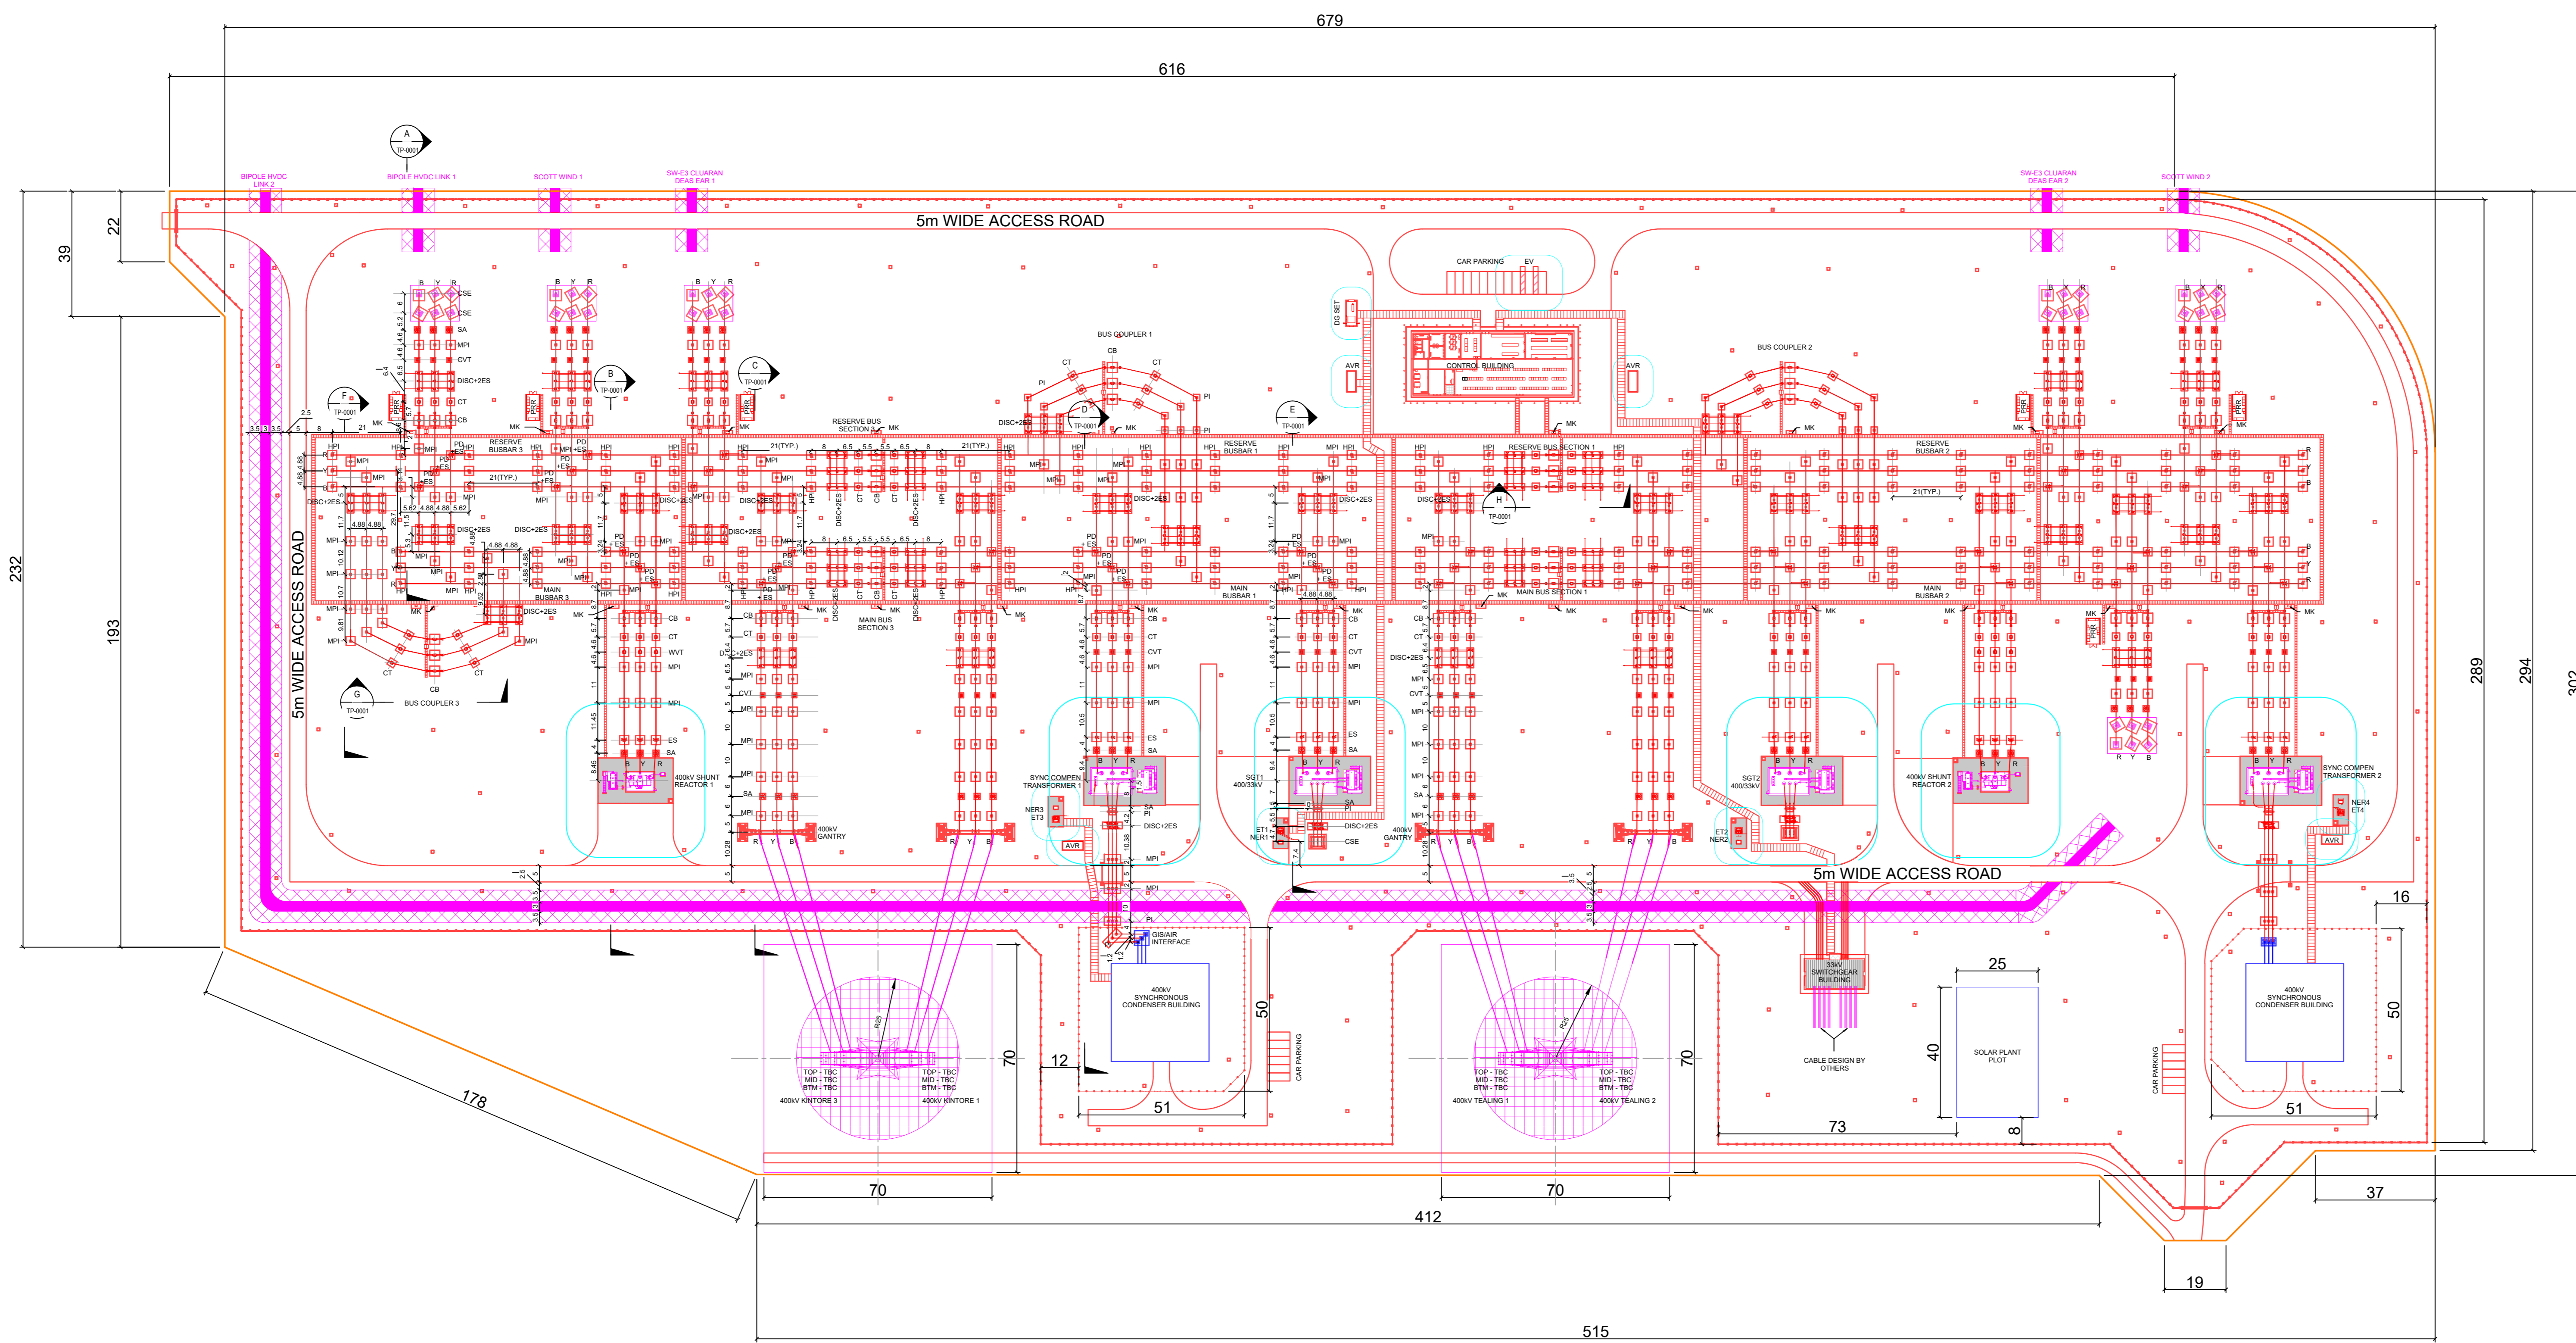

ELECTRICAL LAYOUT
1:1000

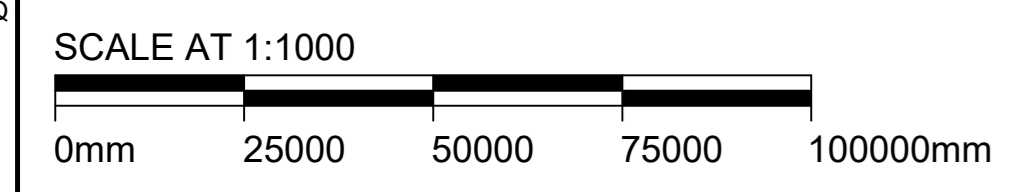

| | | | |
|-------------------|-----------|--------------|----|
| Issue / Revision: | RB | Drawn By: | RB |
| Investment No.: | N/A | Checked By: | JF |
| Date: | 27/SEP/24 | Approved By: | RC |

Description / Remarks
ISSUED FOR PLANNING

| | | | |
|--|--------------|----------------------------------|----------------------|
| Drawing Status: ISSUED FOR PLANNING | | | |
| Software: | Status Code: | Scale: | Paper Size: |
| AUTOCAD | Not Used | 1:1000 | A0 |
| Drawn By: | Checked By: | Approved By: | Date: |
| RB | JF | RC | 27/SEP/24 |
| Contractor: BURNS & MCDONNELL <small>Burns & McDonnell Europe (UK) Limited, trading as Burns & McDonnell 2 Parklands Way, Macc Park, Macclesfield, M11 4PP, UK Email: enquiry@burns-mcd.com Website: www.burnsmcd.com</small> | | | |
| Client: Scottish & Southern Electricity Networks | | Supplier / Subcontractor: | |
| Drawing Title: Figure 3.2: Substation Layout | | | |
| Project Name: HURLIE 400kV SUBSTATION | | | |
| Site Name: HURLIE 400kV SUBSTATION | | | |
| Contractor Drawing No.: 162507-BMD-PL-HR-DPL-TP-0001 | | | |
| Client Drawing No.: 162507-BMD-PL-HR-DPL-TP-0001 | | | Sheet: 1 OF 1 |
| Supplier / Subcontractor Drawing No.: XXX | | | Next: - |
| Issue / Revision: 01 | | | |
| <small>The information in this drawing is the copyright of Burns & McDonnell Europe (UK) Limited. It must not be copied or reproduced without the express permission of Burns & McDonnell Europe (UK) Limited. © 2023 Burns & McDonnell Europe (UK) Limited.</small> | | | |