


Mapped Location

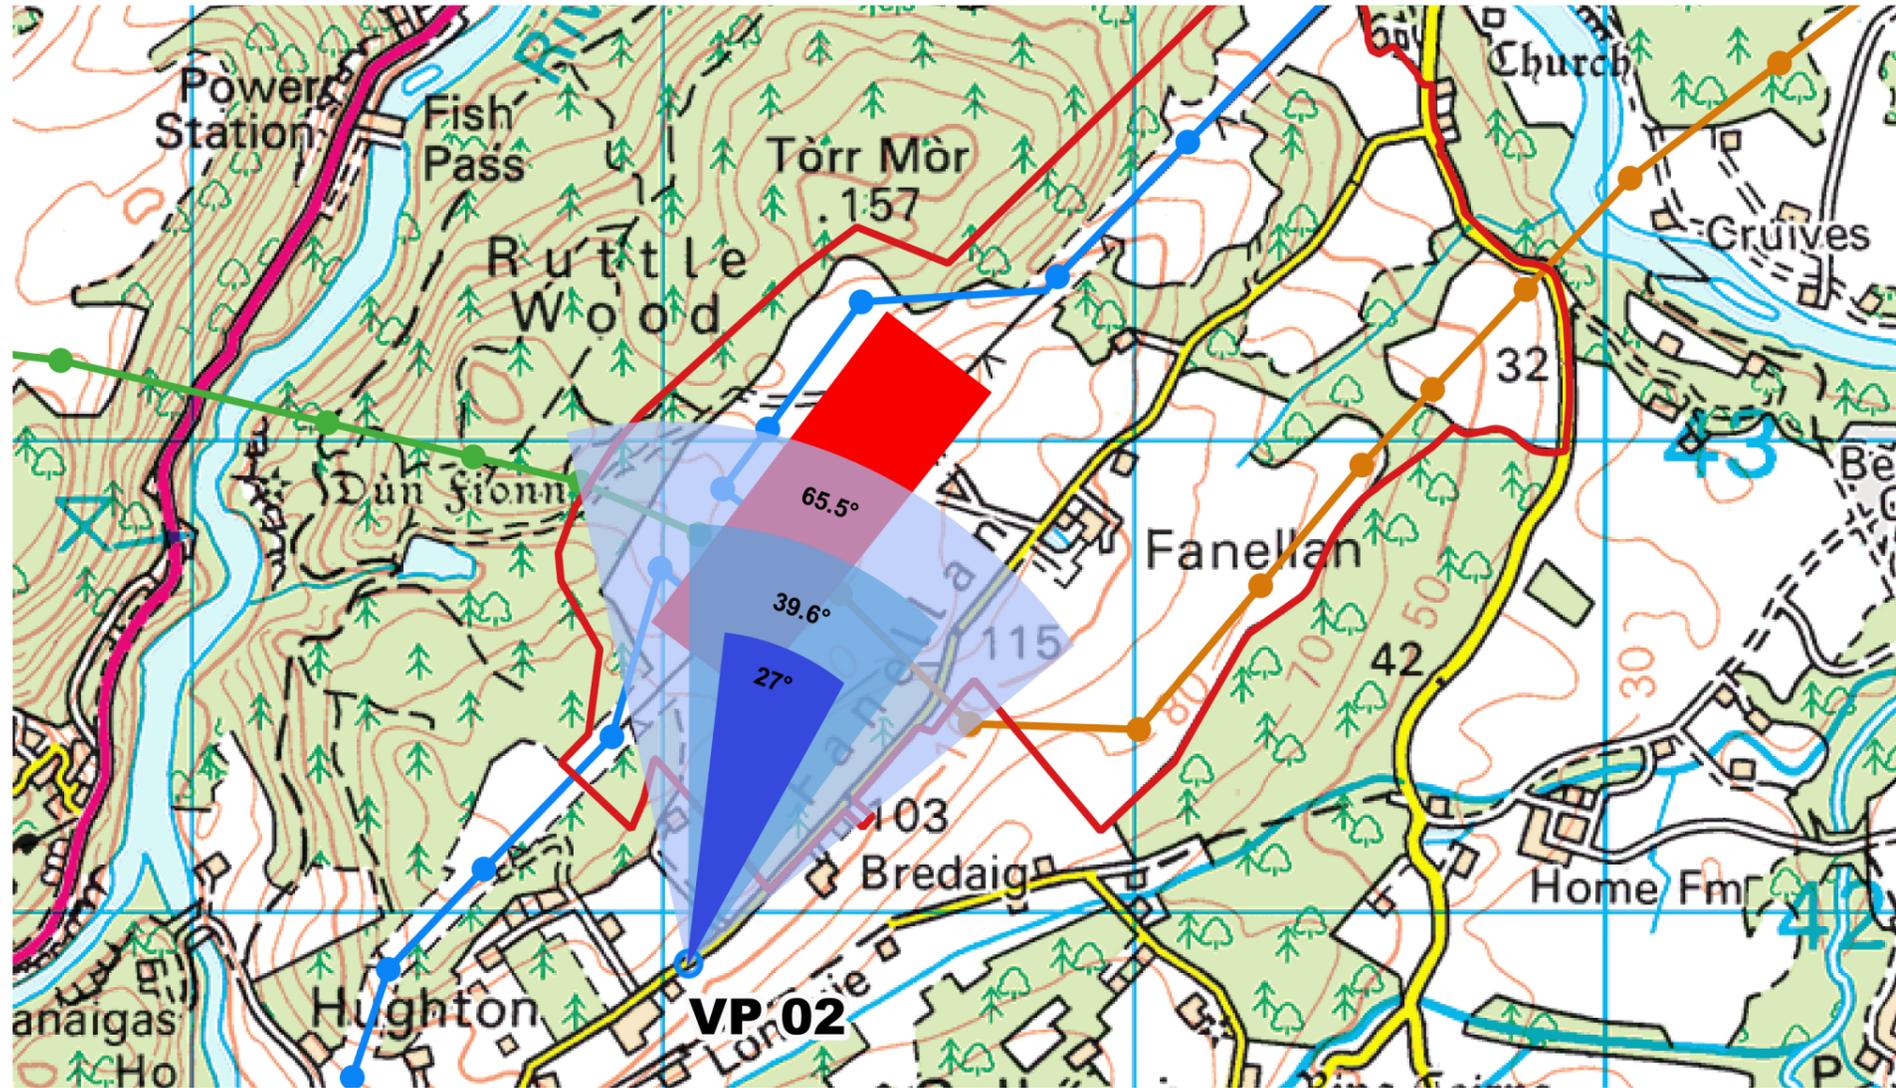


- Key:**
- Fanellan 400kV Substation & Converter Station
 - Proposed Beauly to Peterhead 400 kV Overhead Line (BBNP)
 - Proposed Spittal to Beauly 400 kV Overhead Line (SLBB)
 - Proposed Beauly to Denny 400 kV Overhead Line Permanent Diversion and Permanent Tie-ins (to the Proposed Development)

Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Viewpoint Visualisations The Highland Council
Figure 8.13a
Viewpoint 2: View looking north from near Sunnybrae and Bredaig


Location Description:
 The viewpoint is on Fanellan Road, just north of the area Hughton. There is a layby for parking adjacent to the viewpoint.

Camera Location

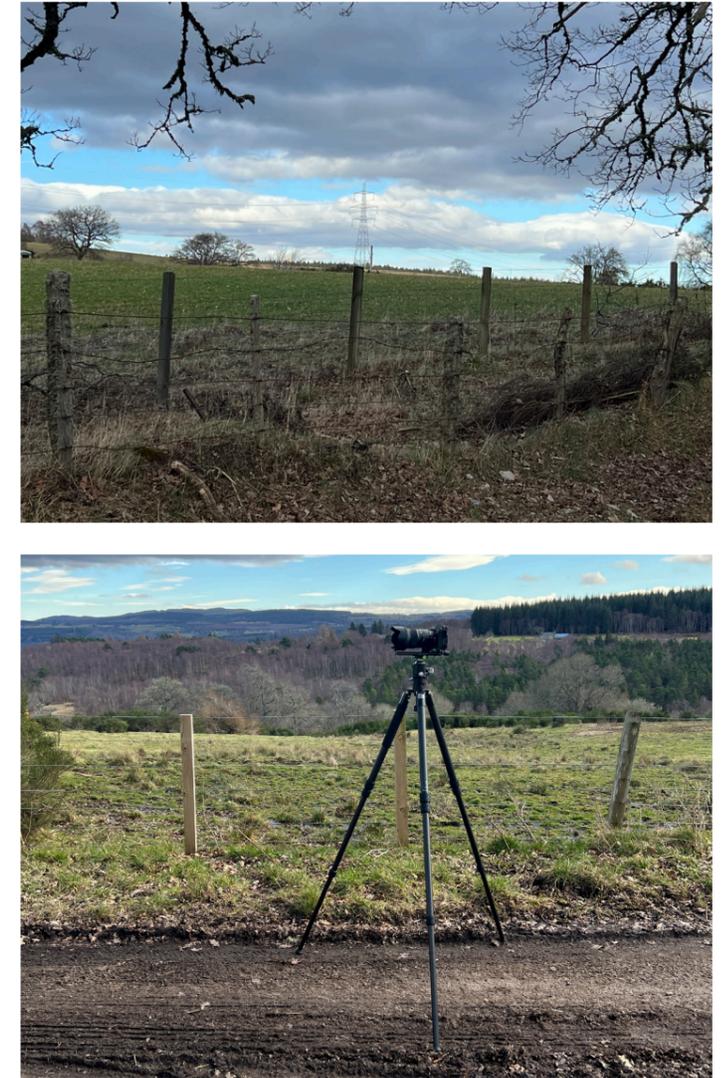

Location Data

OSGB36 Location:	248055 841890
AOD:	109m
Camera Height:	1.5m
Distance to Development:	583m

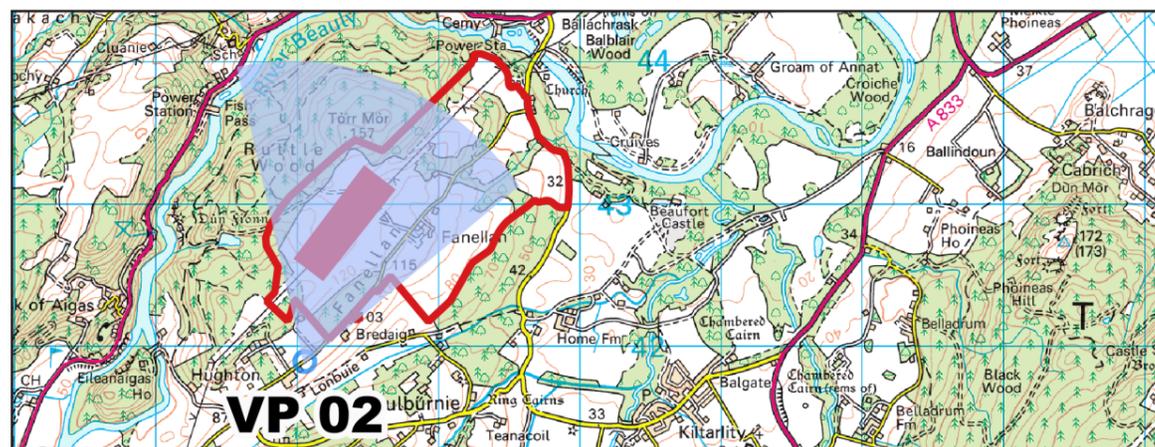

Receptor list: Residents along / off Fanellan Road between Sunnybrae and Bredaig. Road users travelling along Fanellan Road.

This visualisation has been identified and created for use with the visual impact assessment, but can also be used to inform landscape impacts on LCT229 Enclosed Farmland. The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.


Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Viewpoint Visualisations The Highland Council
Figure 8.13b
Viewpoint 2: View looking north from near Sunnybrae and Bredaig
Operational View (Baseline) - 65.5°

Viewpoint Location: X 248055, Y 841890
 AOD: 109m
 Distance to Development and Direction of view: 583m, 20° (North)

Camera: Sony ILCE-7M4
 Lens: 50mm
 Height of camera above the ground: 1.5m
 Date: 05/03/2024



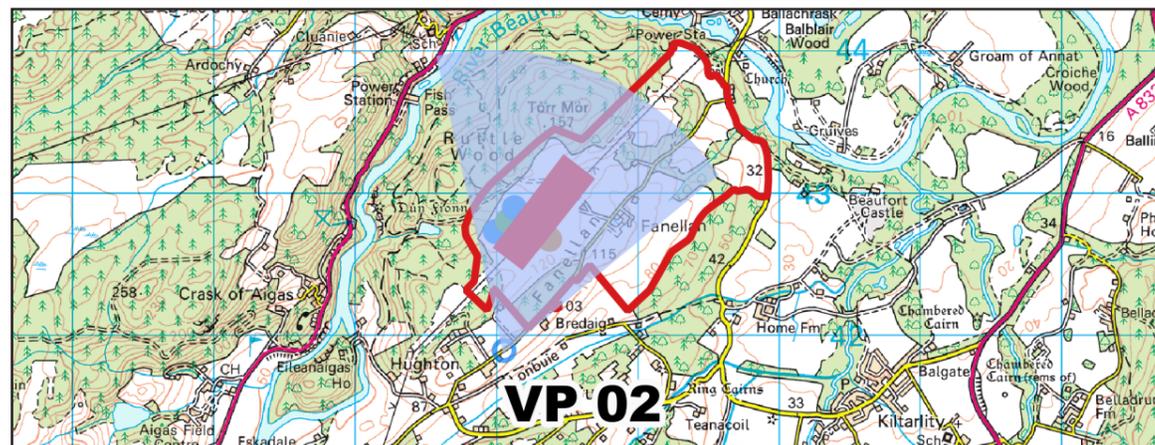

Receptor list: Residents along / off Fanellan Road between Sunnybrae and Bredaig. Road users travelling along Fanellan Road.

This visualisation has been identified and created for use with the visual impact assessment, but can also be used to inform landscape impacts on LCT229 Enclosed Farmland. The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.

Key:

- Fanellan 400kV Substation & Converter Station
- Proposed Beauly to Peterhead 400 kV Overhead Line (BBNP)
- Proposed Spittal to Beauly 400 kV Overhead Line (SLBB)
- Proposed Beauly to Denny 400 kV Overhead Line Permanent Diversion and Permanent Tie-ins (to the Proposed Development)

Alignment information correct as of 22.12.2024


Fanellan 400kV Substation & Converter Station
Viewpoint Visualisations The Highland Council
Figure 8.13c
Viewpoint 2: View looking north from near Sunnybrae and Bredaig
Operational View (Photowire: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers) - 65.5°

Viewpoint Location: X 248055, Y 841890
 AOD: 109m
 Distance to Development and Direction of view: 583m, 20° (North)

Camera: Sony ILCE-7M4
 Lens: 50mm
 Height of camera above the ground: 1.5m
 Date: 05/03/2024



TRANSMISSION

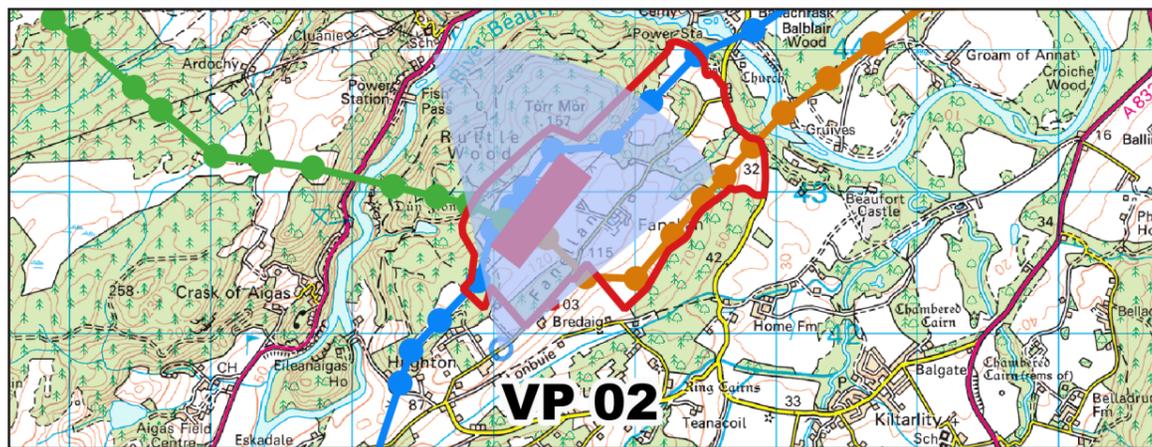

Receptor list: Residents along / off Fanellan Road between Sunnybrae and Bredaig. Road users travelling along Fanellan Road.

This visualisation has been identified and created for use with the visual impact assessment, but can also be used to inform landscape impacts on LCT229 Enclosed Farmland. The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.

Key:

- Fanellan 400kV Substation & Converter Station
- Proposed Beauly to Peterhead 400 kV Overhead Line (BBNP)
- Proposed Spittal to Beauly 400 kV Overhead Line (SLBB)
- Proposed Beauly to Denny 400 kV Overhead Line Permanent Diversion and Permanent Tie-ins (to the Proposed Development)


Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Viewpoint Visualisations The Highland Council
Figure 8.13d
Viewpoint 2: View looking north from near Sunnybrae and Bredaig
Operational View (Photowire: SSEN Cumulative Overhead Line Schemes Only) - 65.5°

Viewpoint Location: X 248055, Y 841890
 AOD: 109m
 Distance to Development and Direction of view: 583m, 20° (North)

Camera: Sony ILCE-7M4
 Lens: 50mm
 Height of camera above the ground: 1.5m
 Date: 05/03/2024



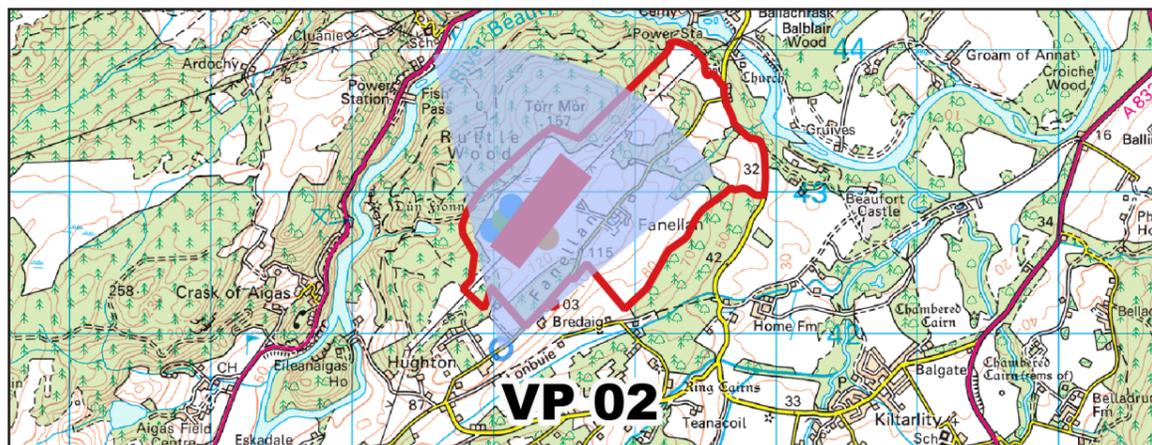

Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Viewpoint Visualisations The Highland Council
Figure 8.13e
Viewpoint 2: View looking north from near Sunnybrae and Bredaig
Operational View (Photomontage: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers - Year 0) - 65.5°

Viewpoint Location: X 248055, Y 841890
 AOD: 109m
 Distance to Development and Direction of view: 583m, 20° (North)


Camera: Sony ILCE-7M4
 Lens: 50mm
 Height of camera above the ground: 1.5m
 Date: 05/03/2024

Receptor list: Residents along / off Fanellan Road between Sunnybrae and Bredaig. Road users travelling along Fanellan Road.

This visualisation has been identified and created for use with the visual impact assessment, but can also be used to inform landscape impacts on LCT229 Enclosed Farmland. The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.

Key:

- Fanellan 400kV Substation & Converter Station
- Proposed Beauly to Peterhead 400 kV Overhead Line (BBNP)
- Proposed Spittal to Beauly 400 kV Overhead Line (SLBB)
- Proposed Beauly to Denny 400 kV Overhead Line Permanent Diversion and Permanent Tie-ins (to the Proposed Development)

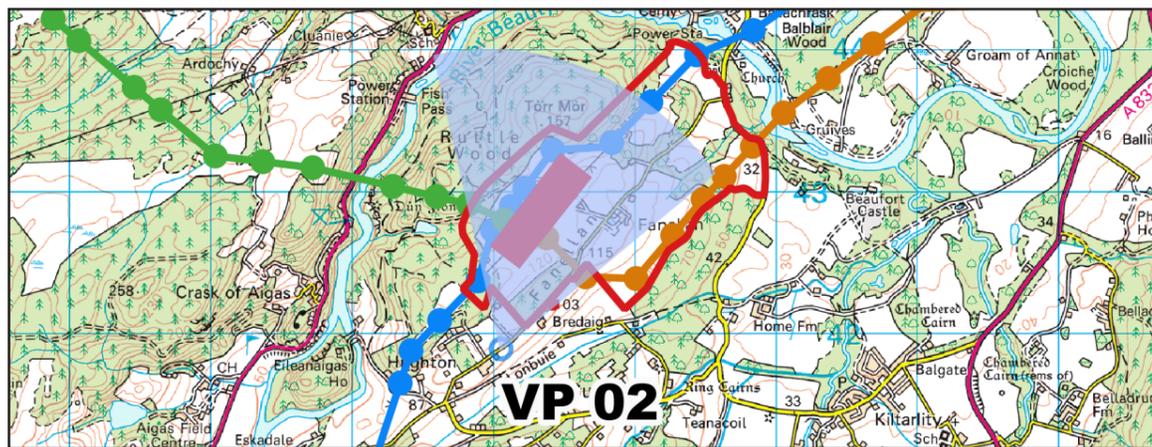

Receptor list: Residents along / off Fanellan Road between Sunnybrae and Bredaig. Road users travelling along Fanellan Road.

This visualisation has been identified and created for use with the visual impact assessment, but can also be used to inform landscape impacts on LCT229 Enclosed Farmland. The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.

Key:

- Fanellan 400kV Substation & Converter Station
- Proposed Beauly to Peterhead 400 kV Overhead Line (BBNP)
- Proposed Spittal to Beauly 400 kV Overhead Line (SLBB)
- Proposed Beauly to Denny 400 kV Overhead Line Permanent Diversion and Permanent Tie-ins (to the Proposed Development)

Alignment information correct as of 22.12.2024


Fanellan 400kV Substation & Converter Station
Viewpoint Visualisations The Highland Council
Figure 8.13f
Viewpoint 2: View looking north from near Sunnybrae and Bredaig
Operational View (Photomontage: SSEN Cumulative Overhead Line Schemes Only - Year 0) - 65.5°

Viewpoint Location: X 248055, Y 841890
 AOD: 109m
 Distance to Development and Direction of view: 583m, 20° (North)

Camera: Sony ILCE-7M4
 Lens: 50mm
 Height of camera above the ground: 1.5m
 Date: 05/03/2024



TRANSMISSION

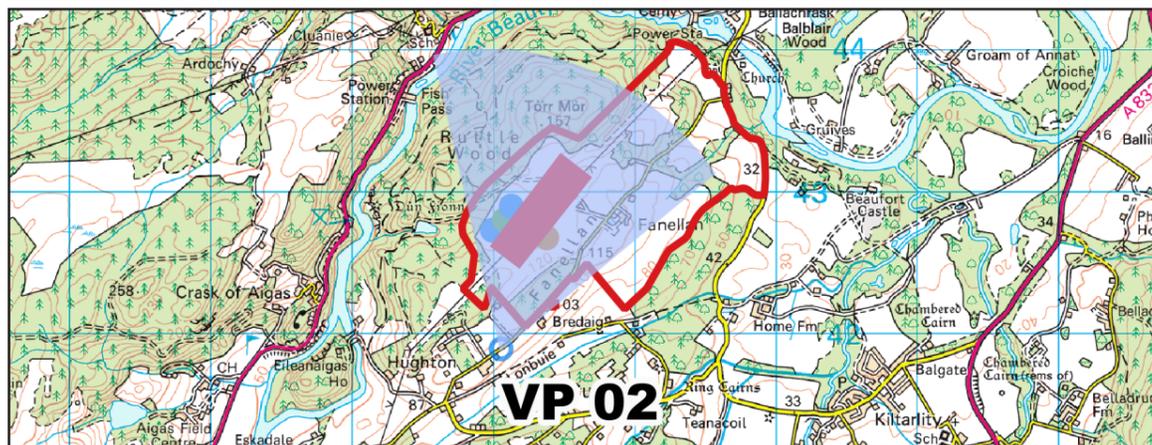

Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Viewpoint Visualisations The Highland Council
Figure 8.13g
Viewpoint 2: View looking north from near Sunnybrae and Bredaig
Operational View (Photomontage: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers - Year 7) - 65.5°

Viewpoint Location: X 248055, Y 841890
 AOD: 109m
 Distance to Development and Direction of view: 583m, 20° (North)

Camera: Sony ILCE-7M4
 Lens: 50mm
 Height of camera above the ground: 1.5m
 Date: 05/03/2024

Receptor list: Residents along / off Fanellan Road between Sunnybrae and Bredaig. Road users travelling along Fanellan Road.


This visualisation has been identified and created for use with the visual impact assessment, but can also be used to inform landscape impacts on LCT229 Enclosed Farmland. The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.

Key:

- Fanellan 400kV Substation & Converter Station
- Proposed Beauly to Peterhead 400 kV Overhead Line (BBNP)
- Proposed Spittal to Beauly 400 kV Overhead Line (SLBB)
- Proposed Beauly to Denny 400 kV Overhead Line Permanent Diversion and Permanent Tie-ins (to the Proposed Development)



TRANSMISSION

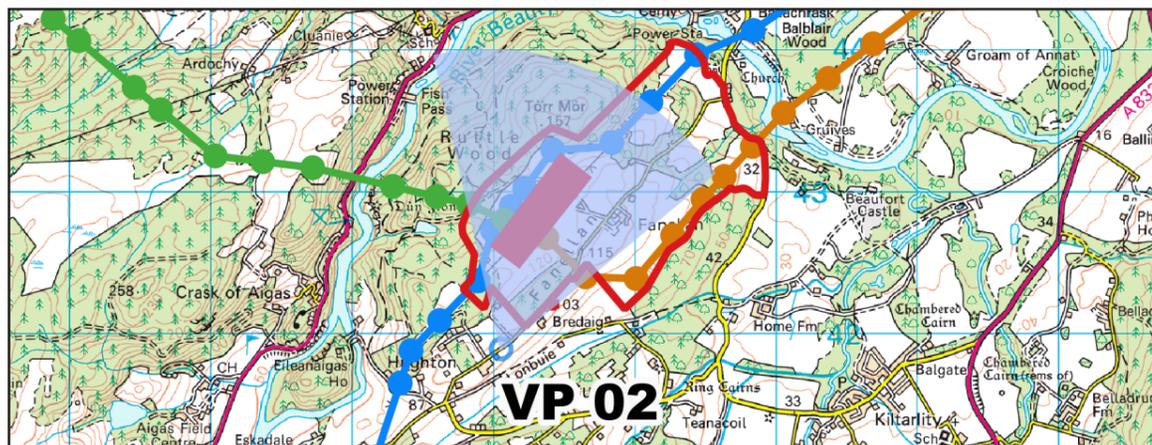

Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Viewpoint Visualisations The Highland Council
Figure 8.13h
Viewpoint 2: View looking north from near Sunnybrae and Bredaig
Operational View (Photomontage: SSEN Cumulative Overhead Line Schemes Only - Year 7) - 65.5°

Viewpoint Location: X 248055, Y 841890
 AOD: 109m
 Distance to Development and Direction of view: 583m, 20° (North)

Camera: Sony ILCE-7M4
 Lens: 50mm
 Height of camera above the ground: 1.5m
 Date: 05/03/2024

Receptor list: Residents along / off Fanellan Road between Sunnybrae and Bredaig. Road users travelling along Fanellan Road.


This visualisation has been identified and created for use with the visual impact assessment, but can also be used to inform landscape impacts on LCT229 Enclosed Farmland. The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.

Key:

- Fanellan 400kV Substation & Converter Station
- Proposed Beauly to Peterhead 400 kV Overhead Line (BBNP)
- Proposed Spittal to Beauly 400 kV Overhead Line (SLBB)
- Proposed Beauly to Denny 400 kV Overhead Line Permanent Diversion and Permanent Tie-ins (to the Proposed Development)



TRANSMISSION

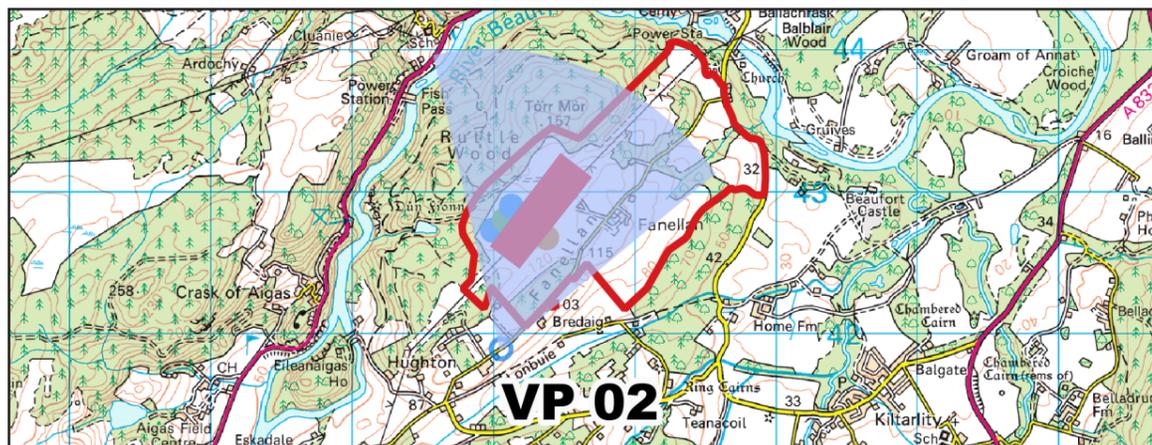

Receptor list: Residents along / off Fanellan Road between Sunnybrae and Bredaig. Road users travelling along Fanellan Road.

This visualisation has been identified and created for use with the visual impact assessment, but can also be used to inform landscape impacts on LCT229 Enclosed Farmland. The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.

Key:

- Fanellan 400kV Substation & Converter Station
- Proposed Beaully to Peterhead 400 kV Overhead Line (BBNP)
- Proposed Spittal to Beaully 400 kV Overhead Line (SLBB)
- Proposed Beaully to Denny 400 kV Overhead Line Permanent Diversion and Permanent Tie-ins (to the Proposed Development)


Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Viewpoint Visualisations The Highland Council
Figure 8.13i
Viewpoint 2: View looking north from near Sunnybrae and Bredaig
Operational View (Photomontage: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers - Year 15) - 65.5°

Viewpoint Location: X 248055, Y 841890
 AOD: 109m
 Distance to Development and Direction of view: 583m, 20° (North)

Camera: Sony ILCE-7M4
 Lens: 50mm
 Height of camera above the ground: 1.5m
 Date: 05/03/2024



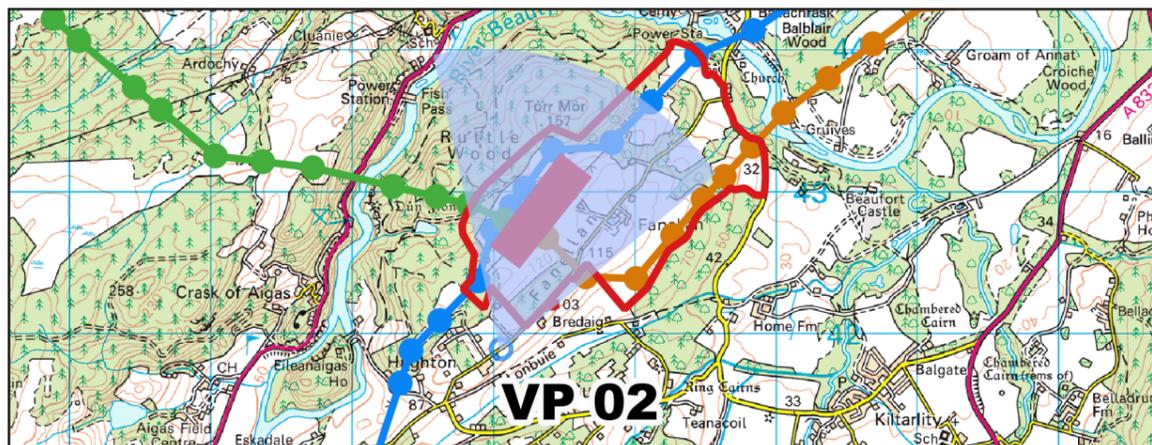

Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Viewpoint Visualisations The Highland Council
Figure 8.13j
Viewpoint 2: View looking north from near Sunnybrae and Bredaig
Operational View (Photomontage: SSEN Cumulative Overhead Line Schemes Only - Year 15) - 65.5°

Viewpoint Location: X 248055, Y 841890
 AOD: 109m
 Distance to Development and Direction of view: 583m, 20° (North)

Camera: Sony ILCE-7M4
 Lens: 50mm
 Height of camera above the ground: 1.5m
 Date: 05/03/2024

Receptor list: Residents along / off Fanellan Road between Sunnybrae and Bredaig. Road users travelling along Fanellan Road.

This visualisation has been identified and created for use with the visual impact assessment, but can also be used to inform landscape impacts on LCT229 Enclosed Farmland. The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.

Key:

- Fanellan 400kV Substation & Converter Station
- Proposed Beauly to Peterhead 400 kV Overhead Line (BBNP)
- Proposed Spittal to Beauly 400 kV Overhead Line (SLBB)
- Proposed Beauly to Denny 400 kV Overhead Line Permanent Diversion and Permanent Tie-ins (to the Proposed Development)



TRANSMISSION



Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.13-k Viewpoint 2: View looking north from near Sunnybrae and Bredaig
Operational View (Photowire: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers) - 50mm

Viewpoint Location: X 248055, Y 841890 AOD: 109
Distance to Development and Direction of view: 583m, 20°
Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m



TRANSMISSION



Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.13-I Viewpoint 2: View looking north from near Sunnybrae and Bredaig
Operational View (Photowire: SSEN Cumulative Overhead Line Schemes Only)
- 50mm

Viewpoint Location: X 248055, Y 841890 AOD: 109
Distance to Development and Direction of view: 583m, 20°
Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m



TRANSMISSION



Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.13-m Viewpoint 2: View looking north from near Sunnybrae and Bredaig
Operational View (Photomontage: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers - Year 0) - 50mm

Viewpoint Location: X 248055, Y 841890 AOD: 109
Distance to Development and Direction of view: 583m, 20°
Date: 05/03/2024

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
The printed image is representative of the Proposed Development, but is not representative of scale or distance.*



TRANSMISSION



Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.13-n Viewpoint 2: View looking north from near Sunnybrae and Bredaig
Operational View (Photomontage: SSEN Cumulative Overhead Line Schemes
Only - Year 0) - 50mm

Viewpoint Location: X 248055, Y 841890 AOD: 109
Distance to Development and Direction of view: 583m, 20°
Date: 05/03/2024

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
The printed image is representative of the Proposed Development, but is not representative of scale or distance.*



TRANSMISSION



Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.13-o Viewpoint 2: View looking north from near Sunnybrae and Bredaig
Operational View (Photomontage: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers - Year 7) - 50mm

Viewpoint Location: X 248055, Y 841890 AOD: 109
Distance to Development and Direction of view: 583m, 20°
Date: 05/03/2024

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
The printed image is representative of the Proposed Development, but is not representative of scale or distance.*



TRANSMISSION



Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.13-p Viewpoint 2: View looking north from near Sunnybrae and Bredaig
Operational View (Photowire: SSEN Cumulative Overhead Line Schemes Only - Year 7) - 50mm

Viewpoint Location: X 248055, Y 841890 AOD: 109
Distance to Development and Direction of view: 583m, 20°
Date: 05/03/2024

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
The printed image is representative of the Proposed Development, but is not representative of scale or distance.*



TRANSMISSION



Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.13-q Viewpoint 2: View looking north from near Sunnybrae and Bredaig
Operational View (Photomontage: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers - Year 15) - 50mm

Viewpoint Location: X 248055, Y 841890 AOD: 109
Distance to Development and Direction of view: 583m, 20°
Date: 05/03/2024

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
The printed image is representative of the Proposed Development, but is not representative of scale or distance.*



TRANSMISSION



Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.13-r Viewpoint 2: View looking north from near Sunnybrae and Bredaig
Operational View (Photowire: SSEN Cumulative Overhead Line Schemes Only - Year 15) - 50mm

Viewpoint Location: X 248055, Y 841890 AOD: 109
Distance to Development and Direction of view: 583m, 20°
Date: 05/03/2024

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
The printed image is representative of the Proposed Development, but is not representative of scale or distance.*



TRANSMISSION



Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.13-s Viewpoint 2: View looking north from near Sunnybrae and Bredaig
Operational View (Photowire: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers) - 75mm

Viewpoint Location: X 248055, Y 841890 AOD: 109
Distance to Development and Direction of view: 583m, 20°
Date: 05/03/2024

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
The printed image is representative of the Proposed Development, but is not representative of scale or distance.*



TRANSMISSION



Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.13-t Viewpoint 2: View looking north from near Sunnybrae and Bredaig
Operational View (Photowire: SSEN Cumulative Overhead Line Schemes Only)
- 75mm

Viewpoint Location: X 248055, Y 841890 AOD: 109
Distance to Development and Direction of view: 583m, 20°
Date: 05/03/2024

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
The printed image is representative of the Proposed Development, but is not representative of scale or distance.*



TRANSMISSION



Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.13-u Viewpoint 2: View looking north from near Sunnybrae and Bredaig
Operational View (Photomontage: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers - Year 0) - 75mm

Viewpoint Location: X 248055, Y 841890 AOD: 109
Distance to Development and Direction of view: 583m, 20°
Date: 05/03/2024

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
The printed image is representative of the Proposed Development, but is not representative of scale or distance.*



TRANSMISSION



Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.13-v Viewpoint 2: View looking north from near Sunnybrae and Bredaig
Operational View (Photomontage: SSEN Cumulative Overhead Line Schemes
Only - Year 0) - 75mm

Viewpoint Location: X 248055, Y 841890 AOD: 109
Distance to Development and Direction of view: 583m, 20°
Date: 05/03/2024

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
The printed image is representative of the Proposed Development, but is not representative of scale or distance.*



TRANSMISSION



Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.13-w Viewpoint 2: View looking north from near Sunnybrae and Bredaig
Operational View (Photomontage: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers - Year 7) - 75mm

Viewpoint Location: X 248055, Y 841890 AOD: 109
Distance to Development and Direction of view: 583m, 20°
Date: 05/03/2024

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
The printed image is representative of the Proposed Development, but is not representative of scale or distance.*



TRANSMISSION



Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.13-x Viewpoint 2: View looking north from near Sunnybrae and Bredaig
Operational View (Photomontage: SSEN Cumulative Overhead Line Schemes Only - Year 7) - 75mm

Viewpoint Location: X 248055, Y 841890 AOD: 109
Distance to Development and Direction of view: 583m, 20°
Date: 05/03/2024

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
The printed image is representative of the Proposed Development, but is not representative of scale or distance.*



TRANSMISSION



Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.13-y Viewpoint 2: View looking north from near Sunnybrae and Bredaig
Operational View (Photomontage: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers - Year 15) - 75mm

Viewpoint Location: X 248055, Y 841890 AOD: 109
Distance to Development and Direction of view: 583m, 20°
Date: 05/03/2024

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
The printed image is representative of the Proposed Development, but is not representative of scale or distance.*



TRANSMISSION



Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.13-z Viewpoint 2: View looking north from near Sunnybrae and Bredaig
Operational View (Photomontage: SSEN Cumulative Overhead Line Schemes Only - Year 15) - 75mm

Viewpoint Location: X 248055, Y 841890 AOD: 109
Distance to Development and Direction of view: 583m, 20°
Date: 05/03/2024

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
The printed image is representative of the Proposed Development, but is not representative of scale or distance.*



TRANSMISSION