


Mapped Location

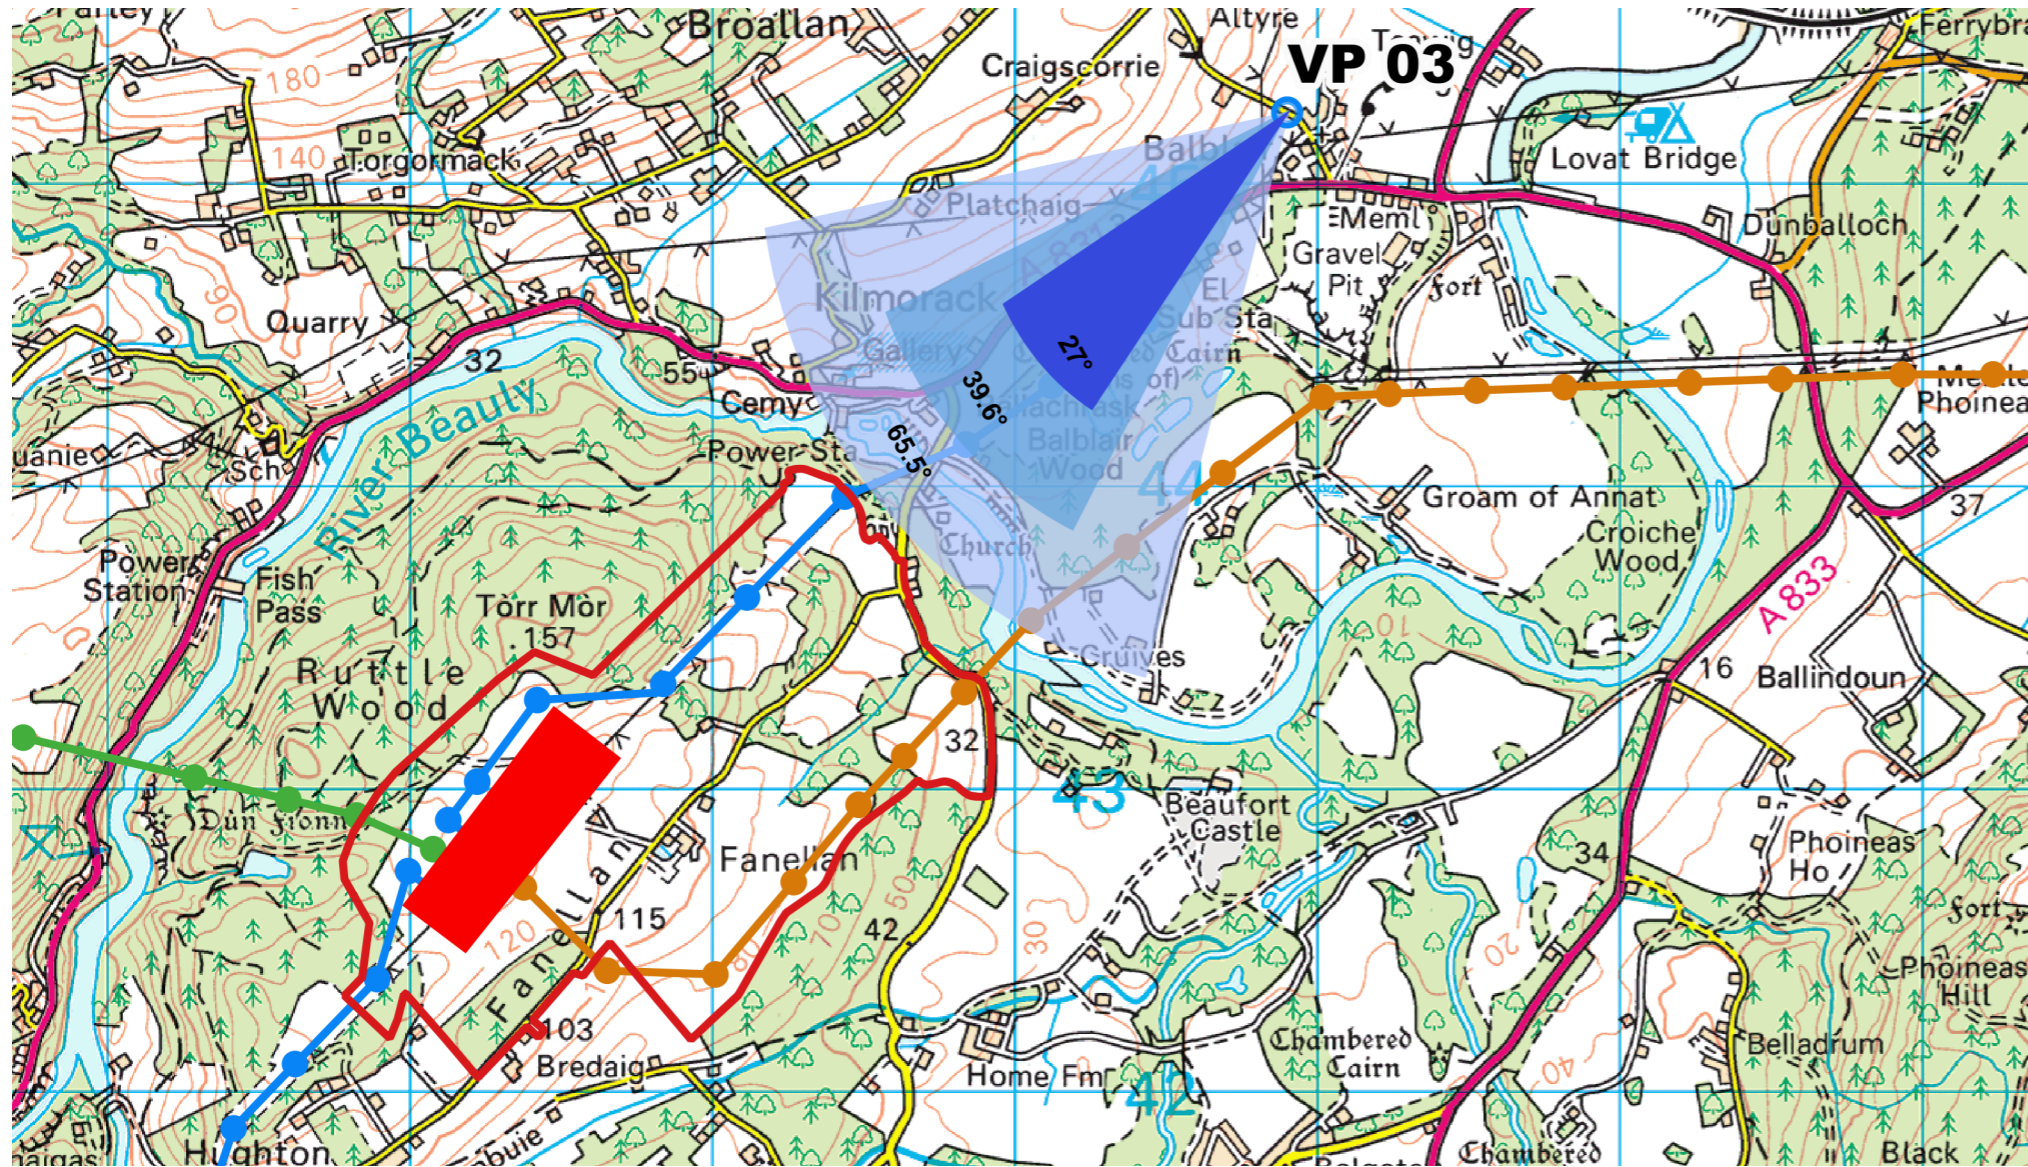

- Key:**
- Fanellan 400kV Substation & Converter Station
 - Proposed Beauly to Peterhead 400 kV Overhead Line (BBNP)
 - Proposed Spittal to Beauly 400 kV Overhead Line (SLBB)
 - Proposed Beauly to Denny 400 kV Overhead Line Permanent Diversion and Permanent Tie-ins (to the Proposed Development)

Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Viewpoint Visualisations The Highland Council
Figure 8.14a
Viewpoint 3: View looking south-west from the north-western edge of West Balblair


Location Description:
 The viewpoint is on Wester Balblair Road, just off the A8311. There is a layby for parking to the North West of the viewpoint or alternatively parking could be found to the South East in a nearby residential area with pedestrian access to the viewpoint from here.

Camera Location



Location Data

OSGB36 Location:	250901 845234
AOD:	26m
Camera Height:	1.5m
Distance to Development:	3096m

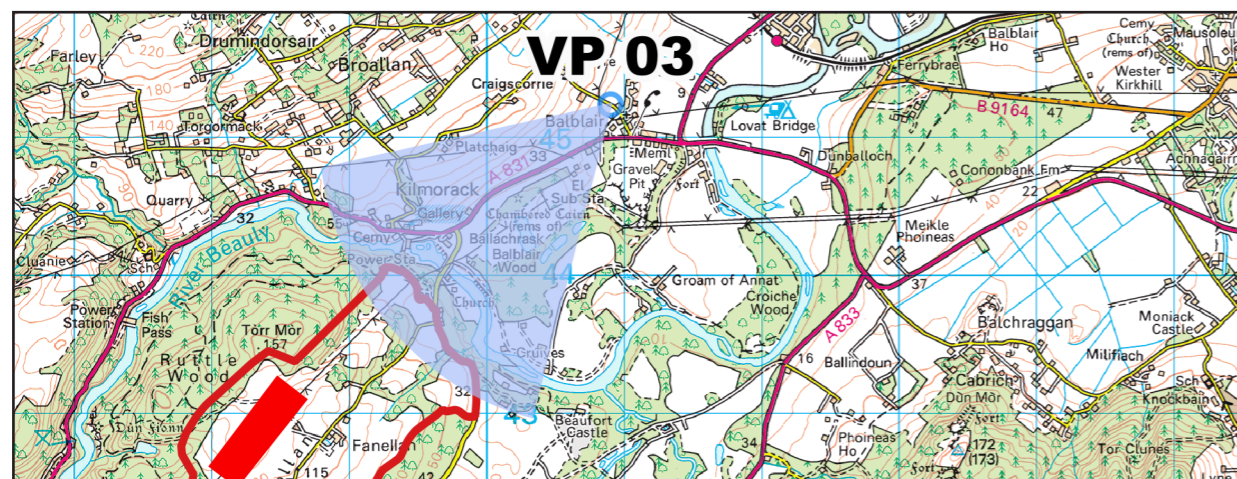

Receptor list: Residents at Wester Balblair. Road users of the road that forms the main access to the village off the A831.

This visualisation has been identified and created for use with the visual impact assessment, but can also be used to inform landscape impacts on LCT346 Open Farmed Slopes.

The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.


Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Viewpoint Visualisations The Highland Council
Figure 8.14b
Viewpoint 3: View looking south-west from the north-western edge of West Balblair Operational View (Baseline) - 65.5°

Viewpoint Location: X 250901, Y 845234
 AOD: 26m
 Distance to Development and Direction of view: 3096m, 227°
 (South-West)

Camera: Sony ILCE-7M4
 Lens: 50mm
 Height of camera above the ground: 1.5m
 Date: 05/03/2024



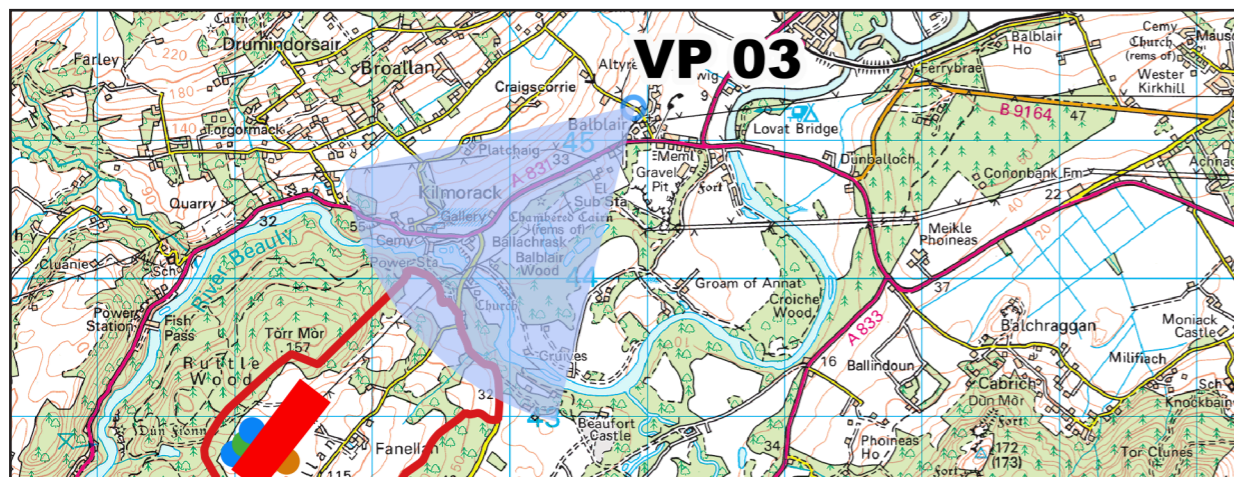

Receptor list: Residents at Wester Balblair. Road users of the road that forms the main access to the village off the A831.

This visualisation has been identified and created for use with the visual impact assessment, but can also be used to inform landscape impacts on LCT346 Open Farmed Slopes.

The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.

Key:

- Fanellan 400kV Substation & Converter Station
- Proposed Beauly to Peterhead 400 kV Overhead Line (BBNP)
- Proposed Spittal to Beauly 400 kV Overhead Line (SLBB)
- Proposed Beauly to Denny 400 kV Overhead Line Permanent Diversion and Permanent Tie-ins (to the Proposed Development)


Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Viewpoint Visualisations The Highland Council
Figure 8.14c
Viewpoint 3: View looking south-west from the north-western edge of West Balblair
Operational View (Photowire: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers) - 65.5°

Viewpoint Location: X 250901, Y 845234
 AOD: 26m
 Distance to Development and Direction of view: 3096m, 227° (South-West)

Camera: Sony ILCE-7M4
 Lens: 50mm
 Height of camera above the ground: 1.5m
 Date: 05/03/2024



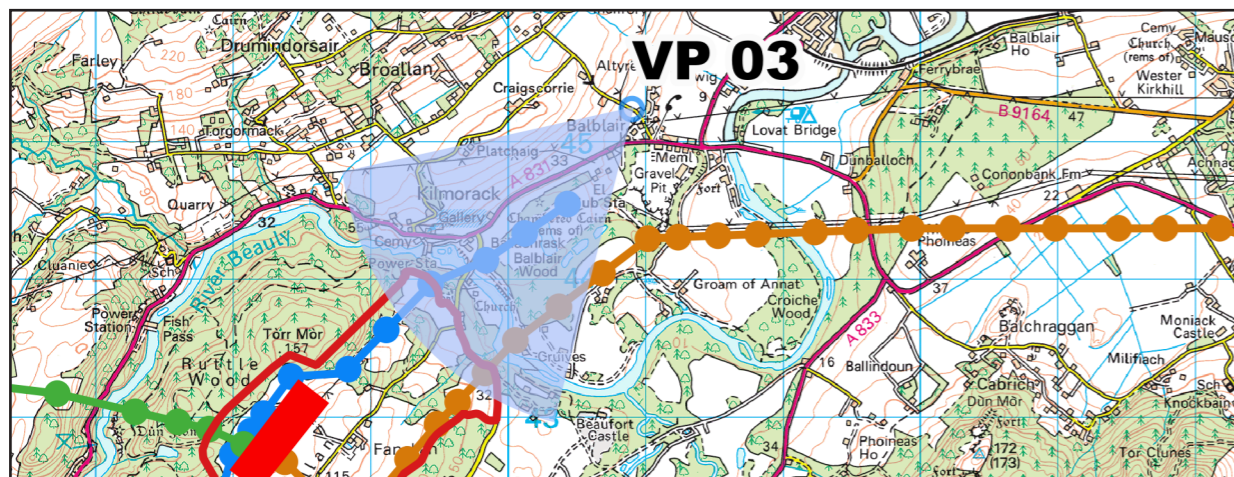

Receptor list: Residents at Wester Balblair. Road users of the road that forms the main access to the village off the A831.

This visualisation has been identified and created for use with the visual impact assessment, but can also be used to inform landscape impacts on LCT346 Open Farmed Slopes.

The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.

Key:

- Fanellan 400kV Substation & Converter Station
- Proposed Beauly to Peterhead 400 kV Overhead Line (BBNP)
- Proposed Spittal to Beauly 400 kV Overhead Line (SLBB)
- Proposed Beauly to Denny 400 kV Overhead Line Permanent Diversion and Permanent Tie-ins (to the Proposed Development)

Alignment information correct as of 22.12.2024


Fanellan 400kV Substation & Converter Station
Viewpoint Visualisations The Highland Council
Figure 8.14d
Viewpoint 3: View looking south-west from the north-western edge of West Balblair
Operational View (Photowire: SSEN Cumulative Overhead Line Schemes Only) - 65.5°

Viewpoint Location: X 250901, Y 845234
 AOD: 26m
 Distance to Development and Direction of view: 3096m, 227° (South-West)

Camera: Sony ILCE-7M4
 Lens: 50mm
 Height of camera above the ground: 1.5m
 Date: 05/03/2024



TRANSMISSION

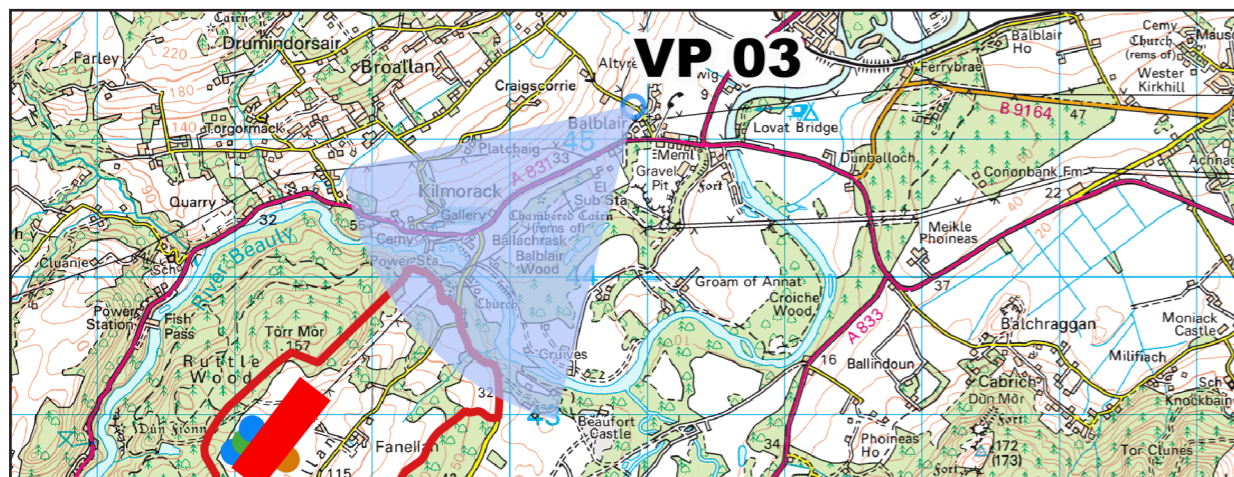

Receptor list: Residents at Wester Balblair. Road users of the road that forms the main access to the village off the A831.

This visualisation has been identified and created for use with the visual impact assessment, but can also be used to inform landscape impacts on LCT346 Open Farmed Slopes.

The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.

Key:

- Fanellan 400kV Substation & Converter Station
- Proposed Beaulieu to Peterhead 400 kV Overhead Line (BBNP)
- Proposed Spittal to Beaulieu 400 kV Overhead Line (SLBB)
- Proposed Beaulieu to Denny 400 kV Overhead Line Permanent Diversion and Permanent Tie-ins (to the Proposed Development)


Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Viewpoint Visualisations The Highland Council
Figure 8.14e
Viewpoint 3: View looking south-west from the north-western edge of West Balblair
Operational View (Photomontage: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers - Year 0) - 65.5°

Viewpoint Location: X 250901, Y 845234
 AOD: 26m
 Distance to Development and Direction of view: 3096m, 227° (South-West)

Camera: Sony ILCE-7M4
 Lens: 50mm
 Height of camera above the ground: 1.5m
 Date: 05/03/2024



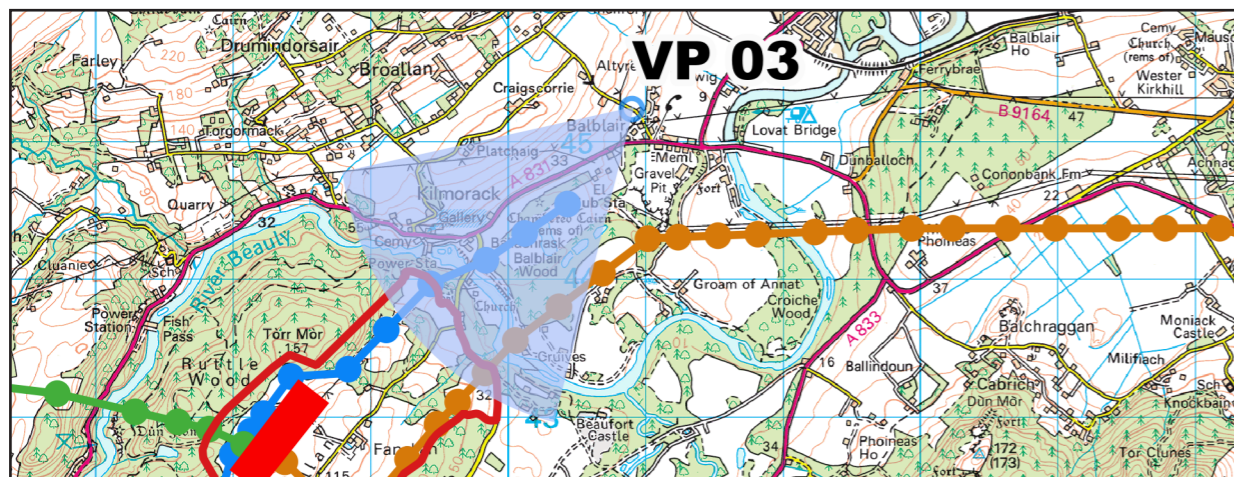

Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Viewpoint Visualisations The Highland Council
Figure 8.14f
Viewpoint 3: View looking south-west from the north-western edge of West Balblair
Operational View (Photomontage: SSEN Cumulative Overhead Line Schemes Only - Year 0) - 65.5°

Viewpoint Location: X 250901, Y 845234
 AOD: 26m
 Distance to Development and Direction of view: 3096m, 227°
 (South-West)

Receptor list: Residents at Wester Balblair. Road users of the road that forms the main access to the village off the A831.

This visualisation has been identified and created for use with the visual impact assessment, but can also be used to inform landscape impacts on LCT346 Open Farmed Slopes.

The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.


Key:

- Fanellan 400kV Substation & Converter Station
- Proposed Beauly to Peterhead 400 kV Overhead Line (BBNP)
- Proposed Spittal to Beauly 400 kV Overhead Line (SLBB)
- Proposed Beauly to Denny 400 kV Overhead Line Permanent Diversion and Permanent Tie-ins (to the Proposed Development)

Camera: Sony ILCE-7M4
 Lens: 50mm
 Height of camera above the ground: 1.5m
 Date: 05/03/2024



TRANSMISSION

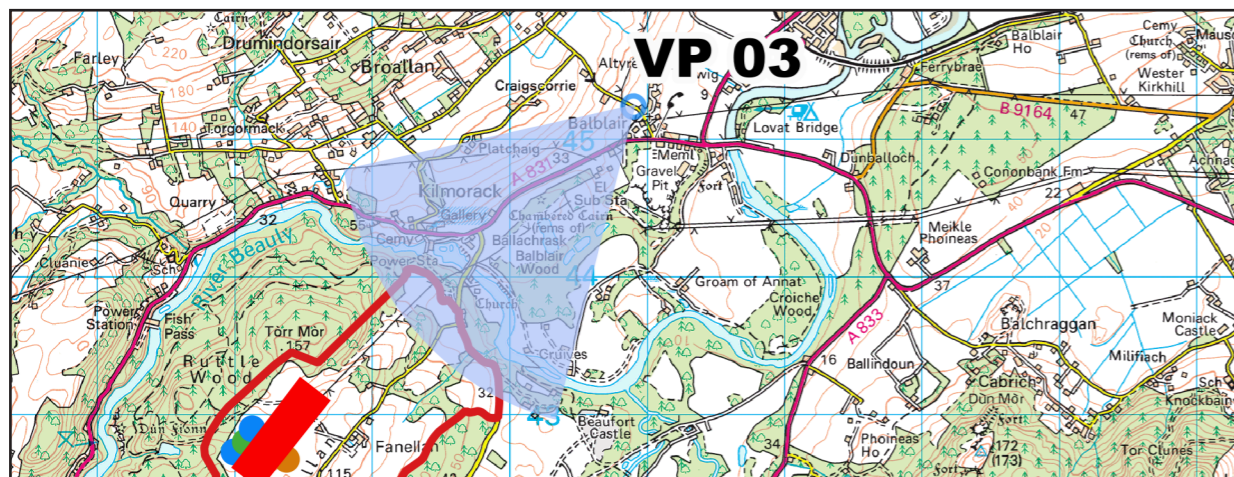

Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Viewpoint Visualisations The Highland Council
Figure 8.14g
Viewpoint 3: View looking south-west from the north-western edge of West Bal Blair
Operational View (Photomontage: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers - Year 15) - 65.5°

Viewpoint Location: X 250901, Y 845234
 AOD: 26m
 Distance to Development and Direction of view: 3096m, 227° (South-West)

Receptor list: Residents at Wester Bal Blair. Road users of the road that forms the main access to the village off the A831.

This visualisation has been identified and created for use with the visual impact assessment, but can also be used to inform landscape impacts on LCT346 Open Farmed Slopes.

The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.


Key:

- Fanellan 400kV Substation & Converter Station
- Proposed Beaulie to Peterhead 400 kV Overhead Line (BBNP)
- Proposed Spittal to Beaulie 400 kV Overhead Line (SLBB)
- Proposed Beaulie to Denny 400 kV Overhead Line Permanent Diversion and Permanent Tie-ins (to the Proposed Development)

Camera: Sony ILCE-7M4
 Lens: 50mm
 Height of camera above the ground: 1.5m
 Date: 05/03/2024



TRANSMISSION

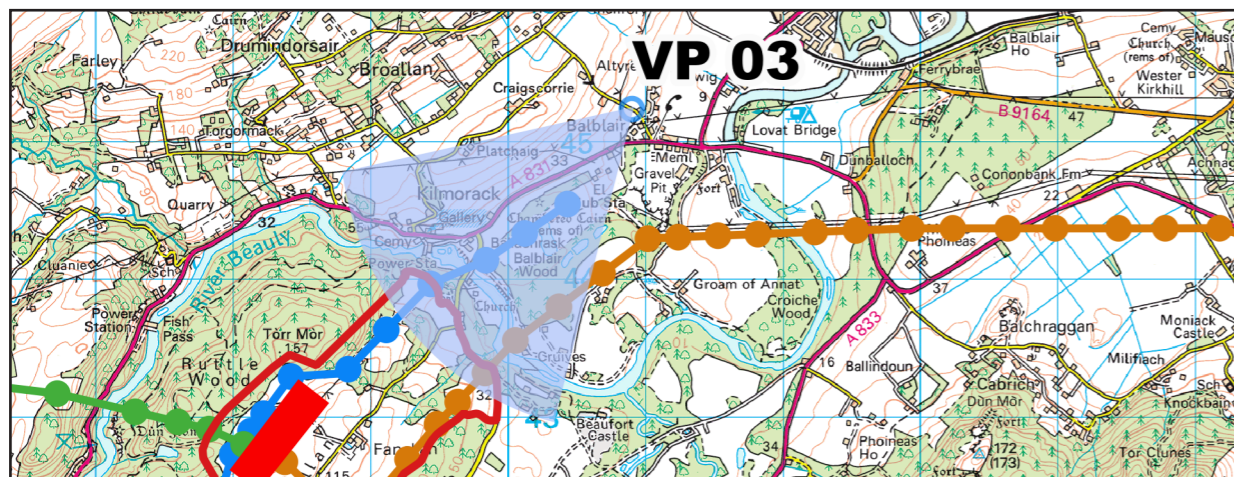

Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Viewpoint Visualisations The Highland Council
Figure 8.14h
Viewpoint 3: View looking south-west from the north-western edge of West Bal Blair
Operational View (Photomontage: SSEN Cumulative Overhead Line Schemes Only - Year 15) - 65.5°

Viewpoint Location: X 250901, Y 845234
 AOD: 26m
 Distance to Development and Direction of view: 3096m, 227°
 (South-West)

Receptor list: Residents at Wester Bal Blair. Road users of the road that forms the main access to the village off the A831.

This visualisation has been identified and created for use with the visual impact assessment, but can also be used to inform landscape impacts on LCT346 Open Farmed Slopes.

The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.

Key:

- Fanellan 400kV Substation & Converter Station
- Proposed Beauly to Peterhead 400 kV Overhead Line (BBNP)
- Proposed Spittal to Beauly 400 kV Overhead Line (SLBB)
- Proposed Beauly to Denny 400 kV Overhead Line Permanent Diversion and Permanent Tie-ins (to the Proposed Development)

Camera: Sony ILCE-7M4
 Lens: 50mm
 Height of camera above the ground: 1.5m
 Date: 05/03/2024



TRANSMISSION



Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.14-i Viewpoint 3: View looking south-west from the north-western edge of West Balbair

Operational View (Photowire: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers) - 50mm

Viewpoint Location: X 250901, Y 845234 AOD: 26m
Distance to Development and Direction of view: 3096m, 227°
Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m



TRANSMISSION



Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.14-j Viewpoint 3: View looking south-west from the north-western edge of West Balbar
Operational View (Photowire: SSEN Cumulative Overhead Line Schemes Only)
- 50mm

Viewpoint Location: X 250901, Y 845234 AOD: 26m
Distance to Development and Direction of view: 3096m, 227°
Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m



TRANSMISSION



Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.14-k Viewpoint 3: View looking south-west from the north-western edge of West Balbar

Operational View (Photomontage: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers - Year 0) - 50mm

Viewpoint Location: X 250901, Y 845234 AOD: 26m
Distance to Development and Direction of view: 3096m, 227°
Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m



TRANSMISSION



Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.14-I Viewpoint 3: View looking south-west from the north-western edge of West Balbair

Operational View (Photomontage: SSEN Cumulative Overhead Line Schemes Only - Year 0) - 50mm

Viewpoint Location: X 250901, Y 845234 AOD: 26m
Distance to Development and Direction of view: 3096m, 227°
Date: 05/03/2024

The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m



TRANSMISSION



Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.14-m Viewpoint 3: View looking south-west from the north-western edge of West Balbar

Operational View (Photomontage: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers - Year 15) - 50mm

Viewpoint Location: X 250901, Y 845234 AOD: 26m
Distance to Development and Direction of view: 3096m, 227°
Date: 05/03/2024

The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m



TRANSMISSION



Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.14-n Viewpoint 3: View looking south-west from the north-western edge of West Balbar

Operational View (Photowire: SSEN Cumulative Overhead Line Schemes Only - Year 15) - 50mm

Viewpoint Location: X 250901, Y 845234 AOD: 26m
Distance to Development and Direction of view: 3096m, 227°
Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m



TRANSMISSION



Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.14-o Viewpoint 3: View looking south-west from the north-western edge of West Balbar

Operational View (Photowire: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers) - 75mm

Viewpoint Location: X 250901, Y 845234 AOD: 26m
Distance to Development and Direction of view: 3096m, 227°
Date: 05/03/2024

The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m



TRANSMISSION



Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.14-p Viewpoint 3: View looking south-west from the north-western edge of West Balbar
Operational View (Photowire: SSEN Cumulative Overhead Line Schemes Only)
- 75mm

Viewpoint Location: X 250901, Y 845234 AOD: 26m
Distance to Development and Direction of view: 3096m, 227°
Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m



TRANSMISSION



Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.14-q Viewpoint 3: View looking south-west from the north-western edge of West Balbar

Operational View (Photomontage: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers - Year 0) - 75mm

Viewpoint Location: X 250901, Y 845234 AOD: 26m
Distance to Development and Direction of view: 3096m, 227°
Date: 05/03/2024

The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m



TRANSMISSION



Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.14-r Viewpoint 3: View looking south-west from the north-western edge of West Balbar

Operational View (Photomontage: SSEN Cumulative Overhead Line Schemes Only - Year 0) - 75mm

Viewpoint Location: X 250901, Y 845234 AOD: 26m
Distance to Development and Direction of view: 3096m, 227°
Date: 05/03/2024

The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m



TRANSMISSION



Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.14-s Viewpoint 3: View looking south-west from the north-western edge of West Balbar

Operational View (Photomontage: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers - Year 15) - 75mm

Viewpoint Location: X 250901, Y 845234 AOD: 26m
Distance to Development and Direction of view: 3096m, 227°
Date: 05/03/2024

The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m



TRANSMISSION



Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.14-t Viewpoint 3: View looking south-west from the north-western edge of West Balbar

Operational View (Photomontage: SSEN Cumulative Overhead Line Schemes Only - Year 15) - 75mm

Viewpoint Location: X 250901, Y 845234 AOD: 26m
Distance to Development and Direction of view: 3096m, 227°
Date: 05/03/2024

The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m



TRANSMISSION