




Figure 8.28a Viewpoint 3: View looking south-west from the north-western edge of West Balbair Existing View

Alignment information correct as of 22.12.2024

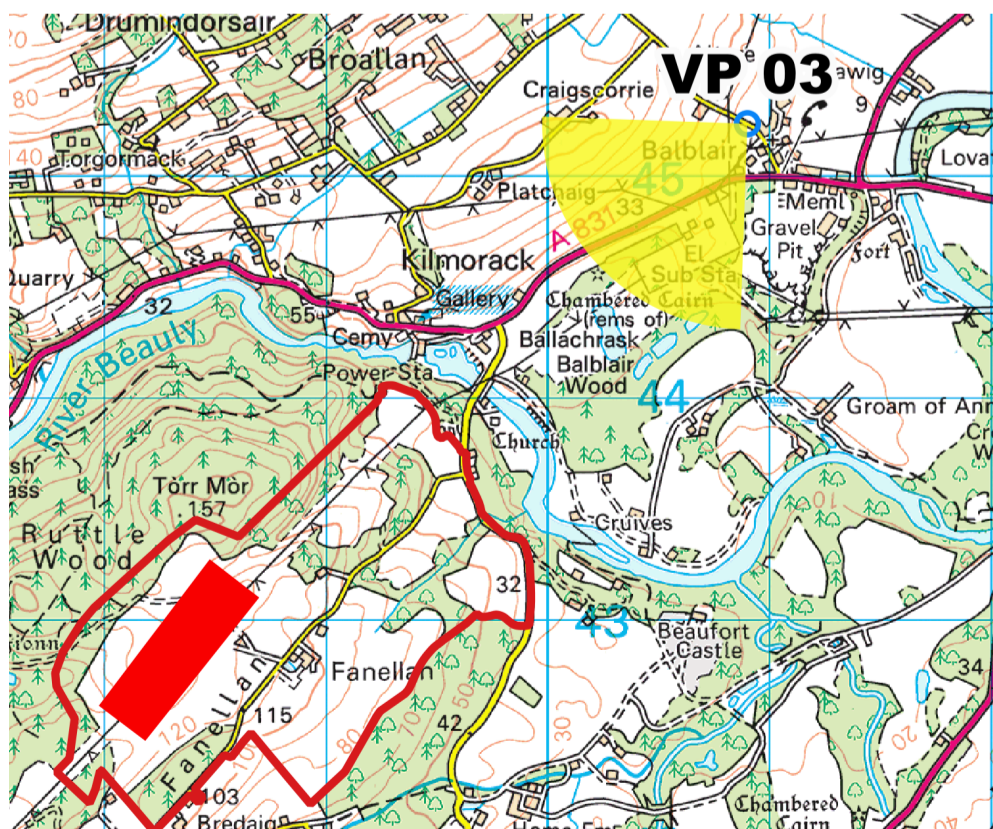

Visualisation Type: Type 3
 Projection: Cylindrical
 Enlargement Factor: 100% @ A1
 Date and time of photography: 5/3/2024, 16:27
 Camera & lens: Sony ILCE-7M4, 50mm

Vertical Field of View: 39.6° Horizontal Field of View: 90°
 Viewpoint location: X 250901, Y 845234, AOD 26m
 Distance (in m) to proposed development and direction of view: 3096 m, 227°
 Height of camera above ground: 1.5m

NOTES:
 This image provides landscape and visual context only
 View flat at a comfortable arm's length. If viewing on screen enlarge to full screen to gain an overview, enlarge to 100% to have a reasonable impression of the size of the development in the view.

This image is an existing view to support a Type 3 photomontage and has been produced in accordance with Landscape Institute Technical Guidance Note 06/19.

**Fanellan 400kV Substation & Converter Station
 Viewpoint 3: View looking south-west from the north-western edge of West Balbair**


Existing View





Figure 8.28b Viewpoint 3: View looking south-west from the north-western edge of West Balair Operational View (Photowire: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers)

Alignment information correct as of 22.12.2024

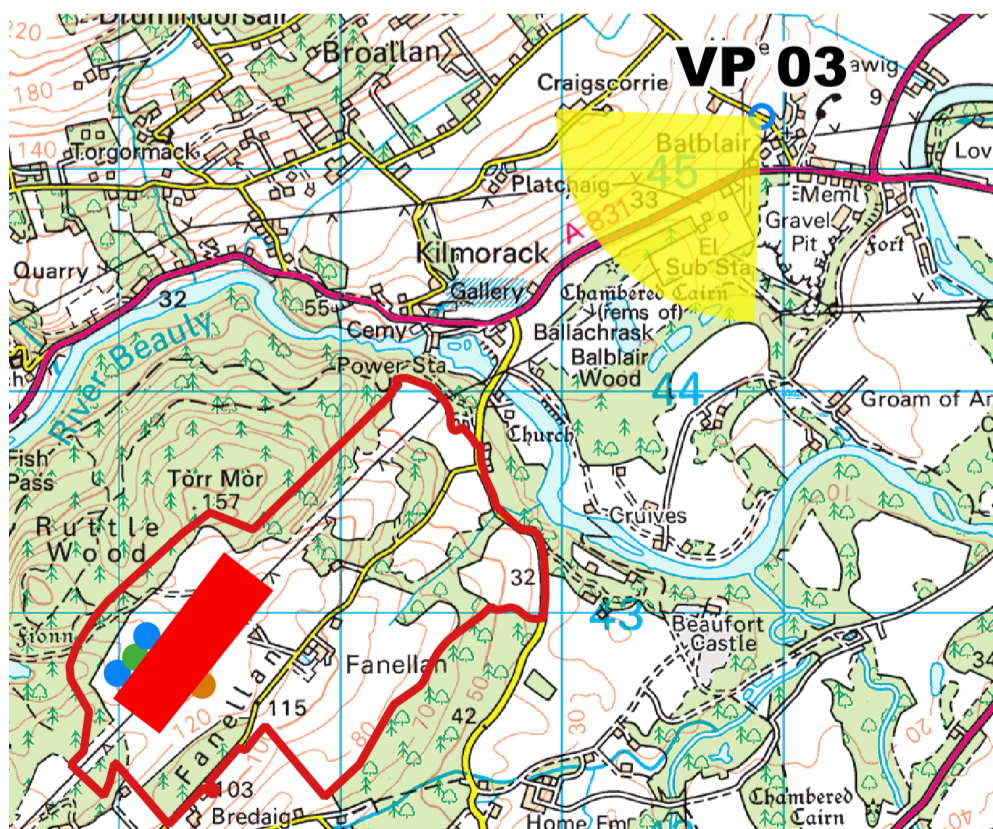

- Key:**
- Fanellan 400kV Substation & Converter Station
 - Proposed Beauly to Peterhead 400 kV Overhead Line (BBNP)
 - Proposed Spittal to Beauly 400 kV Overhead Line (SLBB)
 - Proposed Beauly to Denny 400 kV Overhead Line Permanent
 - Diversion and Permanent Tie-ins (to the Proposed Development)

Visualisation Type: Type 3
 Projection: Cylindrical
 Enlargement Factor: 100% @ A1
 Date and time of photography: 5/3/2024, 16:27
 Camera & lens: Sony ILCE-7M4, 50mm

Vertical Field of View: 39.6° Horizontal Field of View: 90°
 Viewpoint location: X 250901, Y 845234, AOD 26m
 Distance (in m) to proposed development and direction of view: 3096 m, 227°
 Height of camera above ground: 1.5m

NOTES:
 This image provides landscape and visual context only
 View flat at a comfortable arm's length. If viewing on screen enlarge to full screen to gain an overview, enlarge to 100% to have a reasonable impression of the size of the development in the view.


This image is a Type 3 photowire and has been produced in accordance with Landscape Institute Technical Guidance Note 06/19.

Fanellan 400kV Substation & Converter Station Viewpoint 3: View looking south-west from the north-western edge of West Balair Operational View (Photowire: Photowire: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers)



Figure 8.28c Viewpoint 3: View looking south-west from the north-western edge of West Balbir Operational View (Photowire: SSEN Cumulative Overhead Line Schemes Only)

Alignment information correct as of 22.12.2024

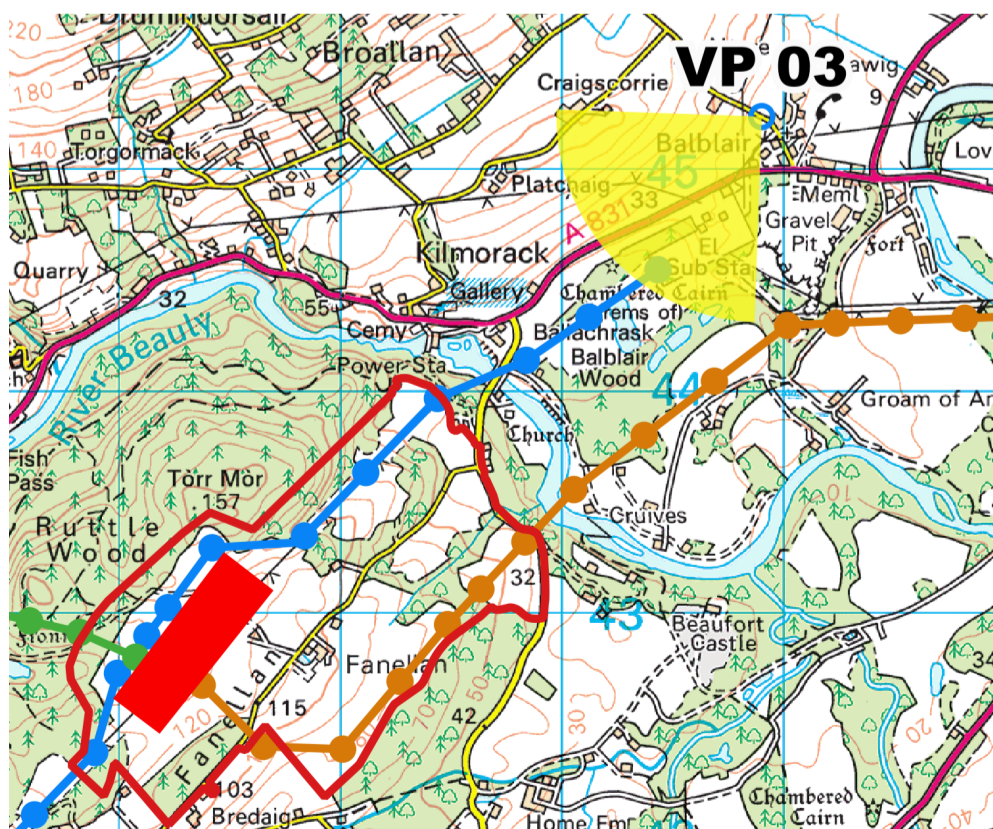

- Key:**
- Fanellan 400kV Substation & Converter Station
 - Proposed Beauly to Peterhead 400 kV Overhead Line (BBNP)
 - Proposed Spittal to Beauly 400 kV Overhead Line (SLBB)
 - Proposed Beauly to Denny 400 kV Overhead Line Permanent
 - Diversion and Permanent Tie-ins (to the Proposed Development)

Visualisation Type: Type 3
 Projection: Cylindrical
 Enlargement Factor: 100% @ A1
 Date and time of photography: 5/3/2024, 16:27
 Camera & lens: Sony ILCE-7M4, 50mm

Vertical Field of View: 39.6° Horizontal Field of View: 90°
 Viewpoint location: X 250901, Y 845234, AOD 26m
 Distance (in m) to proposed development and direction of view: 3096 m, 227°
 Height of camera above ground: 1.5m


NOTES:
 This image provides landscape and visual context only
 View flat at a comfortable arm's length. If viewing on screen enlarge to full screen to gain an overview, enlarge to 100% to have a reasonable impression of the size of the development in the view.

This image is a Type 3 photowire and has been produced in accordance with Landscape Institute Technical Guidance Note 06/19.

Fanellan 400kV Substation & Converter Station
Viewpoint 3: View looking south-west from the north-western edge of West Balbir
 Operational View
 (Photowire: SSEN Cumulative Overhead Line Schemes Only)



Figure 8.28d Viewpoint 3: View looking south-west from the north-western edge of West Balbair
Operational View (Photomontage: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers - Year 0)
 Alignment information correct as of 22.12.2024

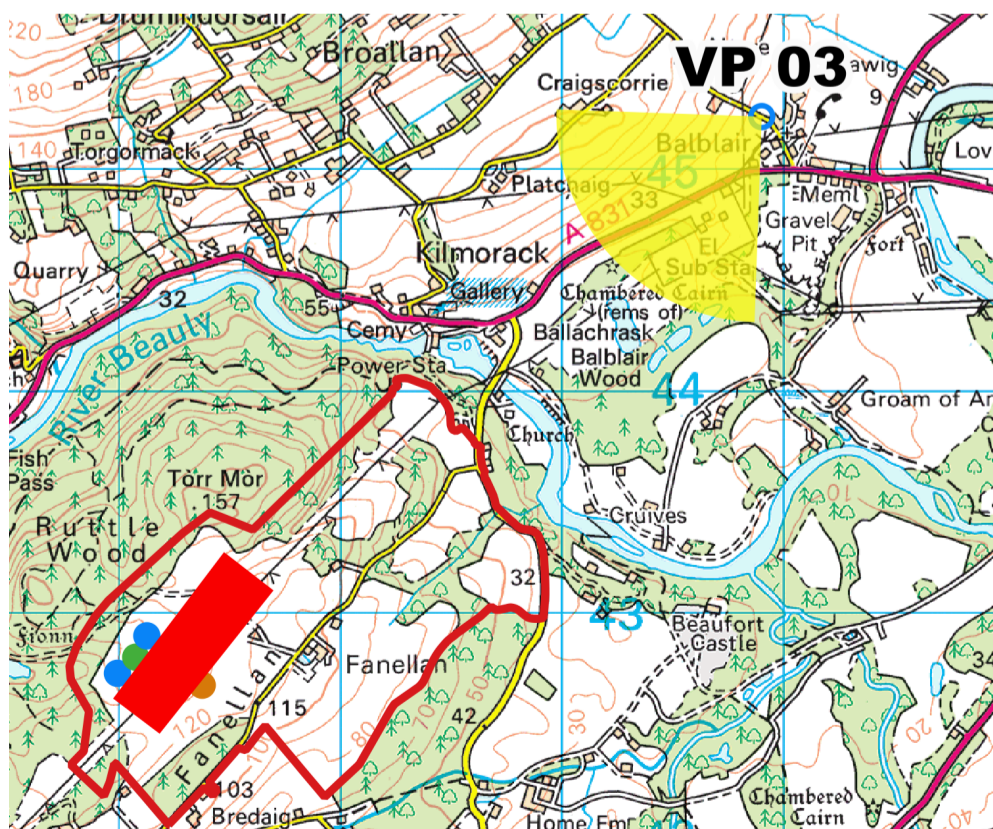

- Key:**
- Fanellan 400kV Substation & Converter Station
 - Proposed Beauly to Peterhead 400 kV Overhead Line (BBNP)
 - Proposed Spittal to Beauly 400 kV Overhead Line (SLBB)
 - Proposed Beauly to Denny 400 kV Overhead Line Permanent Diversion and Permanent Tie-ins (to the Proposed Development)

Visualisation Type: Type 3
 Projection: Cylindrical
 Enlargement Factor: 100% @ A1
 Date and time of photography: 5/3/2024, 16:27
 Camera & lens: Sony ILCE-7M4, 50mm

Vertical Field of View: 39.6° Horizontal Field of View: 90°
 Viewpoint location: X 250901, Y 845234, AOD 26m
 Distance (in m) to proposed development and direction of view: 3096 m, 227°
 Height of camera above ground: 1.5m

NOTES:
 This image provides landscape and visual context only
 View flat at a comfortable arm's length. If viewing on screen enlarge to full screen to gain an overview, enlarge to 100% to have a reasonable impression of the size of the development in the view.


This image is a Type 3 photomontage and has been produced in accordance with Landscape Institute Technical Guidance Note 06/19.

Fanellan 400kV Substation & Converter Station
Viewpoint 3: View looking south-west from the north-western edge of West Balbair
Operational View
 (Photomontage: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers - Year 0)



Figure 8.28e Viewpoint 3: View looking south-west from the north-western edge of West Balbair Operational View (Photomontage: SSEN Cumulative Overhead Line Schemes Only - Year 0)

Alignment information correct as of 22.12.2024

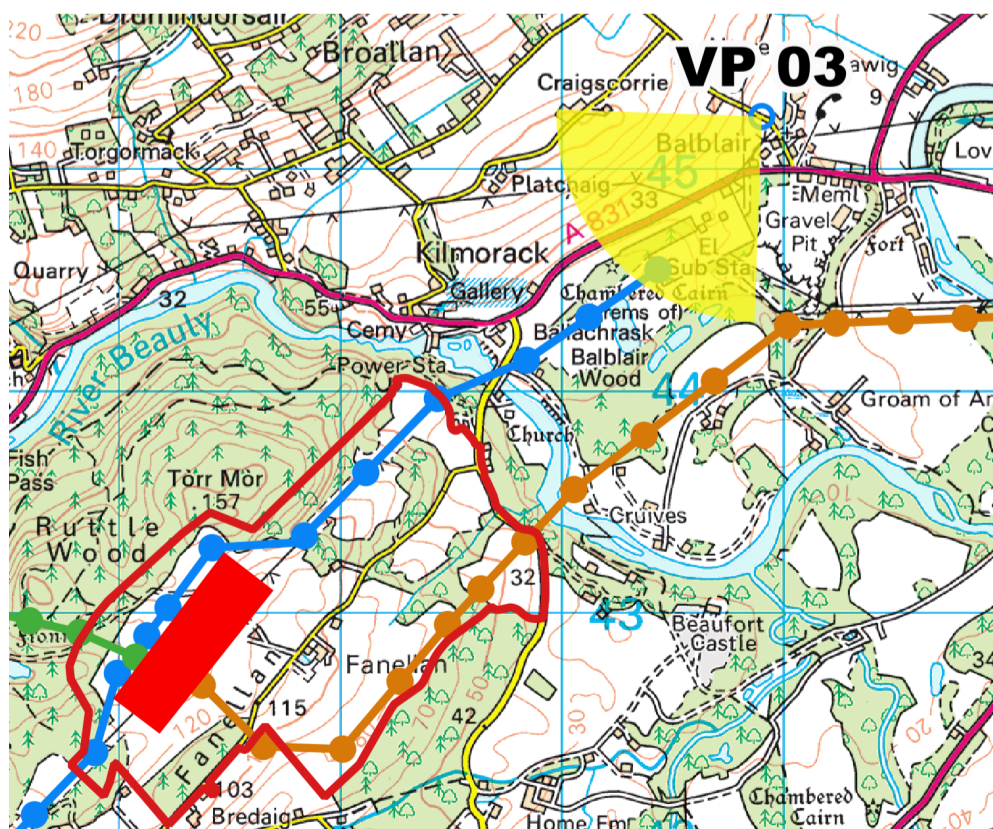

- Key:**
- Fanellan 400kV Substation & Converter Station
 - Proposed Beauly to Peterhead 400 kV Overhead Line (BBNP)
 - Proposed Spittal to Beauly 400 kV Overhead Line (SLBB)
 - Proposed Beauly to Denny 400 kV Overhead Line Permanent
 - Diversion and Permanent Tie-ins (to the Proposed Development)

Visualisation Type: Type 3
 Projection: Cylindrical
 Enlargement Factor: 100% @ A1
 Date and time of photography: 5/3/2024, 16:27
 Camera & lens: Sony ILCE-7M4, 50mm

Vertical Field of View: 39.6° Horizontal Field of View: 90°
 Viewpoint location: X 250901, Y 845234, AOD 26m
 Distance (in m) to proposed development and direction of view: 3096 m, 227°
 Height of camera above ground: 1.5m

NOTES:
 This image provides landscape and visual context only
 View flat at a comfortable arm's length. If viewing on screen enlarge to full screen to gain an overview, enlarge to 100% to have a reasonable impression of the size of the development in the view.


This image is a Type 3 photomontage and has been produced in accordance with Landscape Institute Technical Guidance Note 06/19.

Fanellan 400kV Substation & Converter Station Viewpoint 3: View looking south-west from the north-western edge of West Balbair Operational View (Photomontage: SSEN Cumulative Overhead Line Schemes Only - Year 0)



**Figure 8.28f Viewpoint 3: View looking south-west from the north-western edge of West Balbair
Operational View (Photomontage: Fanellan 400kV Substation & Converter Station & SSEN Cumulative
Terminal Towers - Year 15)**

Alignment information correct as of 22.12.2024

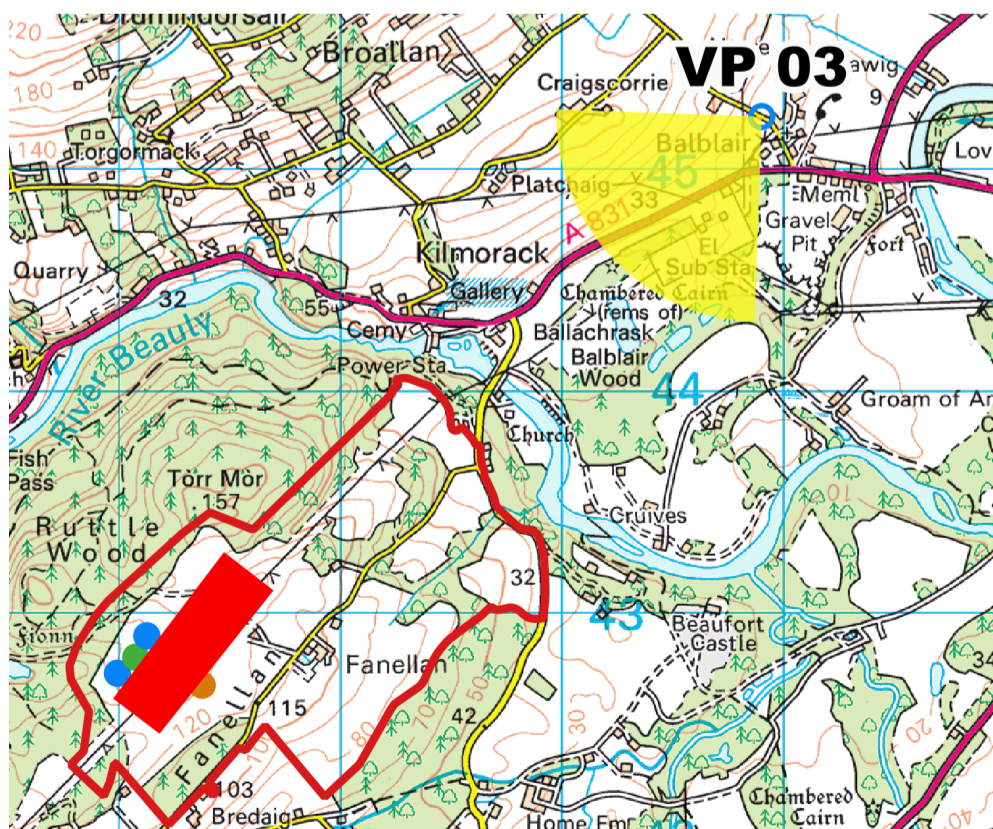

- Key:**
- Fanellan 400kV Substation & Converter Station
 - Proposed Beauly to Peterhead 400 kV Overhead Line (BBNP)
 - Proposed Spittal to Beauly 400 kV Overhead Line (SLBB)
 - Proposed Beauly to Denny 400 kV Overhead Line Permanent
 - Diversion and Permanent Tie-ins (to the Proposed Development)

Visualisation Type: Type 3
 Projection: Cylindrical
 Enlargement Factor: 100% @ A1
 Date and time of photography: 5/3/2024, 16:27
 Camera & lens: Sony ILCE-7M4, 50mm

Vertical Field of View: 39.6° Horizontal Field of View: 90°
 Viewpoint location: X 250901, Y 845234, AOD 26m
 Distance (in m) to proposed development and
 direction of view: 3096 m, 227°
 Height of camera above ground: 1.5m

NOTES:
 This image provides landscape and visual context only
 View flat at a comfortable arm's length. If viewing on screen enlarge
 to full screen to gain an overview, enlarge to 100% to have a
 reasonable impression of the size of the development in the view.


This image is a Type 3 photomontage and has
 been produced in accordance with Landscape
 Institute Technical Guidance Note 06/19.

**Fanellan 400kV Substation & Converter Station
 Viewpoint 3: View looking south-west from the
 north-western edge of West Balbair
 Operational View
 (Photomontage: Fanellan 400kV Substation & Converter
 Station & SSEN Cumulative Terminal Towers - Year 15)**



Figure 8.28g Viewpoint 3: View looking south-west from the north-western edge of West Balbair
Operational View (Photomontage: SSEN Cumulative Overhead Line Schemes Only - Year 15)

Alignment information correct as of 22.12.2024

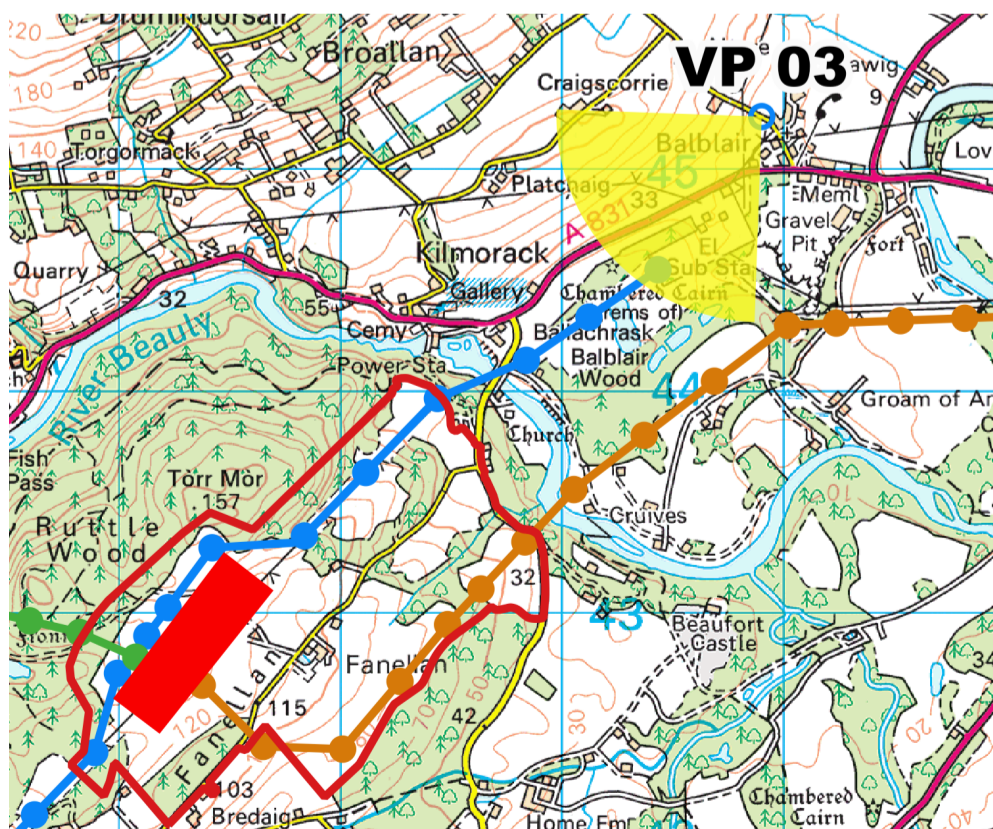

- Key:**
- Fanellan 400kV Substation & Converter Station
 - Proposed Beauly to Peterhead 400 kV Overhead Line (BBNP)
 - Proposed Spittal to Beauly 400 kV Overhead Line (SLBB)
 - Proposed Beauly to Denny 400 kV Overhead Line Permanent
 - Diversion and Permanent Tie-ins (to the Proposed Development)

Visualisation Type: Type 3
 Projection: Cylindrical
 Enlargement Factor: 100% @ A1
 Date and time of photography: 5/3/2024, 16:27
 Camera & lens: Sony ILCE-7M4, 50mm

Vertical Field of View: 39.6° Horizontal Field of View: 90°
 Viewpoint location: X 250901, Y 845234, AOD 26m
 Distance (in m) to proposed development and direction of view: 3096 m, 227°
 Height of camera above ground: 1.5m

NOTES:
 This image provides landscape and visual context only
 View flat at a comfortable arm's length. If viewing on screen enlarge to full screen to gain an overview, enlarge to 100% to have a reasonable impression of the size of the development in the view.

This image is a Type 3 photomontage and has been produced in accordance with Landscape Institute Technical Guidance Note 06/19.

Fanellan 400kV Substation & Converter Station
Viewpoint 3: View looking south-west from the north-western edge of West Balbair
Operational View
 (Photomontage: SSEN Cumulative Overhead Line Schemes Only - Year 15)



Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.14-h Viewpoint 3: View looking south-west from the north-western edge of West Balbair

Operational View (Photowire: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers) - 50mm

Viewpoint Location: X 250901, Y 845234 AOD: 26m
Distance to Development and Direction of view: 3096m, 227°
Date: 05/03/2024

The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m



TRANSMISSION



Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.14-i Viewpoint 3: View looking south-west from the north-western edge of West Balbar
Operational View (Photowire: SSEN Cumulative Overhead Line Schemes Only) - 50mm

Viewpoint Location: X 250901, Y 845234 AOD: 26m
Distance to Development and Direction of view: 3096m, 227°
Date: 05/03/2024

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
The printed image is representative of the Proposed Development, but is not representative of scale or distance.*



TRANSMISSION



Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.14-j Viewpoint 3: View looking south-west from the north-western edge of West Balbar
Operational View (Photomontage: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers - Year 0) - 50mm

Viewpoint Location: X 250901, Y 845234 AOD: 26m
Distance to Development and Direction of view: 3096m, 227°
Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m



TRANSMISSION



Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.14-k Viewpoint 3: View looking south-west from the north-western edge of West Balbar
Operational View (Photomontage: SSEN Cumulative Overhead Line Schemes Only - Year 0) - 50mm

Viewpoint Location: X 250901, Y 845234 AOD: 26m
Distance to Development and Direction of view: 3096m, 227°
Date: 05/03/2024

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
The printed image is representative of the Proposed Development, but is not representative of scale or distance.*



TRANSMISSION



Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.14-I Viewpoint 3: View looking south-west from the north-western edge of West Balbar
Operational View (Photomontage: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers - Year 15) - 50mm

Viewpoint Location: X 250901, Y 845234 AOD: 26m
Distance to Development and Direction of view: 3096m, 227°
Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m



TRANSMISSION



Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.14-m Viewpoint 3: View looking south-west from the north-western edge of West Balbar
Operational View (Photomontage: SSEN Cumulative Overhead Line Schemes Only - Year 15) - 50mm

Viewpoint Location: X 250901, Y 845234 AOD: 26m
Distance to Development and Direction of view: 3096m, 227°
Date: 05/03/2024

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
The printed image is representative of the Proposed Development, but is not representative of scale or distance.*



TRANSMISSION