




Figure 8.37a Viewpoint 12: View looking north-east from Crask of Aigas  
Existing View

Alignment information correct as of 22.12.2024

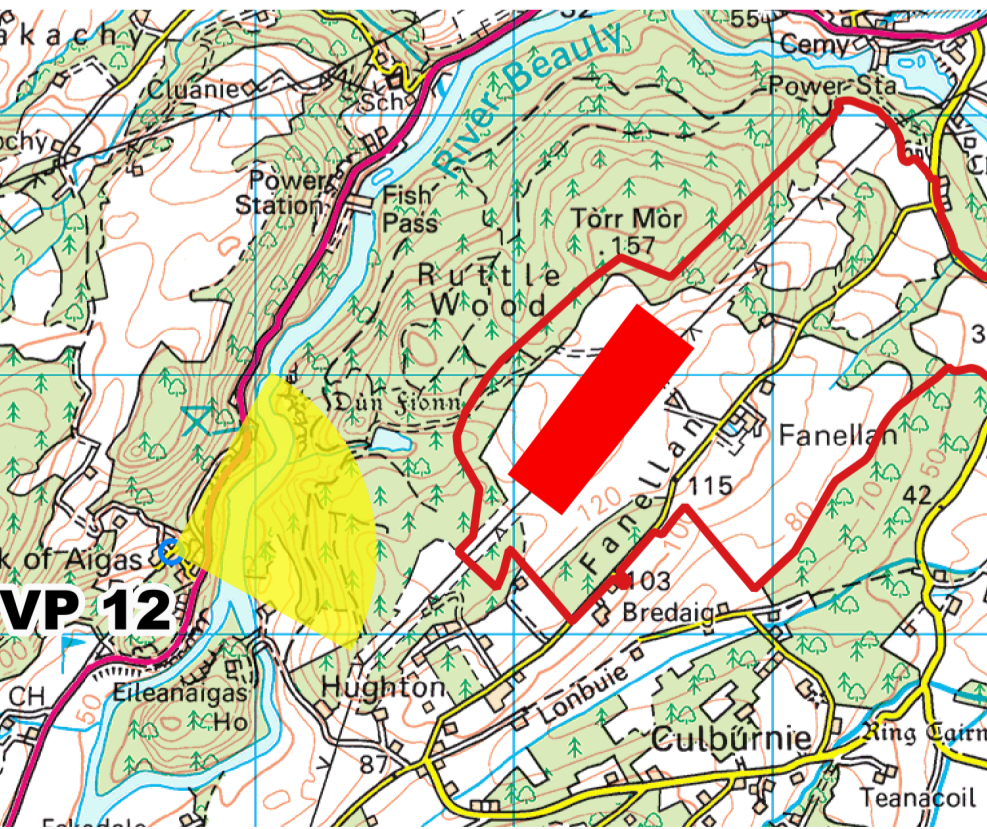

Visualisation Type: Type 3  
Projection: Cylindrical  
Enlargement Factor: 100% @ A1  
Date and time of photography: 5/3/2024, 15:34  
Camera & lens: Sony ILCE-7M4, 50mm

Vertical Field of View: 39.6° Horizontal Field of View: 90°  
Viewpoint location: X 246676, Y 842315, AOD 101m  
Distance (in m) to proposed development and direction of view: 1336 m, 74°  
Height of camera above ground: 1.5m

NOTES:  
This image provides landscape and visual context only  
View flat at a comfortable arm's length. If viewing on screen enlarge to full screen to gain an overview, enlarge to 100% to have a reasonable impression of the size of the development in the view.

This image is an existing view to support a Type 3 photomontage and has been produced in accordance with Landscape Institute Technical Guidance Note 06/19.

Fanellan 400kV Substation & Converter Station  
Viewpoint 12: View looking north-east from Crask of Aigas


Existing View





Figure 8.37b Viewpoint 12: View looking north-east from Crask of Aigas  
Operational View (Photowire: Fanellan 400kV Substation & Converter Station & SSEN Cumulative  
Terminal Towers)

Alignment information correct as of 22.12.2024

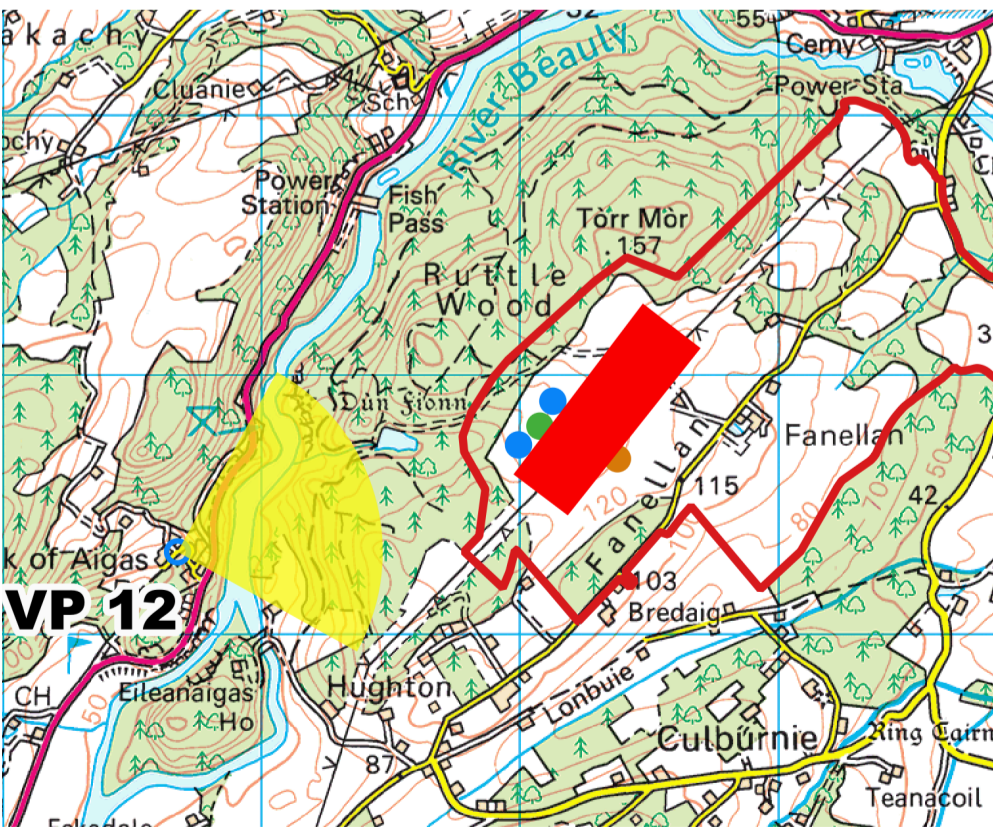

- Key:**
- Fanellan 400kV Substation & Converter Station
  - Proposed Beauly to Peterhead 400 kV Overhead Line (BBNP)
  - Proposed Spittal to Beauly 400 kV Overhead Line (SLBB)
  - Proposed Beauly to Denny 400 kV Overhead Line Permanent
  - Diversion and Permanent Tie-ins (to the Proposed Development)

Visualisation Type: Type 3  
Projection: Cylindrical  
Enlargement Factor: 100% @ A1  
Date and time of photography: 5/3/2024, 15:34  
Camera & lens: Sony ILCE-7M4, 50mm

Vertical Field of View: 39.6° Horizontal Field of View: 90°  
Viewpoint location: X 246676, Y 842315, AOD 101m  
Distance (in m) to proposed development and  
direction of view: 1336 m, 74°  
Height of camera above ground: 1.5m

**NOTES:**  
This image provides landscape and visual context only  
View flat at a comfortable arm's length. If viewing on screen enlarge  
to full screen to gain an overview, enlarge to 100% to have a  
reasonable impression of the size of the development in the view.

This image is a Type 3 photowire and has  
been produced in accordance with Landscape  
Institute Technical Guidance Note 06/19.


Fanellan 400kV Substation & Converter Station  
Viewpoint 12: View looking north-east from  
Crask of Aigas  
Operational View  
(Photowire: Fanellan 400kV Substation & Converter  
Station & SSEN Cumulative Terminal Towers)





Figure 8.37c Viewpoint 12: View looking north-east from Crask of Aigas  
Operational View (Photowire: SSEN Cumulative Overhead Line Schemes Only)

Alignment information correct as of 22.12.2024

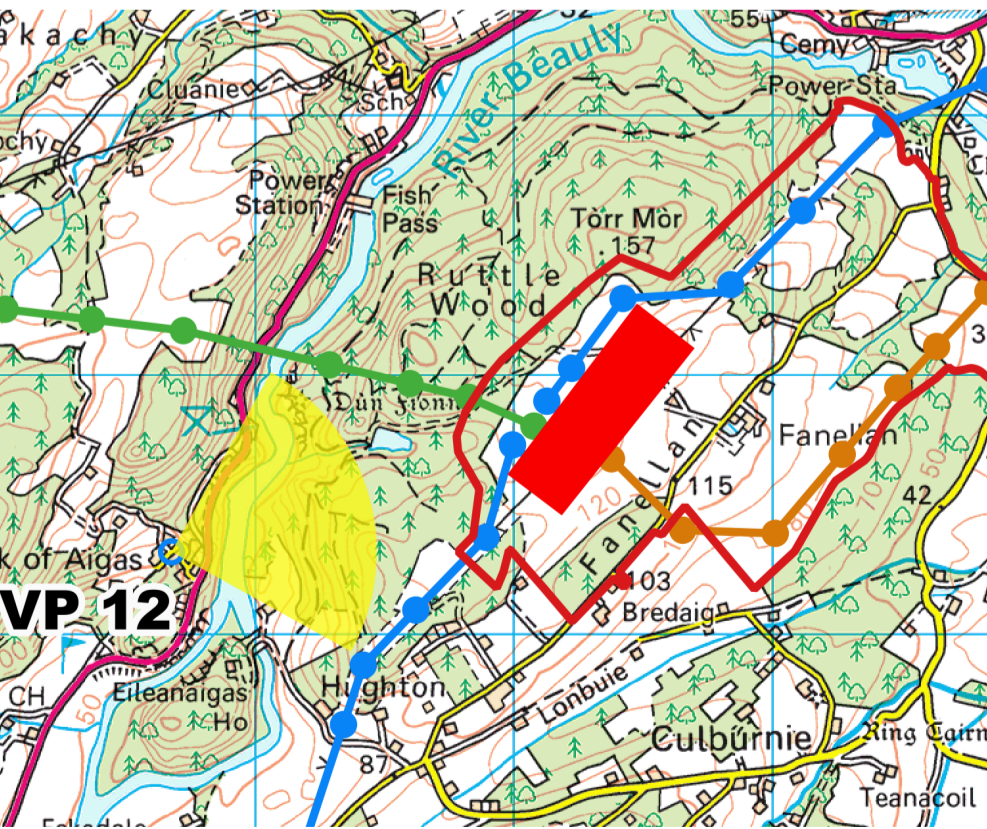

- Key:**
- Fanellan 400kV Substation & Converter Station
  - Proposed Beauly to Peterhead 400 kV Overhead Line (BBNP)
  - Proposed Spittal to Beauly 400 kV Overhead Line (SLBB)
  - Proposed Beauly to Denny 400 kV Overhead Line Permanent
  - Diversion and Permanent Tie-ins (to the Proposed Development)

Visualisation Type: Type 3  
Projection: Cylindrical  
Enlargement Factor: 100% @ A1  
Date and time of photography: 5/3/2024, 15:34  
Camera & lens: Sony ILCE-7M4, 50mm

Vertical Field of View: 39.6° Horizontal Field of View: 90°  
Viewpoint location: X 246676, Y 842315, AOD 101m  
Distance (in m) to proposed development and direction of view: 1336 m, 74°  
Height of camera above ground: 1.5m

**NOTES:**  
This image provides landscape and visual context only  
View flat at a comfortable arm's length. If viewing on screen enlarge to full screen to gain an overview, enlarge to 100% to have a reasonable impression of the size of the development in the view.


This image is a Type 3 photowire and has been produced in accordance with Landscape Institute Technical Guidance Note 06/19.

Fanellan 400kV Substation & Converter Station  
Viewpoint 12: View looking north-east from Crask of Aigas  
Operational View  
(Photowire: SSEN Cumulative Overhead Line Schemes Only)





**Figure 8.37d Viewpoint 12: View looking north-east from Crask of Aigas**  
**Operational View (Photomontage: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers - Year 0)**  
Alignment information correct as of 22.12.2024

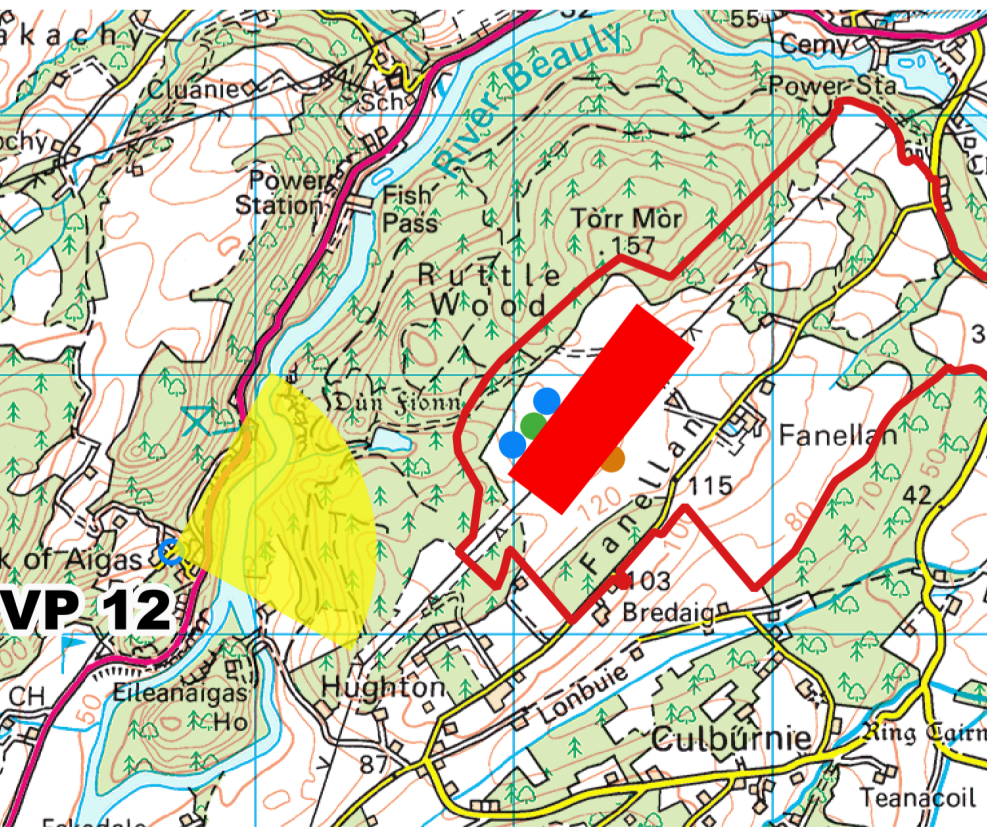

- Key:**
- Fanellan 400kV Substation & Converter Station
  - Proposed Beauly to Peterhead 400 kV Overhead Line (BBNP)
  - Proposed Spittal to Beaulish 400 kV Overhead Line (SLBB)
  - Proposed Beauly to Denny 400 kV Overhead Line Permanent
  - Diversion and Permanent Tie-ins (to the Proposed Development)

**Visualisation Type:** Type 3  
**Projection:** Cylindrical  
**Enlargement Factor:** 100% @ A1  
**Date and time of photography:** 5/3/2024, 15:34  
**Camera & lens:** Sony ILCE-7M4, 50mm

**Vertical Field of View:** 39.6° **Horizontal Field of View:** 90°  
**Viewpoint location:** X 246676, Y 842315, AOD 101m  
**Distance (in m) to proposed development and direction of view:** 1336 m, 74°  
**Height of camera above ground:** 1.5m

**NOTES:**  
This image provides landscape and visual context only  
View flat at a comfortable arm's length. If viewing on screen enlarge to full screen to gain an overview, enlarge to 100% to have a reasonable impression of the size of the development in the view.

This image is a Type 3 photomontage and has been produced in accordance with Landscape Institute Technical Guidance Note 06/19.


**Fanellan 400kV Substation & Converter Station**  
**Viewpoint 12: View looking north-east from Crask of Aigas**  
**Operational View**  
**(Photomontage: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers - Year 0)**





Figure 8.37e Viewpoint 12: View looking north-east from Crask of Aigas  
Operational View (Photomontage: SSEN Cumulative Overhead Line Schemes Only - Year 0)

Alignment information correct as of 22.12.2024

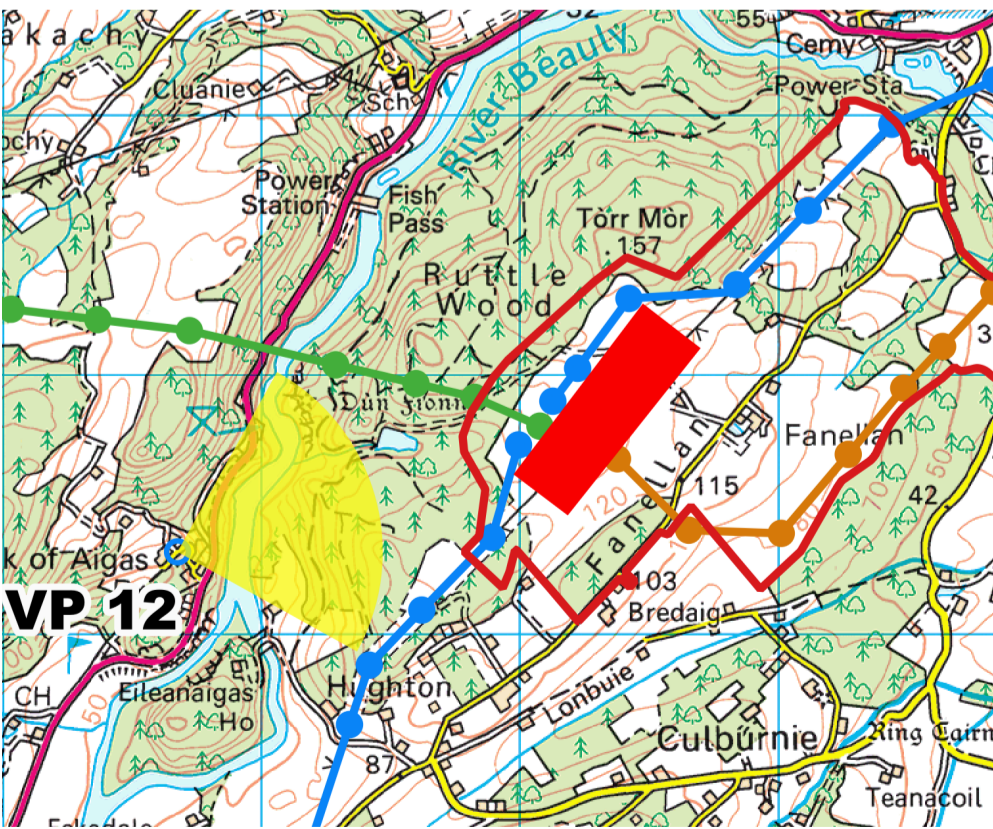

- Key:**
- Fanellan 400kV Substation & Converter Station
  - Proposed Beauly to Peterhead 400 kV Overhead Line (BBNP)
  - Proposed Spittal to Beauly 400 kV Overhead Line (SLBB)
  - Proposed Beauly to Denny 400 kV Overhead Line Permanent
  - Diversion and Permanent Tie-ins (to the Proposed Development)

Visualisation Type: Type 3  
Projection: Cylindrical  
Enlargement Factor: 100% @ A1  
Date and time of photography: 5/3/2024, 15:34  
Camera & lens: Sony ILCE-7M4, 50mm

Vertical Field of View: 39.6° Horizontal Field of View: 90°  
Viewpoint location: X 246676, Y 842315, AOD 101m  
Distance (in m) to proposed development and direction of view: 1336 m, 74°  
Height of camera above ground: 1.5m

**NOTES:**  
This image provides landscape and visual context only  
View flat at a comfortable arm's length. If viewing on screen enlarge to full screen to gain an overview, enlarge to 100% to have a reasonable impression of the size of the development in the view.


This image is a Type 3 photomontage and has been produced in accordance with Landscape Institute Technical Guidance Note 06/19.

Fanellan 400kV Substation & Converter Station  
Viewpoint 12: View looking north-east from Crask of Aigas  
Operational View  
(Photomontage: SSEN Cumulative Overhead Line Schemes Only - Year 0)





**Figure 8.37f Viewpoint 12: View looking north-east from Crask of Aigas**  
**Operational View (Photomontage: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers - Year 15)**  
Alignment information correct as of 22.12.2024

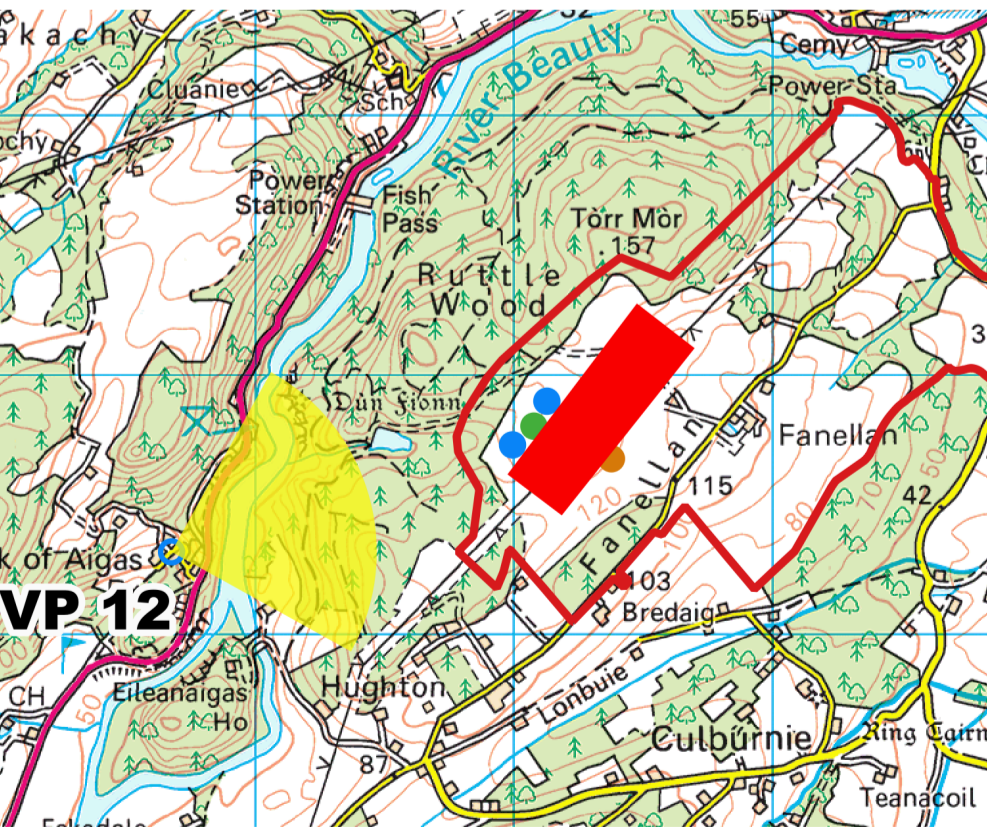

- Key:**
- Fanellan 400kV Substation & Converter Station
  - Proposed Beauly to Peterhead 400 kV Overhead Line (BBNP)
  - Proposed Spittal to Beauly 400 kV Overhead Line (SLBB)
  - Proposed Beauly to Denny 400 kV Overhead Line Permanent
  - Diversion and Permanent Tie-ins (to the Proposed Development)

**Visualisation Type:** Type 3  
**Projection:** Cylindrical  
**Enlargement Factor:** 100% @ A1  
**Date and time of photography:** 5/3/2024, 15:34  
**Camera & lens:** Sony ILCE-7M4, 50mm

**Vertical Field of View:** 39.6° **Horizontal Field of View:** 90°  
**Viewpoint location:** X 246676, Y 842315, AOD 101m  
**Distance (in m) to proposed development and direction of view:** 1336 m, 74°  
**Height of camera above ground:** 1.5m

**NOTES:**  
This image provides landscape and visual context only  
View flat at a comfortable arm's length. If viewing on screen enlarge to full screen to gain an overview, enlarge to 100% to have a reasonable impression of the size of the development in the view.

This image is a Type 3 photomontage and has been produced in accordance with Landscape Institute Technical Guidance Note 06/19.


**Fanellan 400kV Substation & Converter Station**  
**Viewpoint 12: View looking north-east from Crask of Aigas**  
**Operational View**  
**(Photomontage: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers - Year 15)**





Figure 8.37g Viewpoint 12: View looking north-east from Crask of Aigas  
Operational View (Photomontage: SSEN Cumulative Overhead Line Schemes Only - Year 15)

Alignment information correct as of 22.12.2024

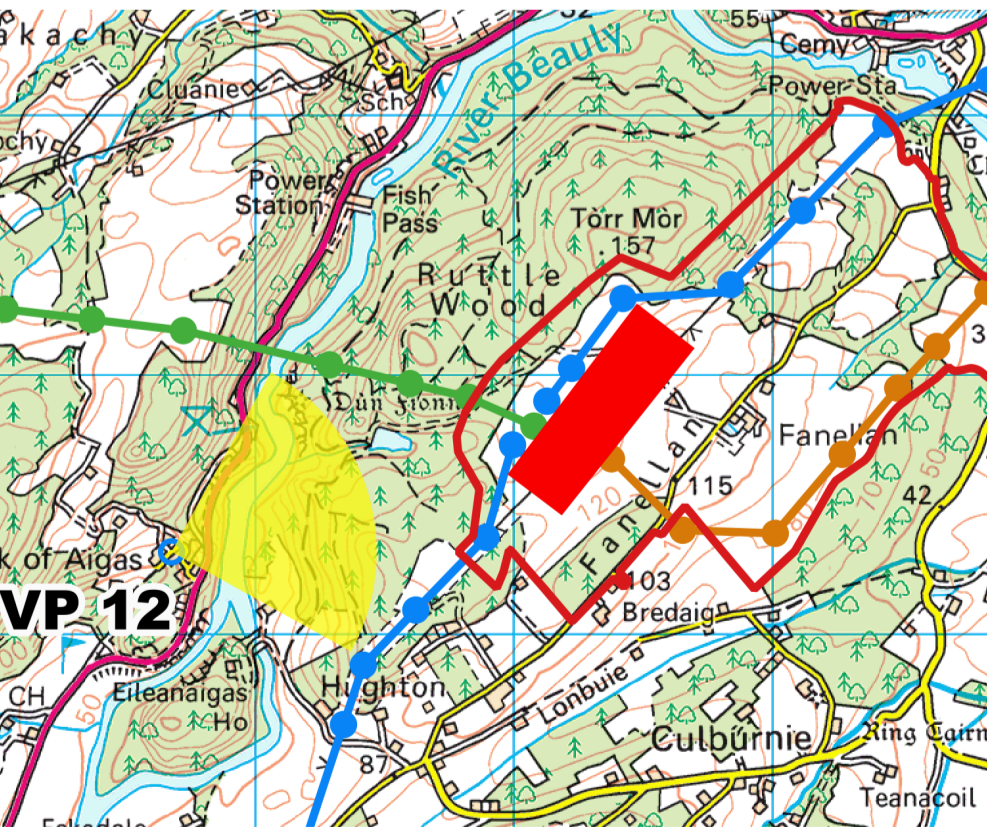

- Key:**
- Fanellan 400kV Substation & Converter Station
  - Proposed Beauly to Peterhead 400 kV Overhead Line (BBNP)
  - Proposed Spittal to Beauly 400 kV Overhead Line (SLBB)
  - Proposed Beauly to Denny 400 kV Overhead Line Permanent
  - Diversion and Permanent Tie-ins (to the Proposed Development)

Visualisation Type: Type 3  
Projection: Cylindrical  
Enlargement Factor: 100% @ A1  
Date and time of photography: 5/3/2024, 15:34  
Camera & lens: Sony ILCE-7M4, 50mm

Vertical Field of View: 39.6° Horizontal Field of View: 90°  
Viewpoint location: X 246676, Y 842315, AOD 101m  
Distance (in m) to proposed development and direction of view: 1336 m, 74°  
Height of camera above ground: 1.5m

**NOTES:**  
This image provides landscape and visual context only  
View flat at a comfortable arm's length. If viewing on screen enlarge to full screen to gain an overview, enlarge to 100% to have a reasonable impression of the size of the development in the view.

This image is a Type 3 photomontage and has been produced in accordance with Landscape Institute Technical Guidance Note 06/19.

Fanellan 400kV Substation & Converter Station  
Viewpoint 12: View looking north-east from Crask of Aigas  
Operational View  
(Photomontage: SSEN Cumulative Overhead Line Schemes Only - Year 15)





Alignment information correct as of 22.12.2024

**Fanellan 400kV Substation & Converter Station**  
**Figure 8.37-h Viewpoint 12: View looking north-east from Crask of Algas**  
 Operational View (Photowire: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers) - 50mm


Viewpoint Location: X 246676, Y 842315 AOD: 101m  
 Distance to Development and Direction of view: 1336m, 74°  
 Date: 05/03/2024

Camera: Sony ILCE-7M4  
 Lens: 50mm  
 Height of camera above the ground: 1.5m

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.  
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*



TRANSMISSION

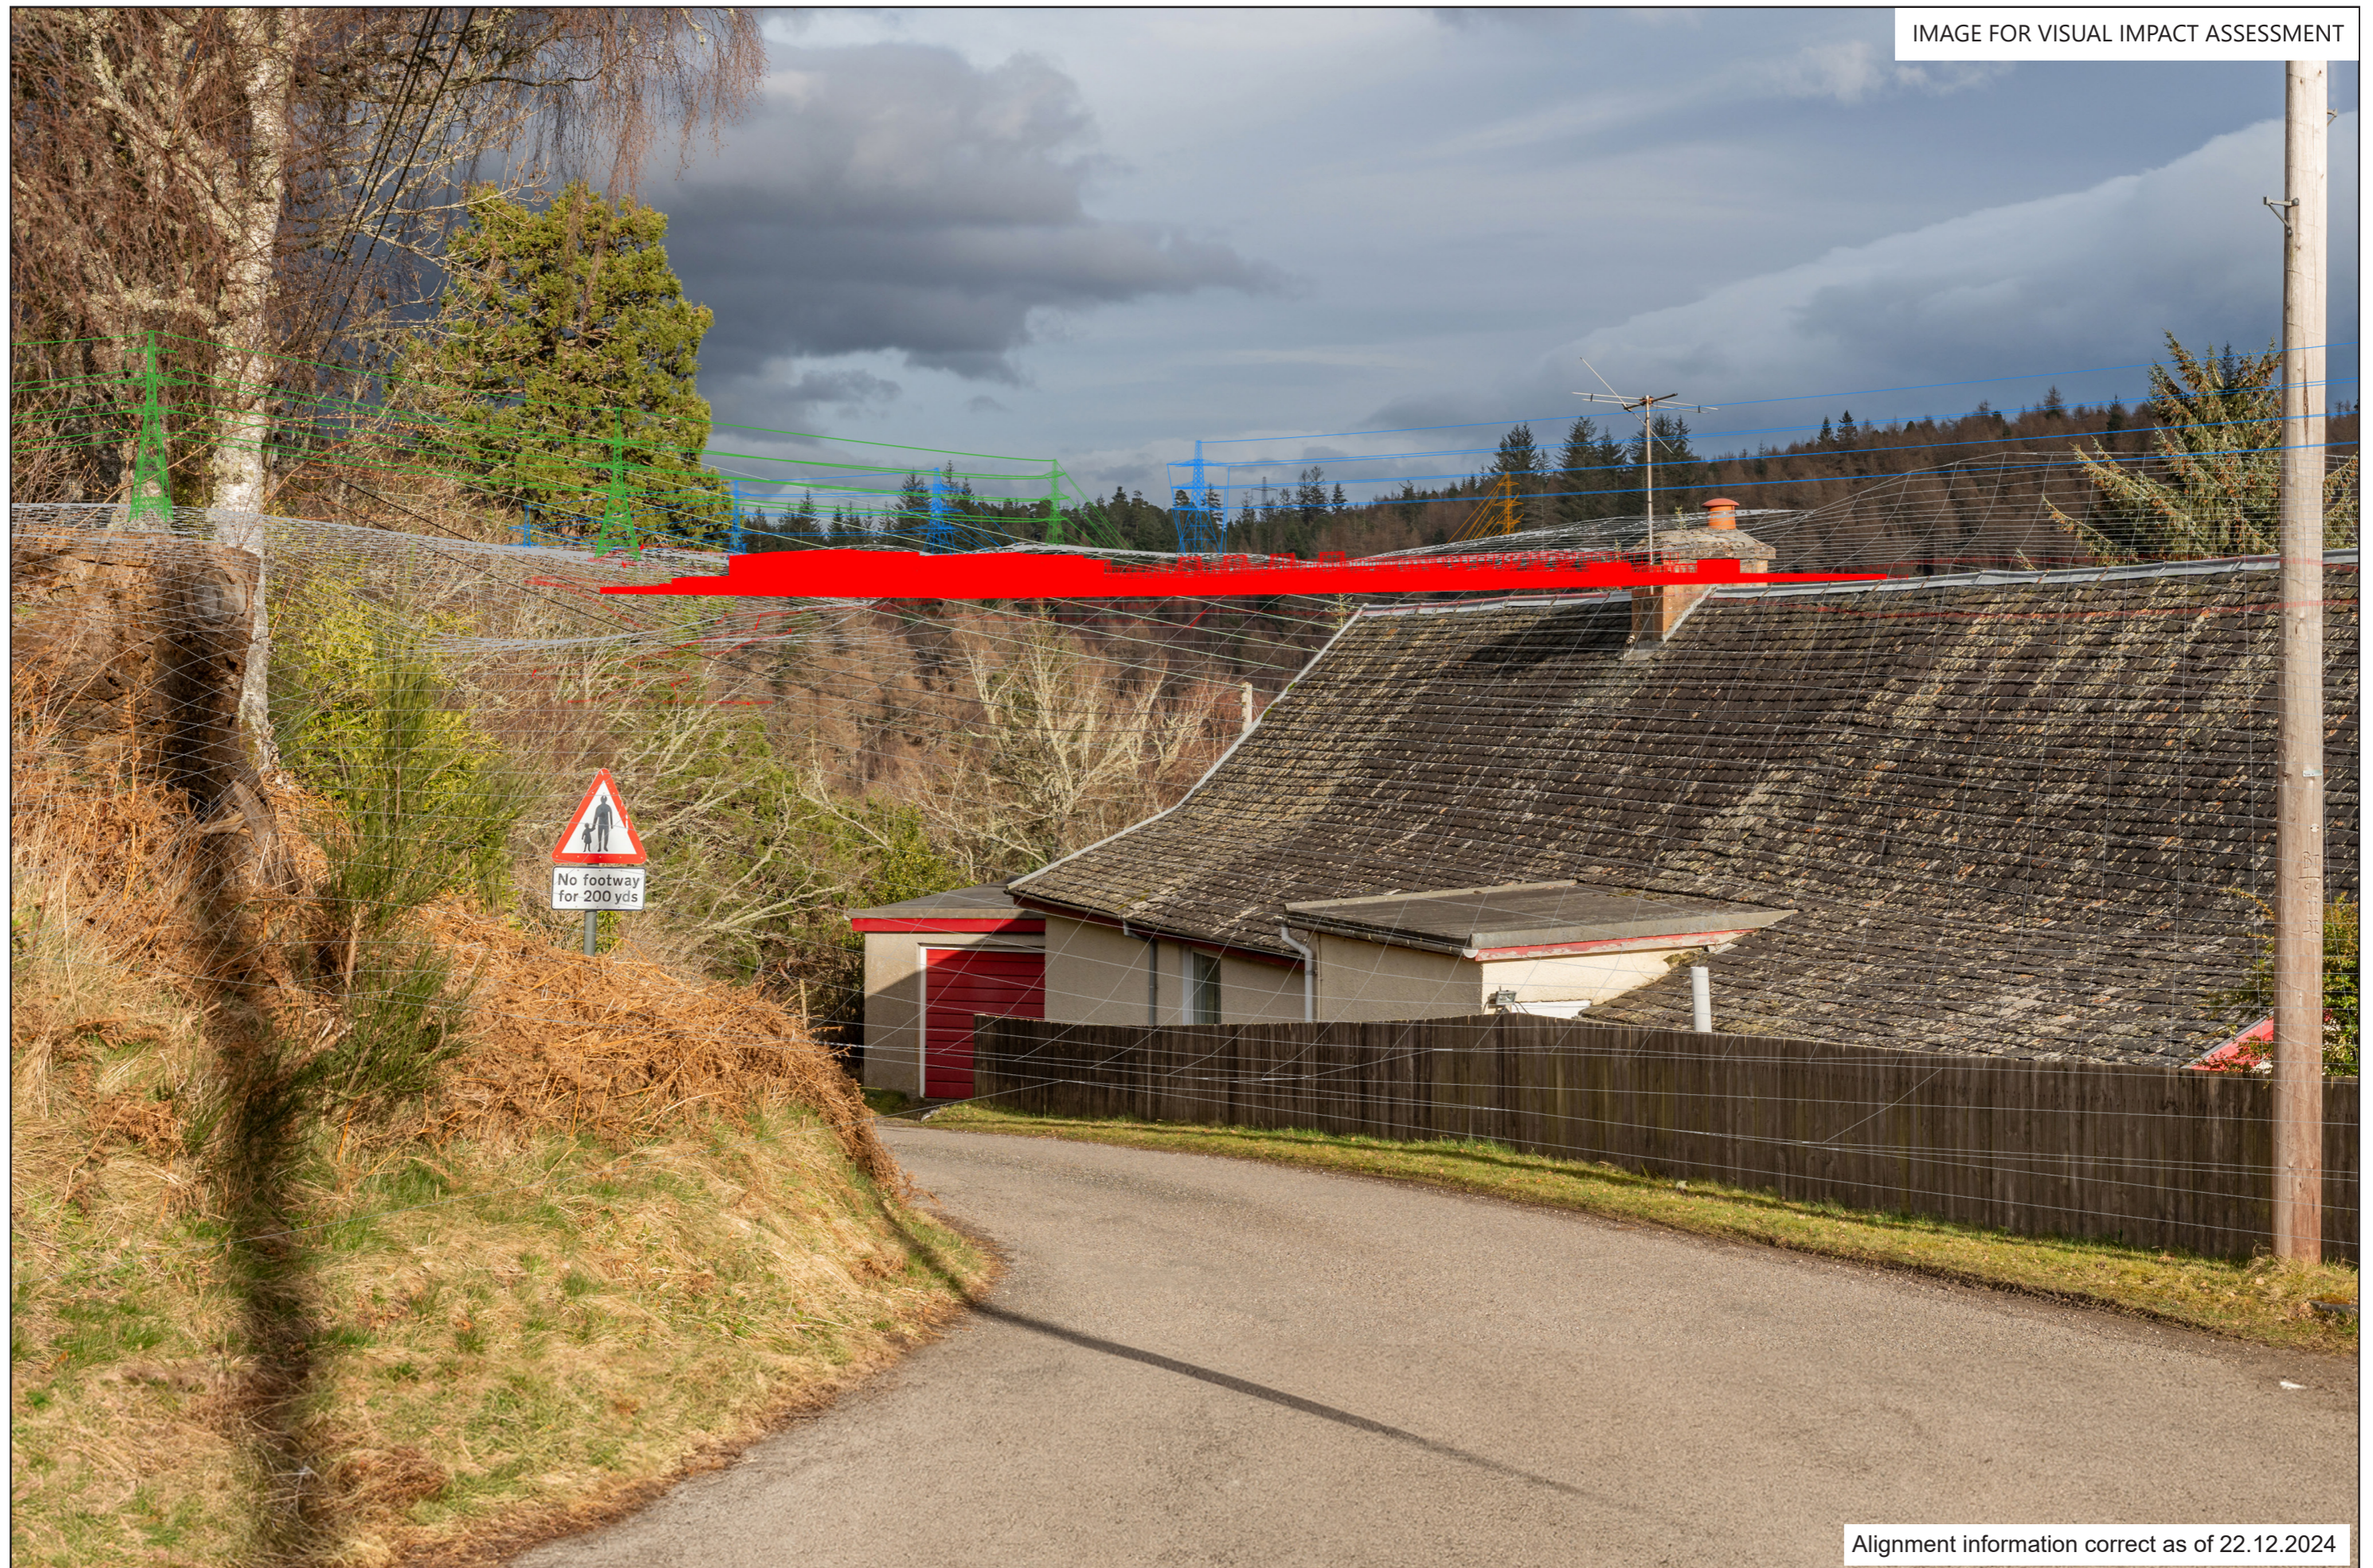

Alignment information correct as of 22.12.2024

**Fanellan 400kV Substation & Converter Station**  
**Figure 8.37-i Viewpoint 12: View looking north-east from Crask of Aigas**  
 Operational View (Photowire: SSN Cumulative Overhead Line Schemes Only) - 50mm

Viewpoint Location: X 246676, Y 842315 AOD: 101m  
 Distance to Development and Direction of view: 1336m, 74°  
 Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.  
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4  
 Lens: 50mm  
 Height of camera above the ground: 1.5m



TRANSMISSION



Alignment information correct as of 22.12.2024

**Fanellan 400kV Substation & Converter Station**  
**Figure 8.37-j Viewpoint 12: View looking north-east from Crask of Aigas**  
 Operational View (Photomontage: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers - Year 0) - 50mm

Viewpoint Location: X 246676, Y 842315 AOD: 101m  
 Distance to Development and Direction of view: 1336m, 74°  
 Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.  
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4  
 Lens: 50mm  
 Height of camera above the ground: 1.5m



TRANSMISSION



Alignment information correct as of 22.12.2024

**Fanellan 400kV Substation & Converter Station**  
**Figure 8.37-k Viewpoint 12: View looking north-east from Crask of Aigas**  
 Operational View (Photomontage: SSEN Cumulative Overhead Line  
 Schemes Only - Year 0) - 50mm

Viewpoint Location: X 246676, Y 842315 AOD: 101m  
 Distance to Development and Direction of view: 1336m, 74°  
 Date: 05/03/2024

Camera: Sony ILCE-7M4  
 Lens: 50mm  
 Height of camera above the ground: 1.5m

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.  
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*



TRANSMISSION



Alignment information correct as of 22.12.2024

**Fanellan 400kV Substation & Converter Station**  
**Figure 8.37-I Viewpoint 12: View looking north-east from Crask of Aigas**  
Operational View (Photomontage: Fanellan 400kV Substation & Converter Station  
& SSEN Cumulative Terminal Towers - Year 15) - 50mm

Viewpoint Location: X 246676, Y 842315 AOD: 101m  
Distance to Development and Direction of view: 1336m, 74°  
Date: 05/03/2024  
*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.  
The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4  
Lens: 50mm  
Height of camera above the ground: 1.5m





Alignment information correct as of 22.12.2024

**Fanellan 400kV Substation & Converter Station**  
**Figure 8.37-m Viewpoint 12: View looking north-east from Crask of Aigas**  
 Operational View (Photomontage: SSEN Cumulative Overhead Line  
 Schemes Only - Year 15) - 50mm

Viewpoint Location: X 246676, Y 842315 AOD: 101m  
 Distance to Development and Direction of view: 1336m, 74°  
 Date: 05/03/2024

Camera: Sony ILCE-7M4  
 Lens: 50mm  
 Height of camera above the ground: 1.5m

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.  
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*



TRANSMISSION