



- Indicative Substation Locations
- Proposed Alignment Section A
- Existing Infrastructure
- Existing 132kV OHL
- Existing 275kV OHL

SSEN Transmission take no responsibility for the release or accuracy of latest version basemaps from Ordnance Survey

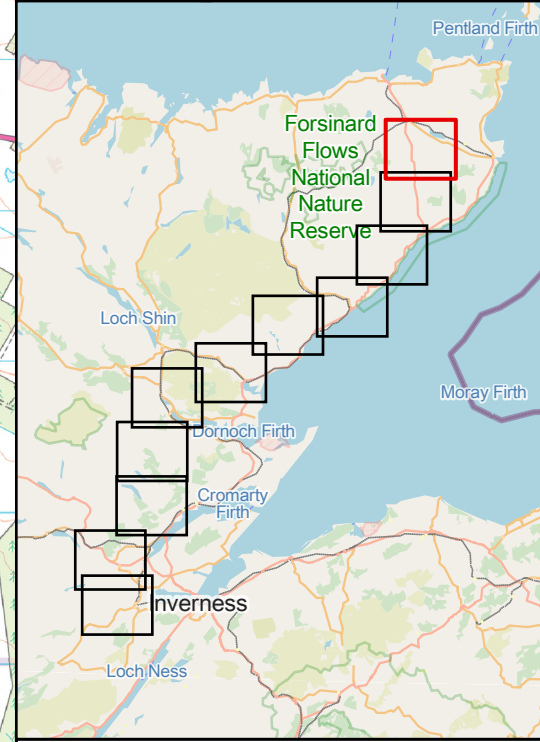

SCALE: See Scale Bar	VERSION: A01
SIZE: A3	DRAWN: CI
PROJECT: 0720281	CHECKED: ES / BM
DATE: 1/13/2025	APPROVED: KG

**Spittal - Loch Buidhe - Beauly 400kV Connection**  
**Proposed Infrastructure**









Proposed Alignment Section A

Existing Infrastructure

Existing 132kV OHL

SSEN Transmission take no responsibility for the release or accuracy of latest version basemaps from Ordnance Survey

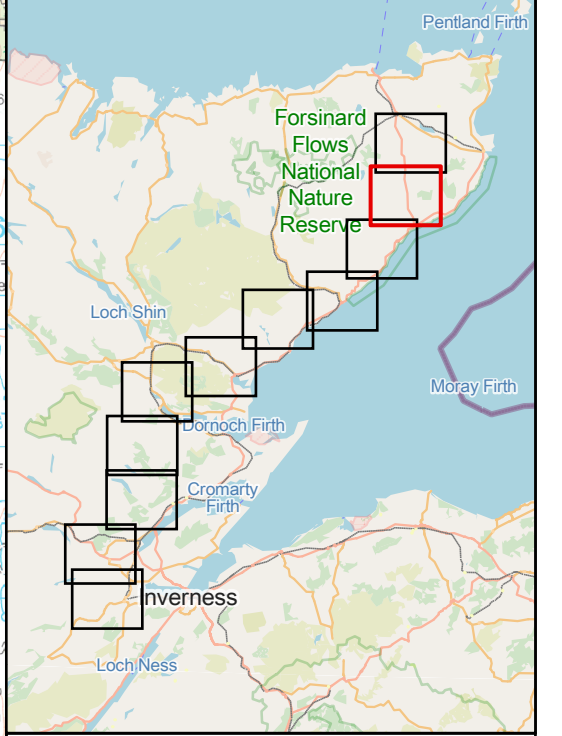

SCALE: See Scale Bar  
 SIZE: A3  
 PROJECT: 0720281  
 DATE: 1/13/2025

VERSION: A01  
 DRAWN: CI  
 CHECKED: ES / BM  
 APPROVED: KG

**Spittal - Loch Buidhe - Beauly 400kV Connection**  
**Proposed Infrastructure**





PROJECTION: British National Grid





- Proposed Alignment Section A
- Existing Infrastructure
- Existing 132kV OHL

SSEN Transmission take no responsibility for the release or accuracy of latest version basemaps from Ordnance Survey

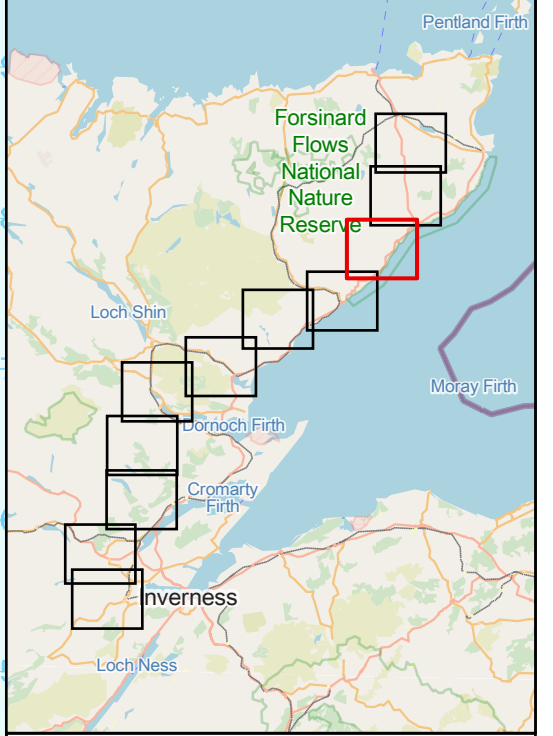


SCALE: See Scale Bar	VERSION: A01
SIZE: A3	DRAWN: CI
PROJECT: 0720281	CHECKED: ES / BM
DATE: 1/13/2025	APPROVED: KG

**Spittal - Loch Buidhe - Beauly 400kV Connection**  
**Proposed Infrastructure**



PROJECTION: British National Grid




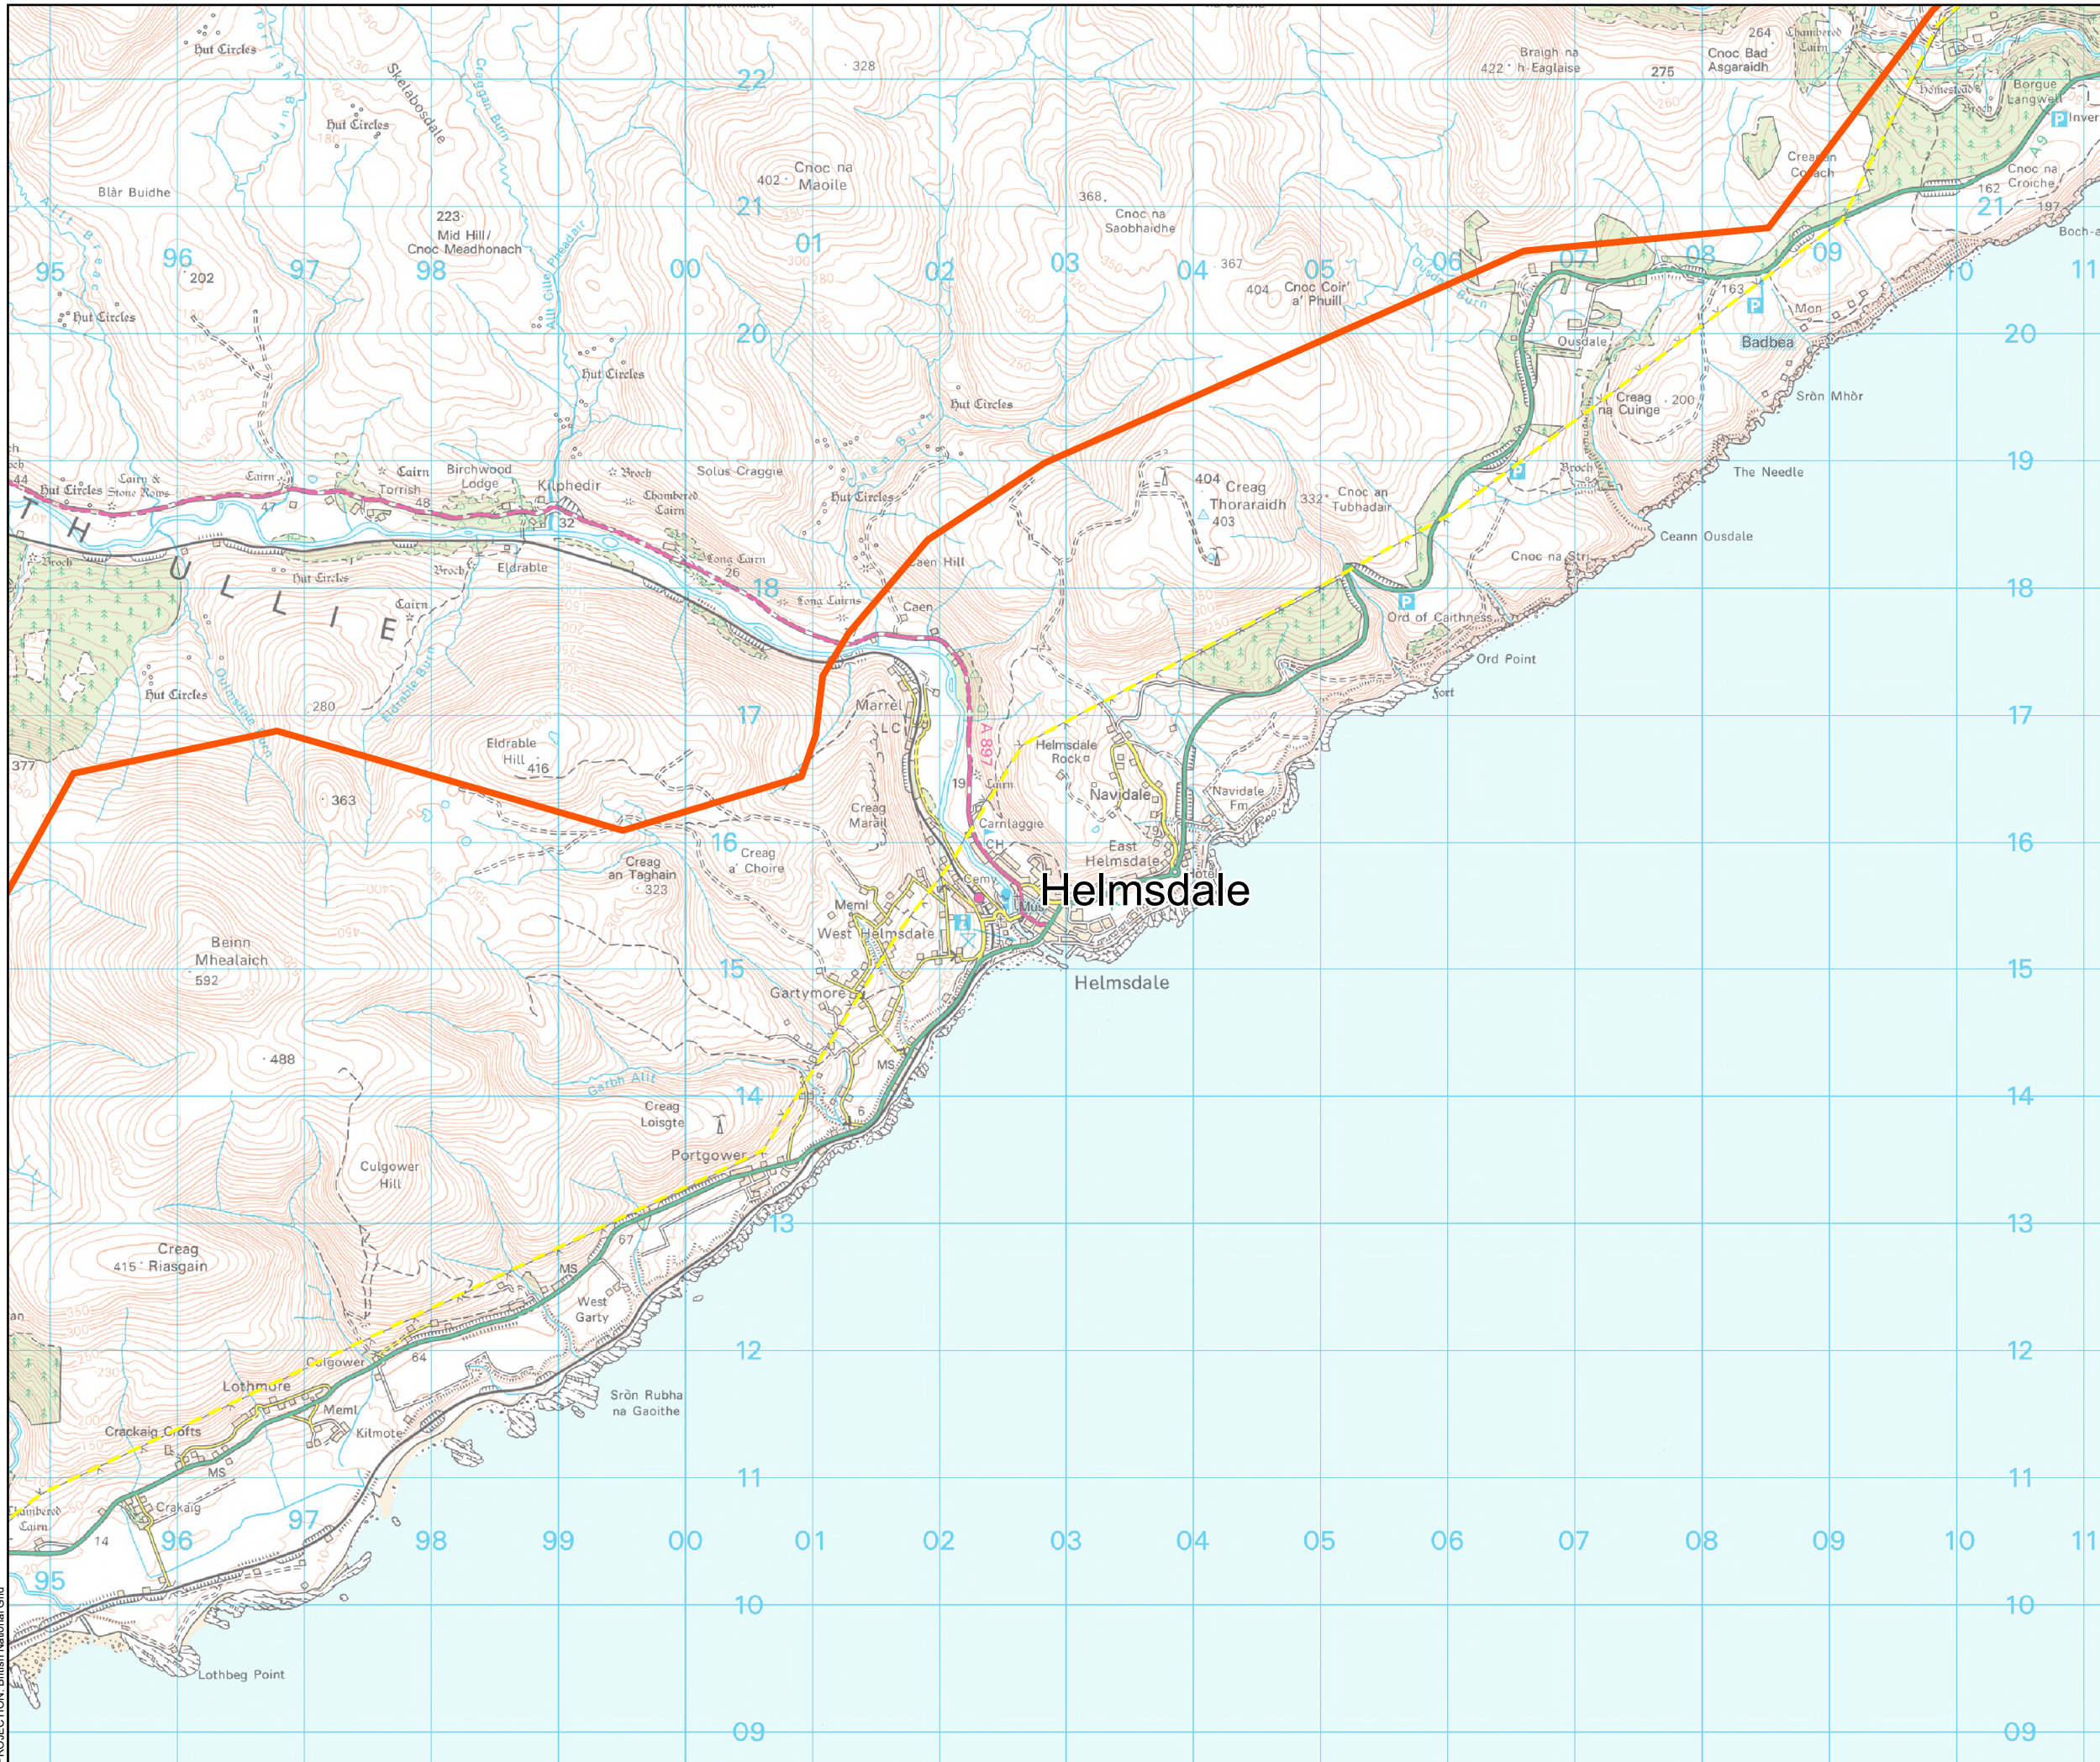


Proposed Alignment Section A

Existing Infrastructure

Existing 132kV OHL

SSEN Transmission take no responsibility for the release or accuracy of latest version basemaps from Ordnance Survey

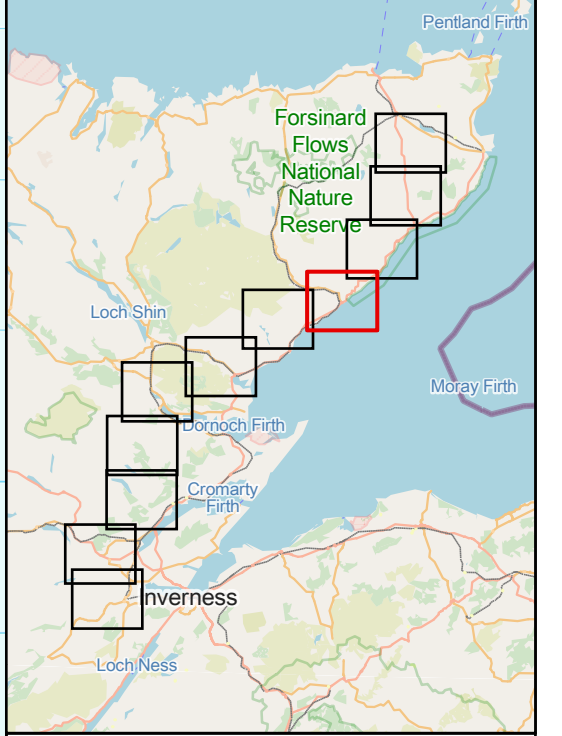

SCALE: See Scale Bar  
 SIZE: A3  
 PROJECT: 0720281  
 DATE: 1/13/2025


VERSION: A01  
 DRAWN: CI  
 CHECKED: ES / BM  
 APPROVED: KG

**Spittal - Loch Buidhe - Beauly 400kV Connection**  
**Proposed Infrastructure**





PROJECTION: British National Grid



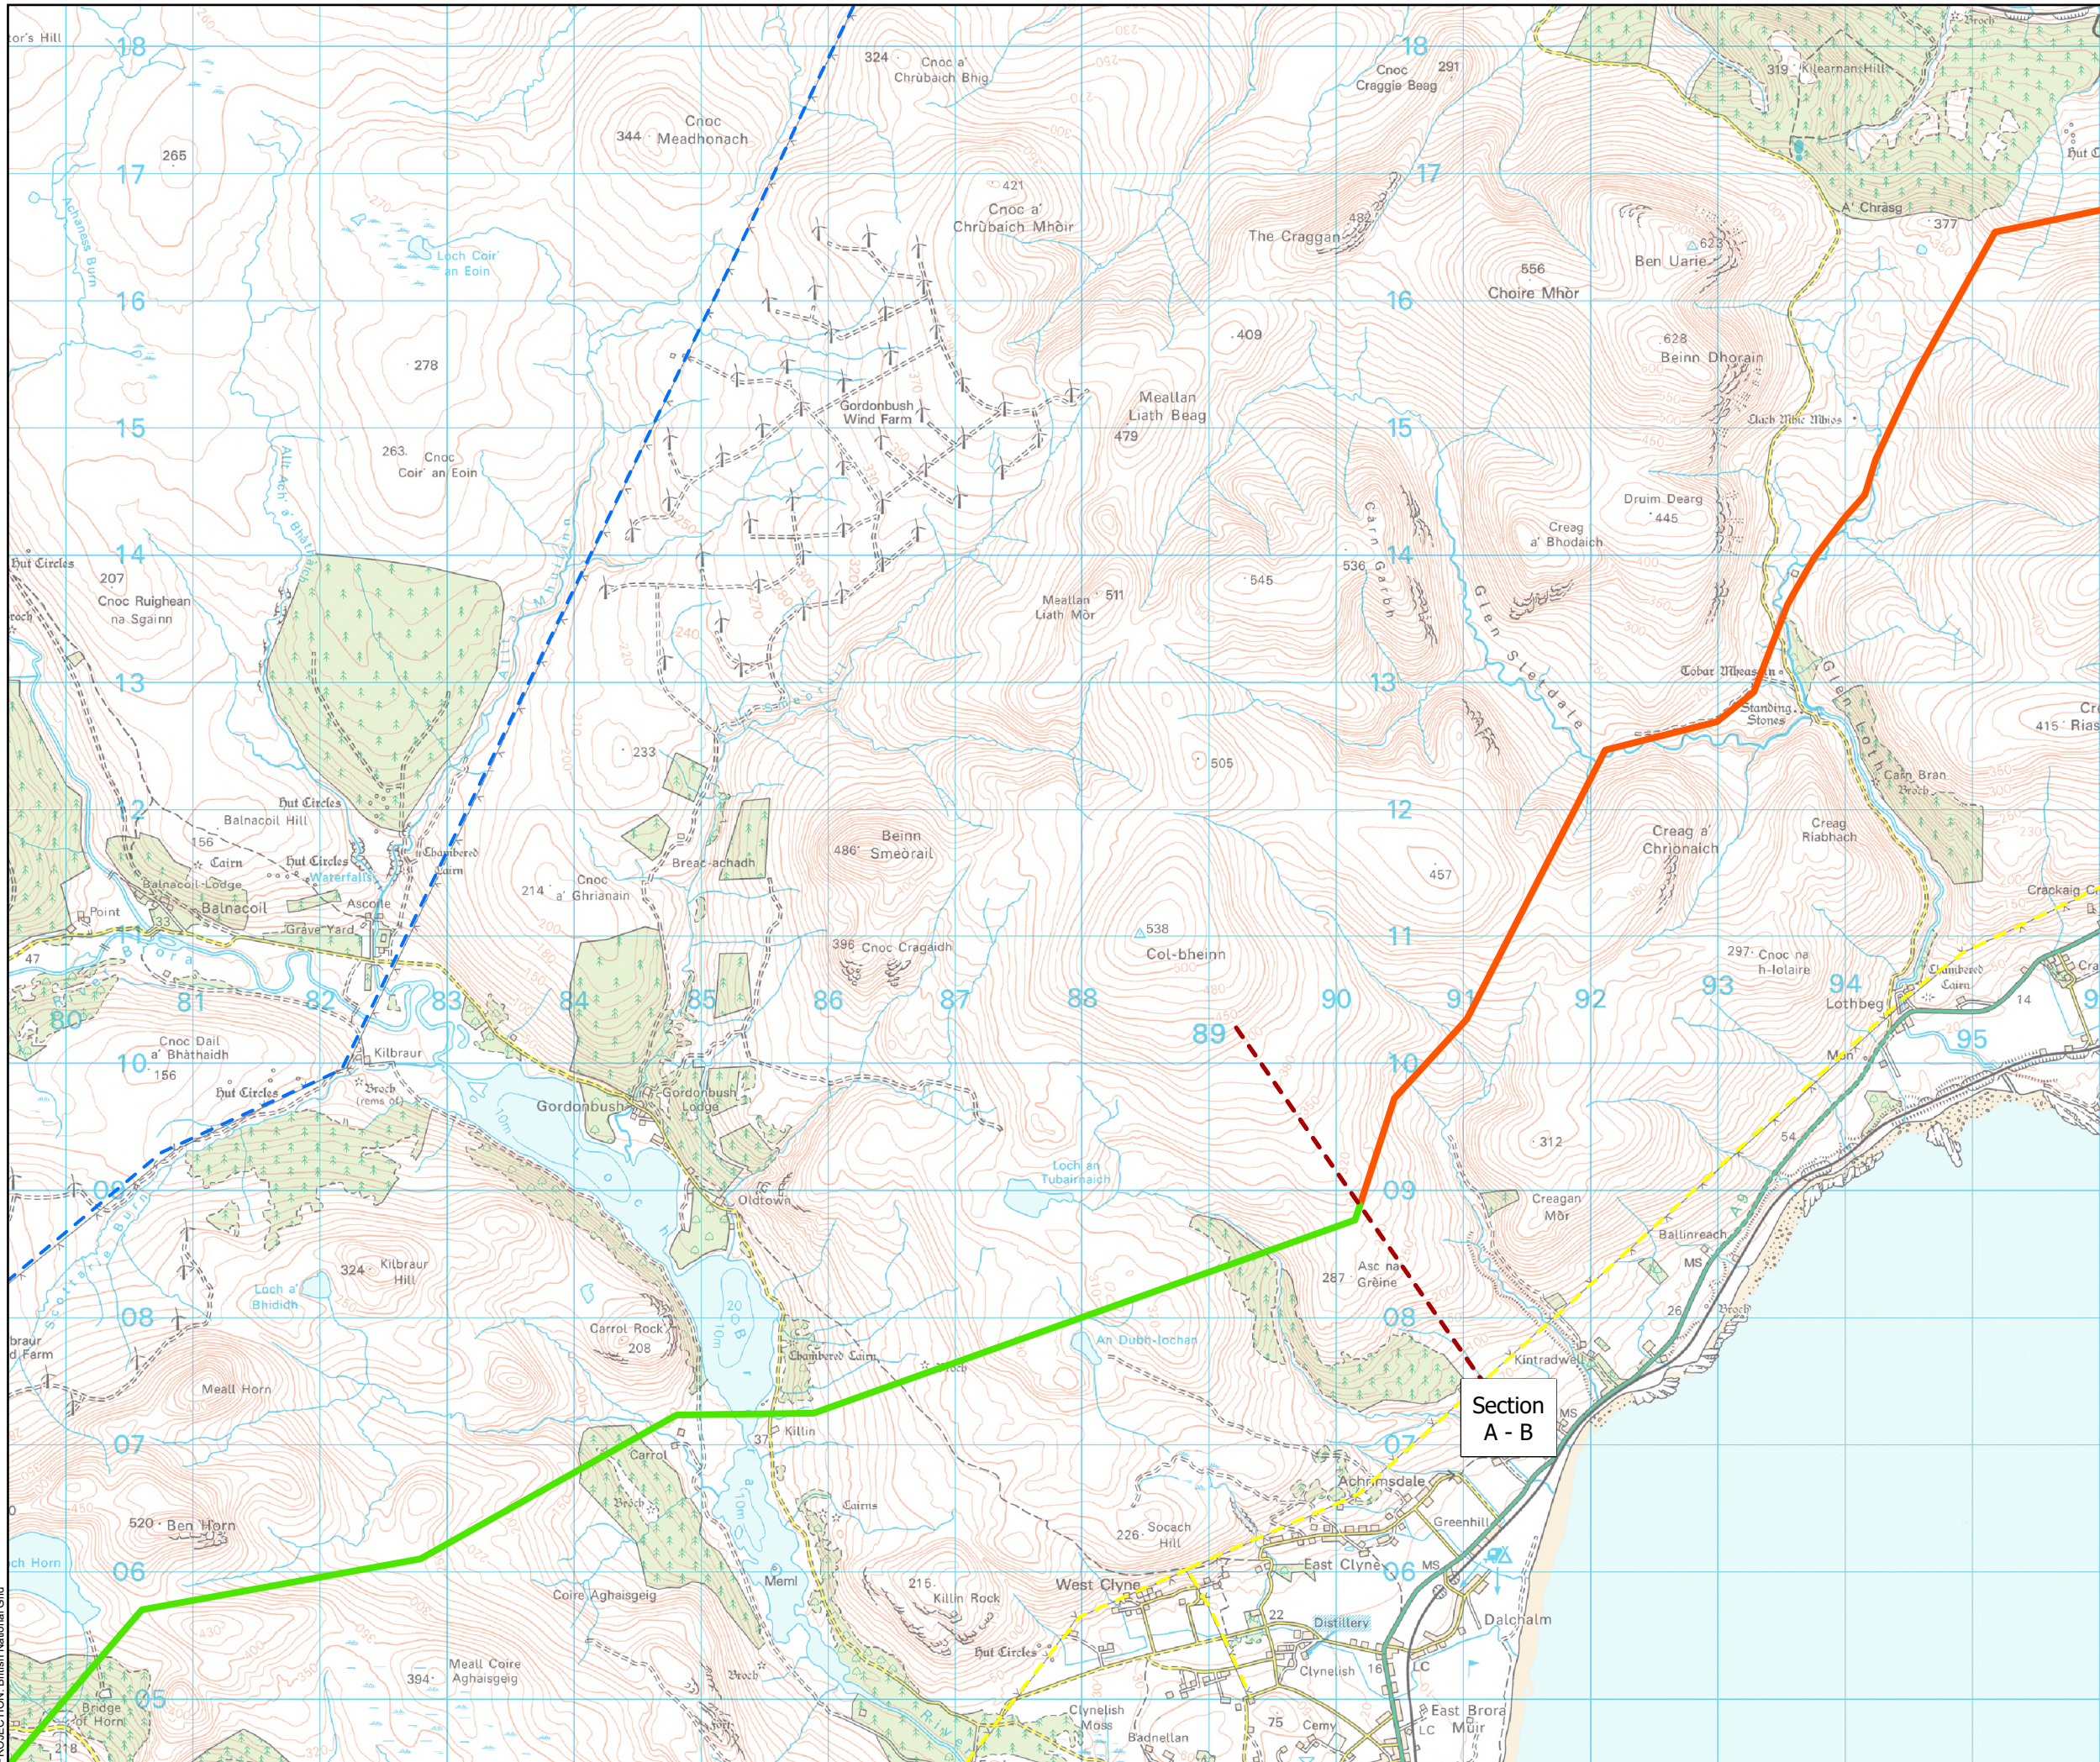

— Proposed Alignment Section A  
— Proposed Alignment Section B  
 Existing Infrastructure  
- - - Existing 132kV OHL  
- - - Existing 275kV OHL  
- - - Alignment Section Break

SSEN Transmission take no responsibility for the release or accuracy of latest version basemaps from Ordnance Survey

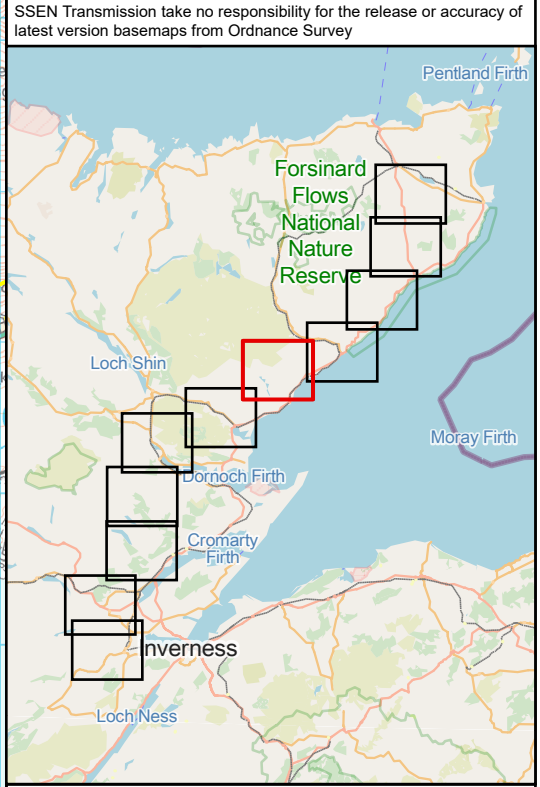


SCALE: See Scale Bar	VERSION: A01
SIZE: A3	DRAWN: CI
PROJECT: 0720281	CHECKED: ES / BM
DATE: 1/13/2025	APPROVED: KG

**Spittal - Loch Buidhe - Beauly 400kV Connection Proposed Infrastructure**


PROJECTION: British National Grid



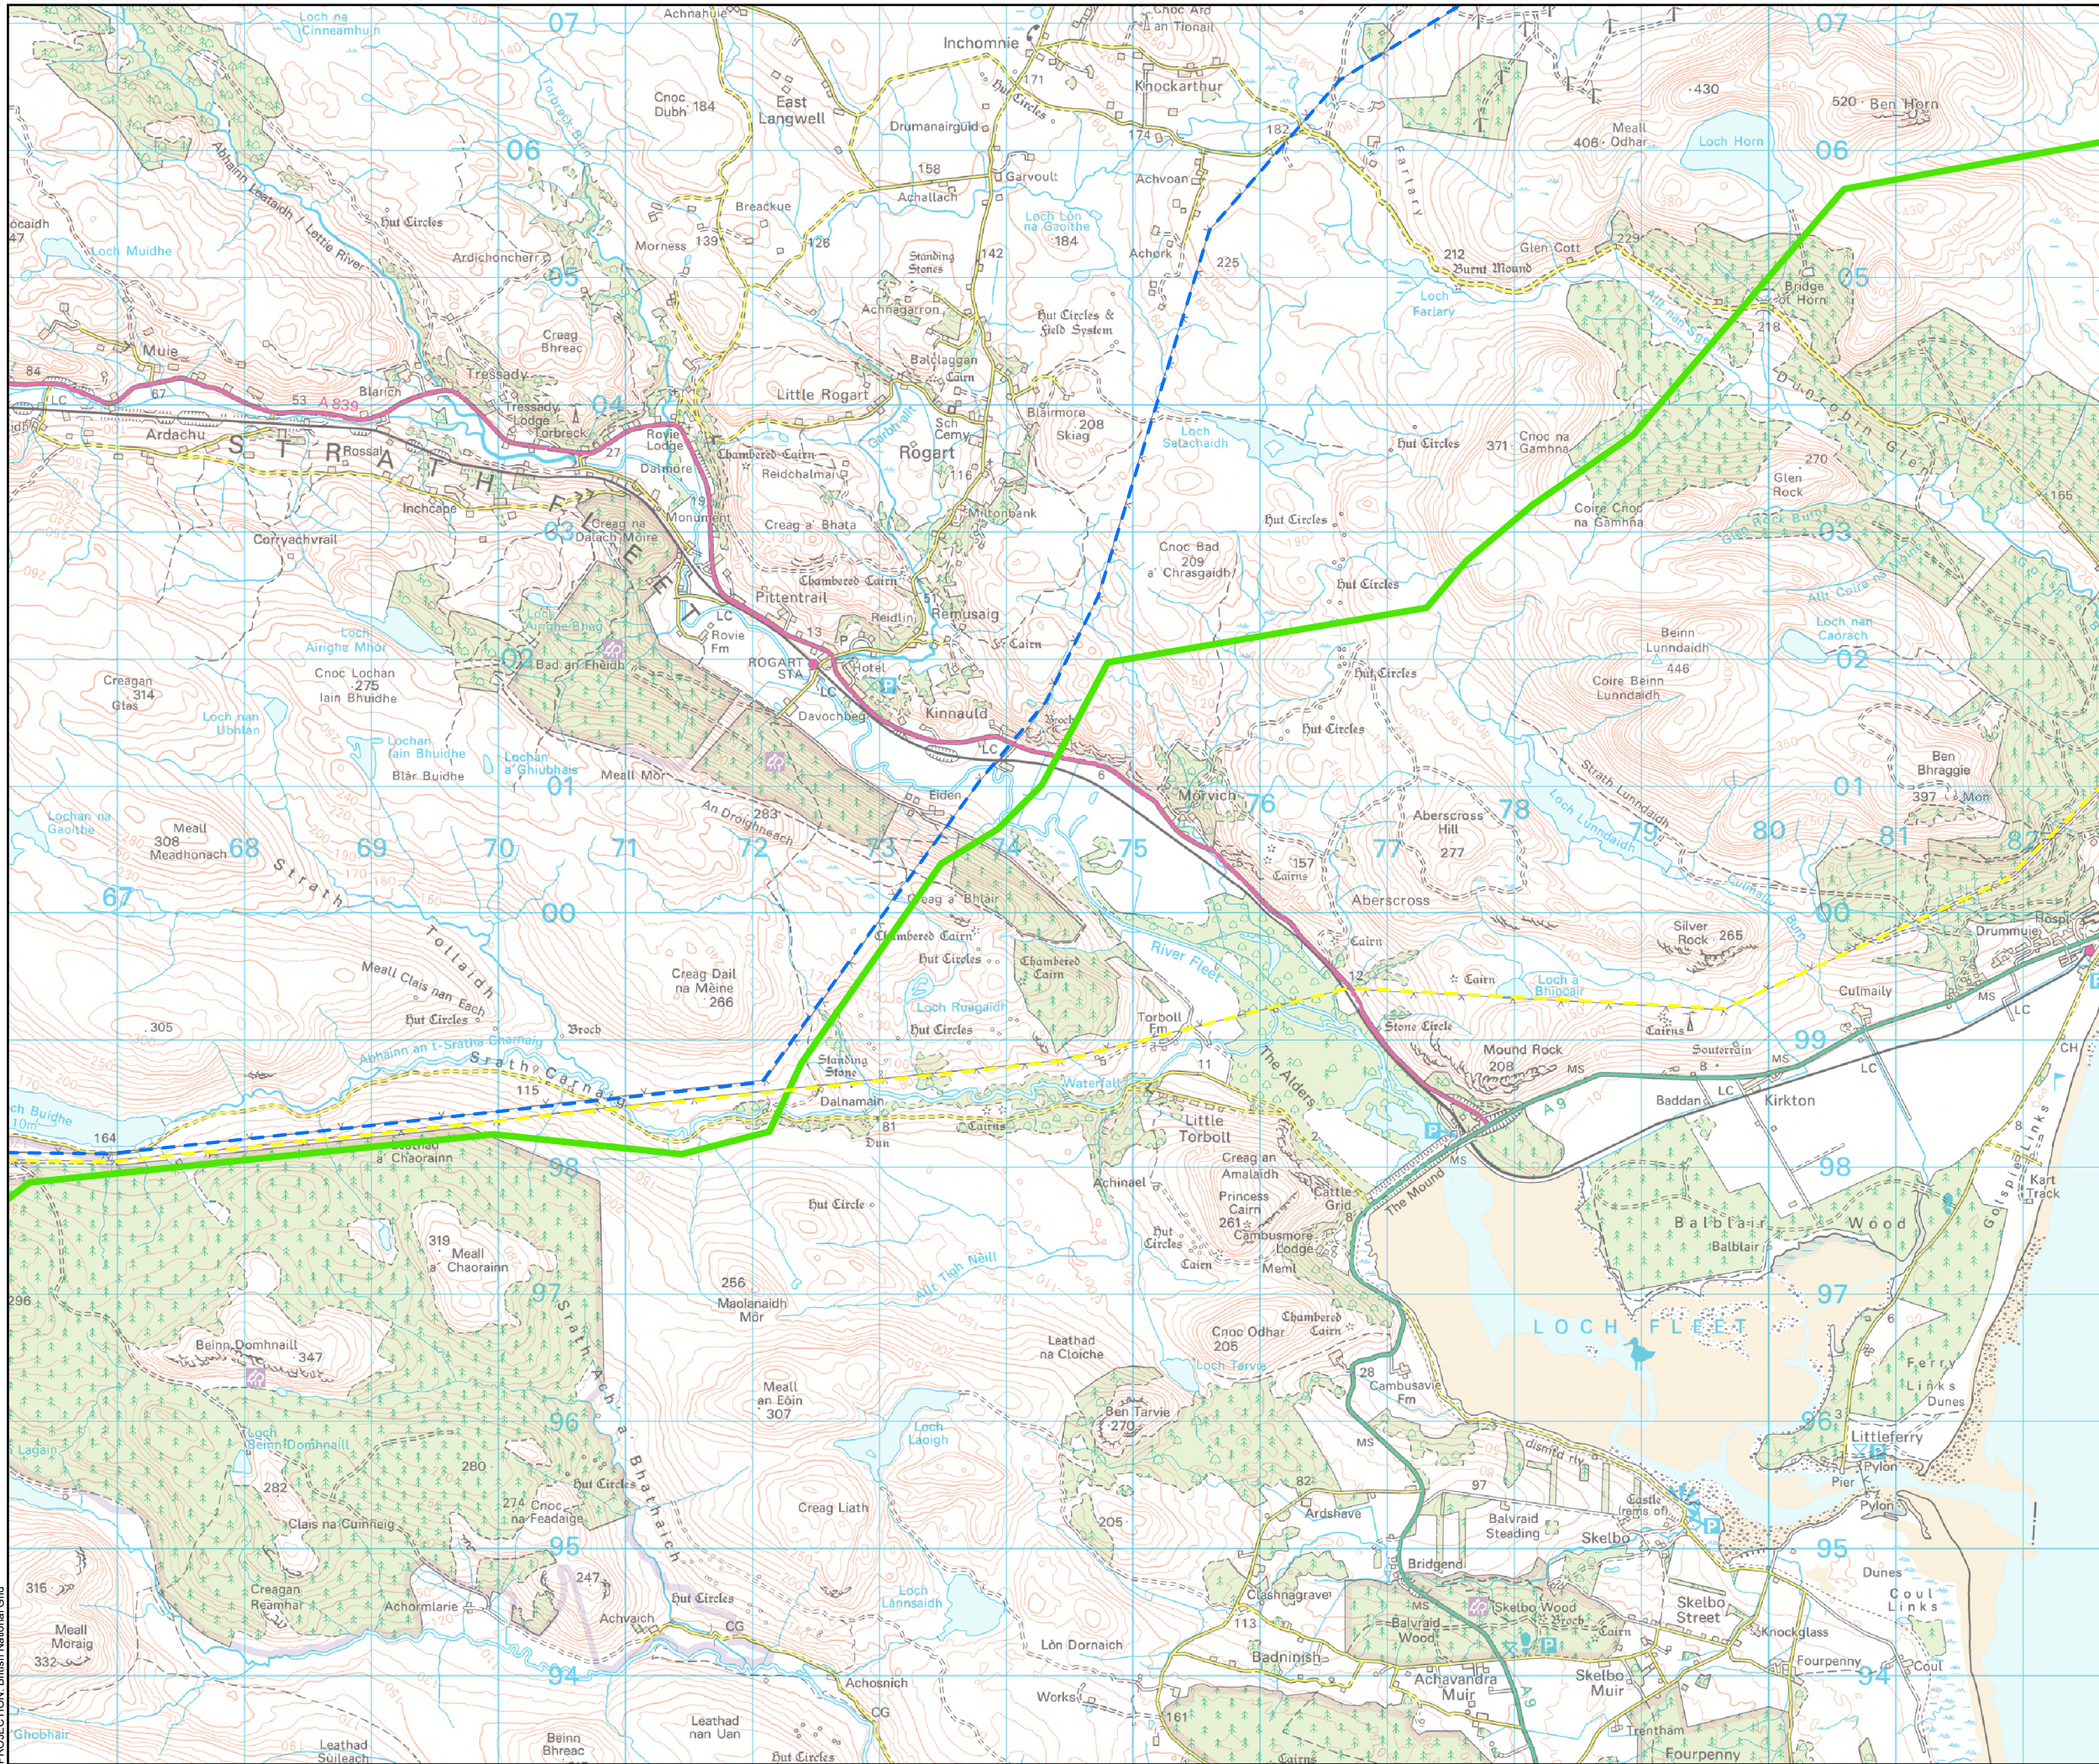

- Proposed Alignment Section B
- Existing Infrastructure
- Existing 132kV OHL
- Existing 275kV OHL

SSEN Transmission take no responsibility for the release or accuracy of latest version basemaps from Ordnance Survey

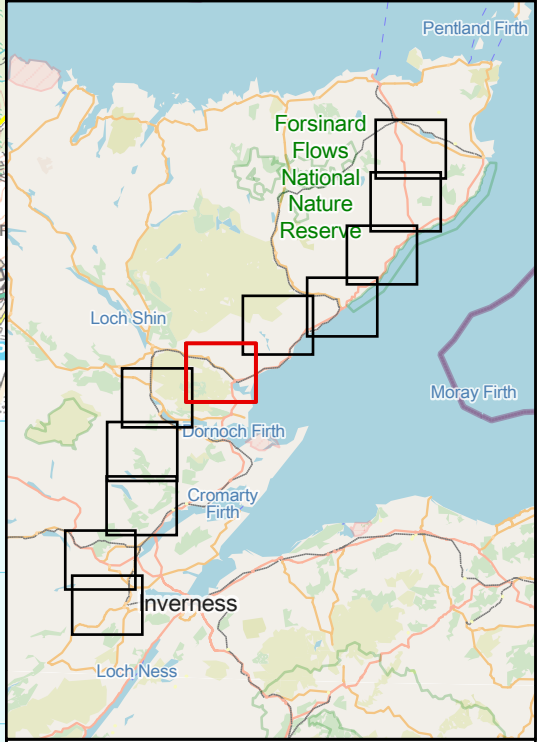


SCALE: See Scale Bar	VERSION: A01
SIZE: A3	DRAWN: CI
PROJECT: 0720281	CHECKED: ES / BM
DATE: 1/13/2025	APPROVED: KG

**Spittal - Loch Buidhe - Beauly 400kV Connection Proposed Infrastructure**







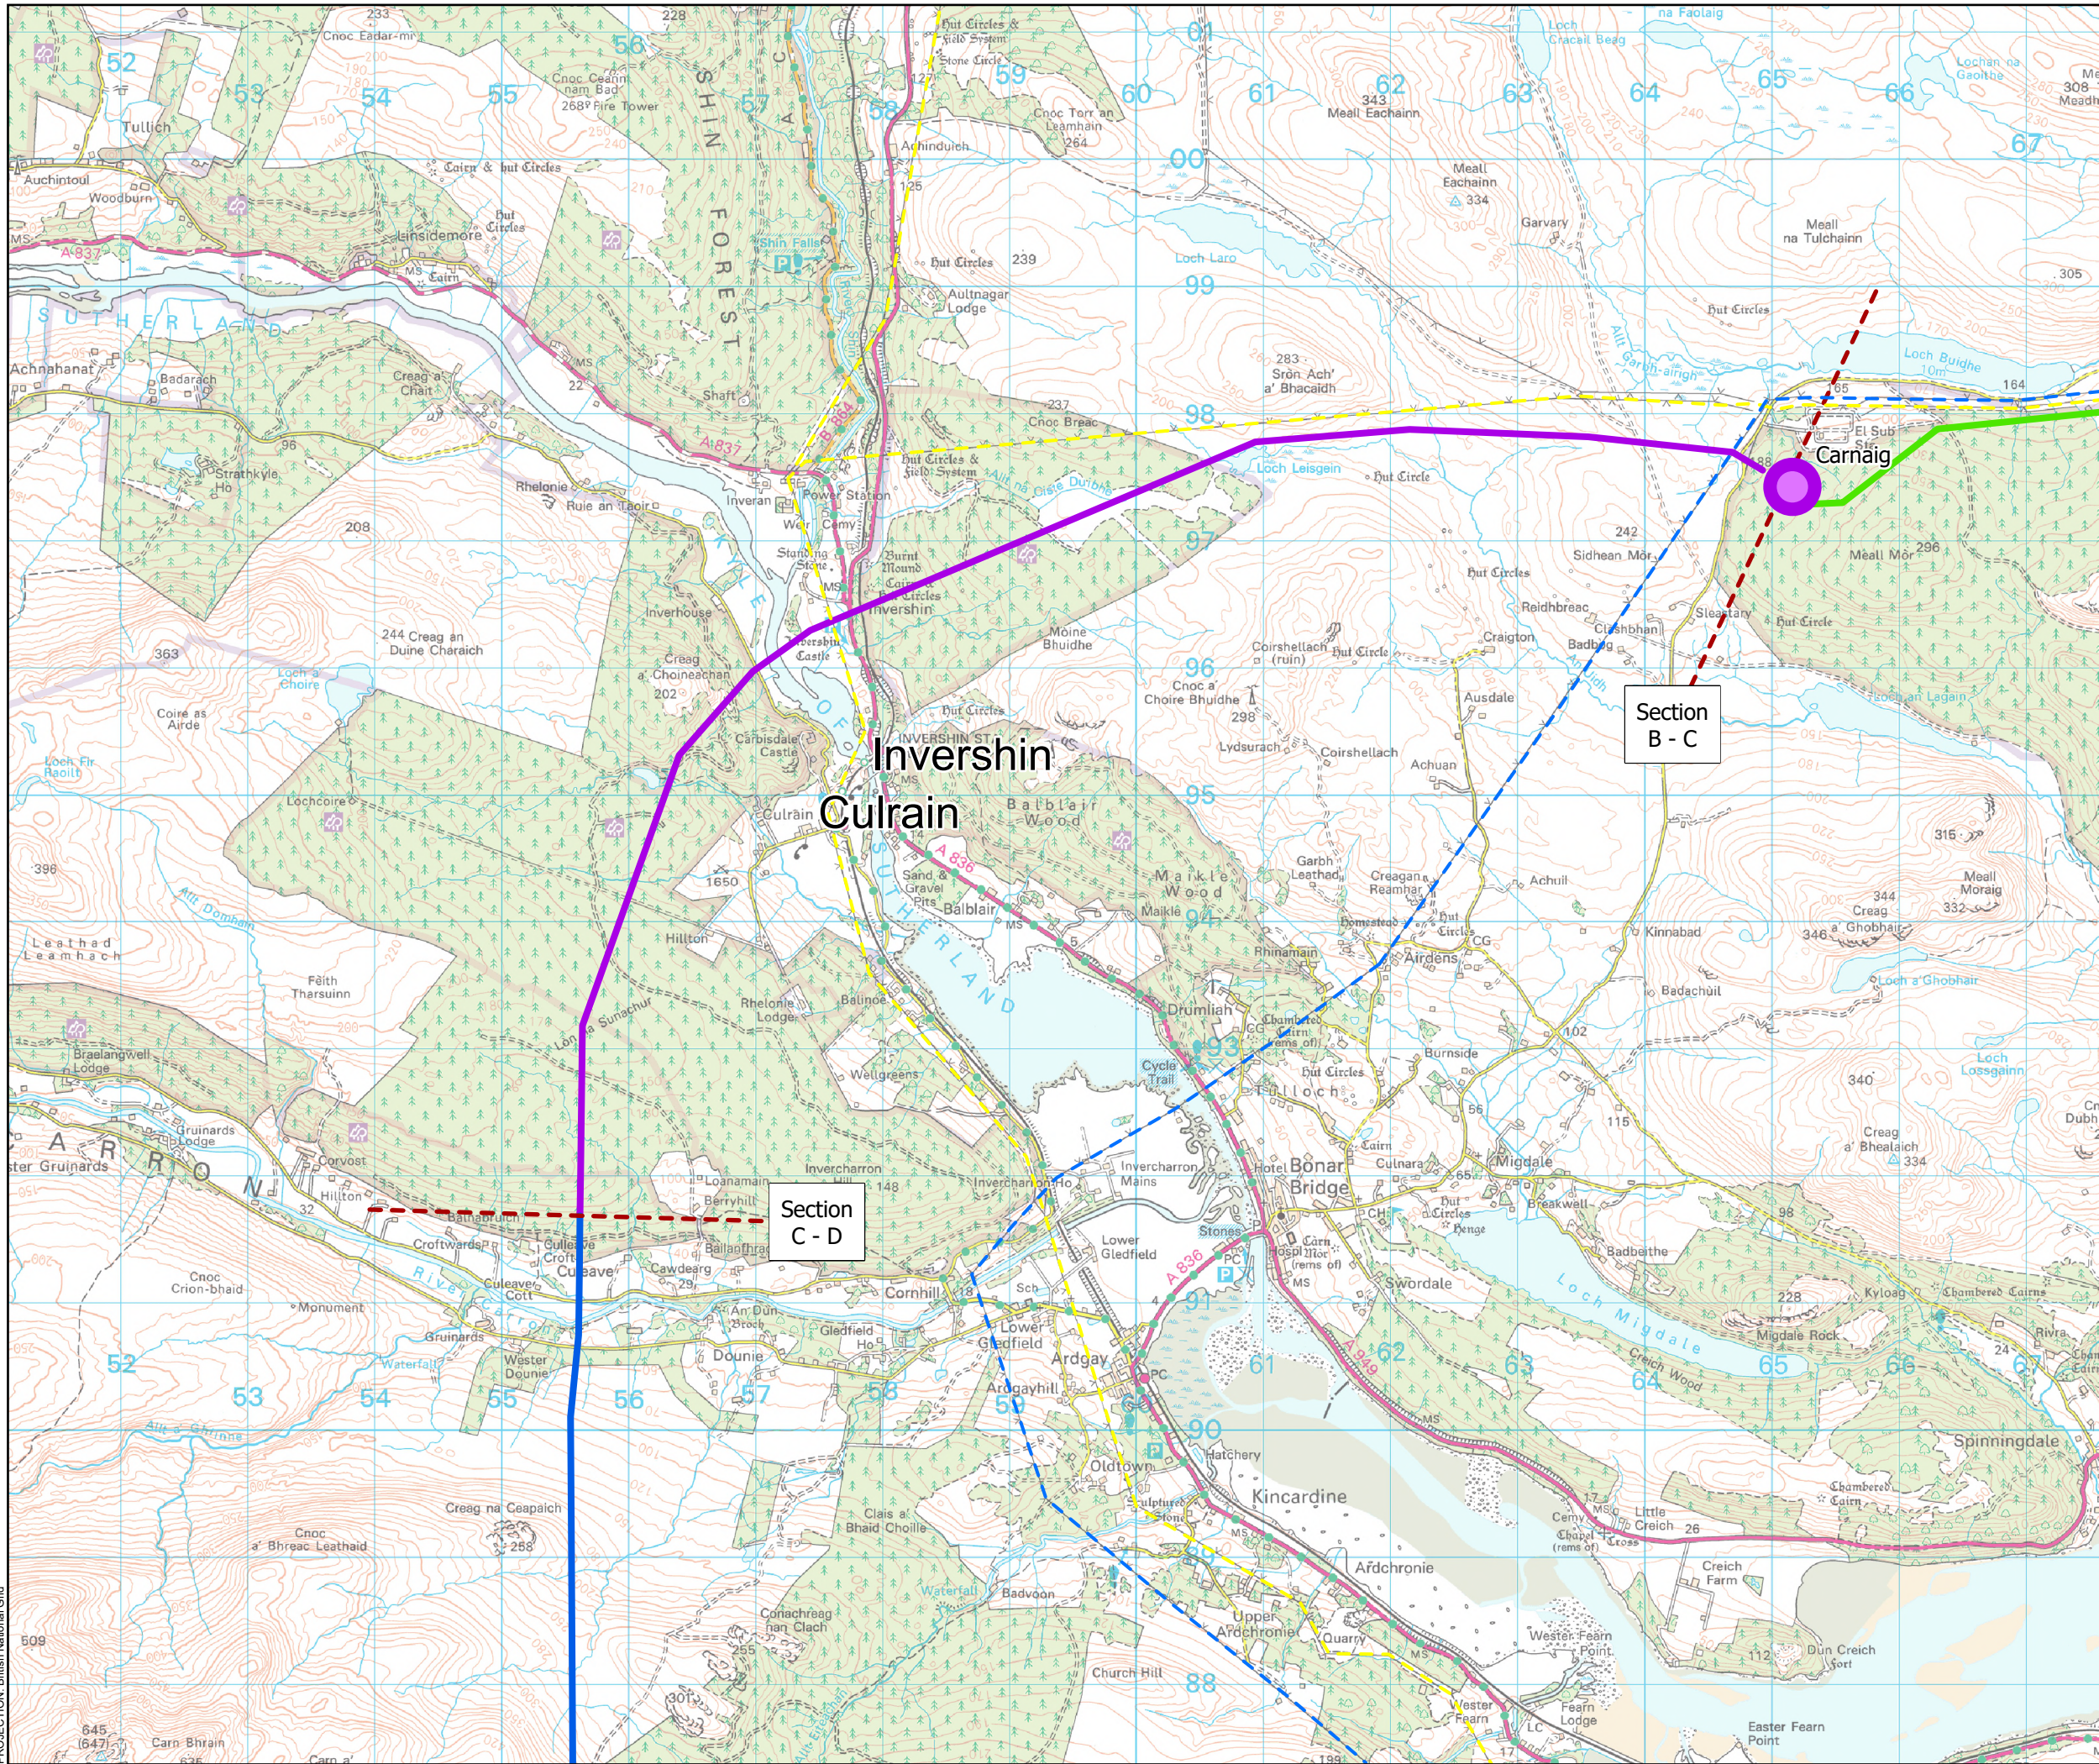

- Indicative Substation Locations
  - Proposed Alignment Section B
  - Proposed Alignment Section C
  - Proposed Alignment Section D
- Existing Infrastructure
- Existing 132kV OHL
  - Existing 275kV OHL
  - Alignment Section Break

SSEN Transmission take no responsibility for the release or accuracy of latest version basemaps from Ordnance Survey

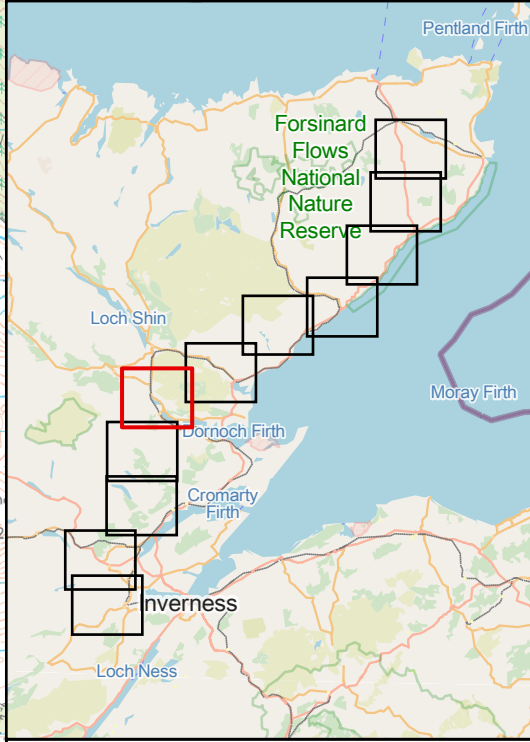


SCALE: See Scale Bar	VERSION: A01
SIZE: A3	DRAWN: CI
PROJECT: 0720281	CHECKED: ES / BM
DATE: 1/13/2025	APPROVED: KG

**Spittal - Loch Buidhe - Beauly 400kV Connection**  
Proposed Infrastructure






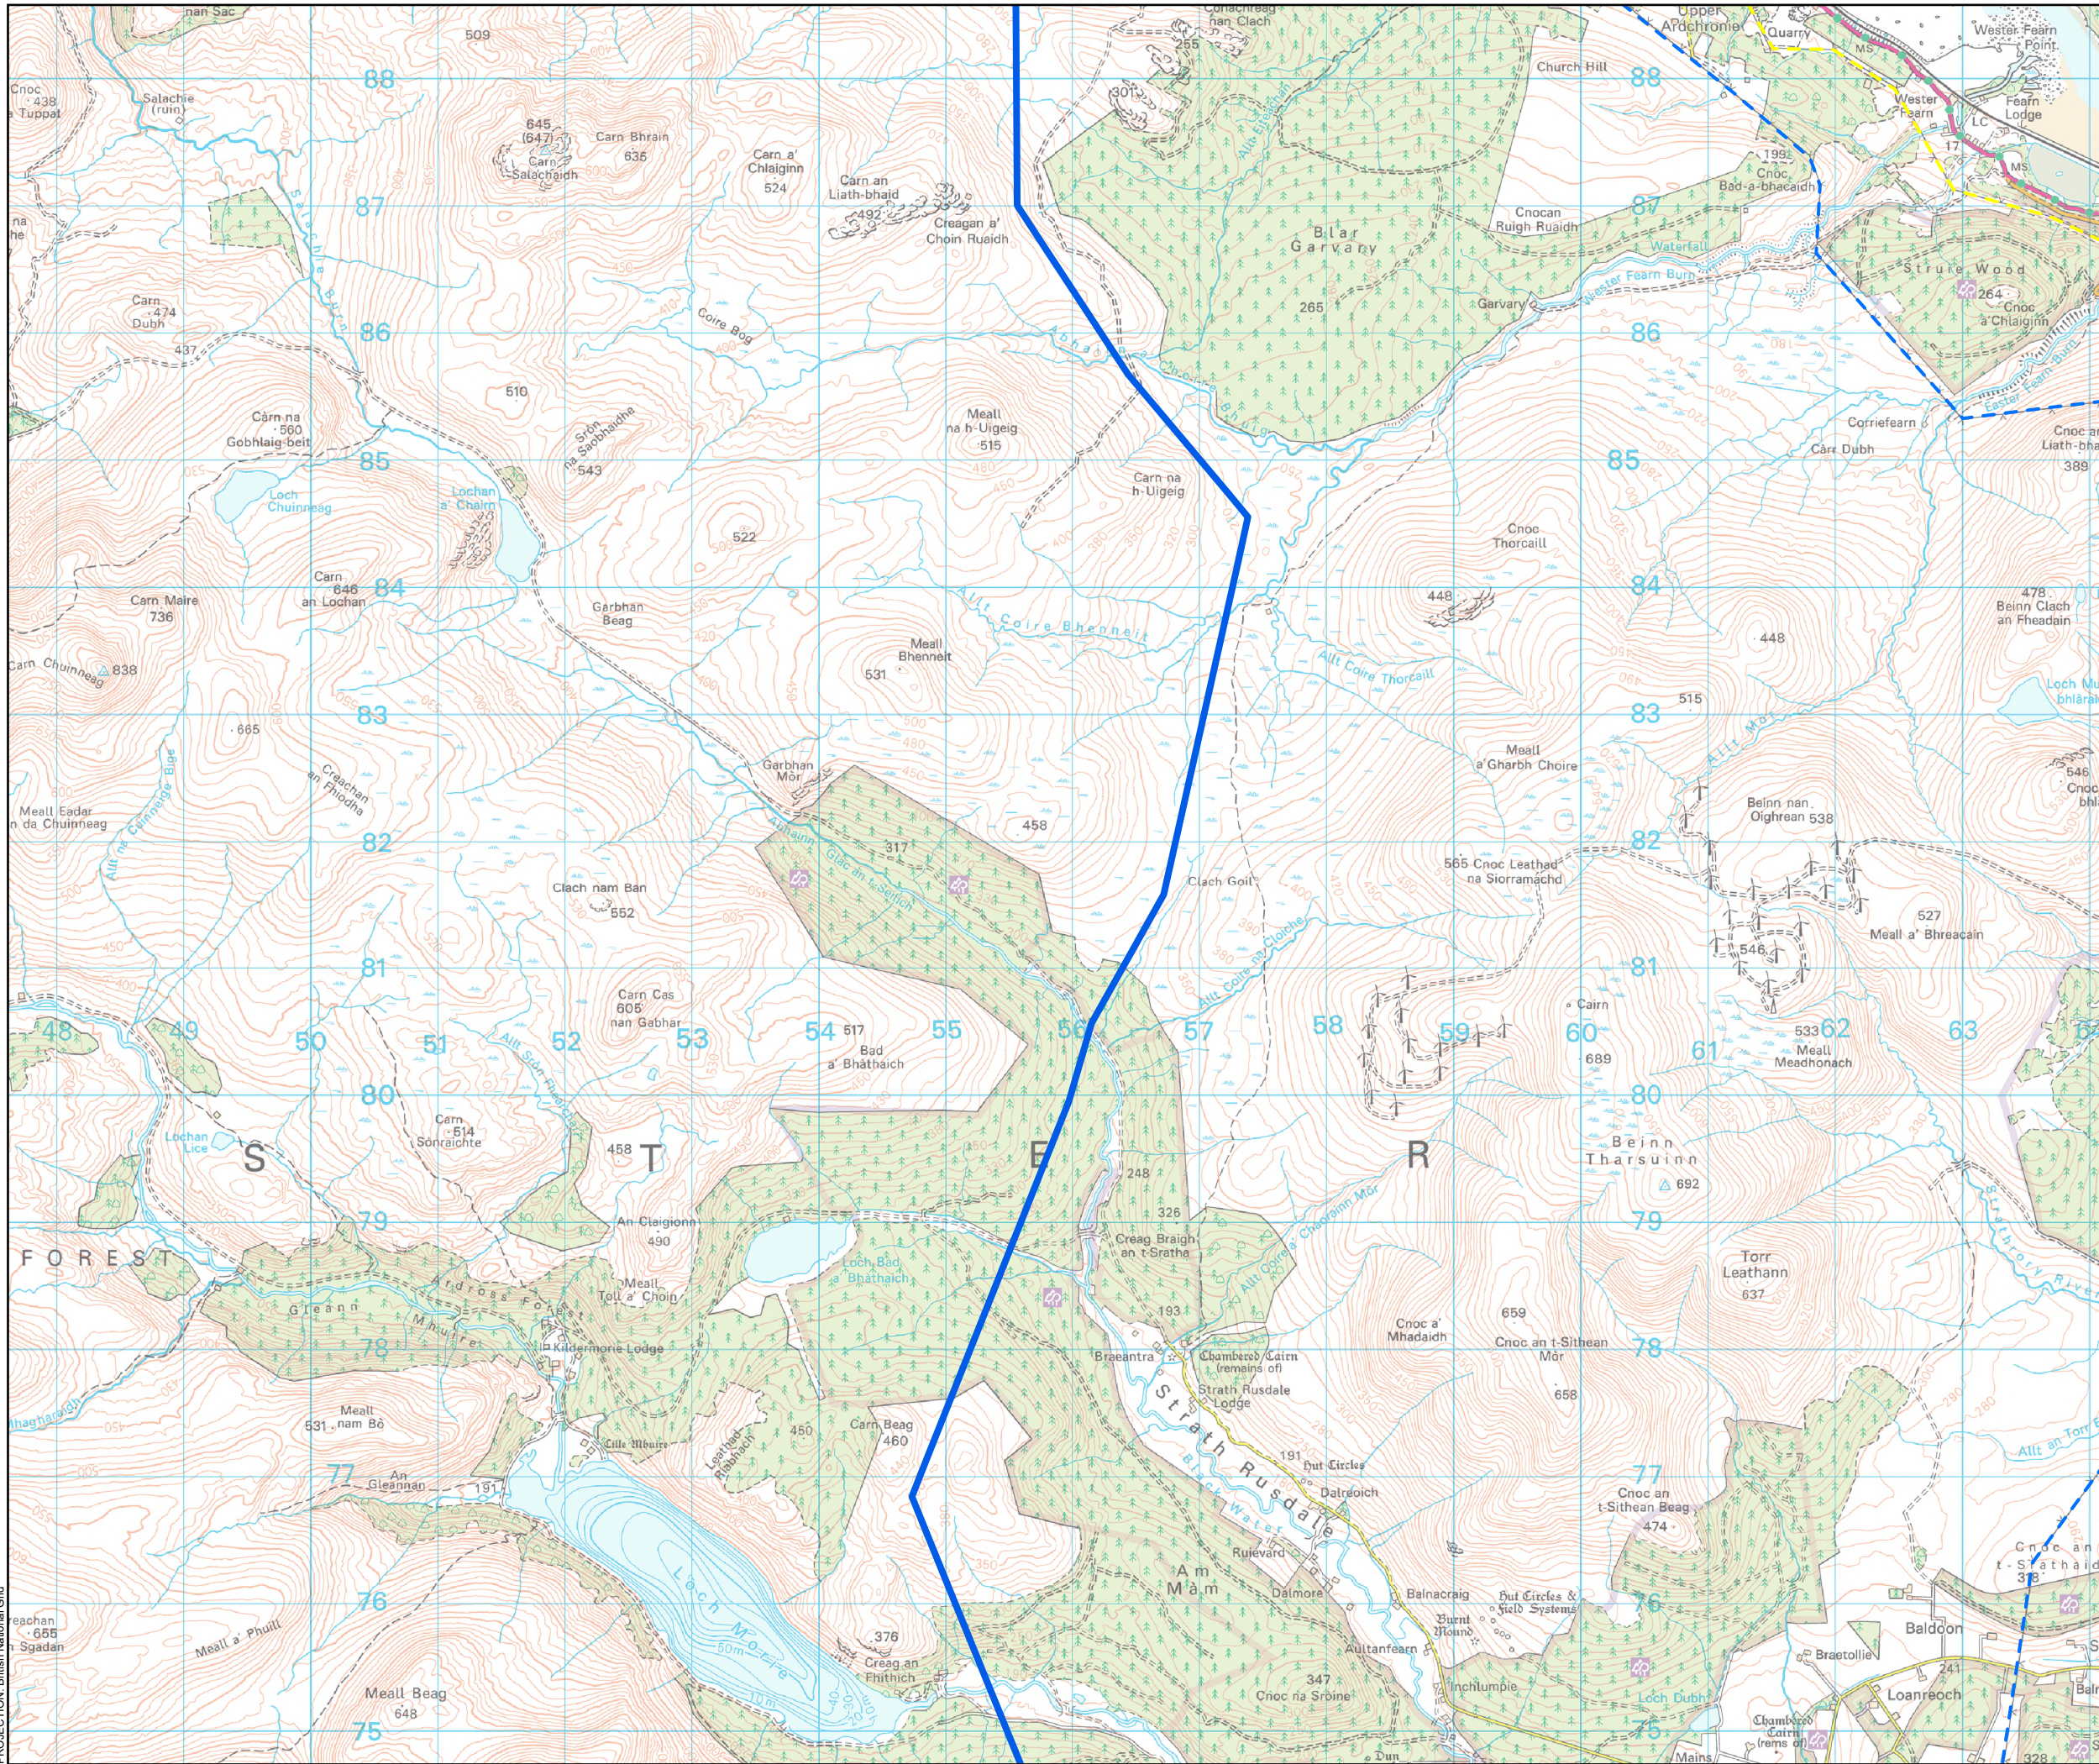

- Proposed Alignment Section D
- Existing Infrastructure
- Existing 132kV OHL
- - - Existing 275kV OHL

SSEN Transmission take no responsibility for the release or accuracy of latest version basemaps from Ordnance Survey

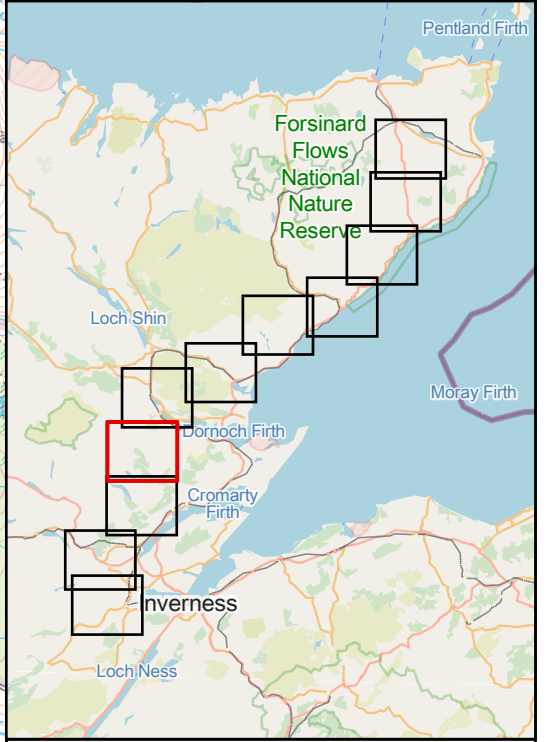


SCALE: See Scale Bar	VERSION: A01
SIZE: A3	DRAWN: CI
PROJECT: 0720281	CHECKED: ES / BM
DATE: 1/13/2025	APPROVED: KG

**Spittal - Loch Buidhe - Beauly 400kV Connection**  
**Proposed Infrastructure**





PROJECTION: British National Grid



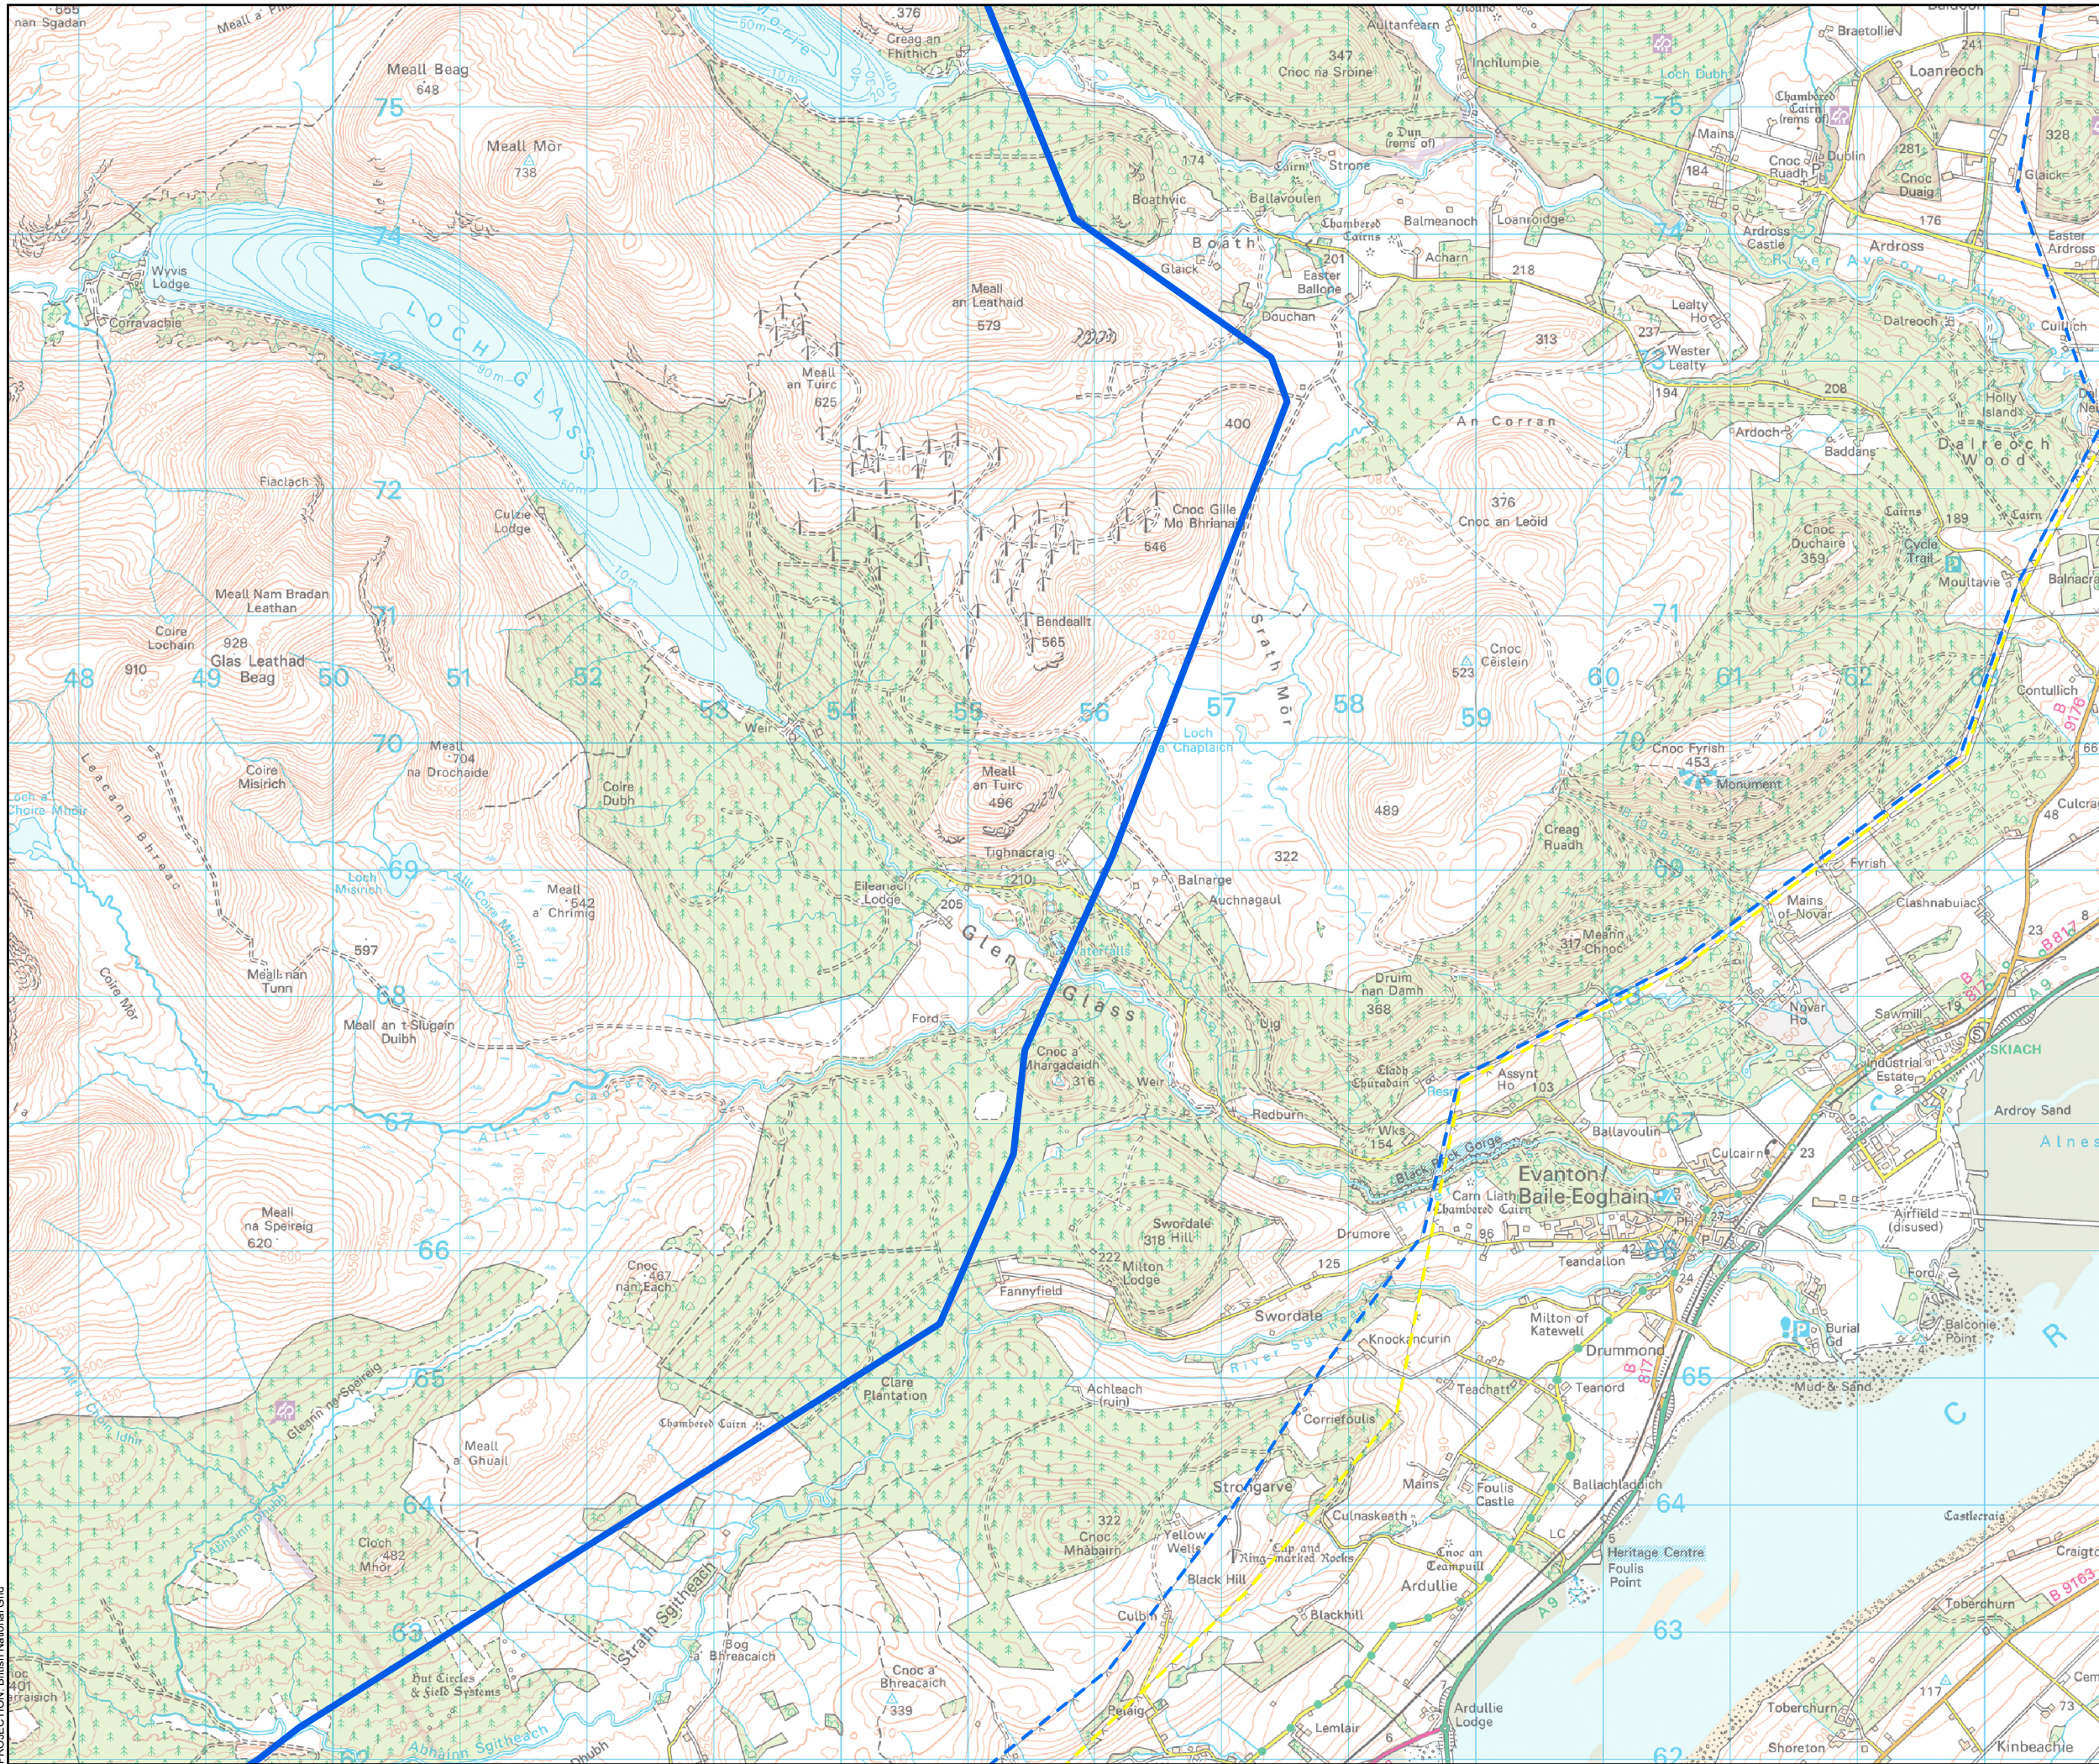

- Proposed Alignment Section D
- - - Existing Infrastructure
- Existing 132kV OHL
- - - Existing 275kV OHL

SSEN Transmission take no responsibility for the release or accuracy of latest version basemaps from Ordnance Survey

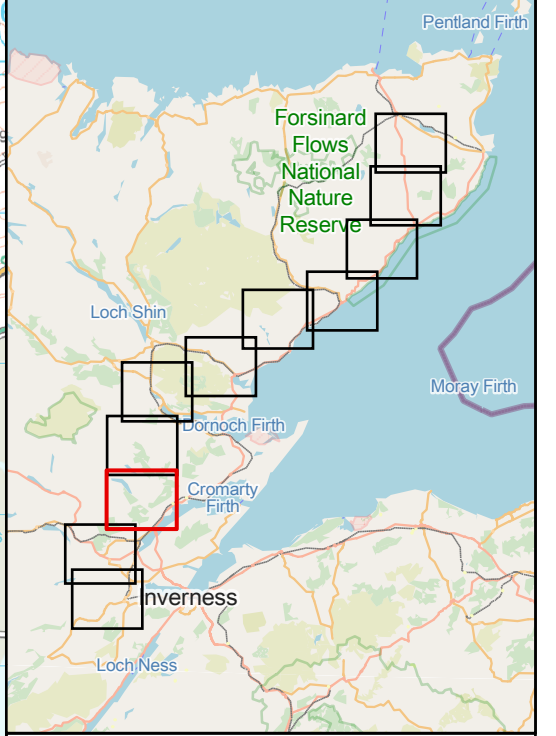

SCALE: See Scale Bar	VERSION: A01
SIZE: A3	DRAWN: CI
PROJECT: 0720281	CHECKED: ES / BM
DATE: 1/13/2025	APPROVED: KG

**Spittal - Loch Buidhe - Beaulie 400kV Connection**  
**Proposed Infrastructure**







- Proposed Alignment Section D
- Proposed Alignment Section E
- Existing Infrastructure
- Existing 132kV OHL
- - - Existing 275kV OHL
- - - Alignment Section Break



Section D - E

Tarvie

Strathpeffer

DINGWAL

SSEN Transmission take no responsibility for the release or accuracy of latest version basemaps from Ordnance Survey

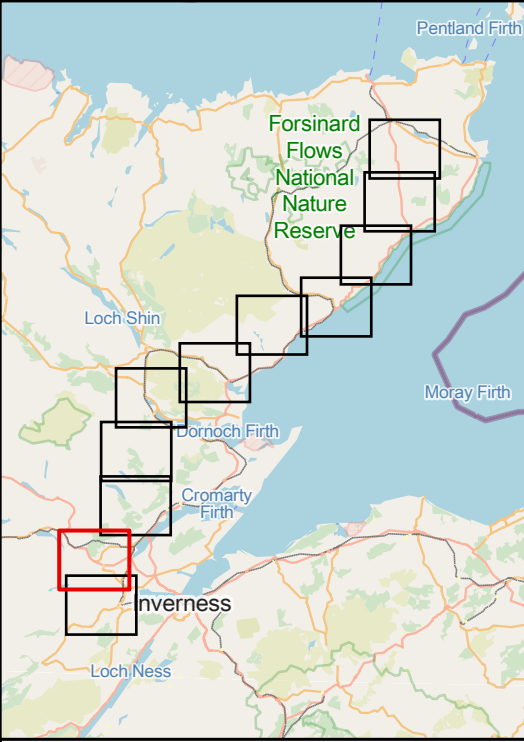


SCALE: See Scale Bar	VERSION: A01
SIZE: A3	DRAWN: CI
PROJECT: 0720281	CHECKED: ES / BM
DATE: 1/13/2025	APPROVED: KG

**Spittal - Loch Buidhe - Beauly 400kV Connection**  
Proposed Infrastructure





PROJECTION: British National Grid



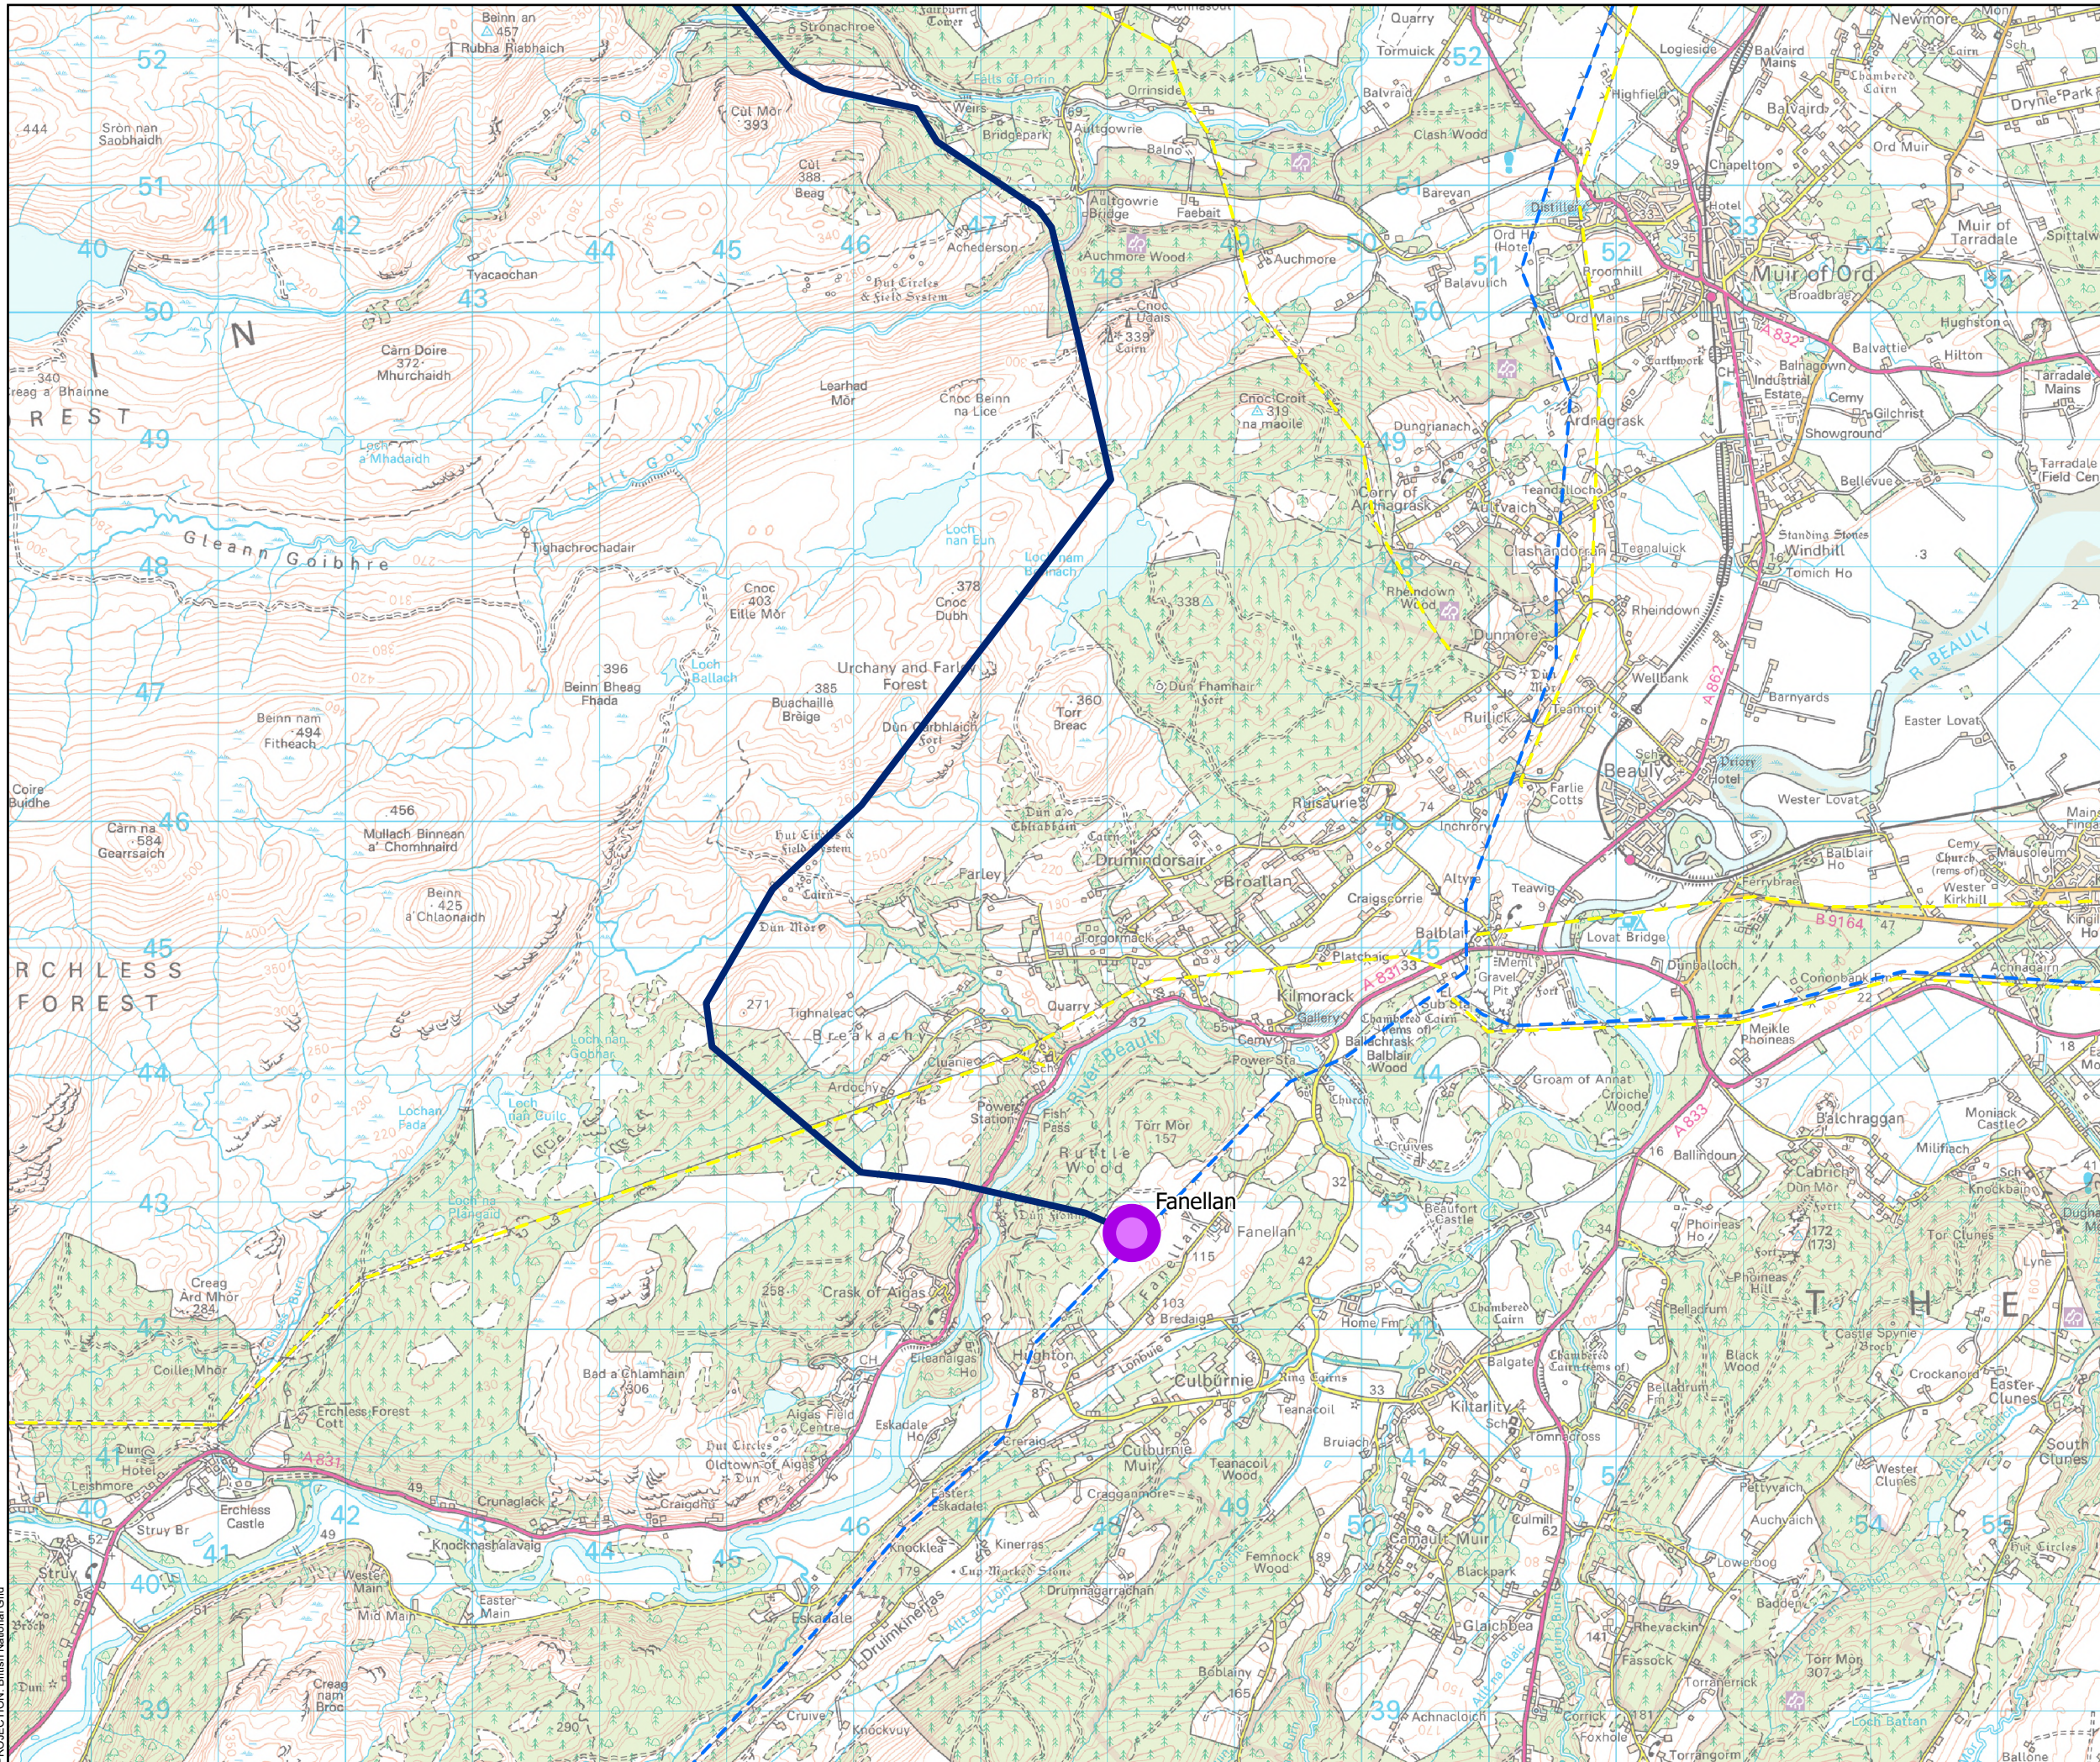

- Indicative Substation Locations
- Proposed Alignment Section E
- Existing Infrastructure
- Existing 132kV OHL
- Existing 275kV OHL

SSEN Transmission take no responsibility for the release or accuracy of latest version basemaps from Ordnance Survey

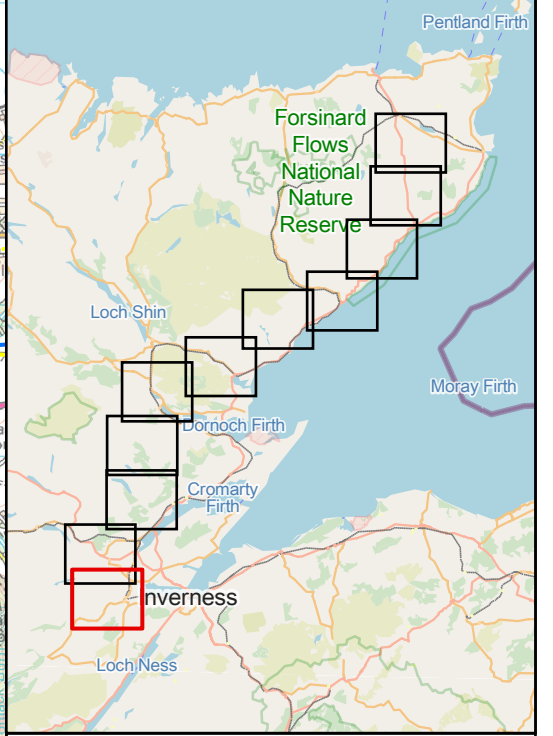

SCALE: See Scale Bar	VERSION: A01
SIZE: A3	DRAWN: CI
PROJECT: 0720281	CHECKED: ES / BM
DATE: 1/13/2025	APPROVED: KG

**Spittal - Loch Buidhe - Beaulieu 400kV Connection**  
Proposed Infrastructure



PROJECTION: British National Grid