


- Tower Location
 - Indicative Substation Location
 - Existing 132kV OHL
 - Existing 275kV OHL
- Proposed Infrastructure:
- Proposed Alignment Section A
 - Proposed Alignment Section B
 - Proposed Alignment Section C
 - Proposed Alignment Section D
 - Proposed Alignment Section E
 - Existing Access Track - Upgrade Required
 - New Permanent Access Track
 - New Temporary Access Track


SSEN Transmission take no responsibility for the release or accuracy of latest version basemaps from Ordnance Survey

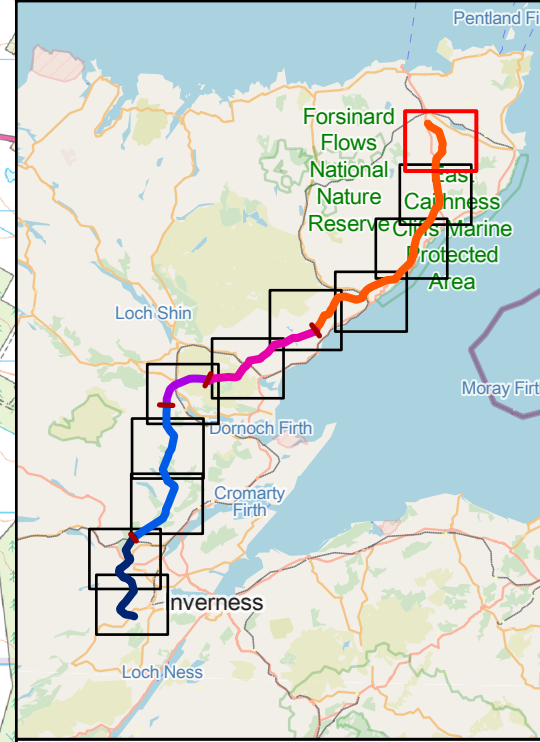

SCALE: See Scale Bar	VERSION: A01
SIZE: A3	DRAWN: WB
PROJECT: 0720281	CHECKED: ES
DATE: 30/01/2025	APPROVED: KG

Spittal - Loch Buidhe - Beaulie 400kV Connection Proposed Infrastructure: Page 1



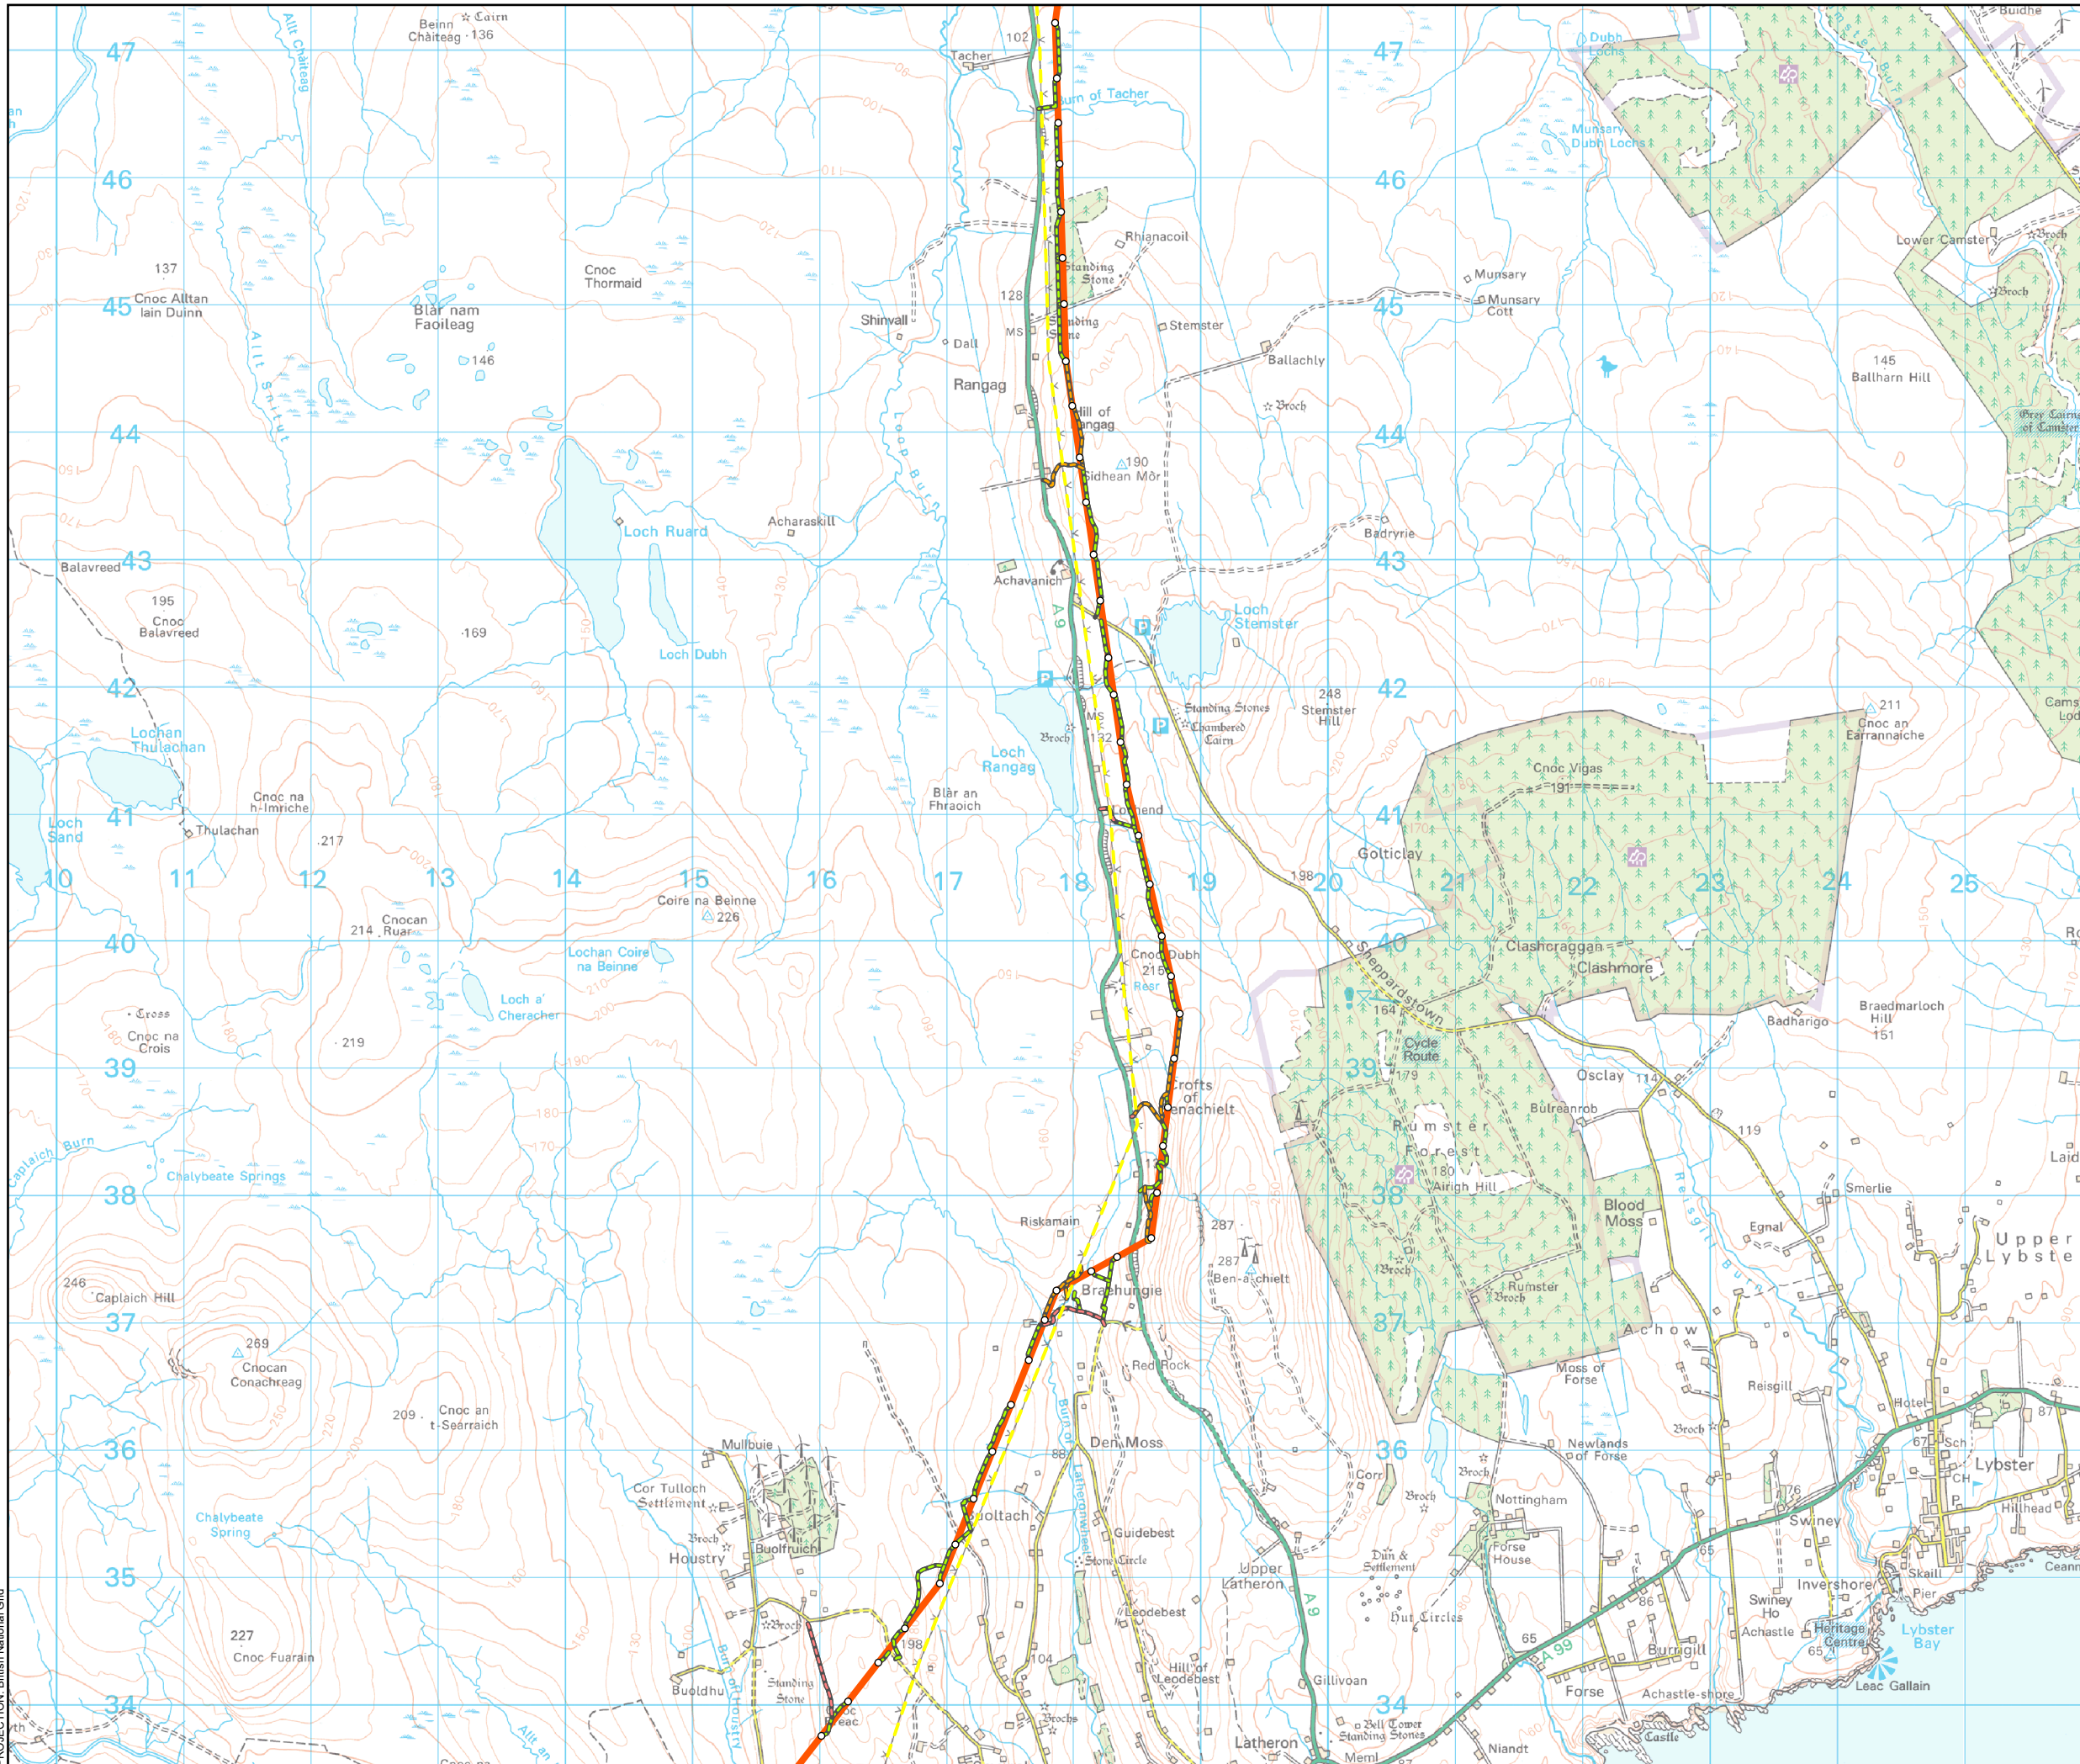


○ Tower Location
 ● Indicative Substation Location
 - - Existing 132kV OHL

Proposed Infrastructure:


- Proposed Alignment Section A
- Proposed Alignment Section B
- Proposed Alignment Section C
- Proposed Alignment Section D
- Proposed Alignment Section E
- - Existing Access Track - Upgrade Required
- New Permanent Access Track
- New Temporary Access Track

SSEN Transmission take no responsibility for the release or accuracy of latest version basemaps from Ordnance Survey

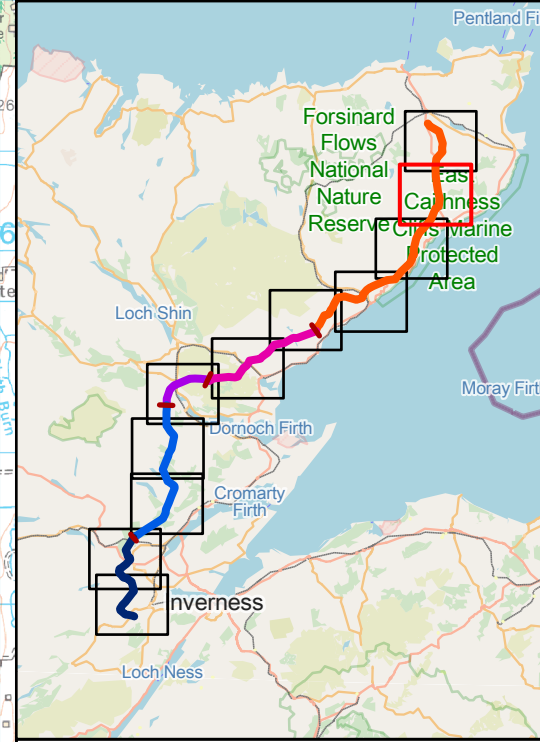

SCALE: See Scale Bar	VERSION: A01
SIZE: A3	DRAWN: WB
PROJECT: 0720281	CHECKED: ES
DATE: 30/01/2025	APPROVED: KG

Spittal - Loch Buidhe - Beauly 400kV Connection Proposed Infrastructure: Page 2

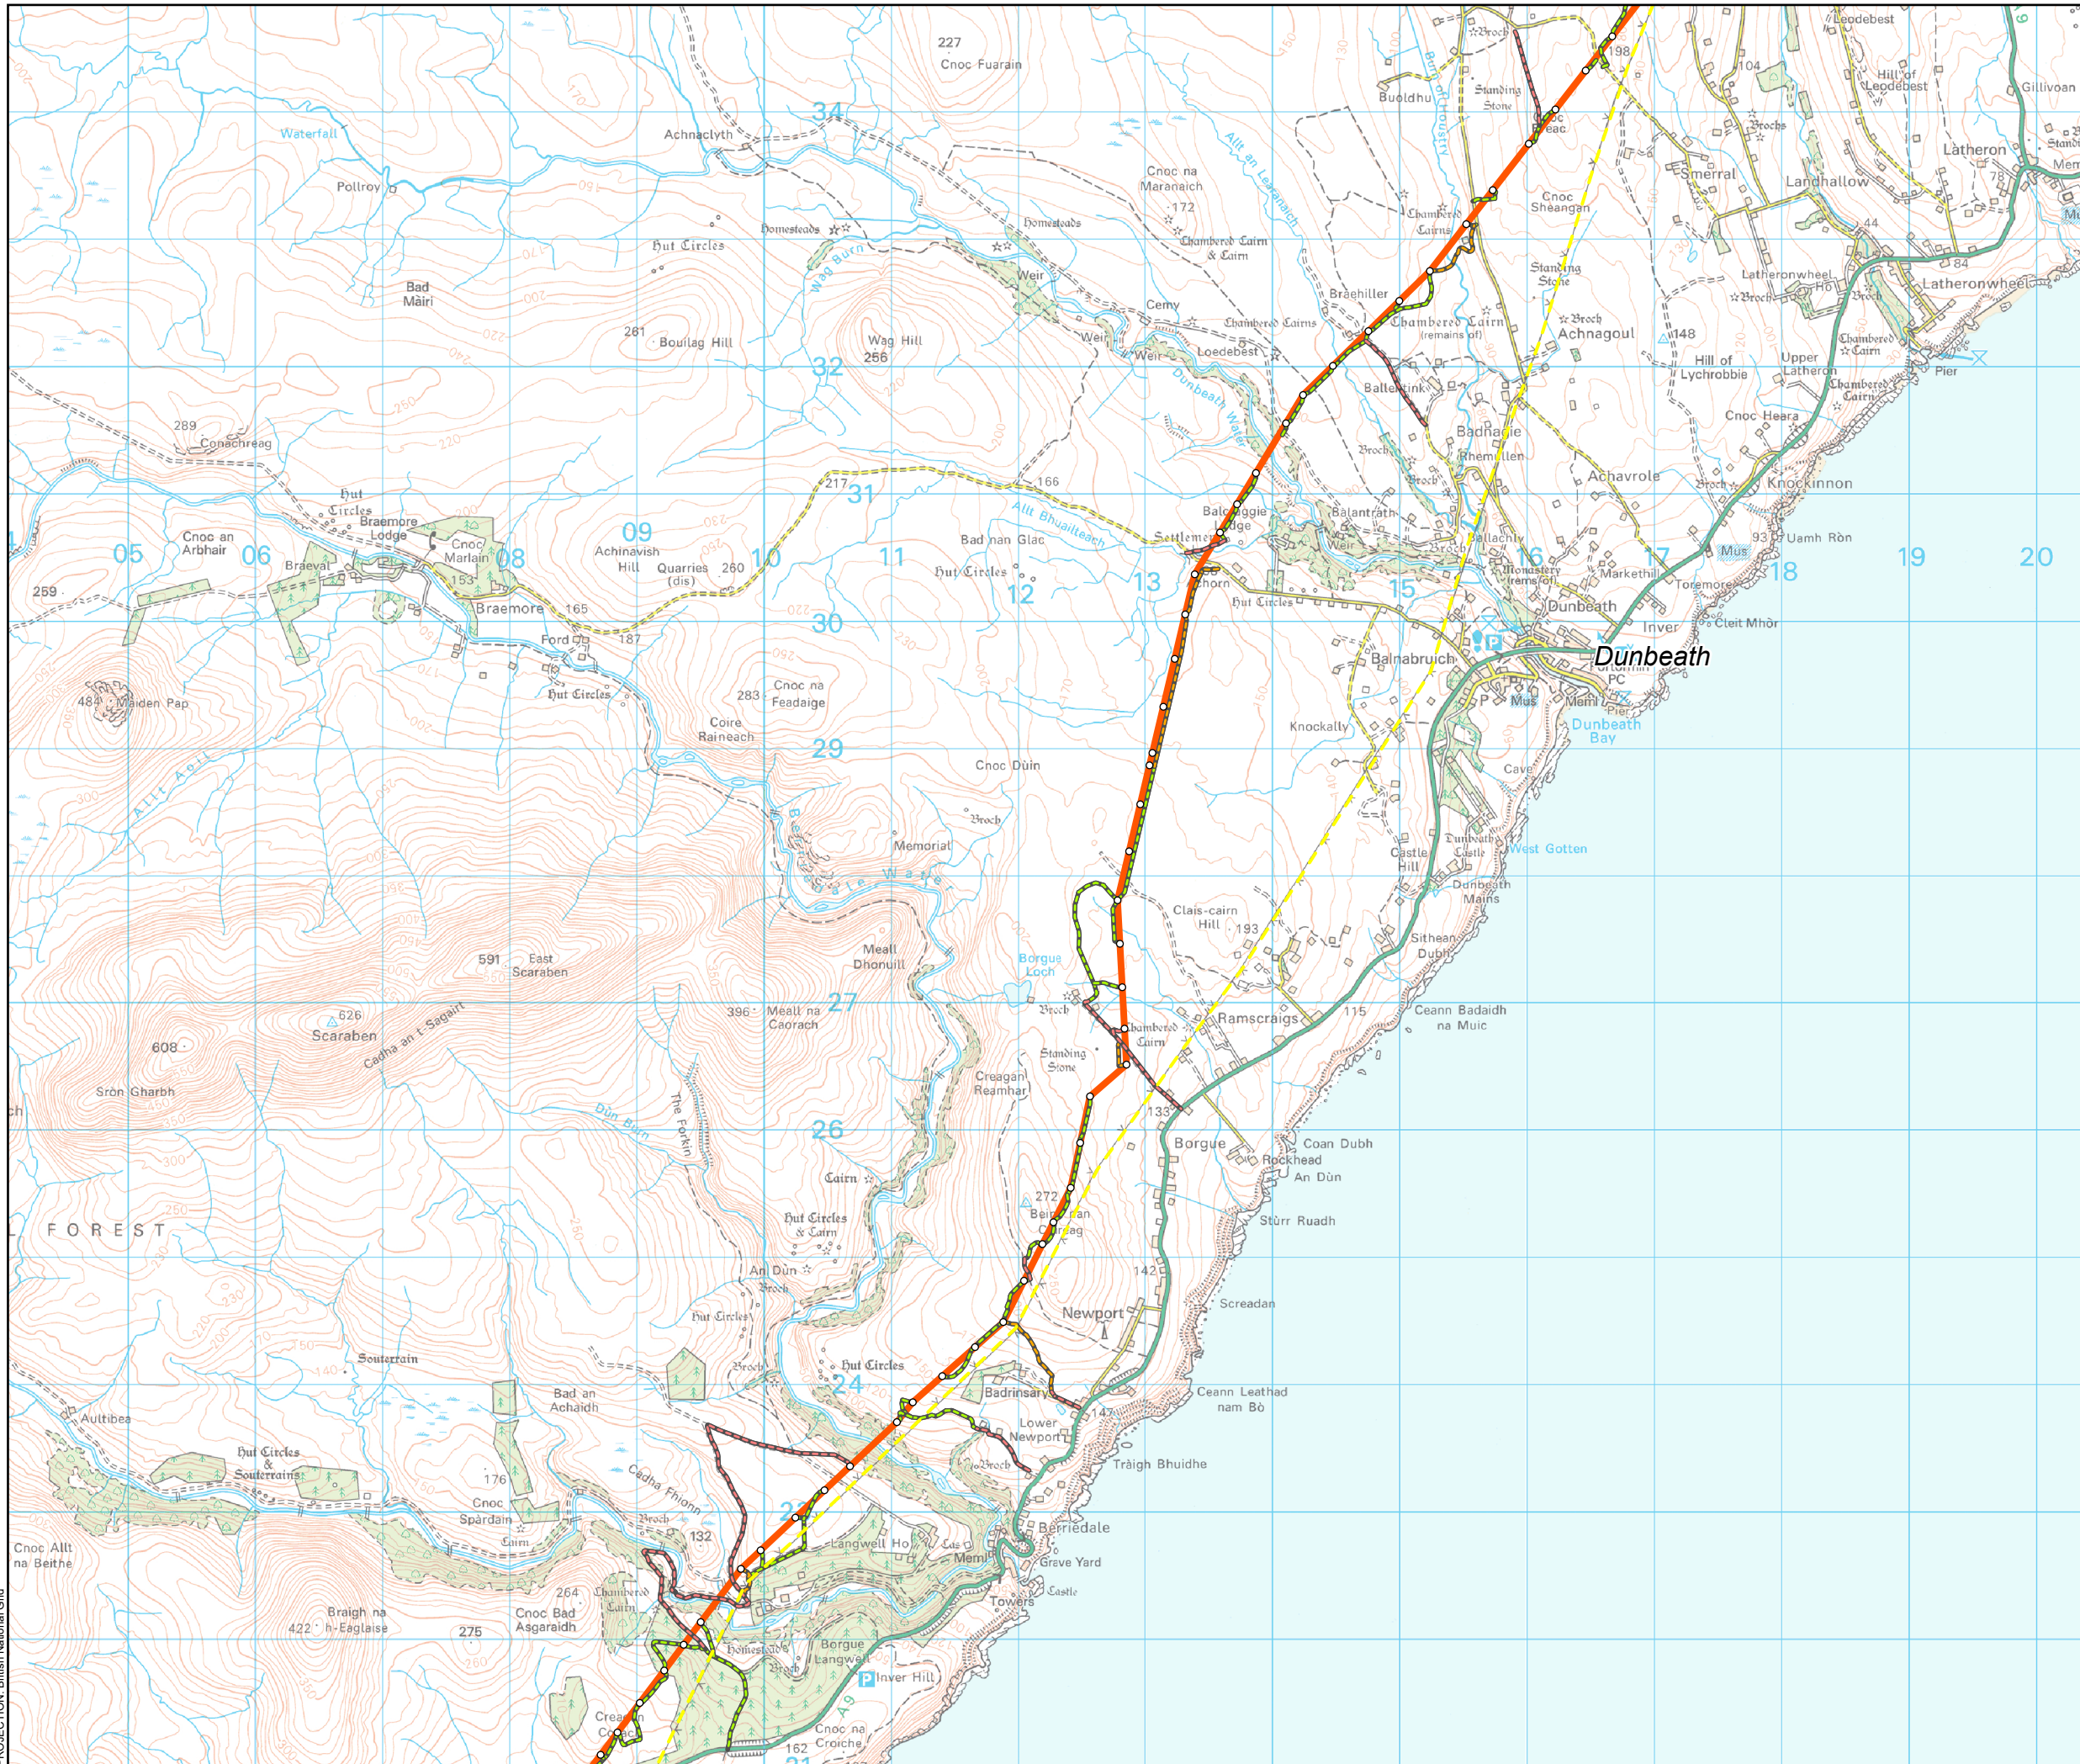


- Tower Location
- Indicative Substation Location
- - - Existing 132kV OHL

Proposed Infrastructure:

- Proposed Alignment Section A
- Proposed Alignment Section B
- Proposed Alignment Section C
- Proposed Alignment Section D
- Proposed Alignment Section E
- - - Existing Access Track - Upgrade Required
- New Permanent Access Track
- New Temporary Access Track


SSEN Transmission take no responsibility for the release or accuracy of latest version basemaps from Ordnance Survey

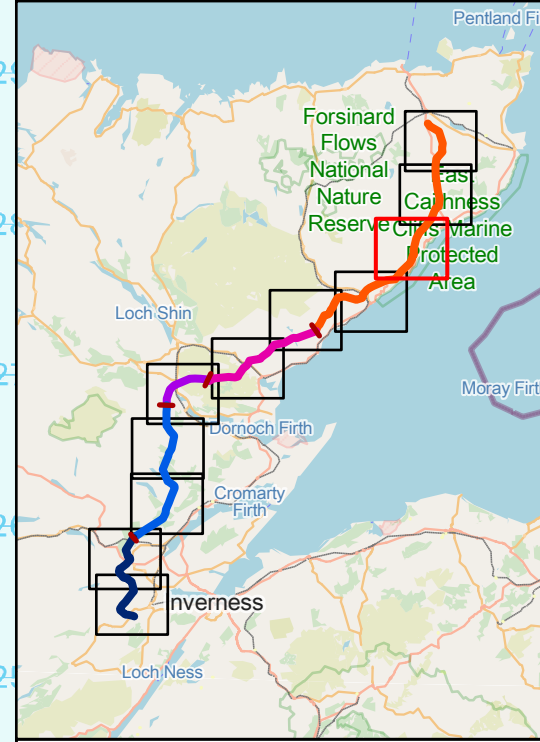

SCALE: See Scale Bar	VERSION: A01
SIZE: A3	DRAWN: WB
PROJECT: 0720281	CHECKED: ES
DATE: 30/01/2025	APPROVED: KG


Spittal - Loch Buidhe - Beauly 400kV Connection Proposed Infrastructure: Page 3

PROJECTION: British National Grid

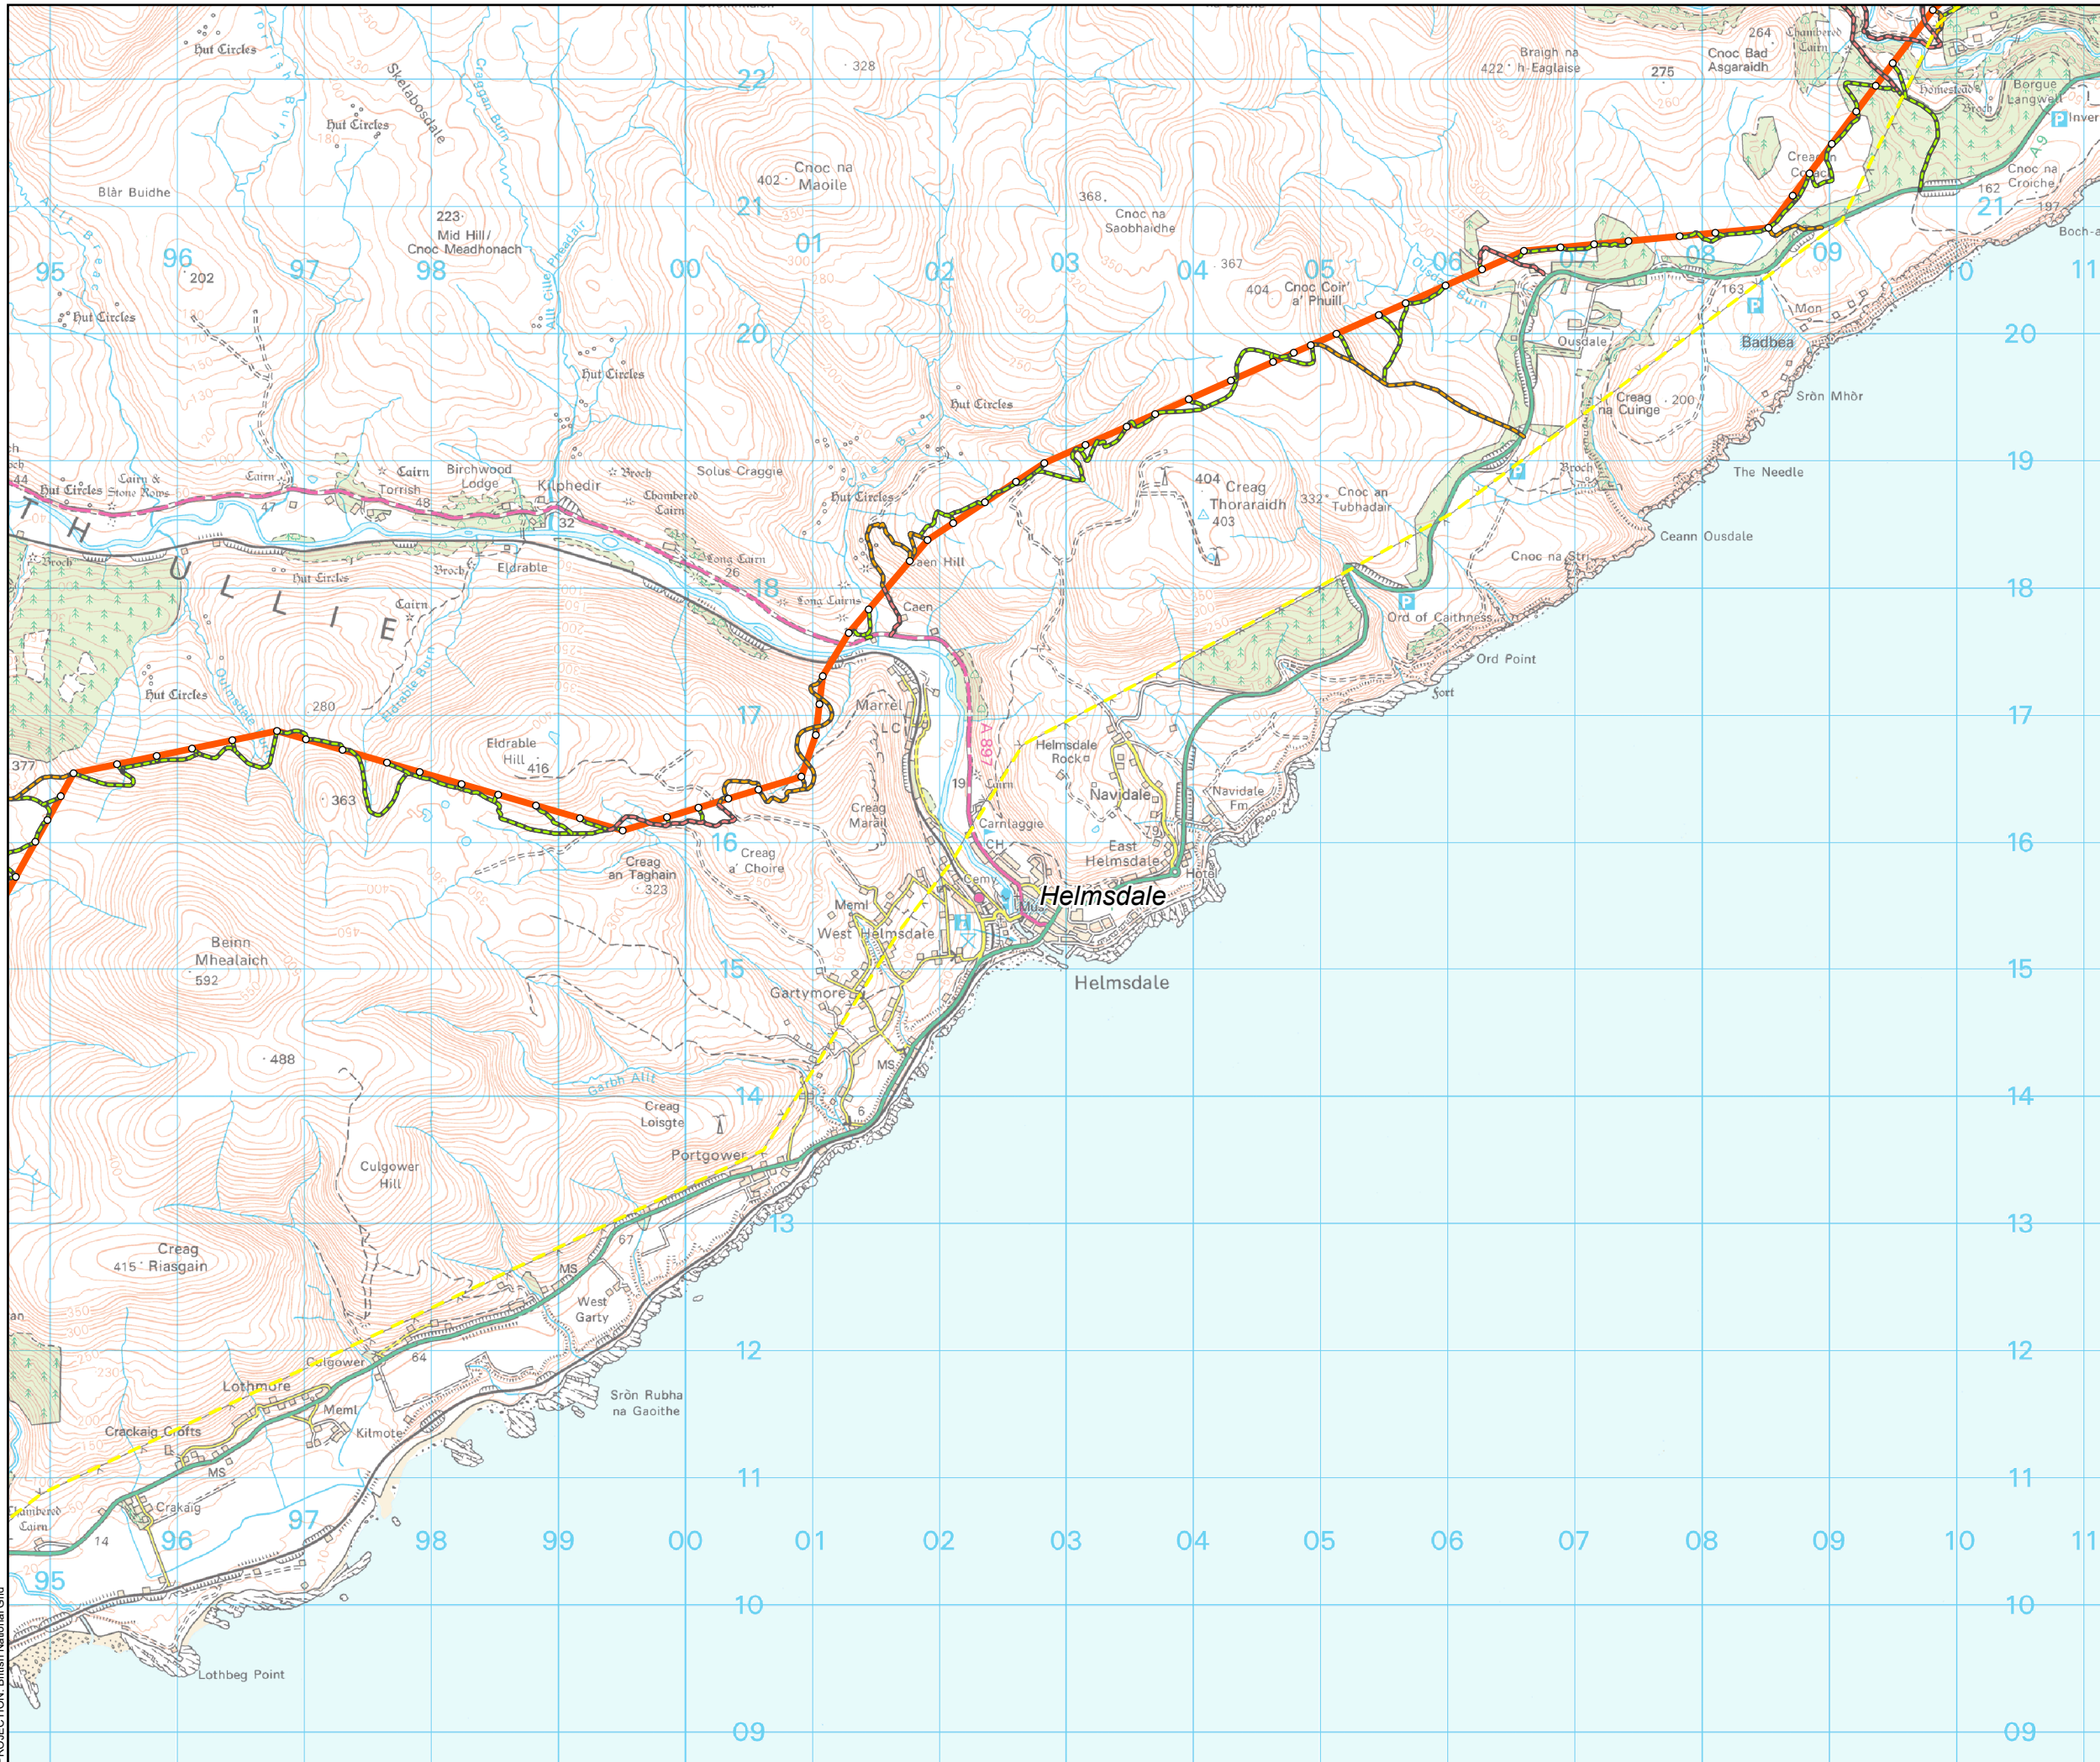

- Tower Location
- Indicative Substation Location
- - - Existing 132kV OHL
- Proposed Infrastructure:**
- Proposed Alignment Section A
- Proposed Alignment Section B
- Proposed Alignment Section C
- Proposed Alignment Section D
- Proposed Alignment Section E
- - - Existing Access Track - Upgrade Required
- New Permanent Access Track
- New Temporary Access Track

SSEN Transmission take no responsibility for the release or accuracy of latest version basemaps from Ordnance Survey

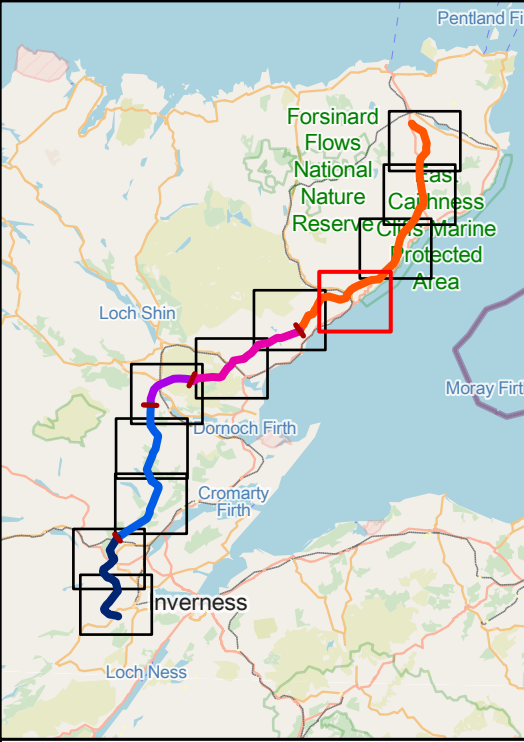


SCALE: See Scale Bar	VERSION: A01
SIZE: A3	DRAWN: WB
PROJECT: 0720281	CHECKED: ES
DATE: 30/01/2025	APPROVED: KG

Spittal - Loch Buidhe - Beauly 400kV Connection Proposed Infrastructure: Page 4




PROJECTION: British National Grid

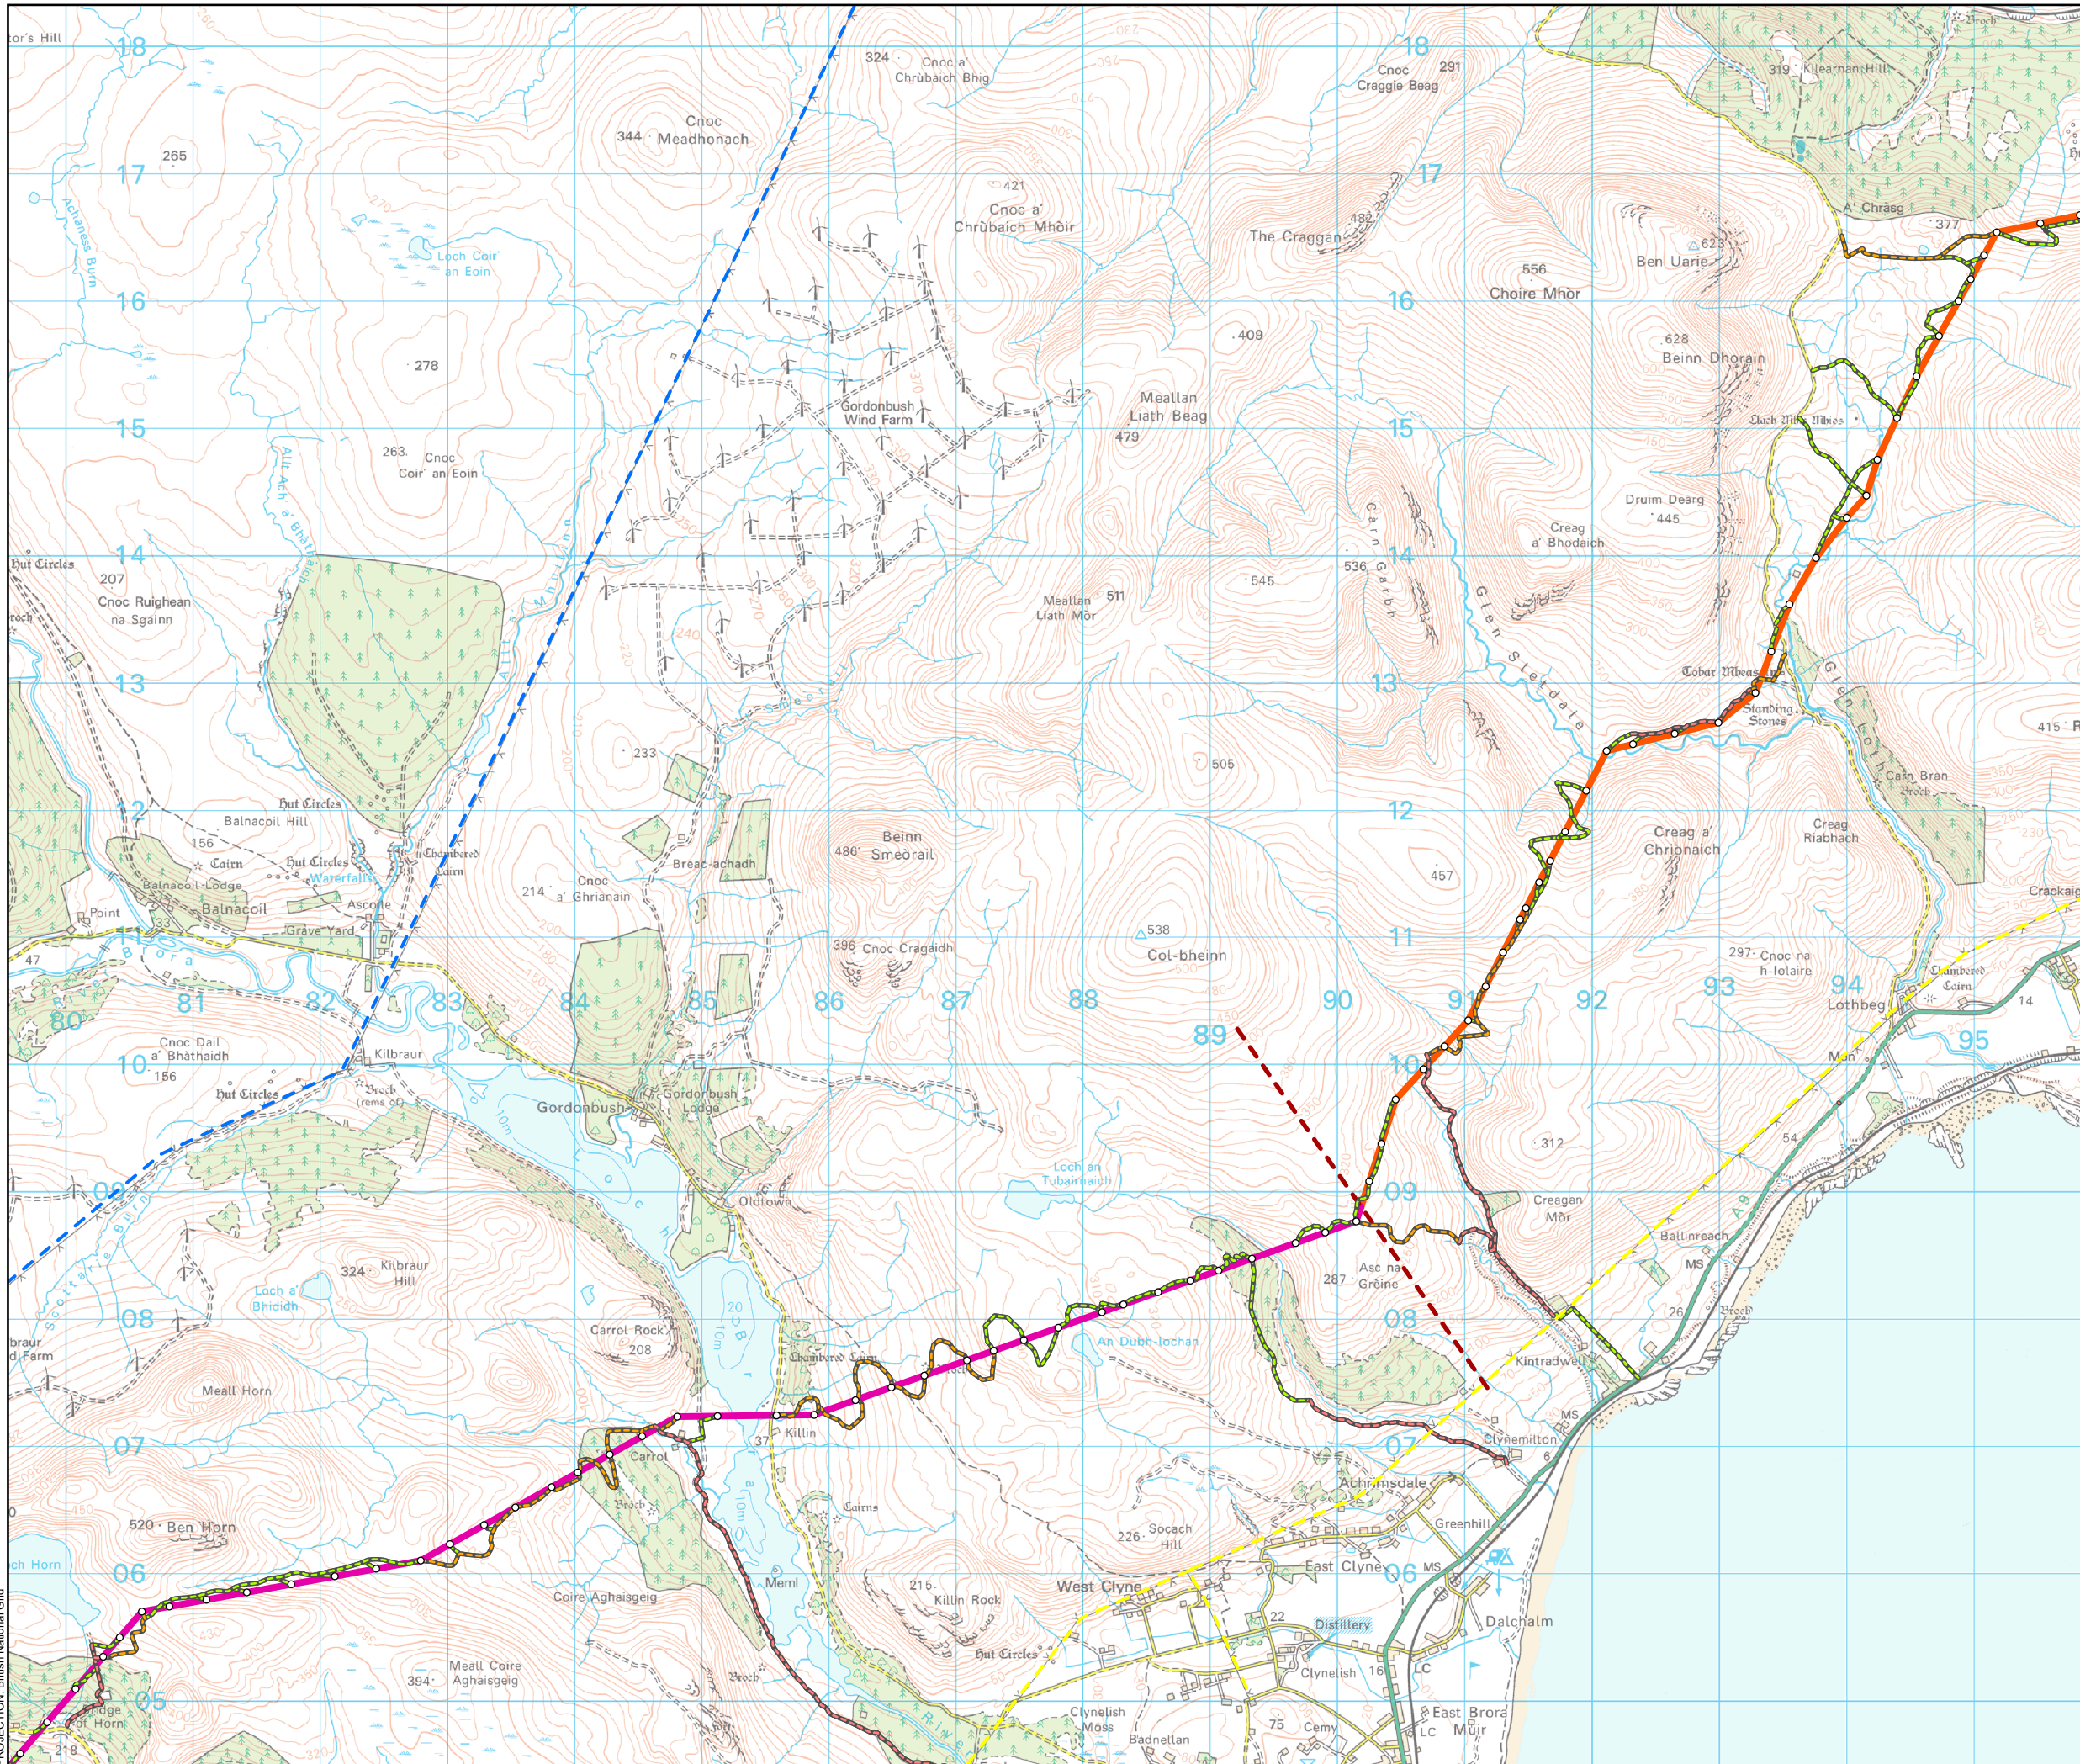

- Tower Location
 - Indicative Substation Location
 - Existing 132kV OHL
 - Existing 275kV OHL
- Proposed Infrastructure:
- Alignment Section Break
 - Proposed Alignment Section A
 - Proposed Alignment Section B
 - Proposed Alignment Section C
 - Proposed Alignment Section D
 - Proposed Alignment Section E
 - Existing Access Track - Upgrade Required
 - New Permanent Access Track
 - New Temporary Access Track

SSEN Transmission take no responsibility for the release or accuracy of latest version basemaps from Ordnance Survey

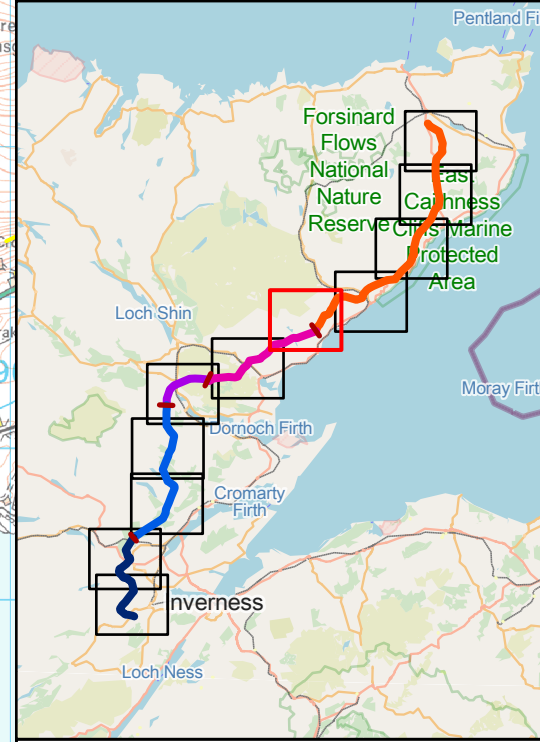


SCALE: See Scale Bar	VERSION: A01
SIZE: A3	DRAWN: WB
PROJECT: 0720281	CHECKED: ES
DATE: 30/01/2025	APPROVED: KG

Spittal - Loch Buidhe - Beauly 400kV Connection Proposed Infrastructure:
Page 5





PROJECTION: British National Grid

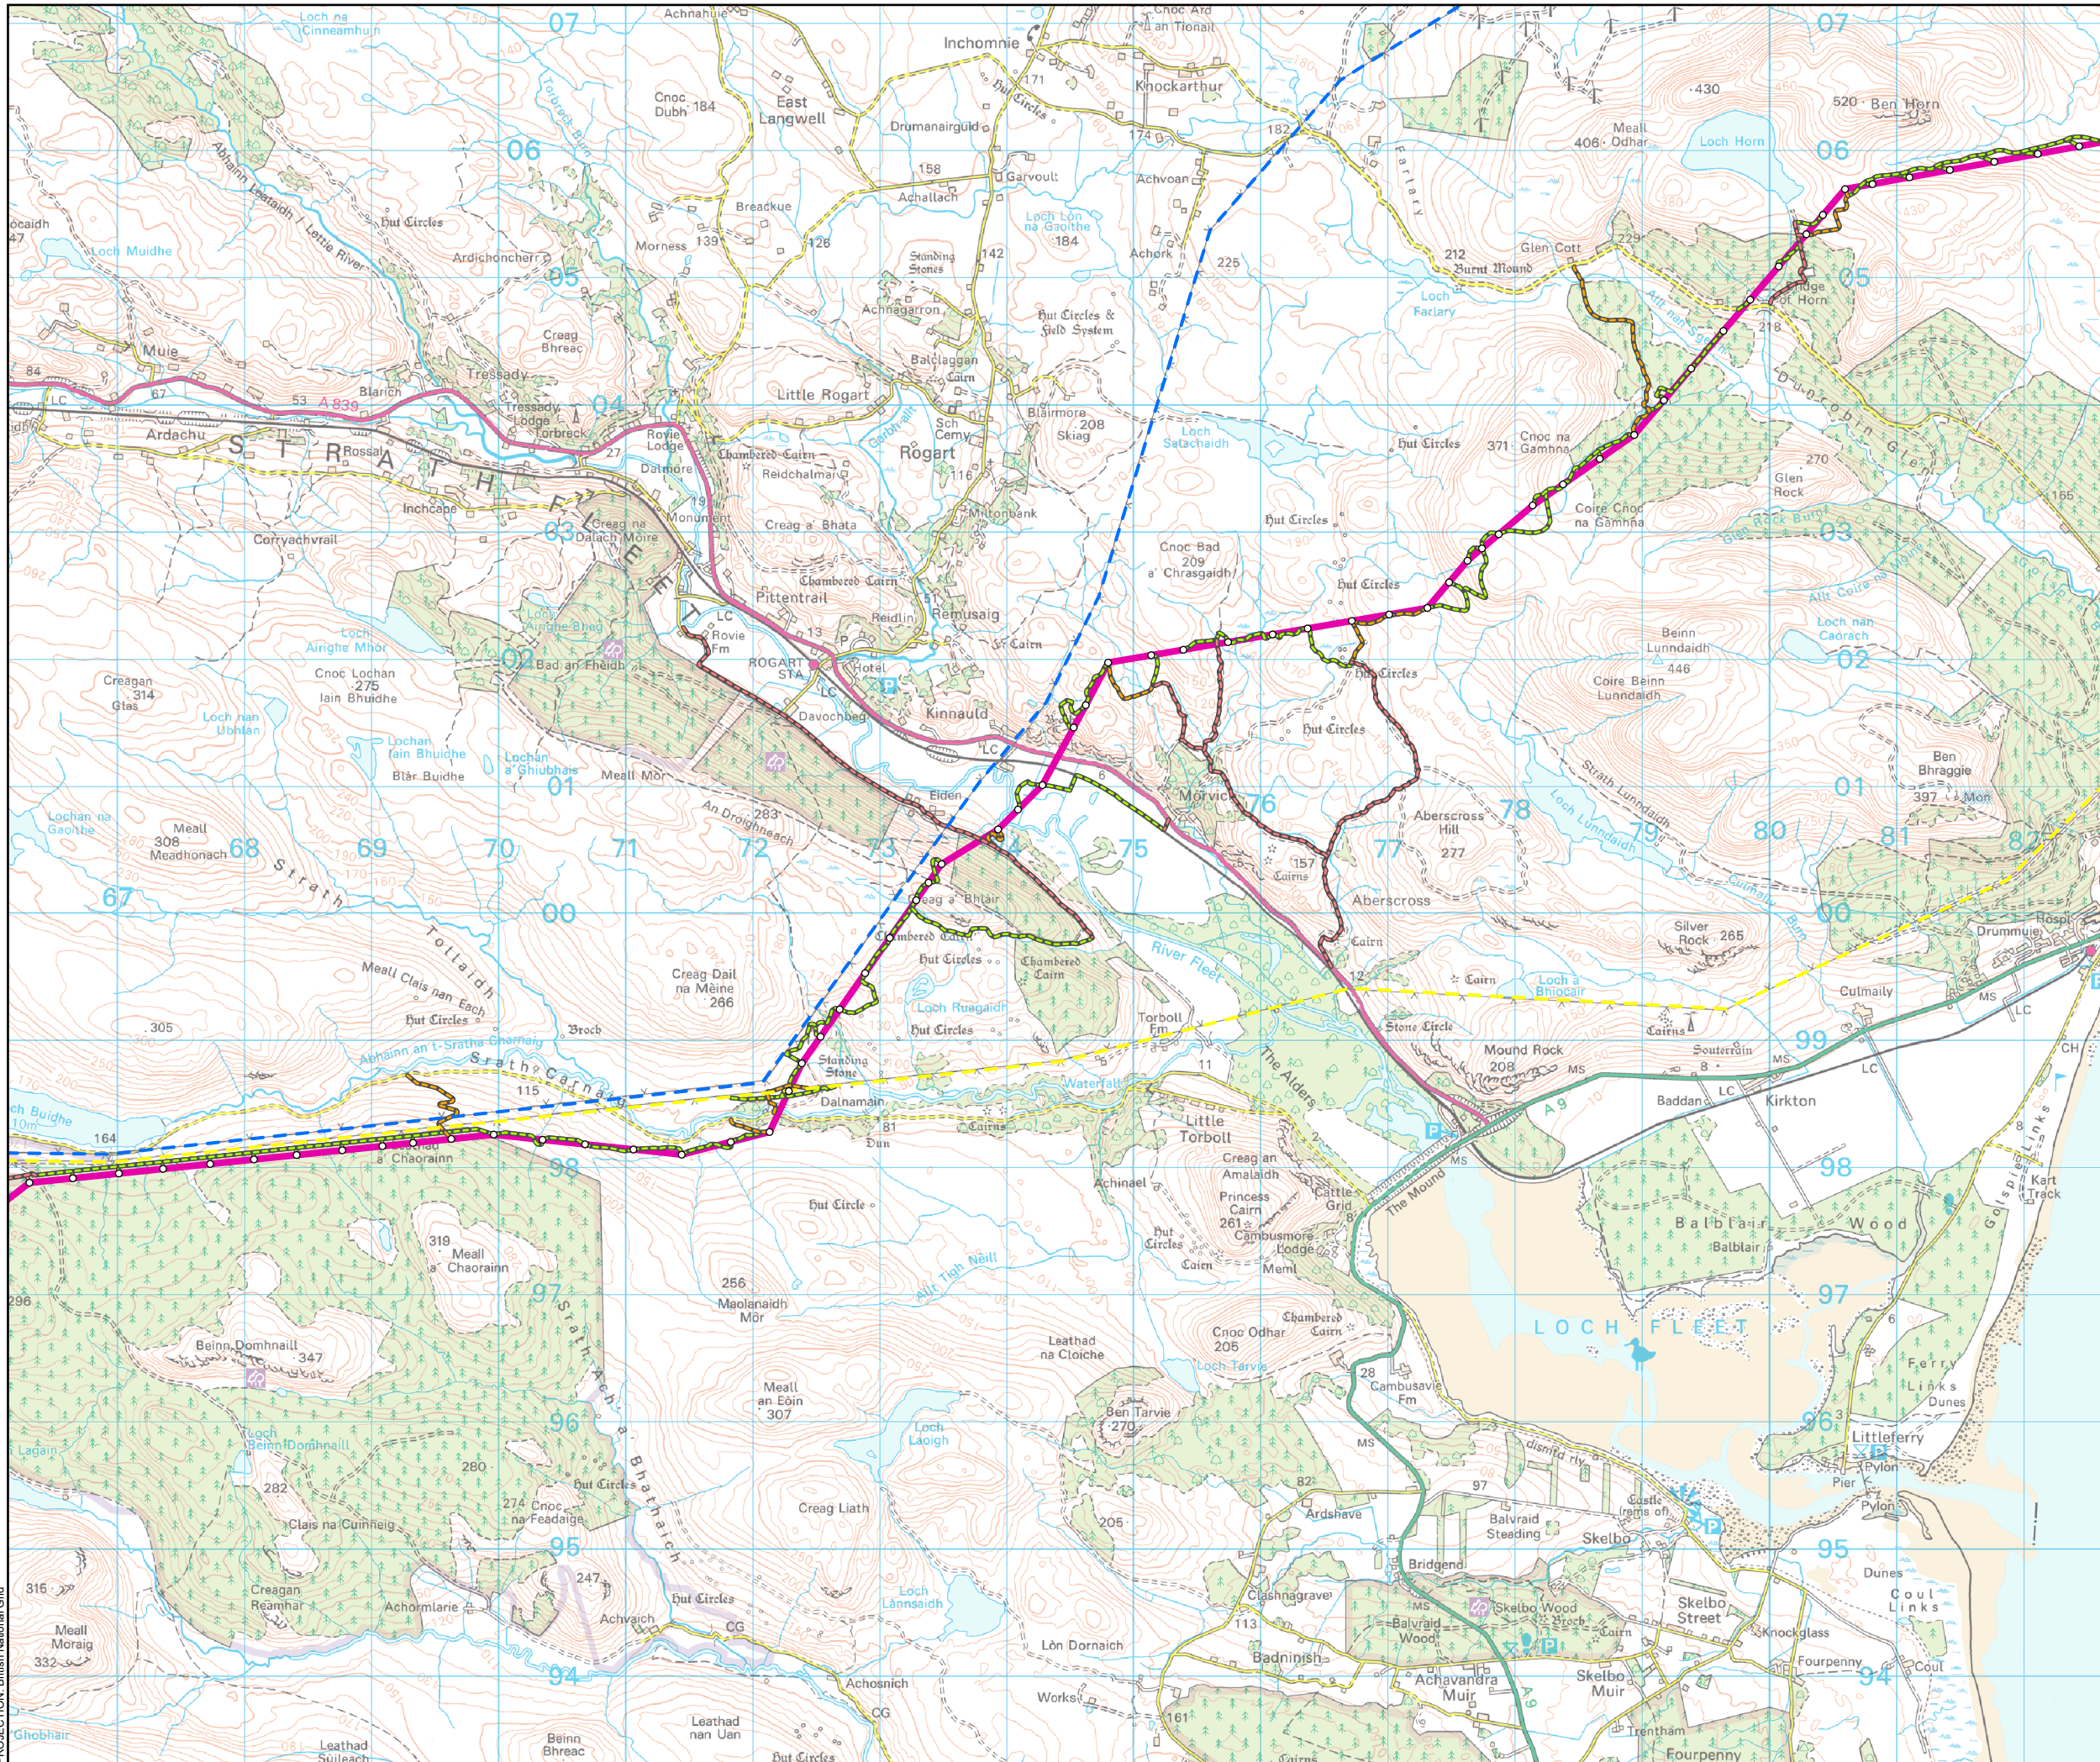


- Tower Location
 - Indicative Substation Location
 - Existing 132kV OHL
 - Existing 275kV OHL
- Proposed Infrastructure:
- Proposed Alignment Section A
 - Proposed Alignment Section B
 - Proposed Alignment Section C
 - Proposed Alignment Section D
 - Proposed Alignment Section E
 - Existing Access Track - Upgrade Required
 - New Permanent Access Track
 - New Temporary Access Track

SSEN Transmission take no responsibility for the release or accuracy of latest version basemaps from Ordnance Survey

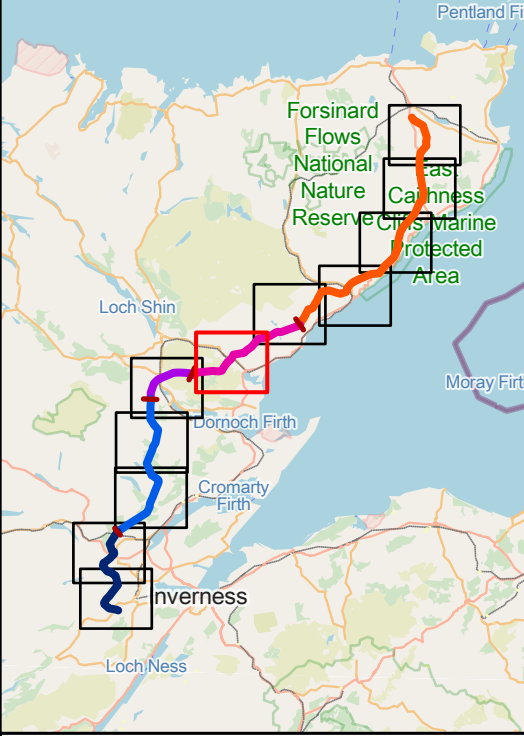

SCALE: See Scale Bar	VERSION: A01
SIZE: A3	DRAWN: WB
PROJECT: 0720281	CHECKED: ES
DATE: 30/01/2025	APPROVED: KG

Spittal - Loch Buidhe - Beauly 400kV Connection Proposed Infrastructure: Page 6

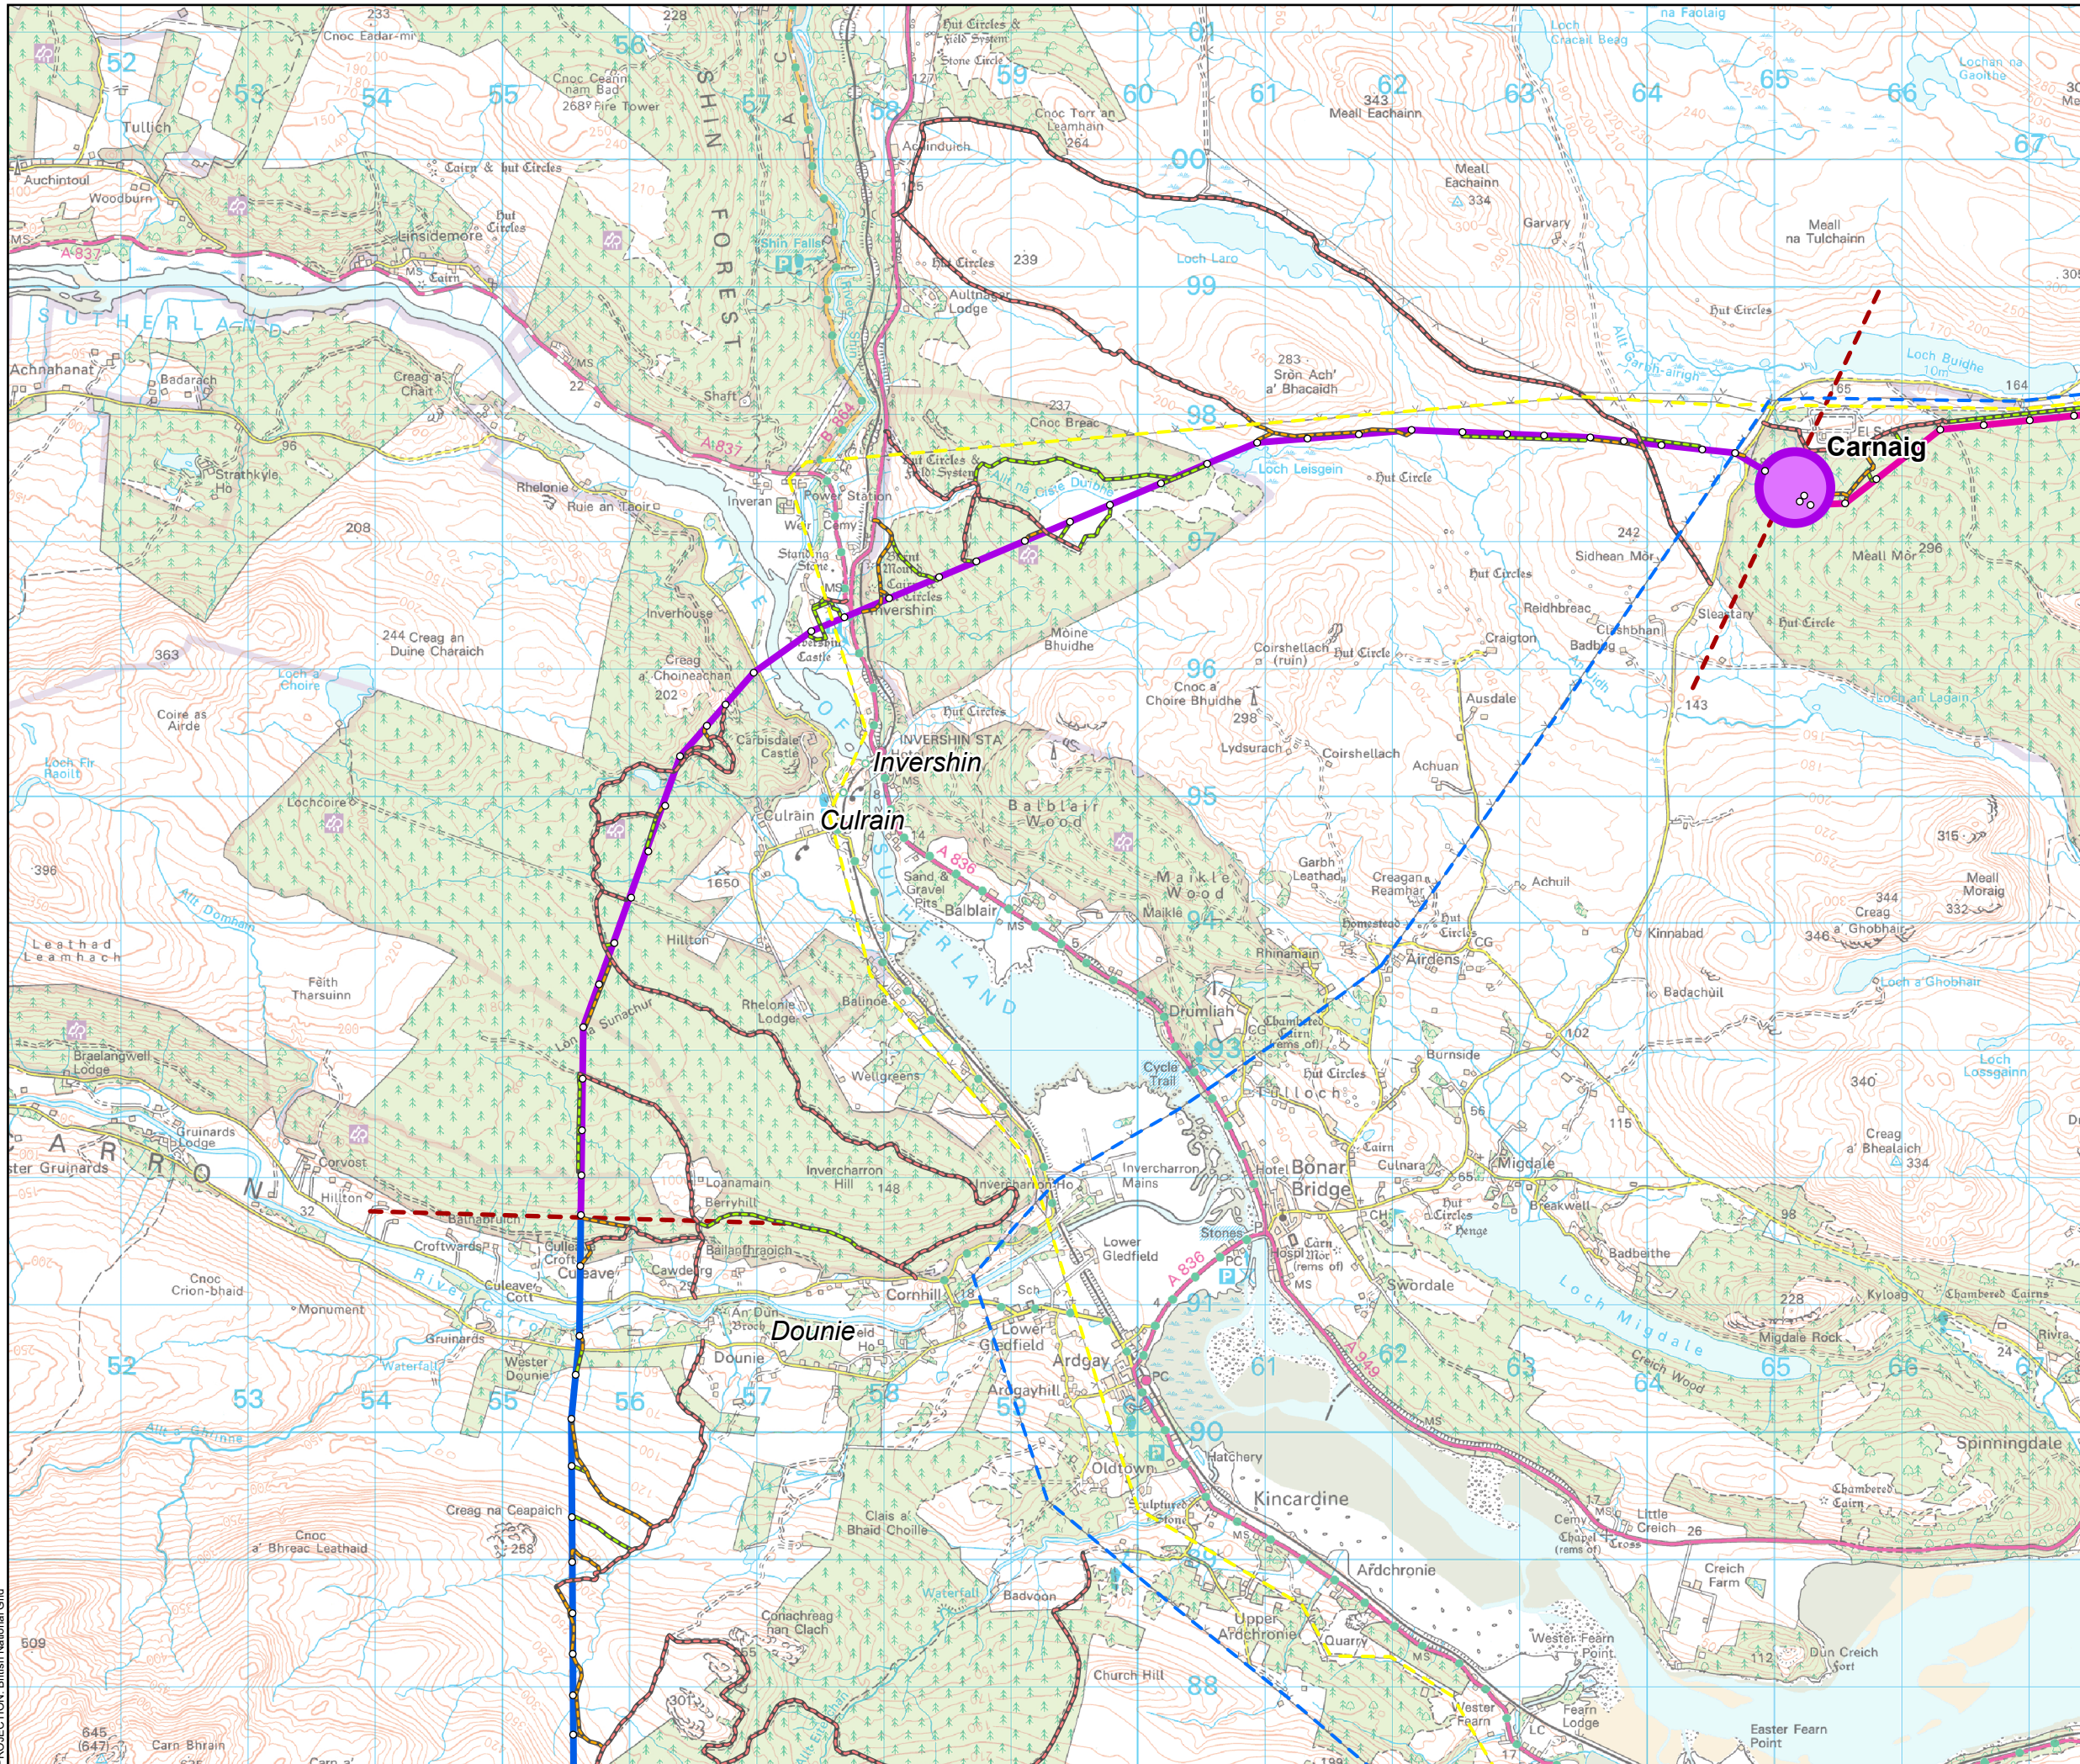


- Tower Location
- Indicative Substation Location
- Existing 132kV OHL
- Existing 275kV OHL

Proposed Infrastructure:

- - - Alignment Section Break
- Proposed Alignment Section A
- Proposed Alignment Section B
- Proposed Alignment Section C
- Proposed Alignment Section D
- Proposed Alignment Section E
- Existing Access Track - Upgrade Required
- New Permanent Access Track
- New Temporary Access Track


SSEN Transmission take no responsibility for the release or accuracy of latest version basemaps from Ordnance Survey

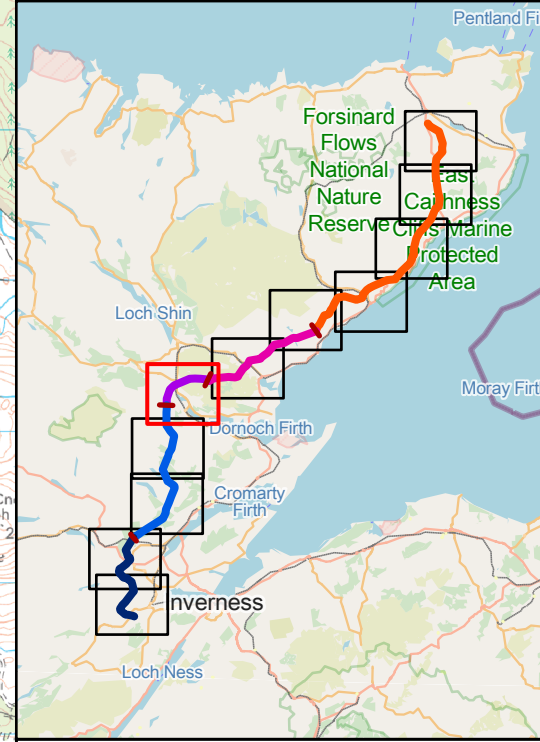

SCALE: See Scale Bar	VERSION: A01
SIZE: A3	DRAWN: WB
PROJECT: 0720281	CHECKED: ES
DATE: 30/01/2025	APPROVED: KG



Spittal - Loch Buidhe - Beauly 400kV Connection Proposed Infrastructure: Page 7

PROJECTION: British National Grid

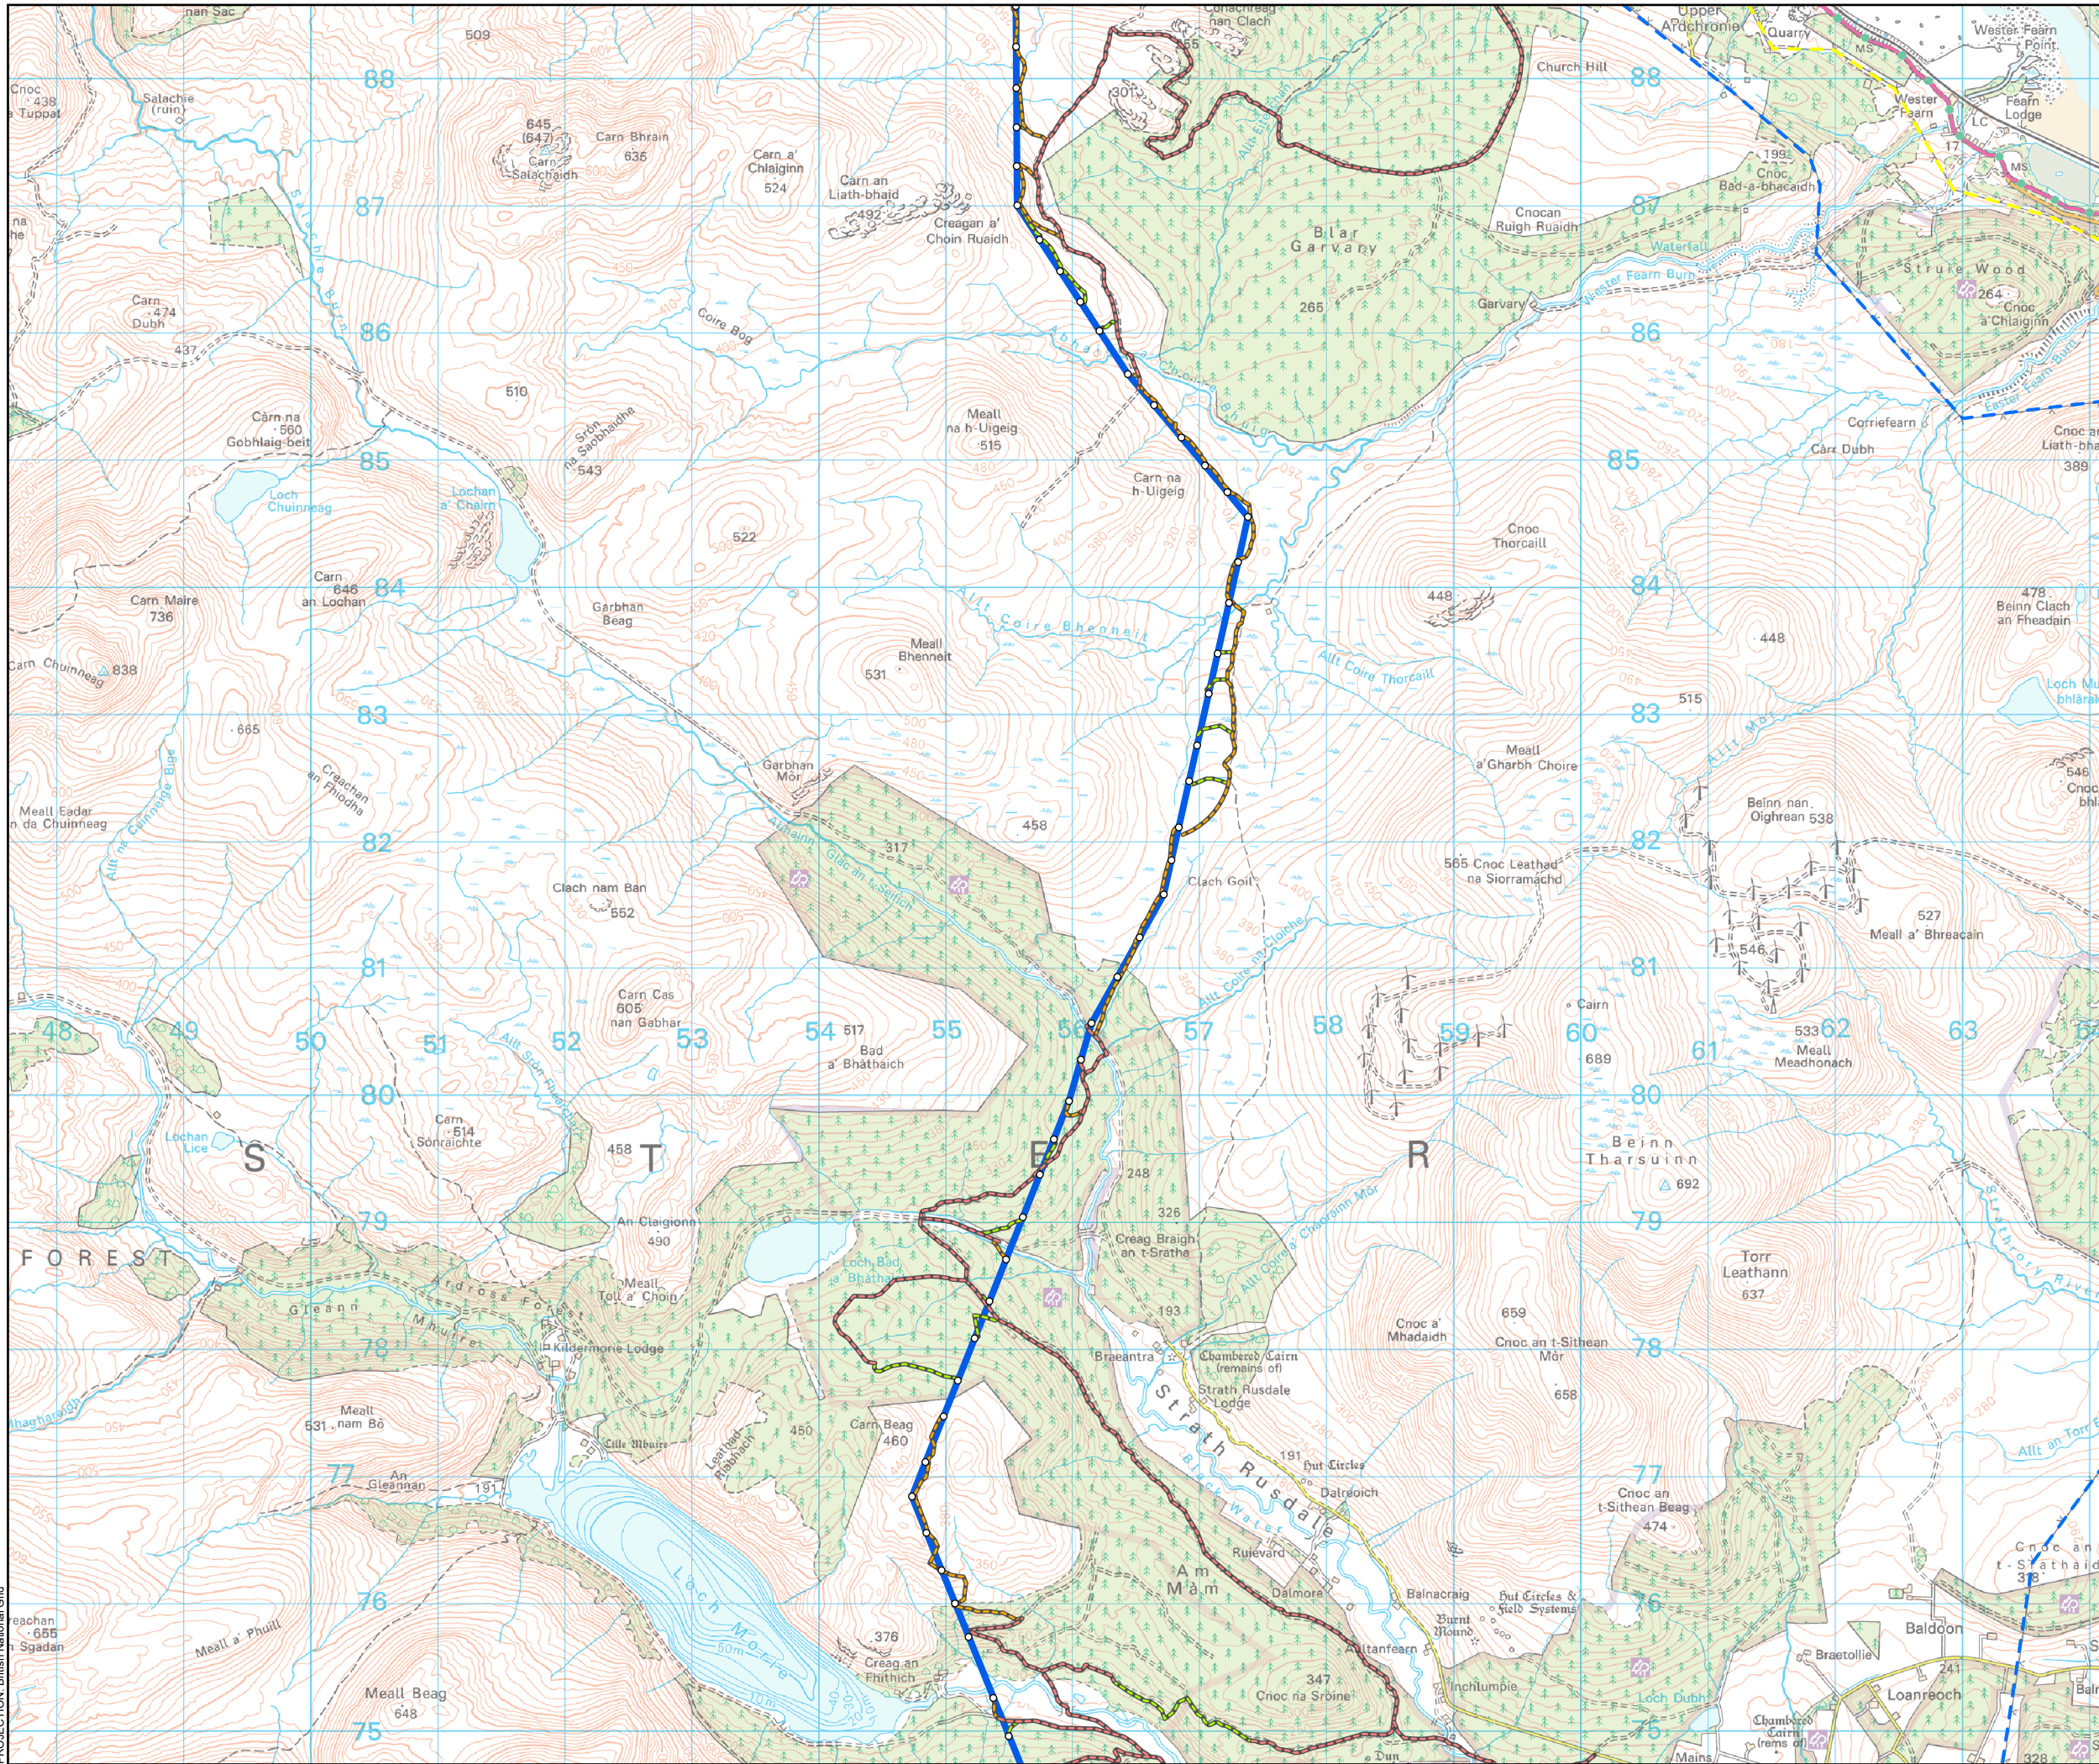


- Tower Location
 - Indicative Substation Location
 - Existing 132kV OHL
 - Existing 275kV OHL
- Proposed Infrastructure:
- Proposed Alignment Section A
 - Proposed Alignment Section B
 - Proposed Alignment Section C
 - Proposed Alignment Section D
 - Proposed Alignment Section E
 - Existing Access Track - Upgrade Required
 - New Permanent Access Track
 - New Temporary Access Track

SSEN Transmission take no responsibility for the release or accuracy of latest version basemaps from Ordnance Survey

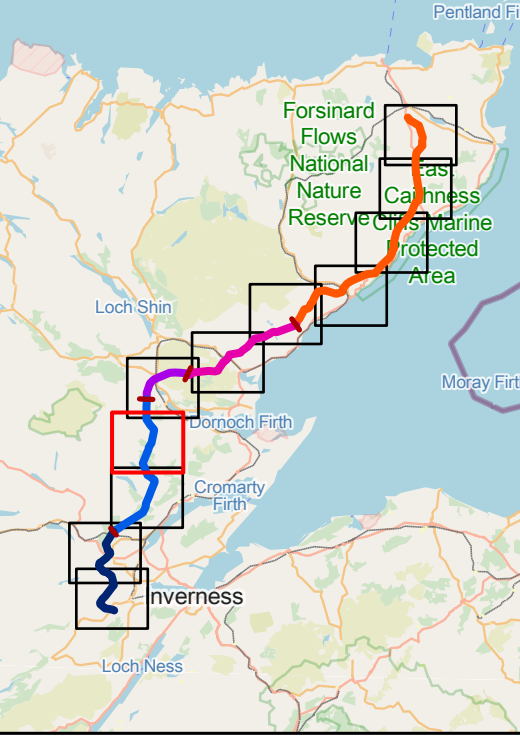


SCALE: See Scale Bar	VERSION: A01
SIZE: A3	DRAWN: WB
PROJECT: 0720281	CHECKED: ES
DATE: 30/01/2025	APPROVED: KG

Spittal - Loch Buidhe - Beaulie 400kV Connection Proposed Infrastructure: Page 8

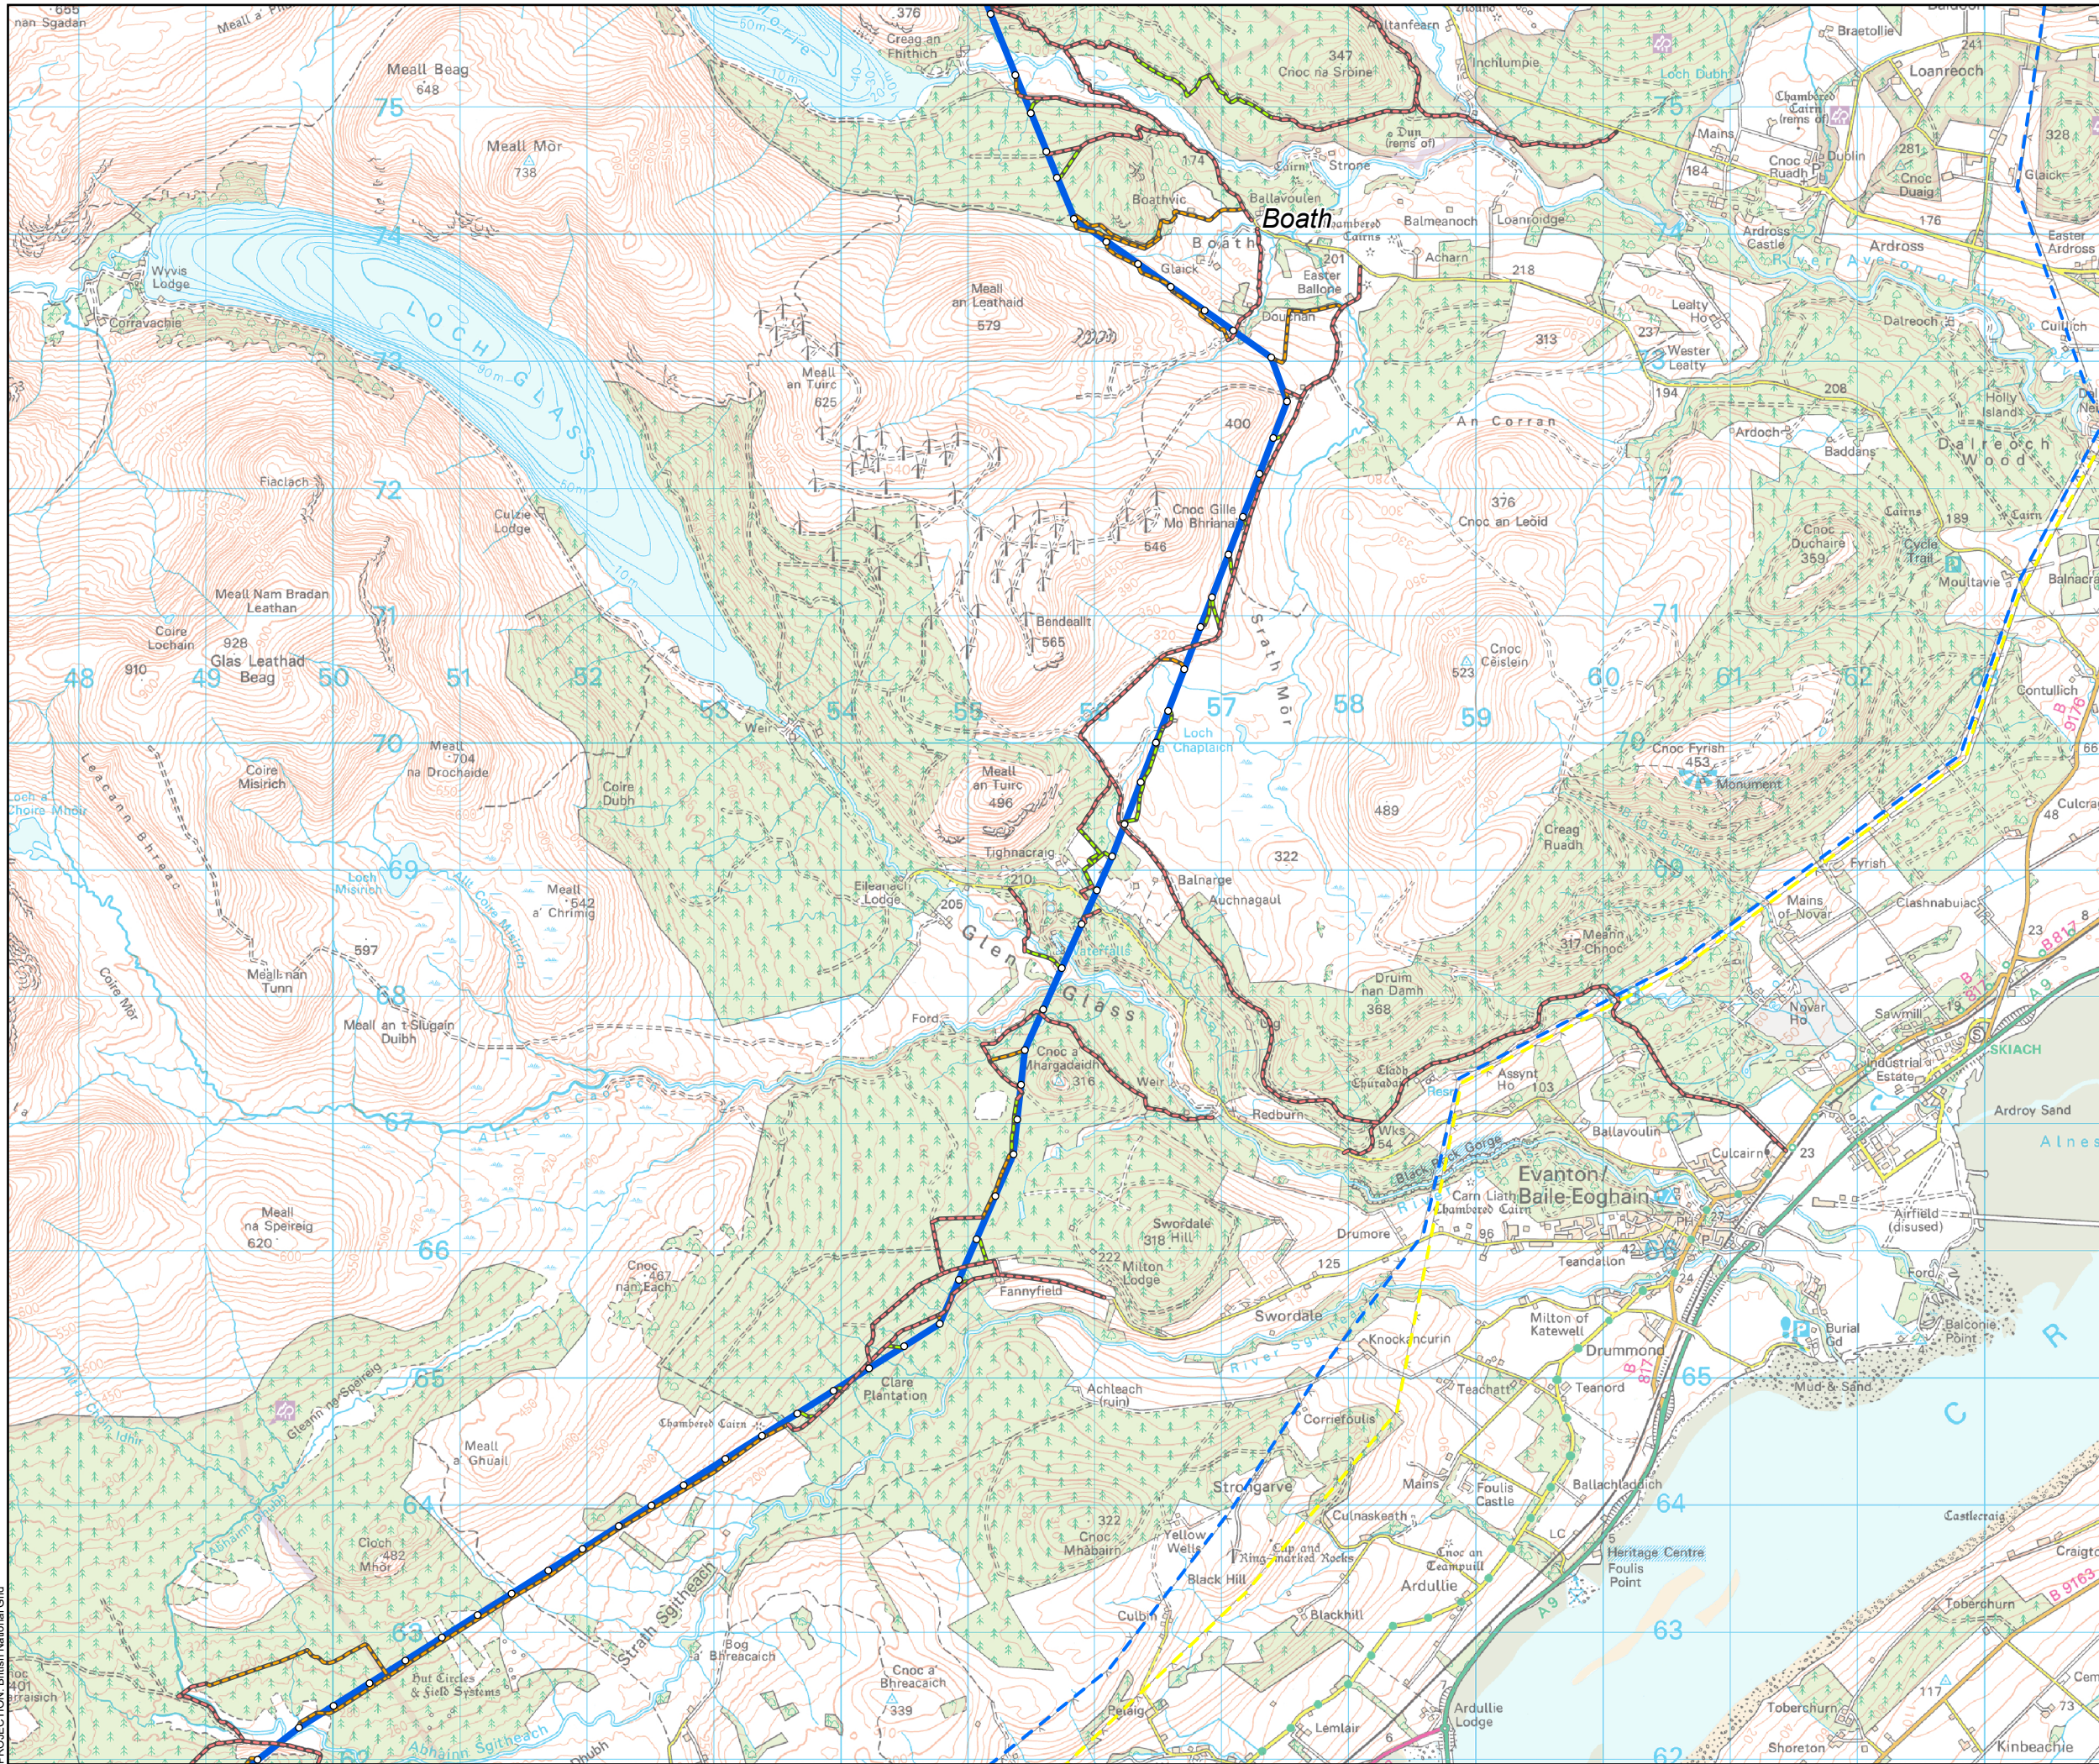

- Tower Location
 - Indicative Substation Location
 - Existing 132kV OHL
 - Existing 275kV OHL
- Proposed Infrastructure:
- Proposed Alignment Section A
 - Proposed Alignment Section B
 - Proposed Alignment Section C
 - Proposed Alignment Section D
 - Proposed Alignment Section E
 - Existing Access Track - Upgrade Required
 - New Permanent Access Track
 - New Temporary Access Track

SSEN Transmission take no responsibility for the release or accuracy of latest version basemaps from Ordnance Survey

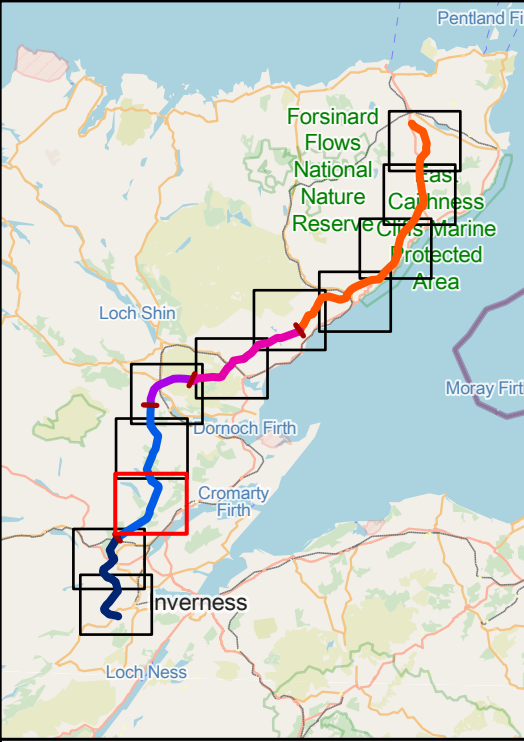


SCALE: See Scale Bar	VERSION: A01
SIZE: A3	DRAWN: WB
PROJECT: 0720281	CHECKED: ES
DATE: 30/01/2025	APPROVED: KG

Spittal - Loch Buidhe - Beauly 400kV Connection Proposed Infrastructure: Page 9




- Tower Location
 - Indicative Substation Location
 - - - Existing 132kV OHL
 - - - Existing 275kV OHL
- Proposed Infrastructure:
- - - Alignment Section Break
 - Proposed Alignment Section A
 - Proposed Alignment Section B
 - Proposed Alignment Section C
 - Proposed Alignment Section D
 - Proposed Alignment Section E
 - - - Existing Access Track - Upgrade Required
 - New Permanent Access Track
 - New Temporary Access Track

SSEN Transmission take no responsibility for the release or accuracy of latest version basemaps from Ordnance Survey

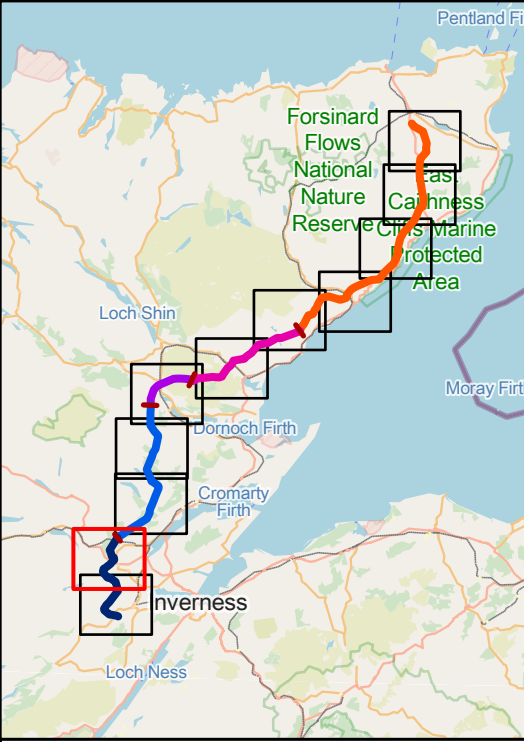



SCALE: See Scale Bar	VERSION: A01
SIZE: A3	DRAWN: WB
PROJECT: 0720281	CHECKED: ES
DATE: 30/01/2025	APPROVED: KG

Spittal - Loch Buidhe - Beauly 400kV Connection Proposed Infrastructure: Page 10

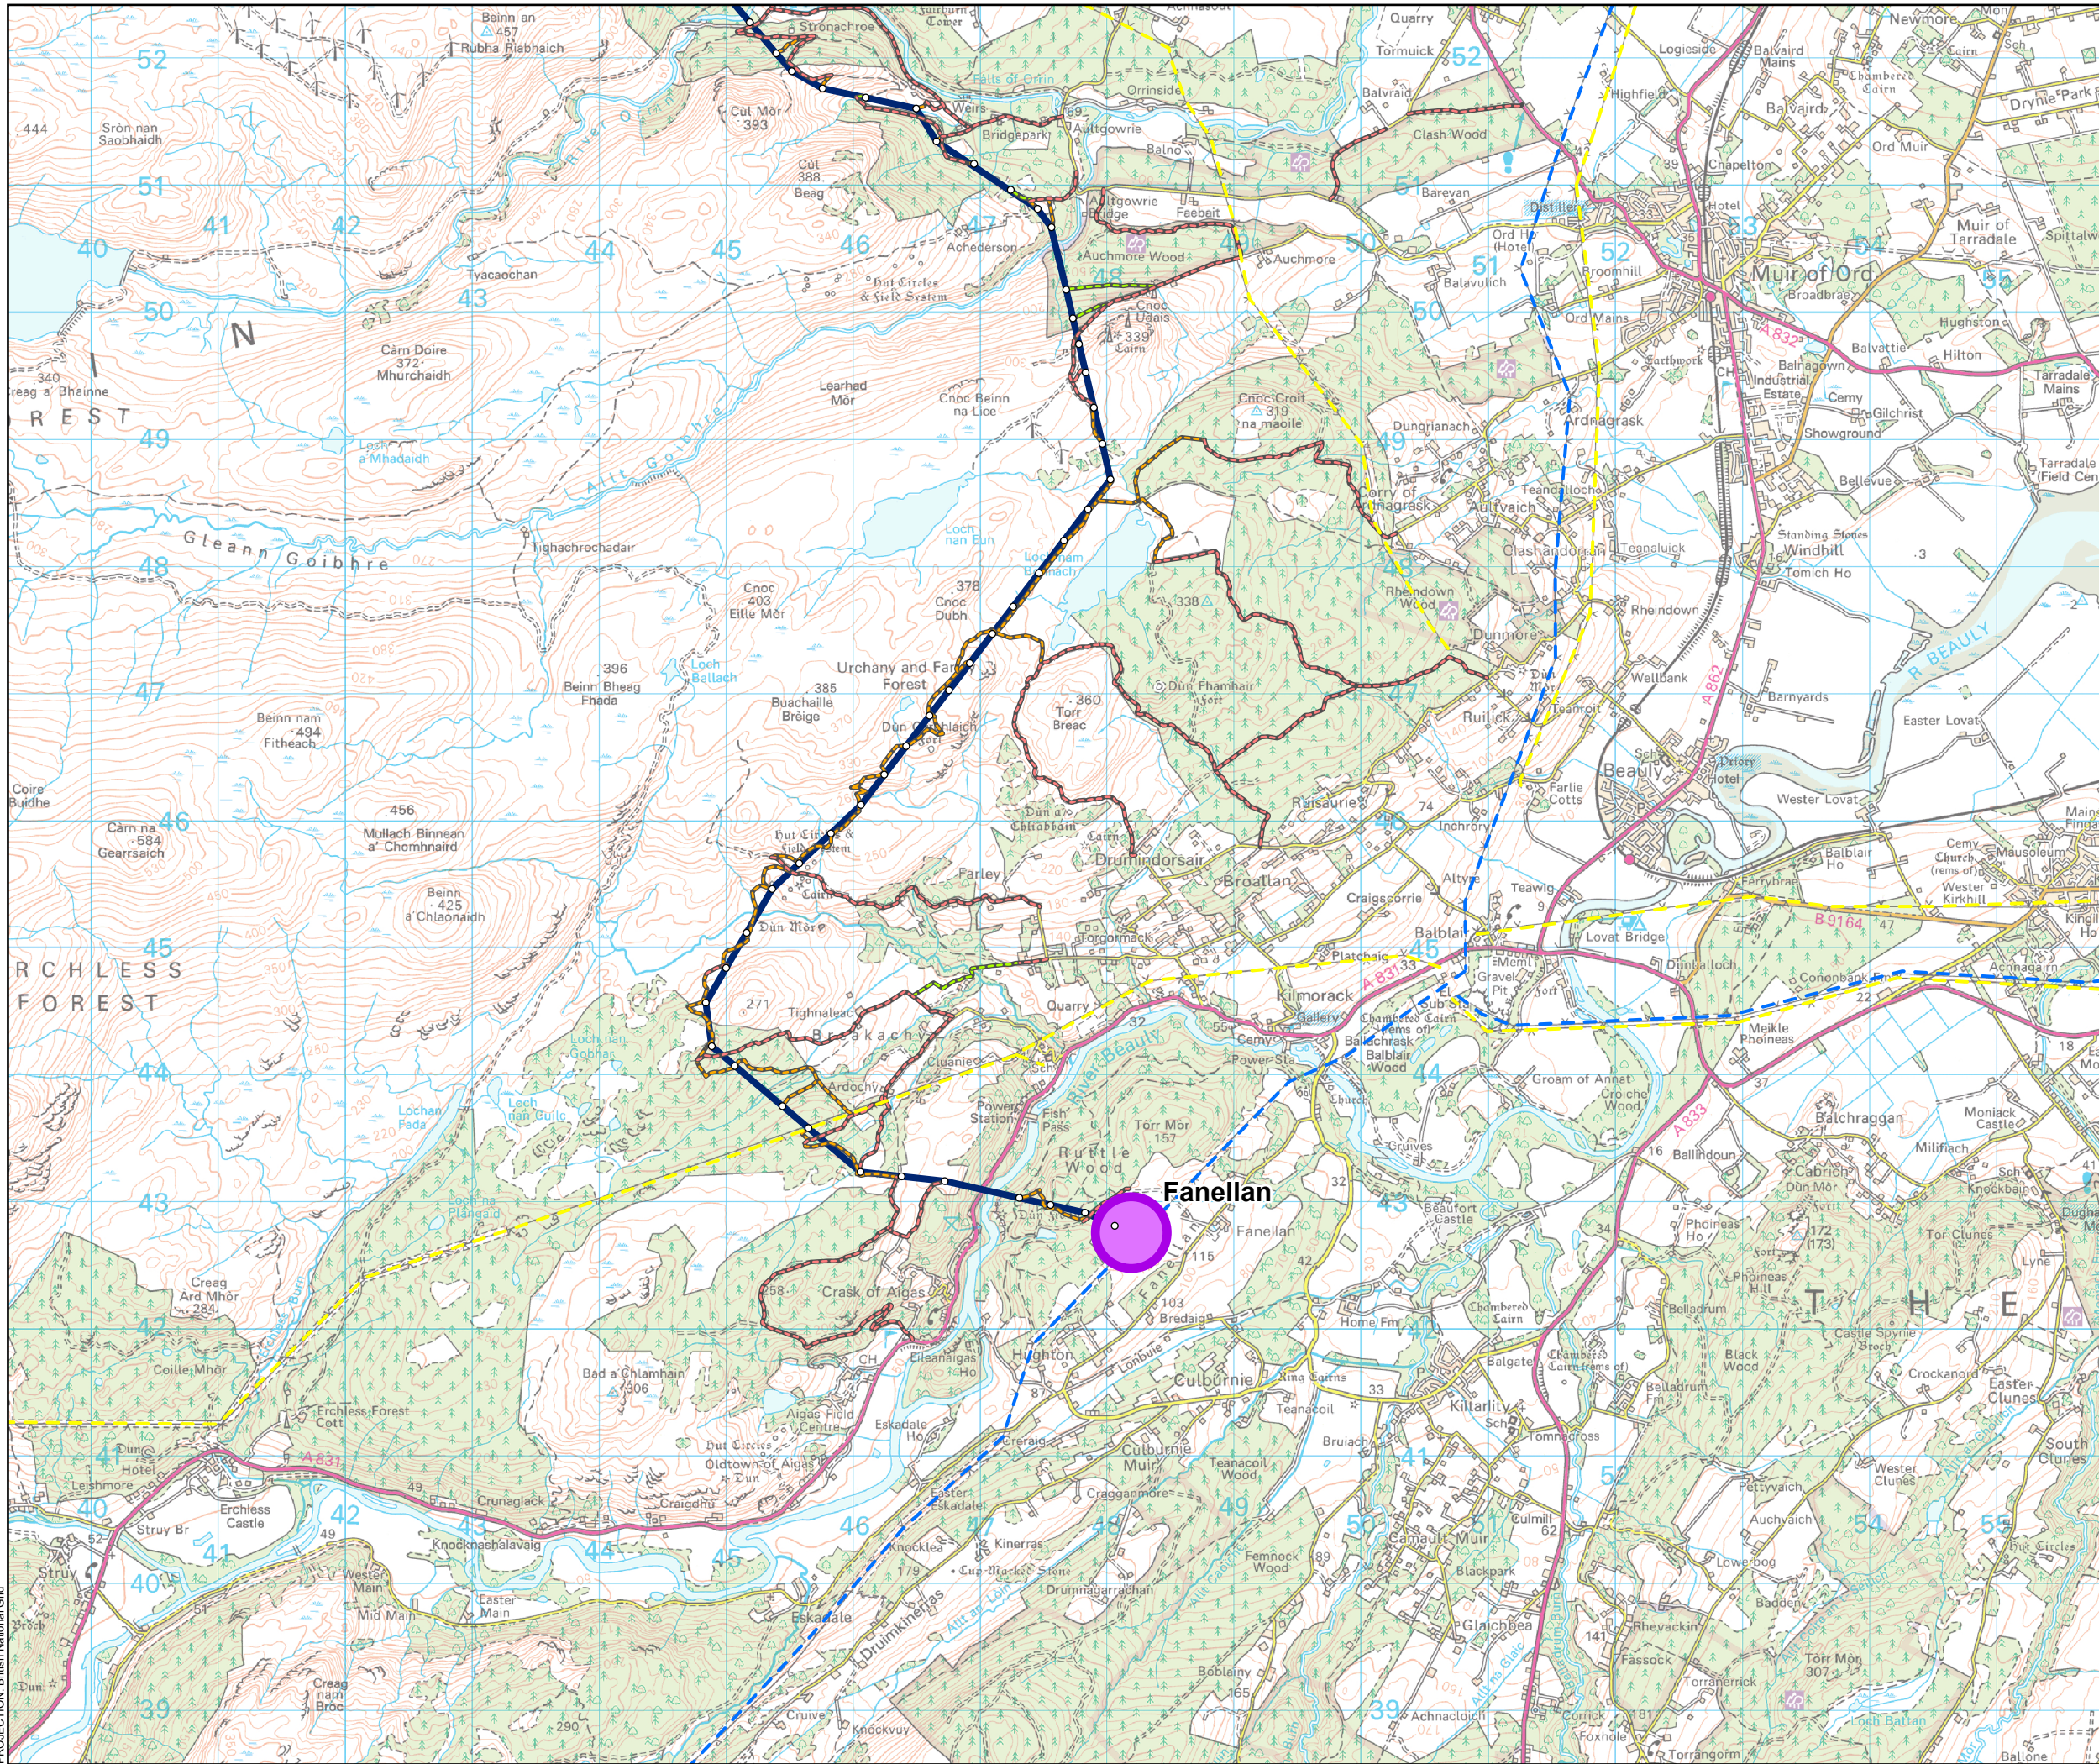

- Tower Location
 - Indicative Substation Location
 - - - Existing 132kV OHL
 - - - Existing 275kV OHL
- Proposed Infrastructure:
- Proposed Alignment Section A
 - Proposed Alignment Section B
 - Proposed Alignment Section C
 - Proposed Alignment Section D
 - Proposed Alignment Section E
 - - - Existing Access Track - Upgrade Required
 - New Permanent Access Track
 - New Temporary Access Track

SSEN Transmission take no responsibility for the release or accuracy of latest version basemaps from Ordnance Survey

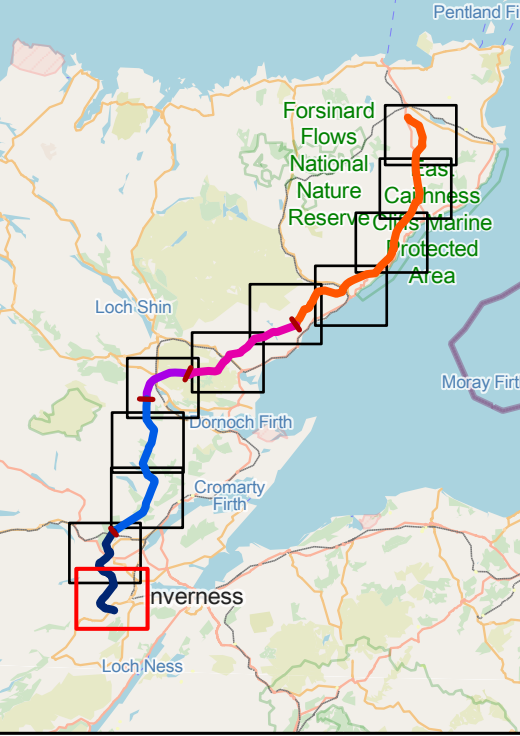

SCALE: See Scale Bar	VERSION: A01
SIZE: A3	DRAWN: WB
PROJECT: 0720281	CHECKED: ES
DATE: 30/01/2025	APPROVED: KG

Spittal - Loch Buidhe - Beaulieu 400kV Connection Proposed Infrastructure: Page 11