






Scottish & Southern
Electricity Networks

TRANSMISSION

Stannergate 132kV Substation and Network Rail Feeder Station

Pre-Application Consultation

May 2024

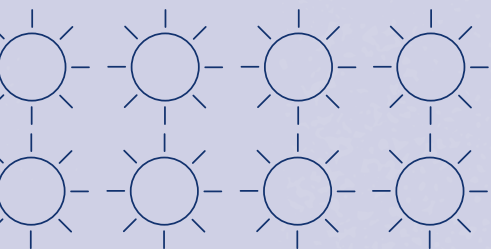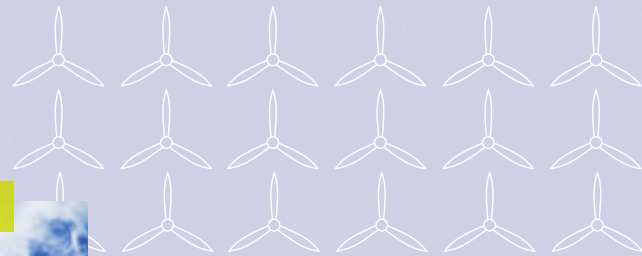


Contents

Powering change together	1	Other projects in the local area	13
SSEN Transmission's Dundee city strategy	2	Help shape our plans	14
What we're consulting on	4	Finding common ground with landowners	15
How we've selected the substation site	5	Leaving things better than we found them	16
Proposed substation layout	7	Project timeline	17
3D visualisations	8	Notes	18
Development considerations	9	Have your say	20
Environmental considerations	10	Your feedback	21
The Town and Country Planning process	12		


The consultation events will be taking place on:

16 May 2024 – 2pm-7pm and 15 Aug 2024 – 2pm-7pm

The Art Gallery room, Apex City Quay Hotel & Spa, 1 West Victoria Dock Road, Dundee DD1 3JP



Powering change together

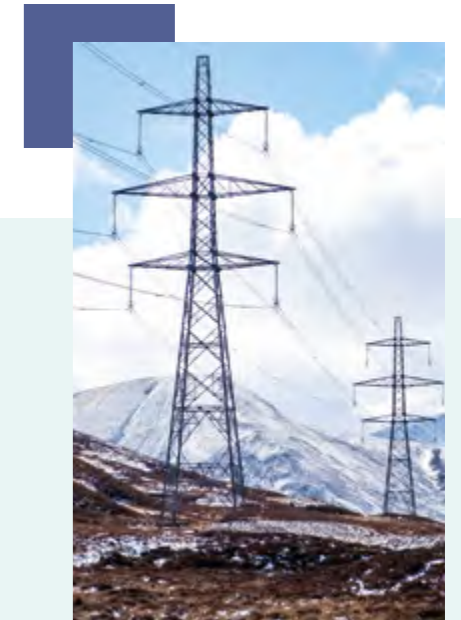

The time has come to further enhance Scotland's energy infrastructure, providing power for future generations as we move towards net zero.

The shift to a cleaner, more sustainable future is about more than climate change. It's about ensuring future generations have the same opportunities to thrive as we have all had.

Countries around the world are investing in their energy infrastructure to support the demands of modern economies and meet net zero targets. The UK is leading the way in building a modern, sustainable energy system for the future.

We all have a part to play

When it comes to net zero, we have to be in it together. The UK and Scottish governments have ambitious net zero targets, and we're playing our part in meeting them.

We work closely with the National Grid to connect vast renewable energy resources – harnessed by solar, wind, hydro and marine generation – to areas of demand across the country. Scotland is playing a big role in meeting this demand, exporting two thirds of power generated in our network.

But there's more to be done. By 2050, the north of Scotland is expected to need 40GW of renewable energy capacity to help deliver net zero. Today, our region has just 8GW of renewable generation connected to the network.

At SSEN Transmission, it is our role to build the energy system of the future.

We're investing £10 billion into our region's energy infrastructure this decade, powering more than ten million UK homes and 20,000 jobs, 9,000 of which will be here in Scotland.



Find out more

Scan the QR code with your smartphone to find out more about how these policies have been assessed and determined.

Who we are

We're responsible for maintaining and investing in the electricity transmission network in the north of Scotland. We're part of SSE plc, one of the world's leading energy companies with a rich heritage in Scotland that dates back more than 80 years. We are also closely regulated by the GB energy regulator Ofgem, who determines how much revenue we are allowed to earn for constructing, maintaining and renovating our transmission network.

What we do

We move electricity all over the UK. We manage the electricity network across over a quarter of the UK's land mass, crossing some of the country's most challenging terrain. We connect renewable energy sources to our network in the north of Scotland and then transport it to where it needs to be. From underground subsea cables and overhead lines to electricity substations, our network keeps your lights on all year round.

Working with you

We understand that the work we do can be disruptive to communities. So we're committed to keeping that disruption to a minimum and maximising all the benefits that local development can bring to your area.

We're regularly assessed by global sustainability consultancy AccountAbility for how we engage with communities. That means we provide all the information you need to know about our plans and how they will impact communities like yours. The way we consult is also a two-way street. We want to hear people's views, concerns, or ideas and harness local knowledge so that our work benefits their communities: today and long into the future. You can share your views with us at: ssen-transmission.co.uk/talk-to-us/contact-us

SSEN Transmission's Dundee city strategy

Summary of strategy

Based on the condition of aging assets across Dundee city SSEN Transmission are proposing a programme of asset renewal. These proposals will cover the substations, underground cables and overhead lines which make up the Dundee Transmission network.

Subject to approval from the regulator Ofgem, the assets will require replacement in the upcoming regulatory periods between 2026 to 2036. The result of this strategy and subsequent works hopes to see assets providing over 40 years of service to the city and beyond.

Asset conditions demand


The Asset Management Department of SSEN Transmission continually assesses the condition of assets across the network. Now approaching 60 years of service, many of the assets in Dundee have either exceeded or are nearing the end of their economic and operational capabilities.

Under Section 6 of the 1989 Electricity Act, SSEN Transmission are required to ensure a safe and secure network, which means replacing these assets in a timely manner. To comply with SSEN Transmission's license obligations, infrastructure upgrade works will be required at the following sites in Dundee:


- Dudhope Grid Supply Point (GSP)
- Glenagnes GSP
- Charleston GSP
- Lyndhurst GSP
- Milton of Craigie GSP

A GSP provides a connection between the transmission network operated by SSEN Transmission and the lower voltage distribution network, operated by SSEN which provides power to houses and business.

Please see the map adjacent which shows all the current Dundee Transmission Assets.

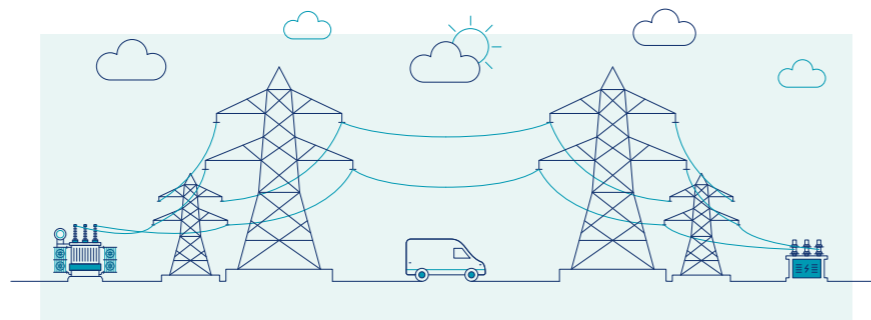

Dundee's current transmission network

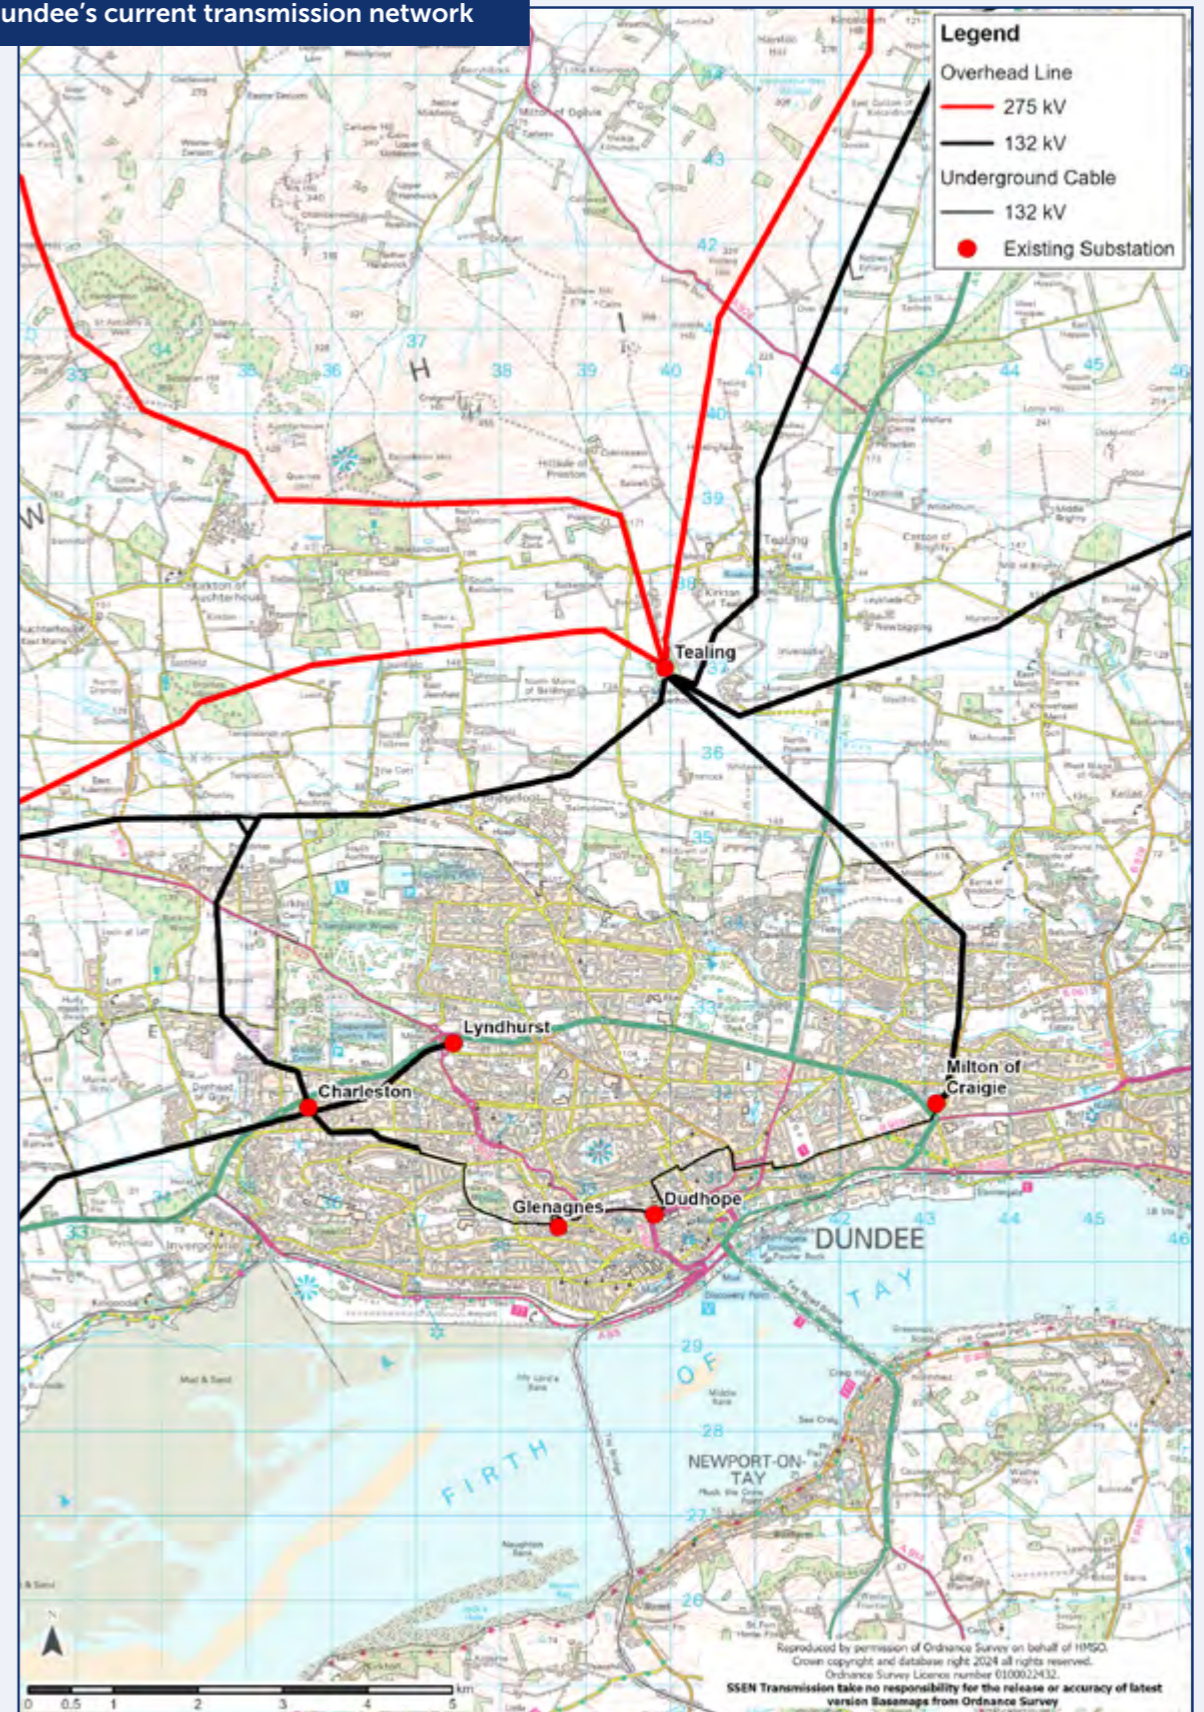

The need/why are we upgrading the network

The primary drivers for the new 132kV substation in Stannergate are; SSEN Transmission's obligation for asset upgrades and reinforcements and a new 132kV connection request from Network Rail. This connection must be within 2km of the existing rail network in the Dundee area.

There is no space at the current Dudhope GSP to extend the site to allow the Network Rail connection or to replace and upgrade the transformers.

This necessitates the requirement for a new 132kV GIS (Gas Insulated Switchgear) substation at Stannergate to provide a connection for Network Rail and sufficient space to provide a replacement for Dudhope GSP.

GIS is proposed to reduce the substation footprint in a city centre location compared to more conventional Air Insulated Switchgear

Network Rail demand

As part of a £120m Scottish Government investment, Network Rail are electrifying Scotland's rail network to help decarbonise and support ambitions to reach Net Zero by 2045. To electrify the rail routes from Dundee – Arbroath – Montrose, Network Rail have requested a 132kV feeder station to deliver power to the newly electrified lines, with a firm demand of 16.2MW from SSEN Transmission.

This request has triggered the demand for 2 key projects at Stannergate, one 132kV feeder station and one 132kV GIS substation which will power the feeder station.

SSEN Transmission and Network Rail will be working in close partnership to plan, design and deliver the required works in a way that reduces risk, minimises disruption and helps to move forward with plans to decarbonise Scotland's railway by 2035.

What we're consulting on

The city of Dundee has high ambitions to decarbonise, aligning its greenhouse emissions reduction targets with the Scottish Government's target of meeting net zero by 2045.

Decarbonisation initiatives include investment in charging infrastructure for electric vehicles, electrification of railway, hydrogen buses and fleet, and district heating. There are three key projects which are proposed within the Stannergate site, with all the details on the proposals for each below.

Dudhope Grid Supply Point (GSP) replacement

Dudhope currently has two 132/33kV transformers with a capacity of 60MVA each. Both transformers were installed in 1967 and are reaching the end of their capacity. These will be upgraded to two 132/33kV transformers at Stannergate with a capacity of 120MVA each.

The existing equipment at Dudhope does not meet current standards. Stannergate substation will accommodate the upgrade and installation of these new assets. Replacement of these assets is required in R110-T3, Ofgem's next price control period, and the existing site is not acceptable for the current design standards or space requirements.

132kV Network Rail feeder station

The Network Rail feeder station will provide a connection to the transmission electricity network and support the electrification of the rail network in Scotland.

The feeder station equipment will include two 132/25kV rail transformers with a capacity of 25MVA for Network Rail and all associated ancillary plant, which will also be developed within the new 132kV Stannergate substation site.

Stannergate 132kV GIS substation

To facilitate Network Rail's connection requirement and replace the existing assets at Dudhope GSP, the following equipment will be installed at the Stannergate 132kV GIS substation:

- An overall site to be developed of approximately 5.25 hectares to accommodate all required equipment
- 132kV indoor GIS substation building housing the 132kV double busbar configuration
- Two 132/25kV 25MVA rail transformers housed in buildings
- Two 132/33kV 120MVA grid transformers housed in buildings
- 33kV distribution building.
- 132kV underground cable to connect Stannergate substation to the existing 132kV transmission network in Dundee.

Work done by others:

- Underground cable connection between Network Rail Feeder Station and the rail (route tbc)
- Underground cable connection between 33kV Building and Dudhope (route tbc)

How we've selected the substation site

Our site selection process makes sure the design, consenting, construction and operation of our projects are undertaken in a manner, which on balance, causes the least disturbance to the environment and the local community, while ensuring the solution taken forward is economically and technically practical.

In the first instance, consideration was given to the redevelopment/extension of the existing Dudhope GSP substation as opposed to its relocation.

However, this was discounted due to the age of the existing buildings, structures on site and the constrained nature of the site, which would not allow for the delivery of a replacement substation that would meet SEN Transmission's most up-to-date construction and operation standards.

Consequently, the only option available was to establish a new site within Dundee. The decision was taken to develop a site that could accommodate both the Network rail connection and asset replacement works. A combined site is likely the most economical solution and the least disruptive from a construction perspective.

As part of an initial desk-based site selection workshop, a wide variety and number of sites across Dundee city were considered. This stage one process produced an initial shortlist of 12 potential sites.

The shortlisted sites were then assessed in greater detail using the following site selection criteria:

- Size of site (0.7 hectares for feeder and 1.4 hectares for GSP, = 2.1 hectares needed in total for combined site)
- Within 2km of Dudhope GSP
- Within 5km of rail infrastructure

Please see the table below which demonstrates the level of constraint for each of the 3 considerations.

From this assessment and the consideration of additional engineering, operational, land and environmental aspects of each site, the only sites that were identified as being viable were:

- Site 1 – Seabraes; and
- Sites 4 and 5 combined – Victoria Works

SEN Transmission subsequently undertook pre-application consultation and discussion with Dundee City Council in relation to both sites during 2023.

The conclusion of this pre-application process led to the identification of a more suitable site at Stannergate, which has been selected as our proposed site to be taken forward to the planning application stage.


RAG Status from Site Selection Workshop					
Site	Site Name	Size	Distance from Dudhope GSP	Distance from Rail	Issues
1	Seabraes	Green	Green	Green	Site safeguarded for employment uses in NPF4 and Development Plan.
2	Ninewells	Green	Red	Green	Distance from SHEP-D Network
3	Whitehall	Yellow	Green	Green	Land now under development
4	Victoria Works (1)	Green	Green	Green	Site contains listed building (Cat. B former Jute Mill) and is allocated for residential land uses, with adopted Development Brief. Blackness Conservation Area. Culverted watercourse.
5	Victoria Works (2)	Green	Green	Green	Allocated for residential land uses, with adopted Development Brief. Blackness Conservation Area.
6	Baird Avenue	Green	Red	Green	Distance from Dudhope GSP
7	Old Glamis Rd	Yellow	Green	Green	Would only fit one site
8	Gowrie Court	Yellow	Red	Green	Distance from SHEP-D network
9	Verdant Works	Red	Green	Green	Would only fit one site
10	Main Street	Yellow	Green	Green	Would only fit one site
11	Faraday Street	Green	Red	Green	Distance from Dudhope GSP
12	Gore	Green	Red	Green	Distance from Dudhope GSP

Performance	Comparative appraisal
Most preferred	Low potential for the development to be constrained
↓	Intermediate potential for the development to be constrained
	High potential for the development to be constrained
Least preferred	

How we've selected the substation site

Our proposed site

The proposed site is located to the east of the town centre within the Stannergate/Harbour area of the city. The site is bounded by East Dock Street to the south, Market Street to the west and Broughty Ferry Road to the north. The site comprises the vacant former abattoir site on Broughty Ferry Road and the derelict former Nynnas fuel storage facility that fronts onto East Dock Street.

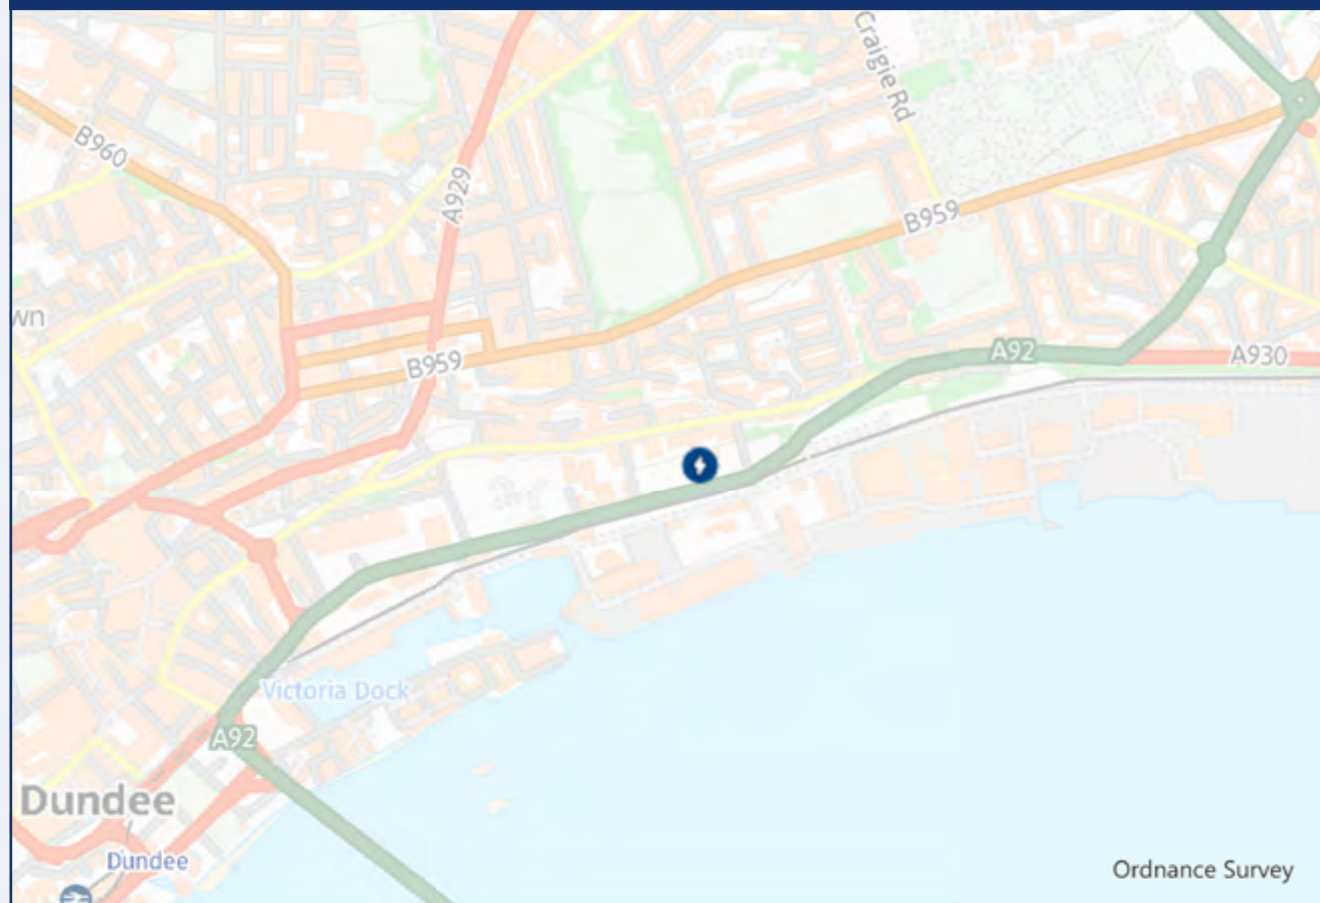

Why this site?


- The site meets the technical requirements of both elements of the development.
- There are fewer residential properties or other sensitive receptors such as cultural heritage assets in close proximity to the site.
- The site currently comprises vacant and derelict former industrial land and the proposals offer the opportunity to redevelop the site in a manner that will make a positive contribution to the character and amenity of the local area.

What next?

We are now at the statutory Pre-Application Consultation (PAC) stage. We will consult again in August 2024, to share feedback from this consultation and any subsequent changes to design, prior to submitting a planning application to Dundee City Council before the end of the year.

Proposed substation layout

Proposed site Red Line Boundary

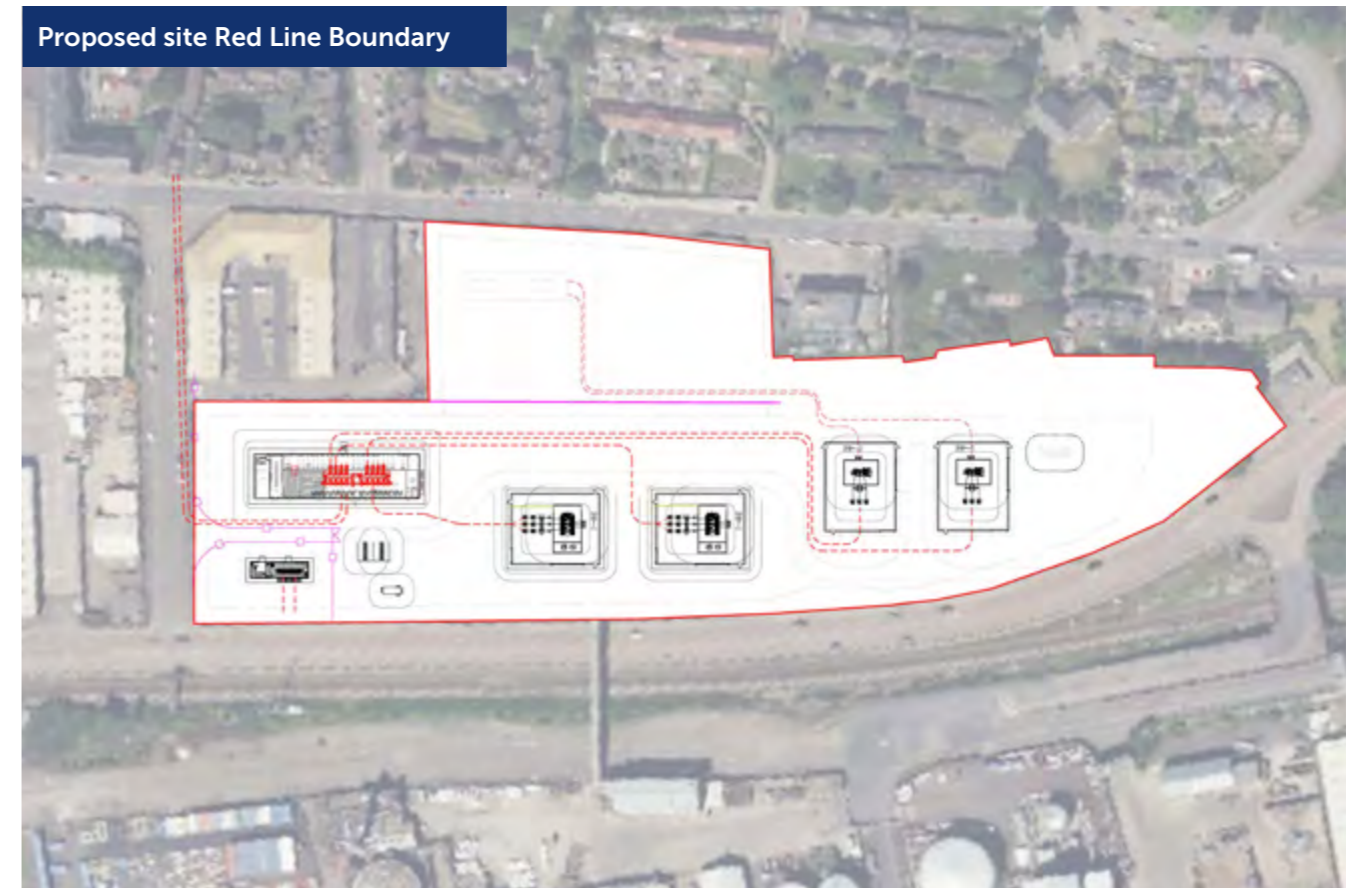

The substation footprint has been positioned to avoid direct impacts on the existing retaining wall within the site, whilst taking advantage of the split in site levels. This approach will maximise the opportunity for natural screening and accommodate the need to manage surface water run off, ensuring that all elements of the proposed development are contained within a single site.

The substation comprises a total of seven separate buildings or structures that range in height and design depending upon their function. Full details of the design of the buildings will follow, however it is anticipated that they will be metal-clad structures ranging in height from 15m to 18m.

From initial designs, a new 132kV UGC will be installed in Market Street, Broughty Ferry Road, Lily Bank Road, Robertson Street & Greendykes Road to connect to the existing 132kV network on Arbroath Road.

A new permanent access will be formed off Market Street with a secondary access onto East Dock Street Road.

A security fence will be erected around the perimeter of the substation and where possible existing perimeter walls will be retained.

A lighting strategy will be prepared and will adopt the following broad principles; lighting will be kept to the minimum to ensure safe operations and security; individual light clusters will be low level, narrow beam, and directed downwards to minimize glare and light spill; different lighting configurations and designs will be adopted for different parts of the site and will be appropriate for use.

3D visualisations

We understand that local stakeholders need to be able to visualise what the development may look like in their local area.

We've commissioned 3D visualisations which model the substation into the local landscape to help understanding of the proposals in terms of the visual impact, distance and height.

A flythrough video is also available to view from the project webpage or via the QR code at the bottom of this page.

Our proposals may change based on feedback and further refinement of the design, if that happens, we'll update our model and video and share this on our webpage and with you at the next event.

Photomontages

Photomontage visualisations will also be produced as part of the Environmental Impact Assessment (EIA). Once the EIA is completed, we'll ensure these photomontages are easily available to view.



Find out more

Scan the QR code with your smartphone to view on the project website.



Overhead visualisation facing Southwest



Visualisation from East Dock Street

Development considerations

A detailed engineering, environmental and cost analysis was undertaken by SSEN Transmission to identify key development considerations for the project outlined below.

Summary of engineering considerations

The fundamental engineering considerations when selecting a preferred site location for a new 132kV substation include access, connectivity, footprint requirements, ground and environmental conditions and avoiding hazards.

The substation is required to be located in Dundee within 5km of the rail network and within 2km from the current Dudhope GSP. Proximity to Dudhope is required to provide feasible continuity of existing connections already connected to Dudhope. Having the replacement site too far away from their existing connection location could result in them becoming stranded and unviable to connect to the new location.

Site selection criteria - Stannergate

- UGC access and connectivity
- Proximity to rail network
- Proximity to existing SSEN Transmission network
- Substation footprint requirements
- Grounds and environmental conditions
- Logistical access for equipment delivery
- Hazards

Site assessment

The site offers good UGC connectivity and flexibility with connecting to new and existing assets on the transmission network. There is good existing access to the site off the A92, which will facilitate the delivery of large substation equipment and provide ease of access for future operational needs.

Access and civil considerations

The chosen site will allow connection of Network Rail's equipment to the proposed 132kV Stannergate substation. The new substation will also facilitate the upgrade of the existing 132kV UGCs from the Glenagnes substation and the Milton of Craigie substation.

The main access to site is proposed to be from the A90 via an existing slip road with survey and design works ongoing to determine any improvements required to facilitate this access.

There will also be the requirement to establish a new access track north of the new substation site to allow for delivery and vehicle access during and post construction

Ground and site investigation works will be undertaken on the preferred site which will be used to inform the civil design of the site. The platform level will be designed to optimise the overall cut fill balance of the site to minimise the amount of material import required.

Site layout

The layout of the substation has been developed as GIS due to space constraints within the city centre location. The GIS equipment will be indoors and consists of busbars and switchgear which is used to marshal and control the electricity supply.

The substation size has been developed based on the number of bays to facilitate the initial connections at the site and allowance made for future connections and is approximately 350m x 150m and the tallest point of the site will be 18m in height.

Building size

A control building will be required on site which contains ancillary equipment required to operate the substation including control panels and low voltage AC and DC systems.

The size of this building is determined by the number of ancillary system equipment required which is determined by the number of bays within the substation which for Stannergate is 11. The building will be double story with an approximate overall height of 18m.

As well as the control building, Stannergate substation will also have two rail transformers and two grid transformers which are required to manage power quality or power factor of the substation and network. Each transformer will be located inside a building with an approximate height of 15m.

Environmental considerations

The potential environmental impacts discussed below will be assessed as part of the Environmental Impact Assessment (EIA), which will accompany the planning application to Dundee City Council. The EIA Report will be available for members of the public to view and comment on as part of the planning process and the determination of the application by Dundee City Council.

Ecology

The site is largely developed industrial and commercial land with limited vegetation found throughout the site and no protected or notable species identified during a desk-based study of the site. The Firth of Tay and Eden Estuary Special Area of Conservation (SAC) is located approximately 300m to the south of the proposed development. This SAC is designated as an important marine habitat.

A field survey and Preliminary Ecological Appraisal (PEA) will be carried out to identify whether there are known or potential ecological features (nature conservation designations and protected and notable habitats and species) that may constrain or influence the design. Any potential adverse impacts on ecological receptors will be mitigated where possible.

In addition, we will carry out a Biodiversity Net Gain (BNG) assessment. If the results of the assessment do not predict a net gain in biodiversity, recommendations will be provided suggesting potential options for habitat creation and/or enhancement either on- or off-site which could help the proposed development to achieve a net gain.

Landscape

The proposed development site has a Landscape Character Assessment of 'Urban' (i.e. an area that is identified as settlements with a population of approximately 25,000) and is located within the industrial context of the wider Dundee Harbour.

There are a number of residential and industrial buildings located along the northern border of the proposed development site boundary.

Noise and vibration

During construction, noise and possibly vibration may be experienced by properties close to the site from the movement of construction equipment and construction activities. The adoption of standard construction methods will ensure the level of off-site construction noise is kept to a minimum.

Baseline noise levels will be measured using industry standard techniques and at locations agreed with Dundee City Council.

A detailed noise and vibration impact assessment will be undertaken as part of the EIA, which will model possible levels of noise based on the equipment specified for the substation and define the measures necessary to attenuate (mitigate) noise so that significant impacts at nearby properties are not experienced.

Traffic and transport

A detailed construction traffic route assessment will be undertaken to define route options with least impact and will include determining how the amenity of properties close to the roads can be protected and what road improvements or modifications may be required.

Geology and soils

The existing site is a brown field site with a previous industrial land use therefore an assessment will be carried out, informed by a site survey, of the site's potential for historical and current ground contamination, or future ground contamination to occur.

Consideration will then be given to how potentially harmful contamination will be addressed as part of the development.



Hydrology and hydrogeology

The Dundee Harbour and the Lower Tay Estuary is situated approximately 280m to the south of the proposed development. This transitional water body is classified with an overall status of 'Good' (Water Framework Directive, 2022).

The proposed development site sits on a moderately productive, 2B class aquifer and is situated within a Drinking Water Protected Area for groundwater.

A large portion of the proposed site has been identified to exhibit a medium likelihood for surface water flooding (each year this area has a 0.5% chance of flooding).

There are some areas of the proposed site which exhibit a high likelihood of surface water flooding (each year this area has a 10% chance of flooding), these are primarily situated along the site's southern border and in the east of the site.

A hydrology and hydrogeology assessment will be carried out addressing the water quality, flows and levels, resources, flood risk and hydromorphology of the proposed site. Where required, mitigation measures will be identified and implemented.

Cultural heritage

There are several Category A and B listed buildings within 300m of the proposed development associated with the heritage of Dundee Harbour as well as the Baxter Park Garden and Designated Landscape. In addition, there are numerous heritage assets situated within the wider Dundee City area.

A cultural heritage site walkover and desk top study will be undertaken to identify the presence of known heritage assets within the proposed site, or with the potential to be impacted as a result of changes to their setting.

Any potential adverse impacts on cultural heritage assets will be mitigated where possible.

The Town and Country Planning process

The legislation that guides the consenting process for projects such as Stannergate is the Town and Country Planning (Scotland) Act 1997.

Engaging the right people

Local Planning Authorities determine the outcome of any applications made under the Town and Country Planning Act and establish the planning pathway our substation projects must take, including which consents are required.

The Stannergate substation project is classed as "National Development" under the Town and Country Planning process; therefore, pre-application consultation is required with the public and interested parties.

The Pre-Application Consultation process

A Proposal of Application Notice (PAN) was submitted to Dundee Council on 19 April 2024. This is the first stage in the planning application process, and the beginning of a statutory public consultation period that must allow at least 12 weeks between the submission of the PAN and submission of the associated planning application.

The proposals we are consulting on at this event might change between now and the submission of the planning application, following further design development and in response to any feedback that is received. The red line boundary that is shown on page 7 represents the maximum extent of the land potentially included in the application site, but this area may be reduced or rationalised as the development proposal becomes finalised.

There is a requirement to hold at least two events to provide the opportunity for members of the public to comment on the proposals. This public event is the first event with the second event due to be held 15 August 2024, at which feedback will be given on the comments and views obtained from the first event.

Submitting a planning application

The planning application is due to be submitted to Dundee City Council before the end of 2024.

A Pre-application Consultation Report will accompany the planning application providing details of the consultation undertaken and communicating how the consultation process has influenced the proposed development.

Where comments are received that cannot be addressed in the final proposal, an explanation will also be given why this is the case.

Comments made through the pre-application consultation process are not formal representations to Dundee City Council. When the planning application is submitted there will be an opportunity to make formal representations to Dundee City.

Other projects in the local area

As the transmission operator in the north of Scotland, we need to maintain and invest in the high voltage electricity transmission network in our area to provide a safe and reliable electricity supply to our communities.

We also need to offer terms for connections to the transmission network for new generation such as wind farms and pumped storage schemes and for new sources of electricity demand.

Therefore, as well as the Stannergate 132kV substation, we have a number of other projects within the local area we are currently developing, described below.

Dundee warehouse

The construction of a 7500m² warehouse is currently ongoing which commenced in May 2023 which is of vital importance to ensure the management of stock and spares for improved logistics and timely response to faults on the SSEN Transmission Network.

The warehouse will have bespoke storage to house oil filled components such as transformers.

132kV cable and towers

The 132kV ring that supplies Dundee City has overhead lines and cable sections.

MD1/MD2 cables between Dudhope and Milton of Craigie were replaced in 2009 and the GDN/GDS cables between Glenagnes and Dudhope were replaced in 2017.

The CGN/CGS cables between Glenagnes and Elmwood compound are oil filled cables which have reached the end of their capabilities. Works are due to commence in June this year with residents receiving mail notifications in mid-May.

Future developments

We know that local stakeholders are keen to understand the full extent of developments being proposed in their local area. Applications from renewable developers to connect to the transmission network are made to National Grid ESO and undergo a lengthy process before we begin to develop a network connection for developments applying in our license area.

We aim to be transparent about the renewable developments looking to connect to our network but are not permitted to disclose any details of these developments until they are in the public domain.

A list of projects that hold contracts for Transmission Entry Capacity (TEC) with National Grid, the Electricity System Owner is available from their website: nationalgrideso.com/data-portal/transmission-entry-capacity-tec-register

Future developments may also require additional work at Tealing substation including further extensions to the existing site.



Help shape our plans

The work we have planned is significant and has the potential to deliver massive benefits in your community, Scotland, and beyond. Yet we know that achieving our goals will require a lot of work that will impact your lives. That's why we want to work with you every step of the way throughout the planning and delivery stages of these essential and ambitious works.

We're committed to delivering a meaningful consultation process that actively seeks the views of everyone affected by our plans. That means making our plans clear and easily accessible, so that you can give us input throughout each stage of the development process.

Throughout the consultation, we'll present our approach to developing the project, including changes made since we last consulted with you.

We will also provide some visualisations and maps to show you where everything will be located.

We want you to share your thoughts and opinions on our plans, where you think we can make improvements, concerns about the impact of our work and what you think of any changes and refinements we've made.

By telling us what you think, you will help shape our proposals. We want to harness your local knowledge so that we spot any unforeseen challenges early and maximise the potential benefits and opportunities for your communities.

Because, ultimately, we want you to work with us to ensure that the energy infrastructure we build will be the best it can possibly be.

Who we are consulting with

As well as communities, we are keen to hear feedback from a broad range of other stakeholders including but not limited to landowners, businesses, non-statutory consultees and statutory consultees such as local authorities, NatureScot, Scottish Environment Protection Agency (SEPA), Historic Environment Scotland (HES) and Forestry and Land Scotland (FLS).



Finding common ground with landowners

We recognise landowners and occupiers as key stakeholders in the development of our projects. At all levels, we will be transparent about our proposals and keep the conversation open and constructive when it comes to those affected and reaching effective compromise.

From the outset of the project, our land team have been identifying and contacting landowners and occupiers who may be affected by our proposals. If you are a landowner who is affected by the proposals and have not yet had contact from us, please get in touch via the contact details for the dedicated project land managers found on the relevant webpage: ssen-transmission.co.uk/stannergate

We work with landowners and occupiers to mitigate the effects of our infrastructure on their properties and our team of dedicated Land Managers will be on hand to answer queries and address concerns throughout this process.

As part of this, we need to carry out various engineering and environmental surveys to inform what we design and how we build it. We will always seek consent from affected landowners and occupiers in advance for these surveys.

Once we have finalised the design, we will be required to secure the appropriate land rights from landowners and occupiers in order to secure planning consent.

Our land managers will endeavour to reach a voluntary agreement with landowners and occupiers, however, as a statutory undertaker, we might need to underpin voluntary discussions with an application to Scottish Ministers for a Necessary Wayleave or Compulsory Purchase Order.

Ultimately this is to ensure nationally significant infrastructure projects are delivered on time and in line with our licence obligations. We also have a duty to protect the interests of the UK bill payer.

Statutory powers are not used lightly as we aim to work with landowners and occupiers to secure the necessary land rights voluntarily.

All potentially affected landowners and occupiers have the opportunity to provide feedback at our in-person consultation events and by submitting a feedback form.

We would encourage all those with an interest to submit their views through this consultation.



Leaving things better than we found them

On every project we deliver, we always need to consider how we impact the environment in that area. As we enhance the transmission network in the East of Scotland, we have a responsibility to design and build our projects to protect and enhance the environment.

We will always look to minimise the potential impacts from our activities and achieve Biodiversity Net Gain (BNG). And we mean it. We are committed to protecting and enhancing the environment by minimising the potential impacts from our construction and operational activities on biodiversity. We have committed to no net loss of biodiversity for all our projects gaining consent from 2020 onwards, and a net gain of biodiversity on all projects gaining consent from 2025.

During the development, construction and operation of our projects, we will leave the environment in a measurably better state than before development started, ensuring a

positive environmental legacy at all our SSEN Transmission sites. As this project progresses through the development process, we will actively seek ways to avoid and minimise impacts on biodiversity, through careful routeing and site design to avoid impacting areas of highest biodiversity value.

Where avoidance is not possible, we will offset this by introducing new habitats along with restoration efforts. These can be achieved within the boundary of the development site, or by providing support to local groups involved with habitat restoration or creation projects, within the locale of the development site.

If there are biodiversity improvement projects in your local area that SSEN Transmission could get involved with, please get in touch. Contact details for the Community Liaison Manager can be found on page 20.

Example projects

Argyll Coast and Countryside Trust (ACT)

Argyll's rainforest is a unique and rare habitat of ancient and native woodland. This collaboration with ACT will help deliver SSEN Transmission's compensatory tree planting and BNG commitments in Argyll. It also aligns with ACT's woodland planting ambitions, supporting its charitable objectives including biodiversity gain, health and wellbeing, improvement for local people, outdoor learning opportunities and climate change workshops.



Argyll Coast and Countryside Trust (ACT)

Thurso South substation and The Bumblebee Conservation Trust


We created approximately 10 hectares of bee-friendly habitat to support the pollination of the rare endemic great yellow bumblebee.

This contributed to wider conservation efforts for this bee species. A collaboration with The Bumblebee Conservation Trust facilitated research on food availability for bumblebees, identifying the need for a diverse seed mix containing key flowering species to enhance early, main and late food supply to support the full lifecycle of bumblebees.



Thurso South substation and The Bumblebee Conservation Trust

Project timeline

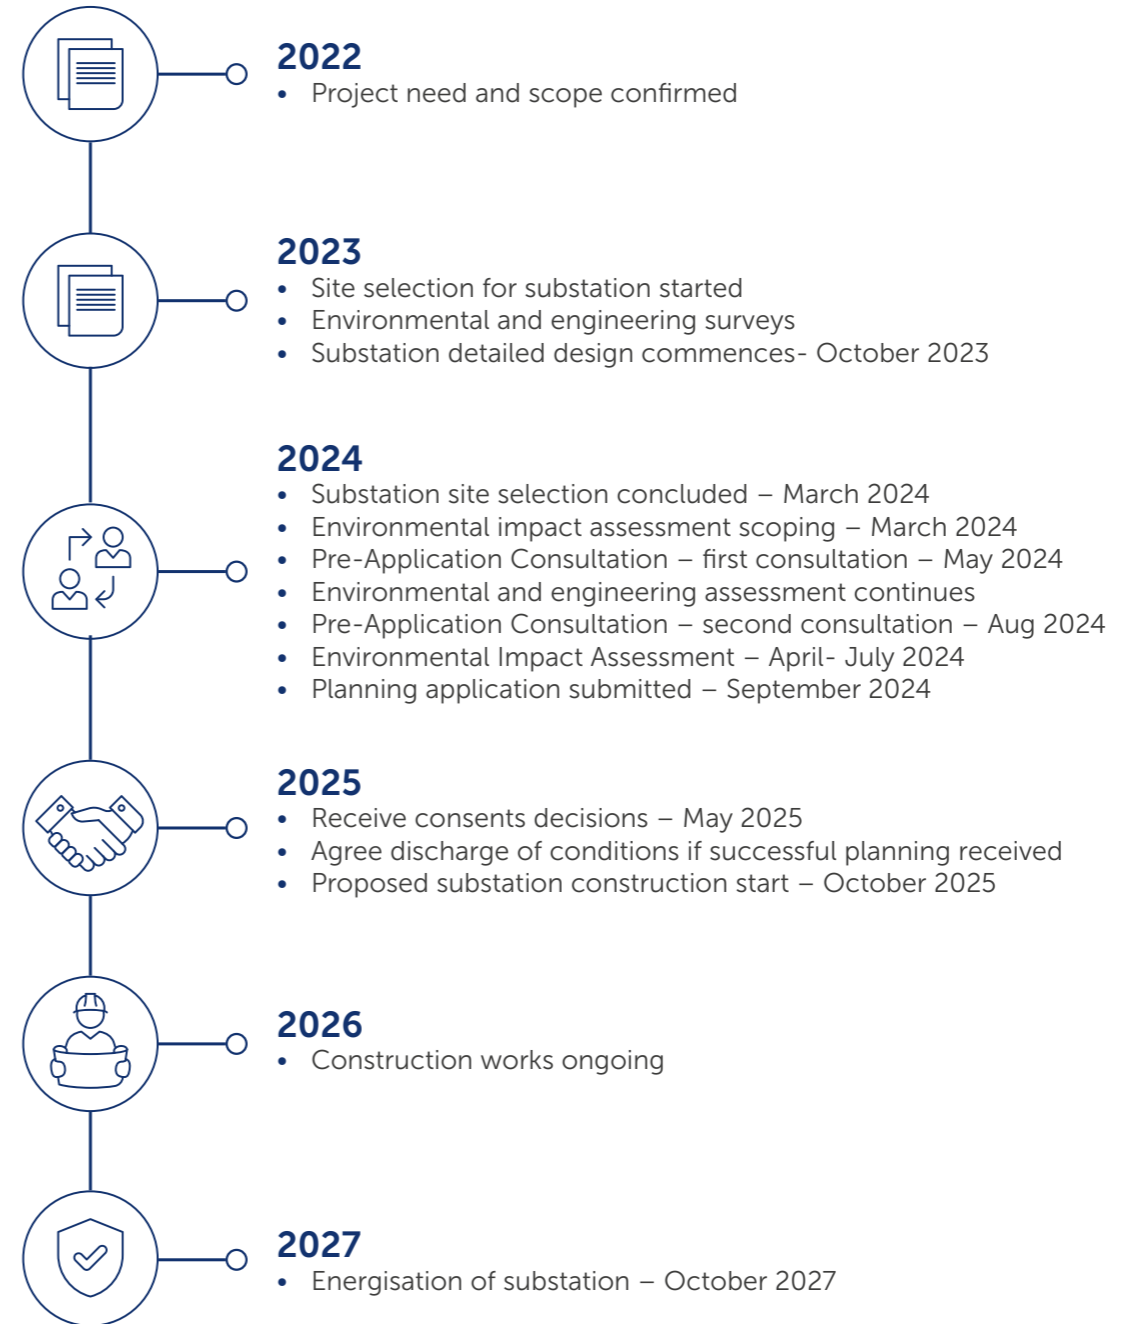

Have your say

We value community and stakeholder feedback. Without this, we would be unable to progress projects and reach a balanced proposal.

The feedback period

We will accept feedback from now until **27 June 2024**.

How to provide feedback

Submit your feedback online by scanning the QR code on this page or via the form on our project webpage at: ssen-transmission.co.uk/stannergate

Email the feedback form to our Community Liaison Manager. Or write to us enclosing the feedback form at the back of this booklet.

What we're seeking views on

We want you to share your thoughts and opinions on our plans, where you think we can make improvements and concerns about the impact of our work.

We'll be actively looking to mitigate the impacts of the project as much as possible over the coming months, but it would be helpful to understand what you believe we should be doing to help minimise these impacts and if there are any opportunities to deliver a local community benefit you would like us to consider.

We encourage all interested community members to fill in a feedback form when submitting feedback, however if you prefer, you can email us to provide your feedback or ask any questions.

Our Community Liaison Team

Each project has a dedicated Community Liaison Manager who works closely with community members to make sure they are well informed of our proposals and that their views, concerns, questions or suggestions are put to our project teams.

Throughout the life of our projects, you will hear from us regularly. We aim to establish strong working relationships by being accessible to key local stakeholders such as community councils, residents' associations and development trusts, and regularly engage with interested individuals.

Community Liaison Manager

Martha Smart
Community Liaison Manager

SSEN Transmission
1 Waterloo Street
Glasgow, G2 6AY

E: martha.e.smart@sse.com
T: 07880 998 846

Additional information

The best way to keep up to date is to sign up to project updates via the project webpage: ssen-transmission.co.uk/stannergate



You can also follow us on social media



To support everyone online, we provide accessibility and language options on our website through 'Recite Me'. The accessibility and language support options provided by 'Recite Me' include text-to-speech functionality, fully customisable styling features, reading aids, and a translation tool with over 100 languages, including 35 text-to-speech.

Please select "Accessibility" on our website to try out our inclusive toolbar.

Your feedback

Thank you for taking the time to read this consultation booklet. In order to record your views and improve the effectiveness of our consultation, please complete this short feedback form.

Please complete in BLOCK CAPITALS.

Q1. Is there anything you'd like to bring to our attention that you believe we may not have already considered during project development?

Comments:

Q2. Are there any environmental features, that you consider important and should be brought to the attention of the project team?

Comments:

Q3. Is there anything regarding the Stannergate 132kV substation proposal that you feel you require more information about? If so, please detail below.

Comments:

Q4. Overall, how do you feel about the project?

Support Neither support or object Object

Comments:

Q5. Do you have any further comments?

Comments:

Full name

Address

Telephone

Email

If you would like your comments to remain anonymous please tick this box.

We would like to send you relevant communications via email such as invitations to stakeholder events, surveys, updates on projects, services and future developments from the Scottish and Southern Electricity Networks group listed below. If you are happy to receive email updates please opt in by ticking the box below. You can unsubscribe at any time by contacting us at stakeholder.admin@sse.com or by clicking on the unsubscribe link that will be at the end of each of our emails.

For information on how we collect and process your data please see our privacy notice available at today's event. This can also be obtained online at ssen-transmission.co.uk/privacy

If you would like to be kept informed of progress on the project please tick this box.

Thank you for taking the time to complete this feedback form. Please submit your completed form by one of the methods below:

Post: SSEN Transmission, 1 Waterloo Street, Glasgow, G2 6AY **Email:** martha.e.smart@sse.com

Online: ssen-transmission.co.uk/stannergate

Download: Comments forms and all the information from today's event will also be available to download from the project website.

The feedback form and all information provided in this booklet can also be downloaded from the dedicated website:

ssen-transmission.co.uk/stannergate

We intend to use Artificial Intelligence (AI) to assist our experienced teams in the analysis of your feedback, so we can categorise key points raised more quickly. You can learn more about how we're utilising AI at ssen-transmission.co.uk/AIFAQ

Any information given on the feedback form can be used and published anonymously as part of Scottish and Southern Electricity Networks consultation report. By completing this feedback form you consent to Scottish and Southern Electricity Networks using feedback for this purpose.

Scottish and Southern Electricity Networks is a trading name of: Scottish and Southern Energy Power Distribution Limited Registered in Scotland No. SC213459; Scottish Hydro Electric Transmission plc Registered in Scotland No. SC213461; Scottish Hydro Electric Power Distribution plc Registered in Scotland No. SC213460; (all having their Registered Offices at Inveralmond House 200 Dunkeld Road Perth PH1 3AQ); and Southern Electric Power Distribution plc Registered in England & Wales No. 04094290 having its Registered Office at Number One Forbury Place, 43 Forbury Road, Reading, Berkshire, RG1 3JH which are members of the SSE Group.