


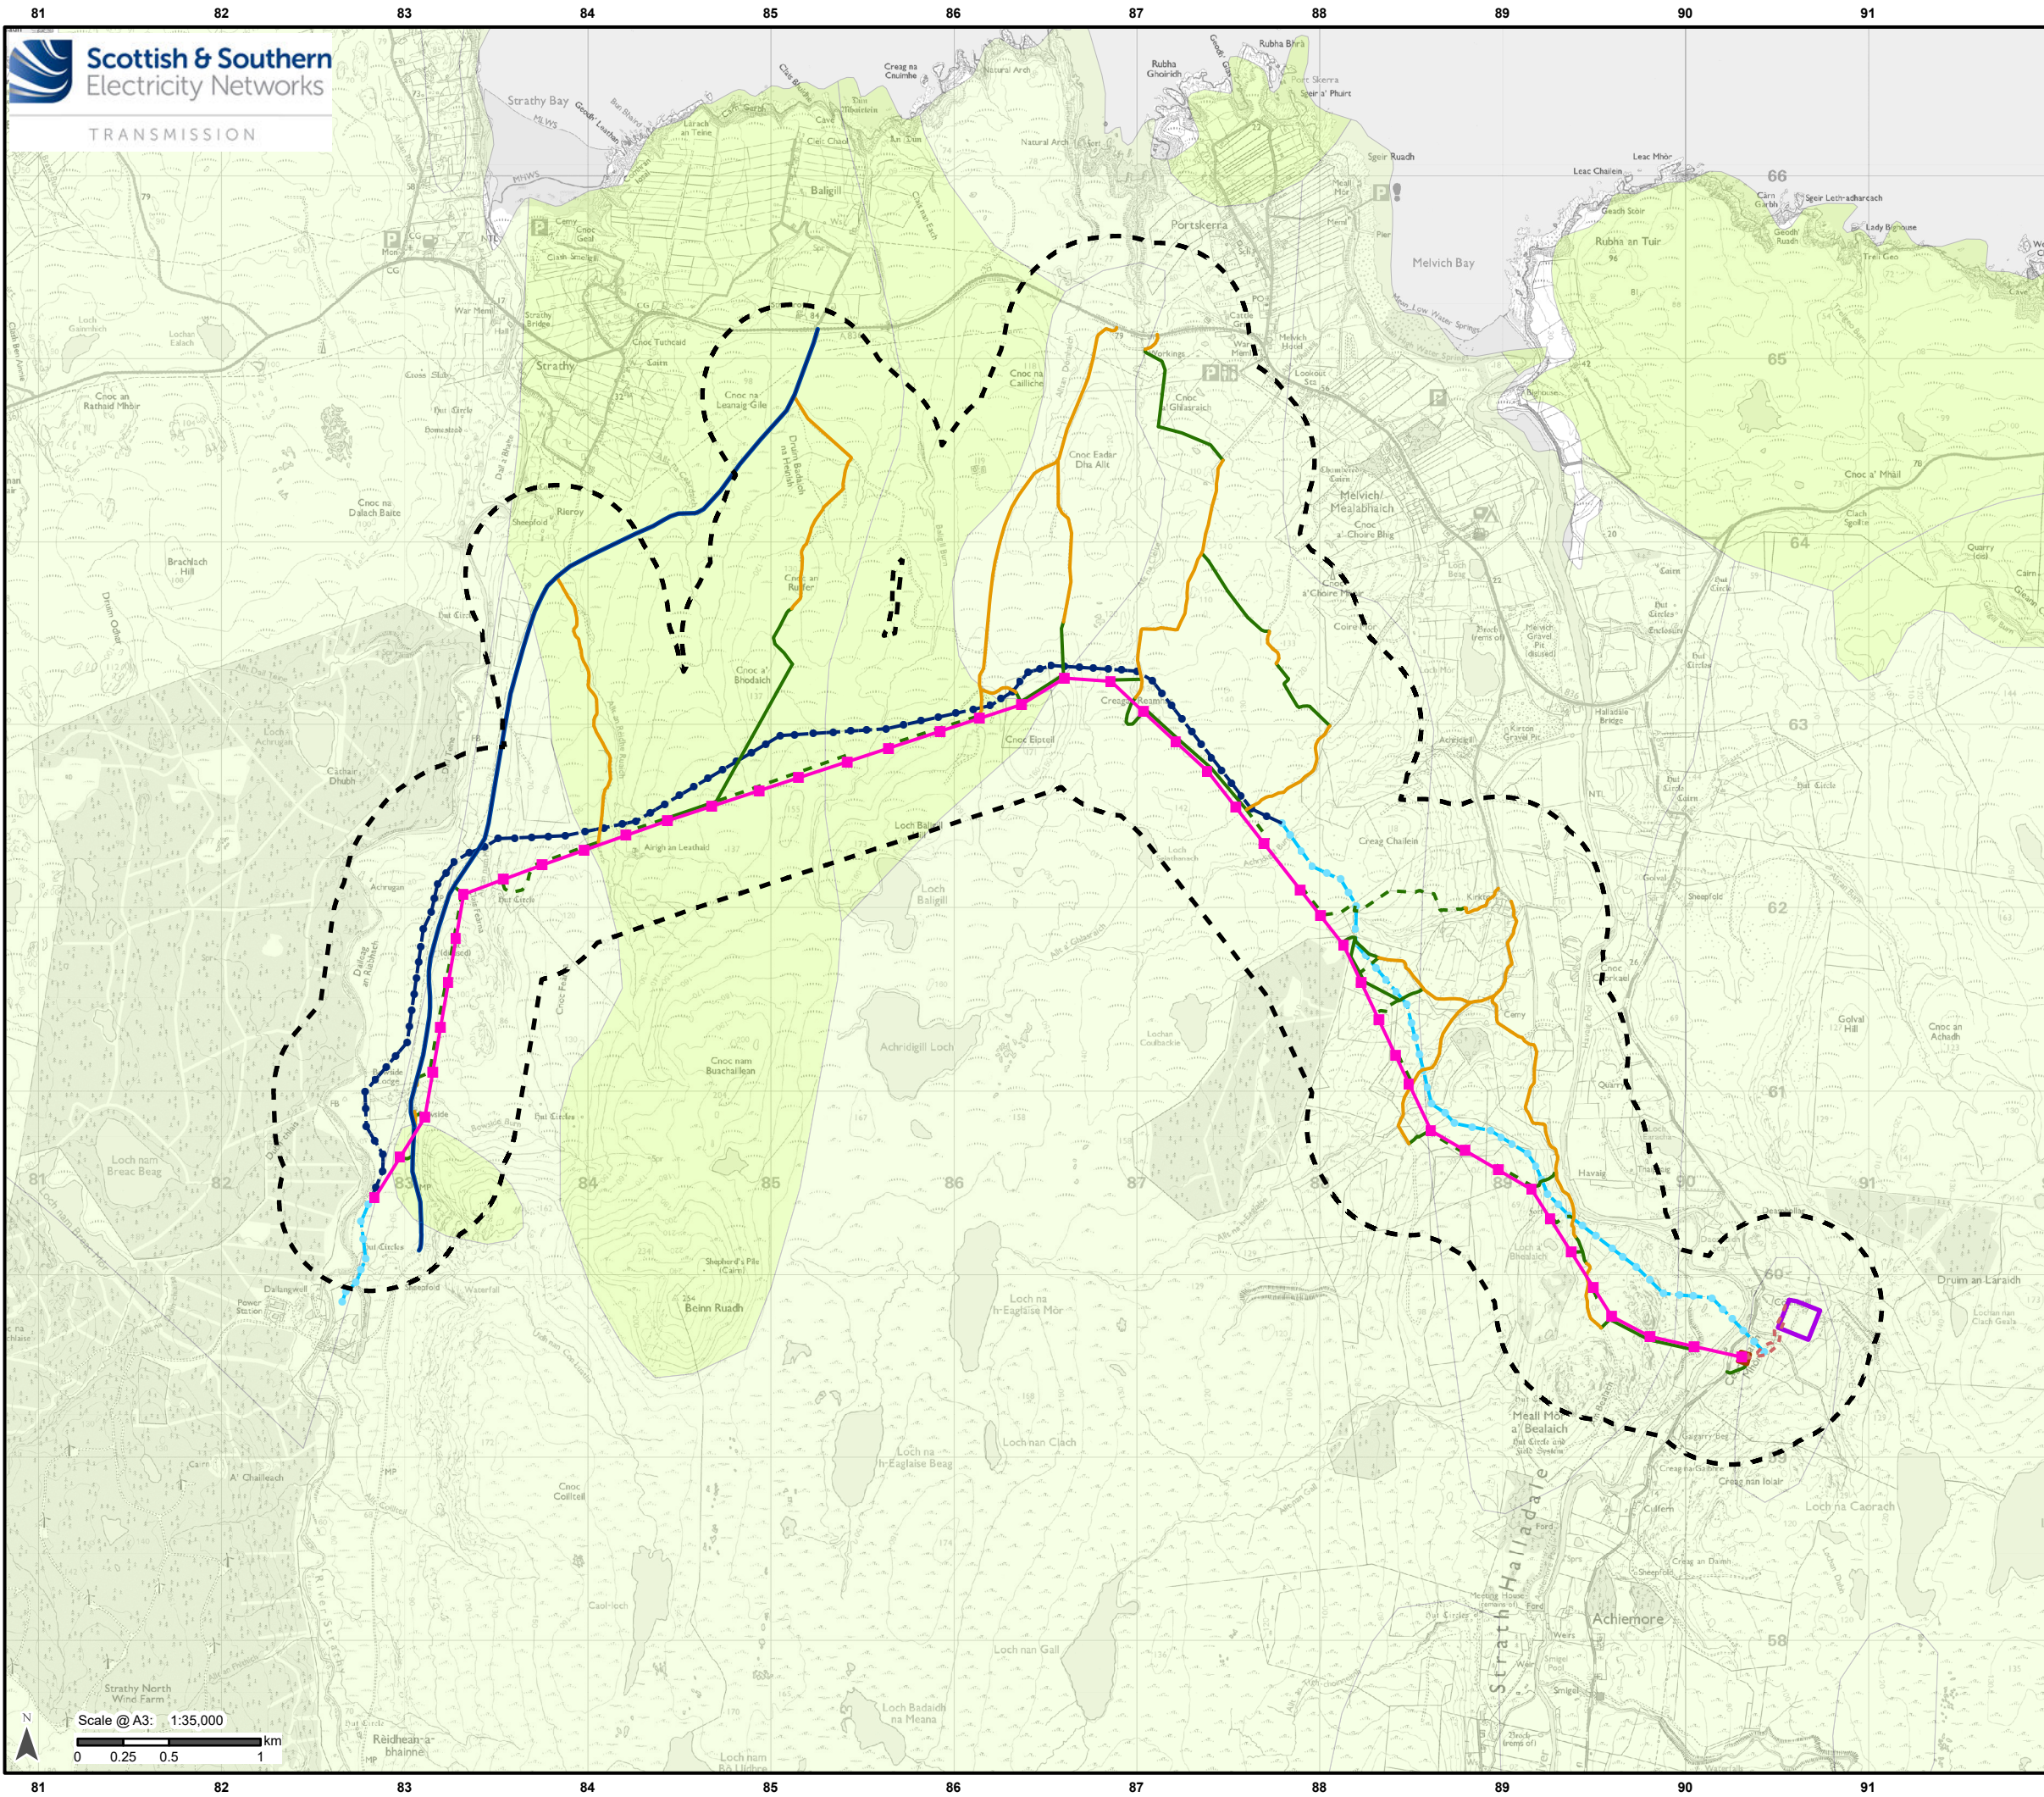

Legend

Study Area

Proposed Steel Lattice Tower

Proposed OHL Alignment

Proposed Underground Cable (UGC)

Proposed Cable Sealing End (CSE) Compound

Existing Access Track

Existing Access Track (to be upgraded)

Proposed Permanent Access Track

Proposed Temporary Access Track

Connagill 275/132 kV Substation

Existing Wood Pole (H pole) (to be dismantled)

Existing 132kV OHL (to be dismantled)

Existing Wood Pole (H pole) (to be retained)

Existing 132kV OHL (to be retained)

Aquifer Classification

Moderately productive aquifer

Low Productivity Aquifer

Reproduced by permission of Ordnance Survey on behalf of HMSO. Crown copyright and database right 2024 all rights reserved. Ordnance Survey Licence number AC0000848283. Extract from BGS Hydrogeological Map of Scotland, 1988 (1:625,000 scale).
Reproduced with the permission of the British Geological Survey ©Nerc. All rights reserved.

Project No: LT560
Project: Strathly South Wind Farm Grid Connection EIA Report
Title: Figure V1-9.6 - Regional Hydrogeology
Drawn by: AA Date: 18/12/2024
Drawing: 428.013137.00001.00057.0