


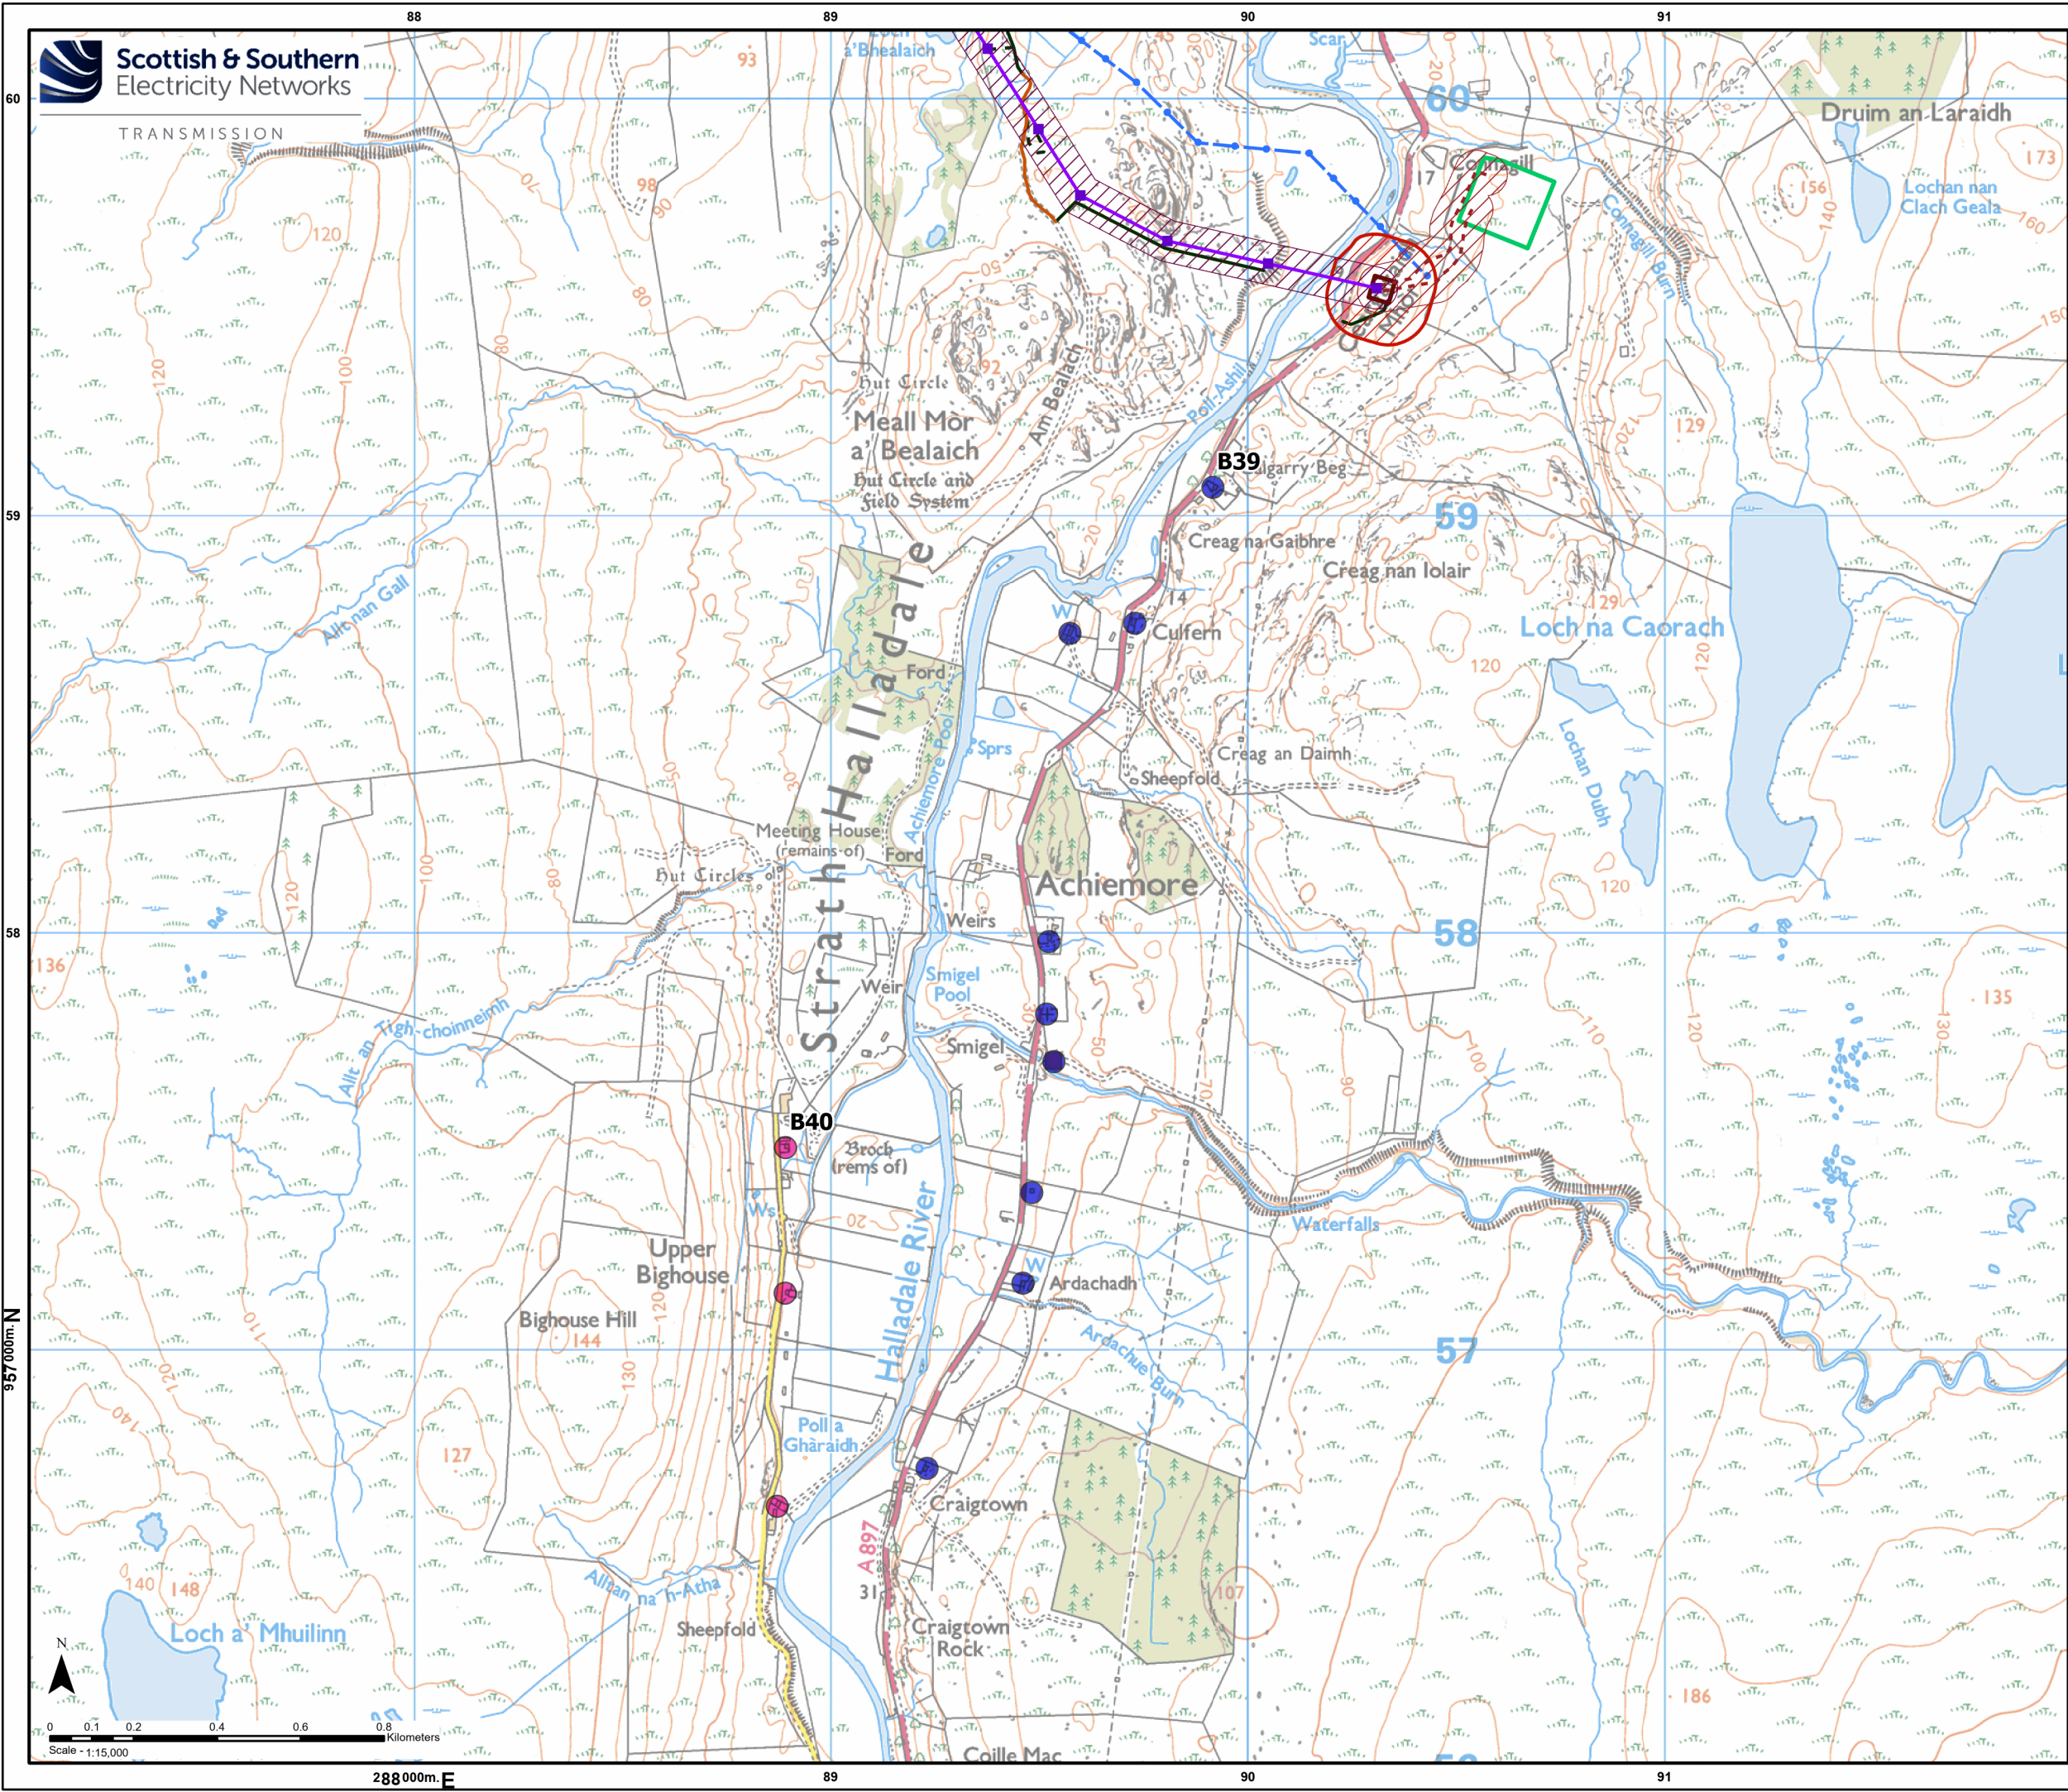

Legend

Alternative Steel Lattice Tower

Alternative OHL Alignment

Limit of Deviation (Alternative OHL)

Proposed Cable Sealing End (CSE) Compound

Limit of Deviation (CSE Compound)

Proposed Underground Cable (UGC)

Limit of Deviation (UGC)

Existing Access Track (to be upgraded)

Proposed Permanent Access Track

Proposed Temporary Access Track

Existing Wood Pole (H pole) (to be retained)

Existing 132kV OHL (to be retained)

Existing Connagill 275/132 kV Substation

Visual receptors - buildings

B39, Properties at Strath Halladale central

B40, Properties at Upper Bighouse

Sheet 4 of 6

Reproduced by permission of Ordnance Survey on behalf of HMSO.
© Crown copyright and database rights 2025 OS AC0000848283.
Supplied by: ukmapcentre.com

Project No: LT560

Project: Strathy South Wind Farm Grid Connection - EIA Report

Title: Figure V5-4.4d Visual Receptors - Buildings - Alternative Alignment

Drawn by: SR

22/01/2025

Drawing: 1269_LT560_LVIA V5-4.4d