


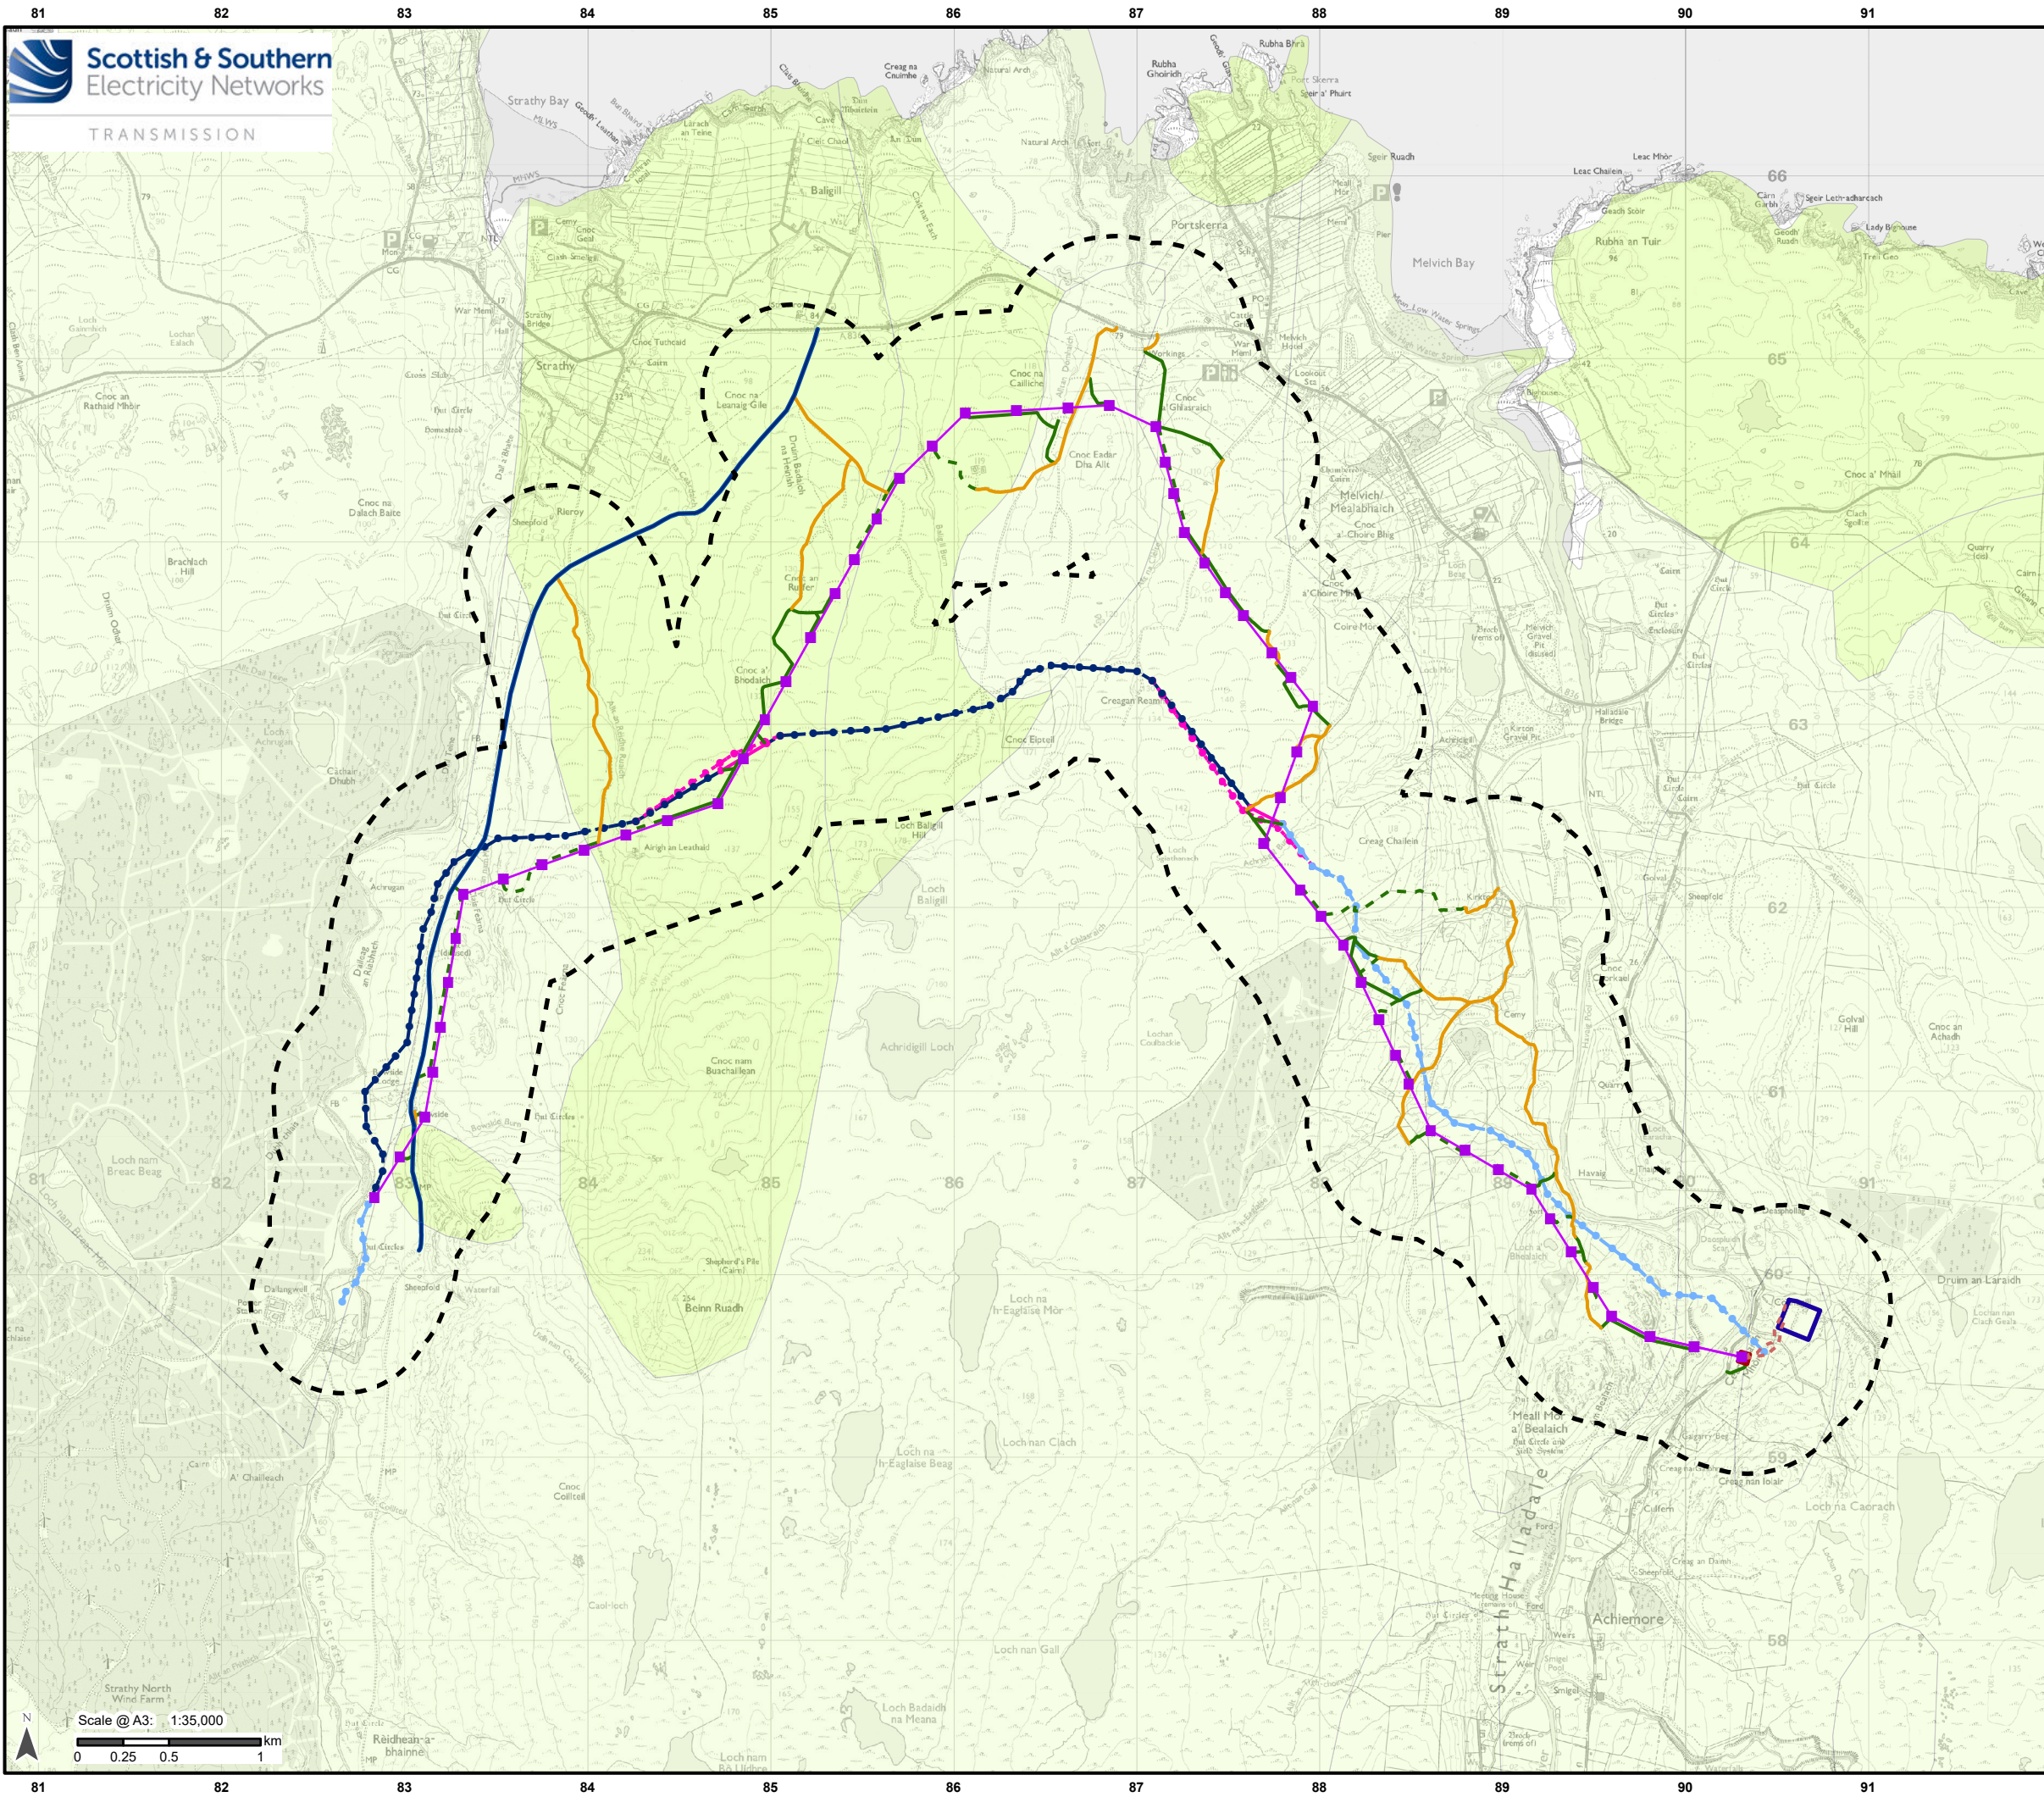

Legend

- Study Area
- Alternative Steel Lattice Tower
- Alternative OHL Alignment
- Proposed Underground Cable (UGC)
- Proposed Cable Sealing End (CSE) Compound
- Existing Access Track
- Existing Access Track (to be upgraded)
- Proposed Permanent Access Track
- Proposed Temporary Access Track
- Existing Wood Pole (H pole) (to be retained)
- Existing OHL (to be retained)
- Existing Wood Pole (H pole) (to be dismantled)
- Temporary Wood Pole (H pole)
- Proposed Temporary OHL
- Temporary UGC Alignment
- Existing Wood Pole (H pole) (to be dismantled)
- Connagill 275/132 kV Substation

Aquifer Classification

- Moderately productive aquifer
- Low Productivity Aquifer

Reproduced by permission of Ordnance Survey on behalf of HMSO. Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number AC0000848283. Extract from BGS Hydrogeological Map of Scotland, 1988 (1:625,000 scale).
Reproduced with the permission of the British Geological Survey ©Nerc. All rights reserved.

Project No: LT560
Project: Strathly South Wind Farm Grid Connection EIA Report

Title: Figure V5-7.6 - Regional Hydrogeology Alternative Alignment

Drawn by: AA Date: 24/01/2025

Drawing: 428.013137.00001.00058.0