


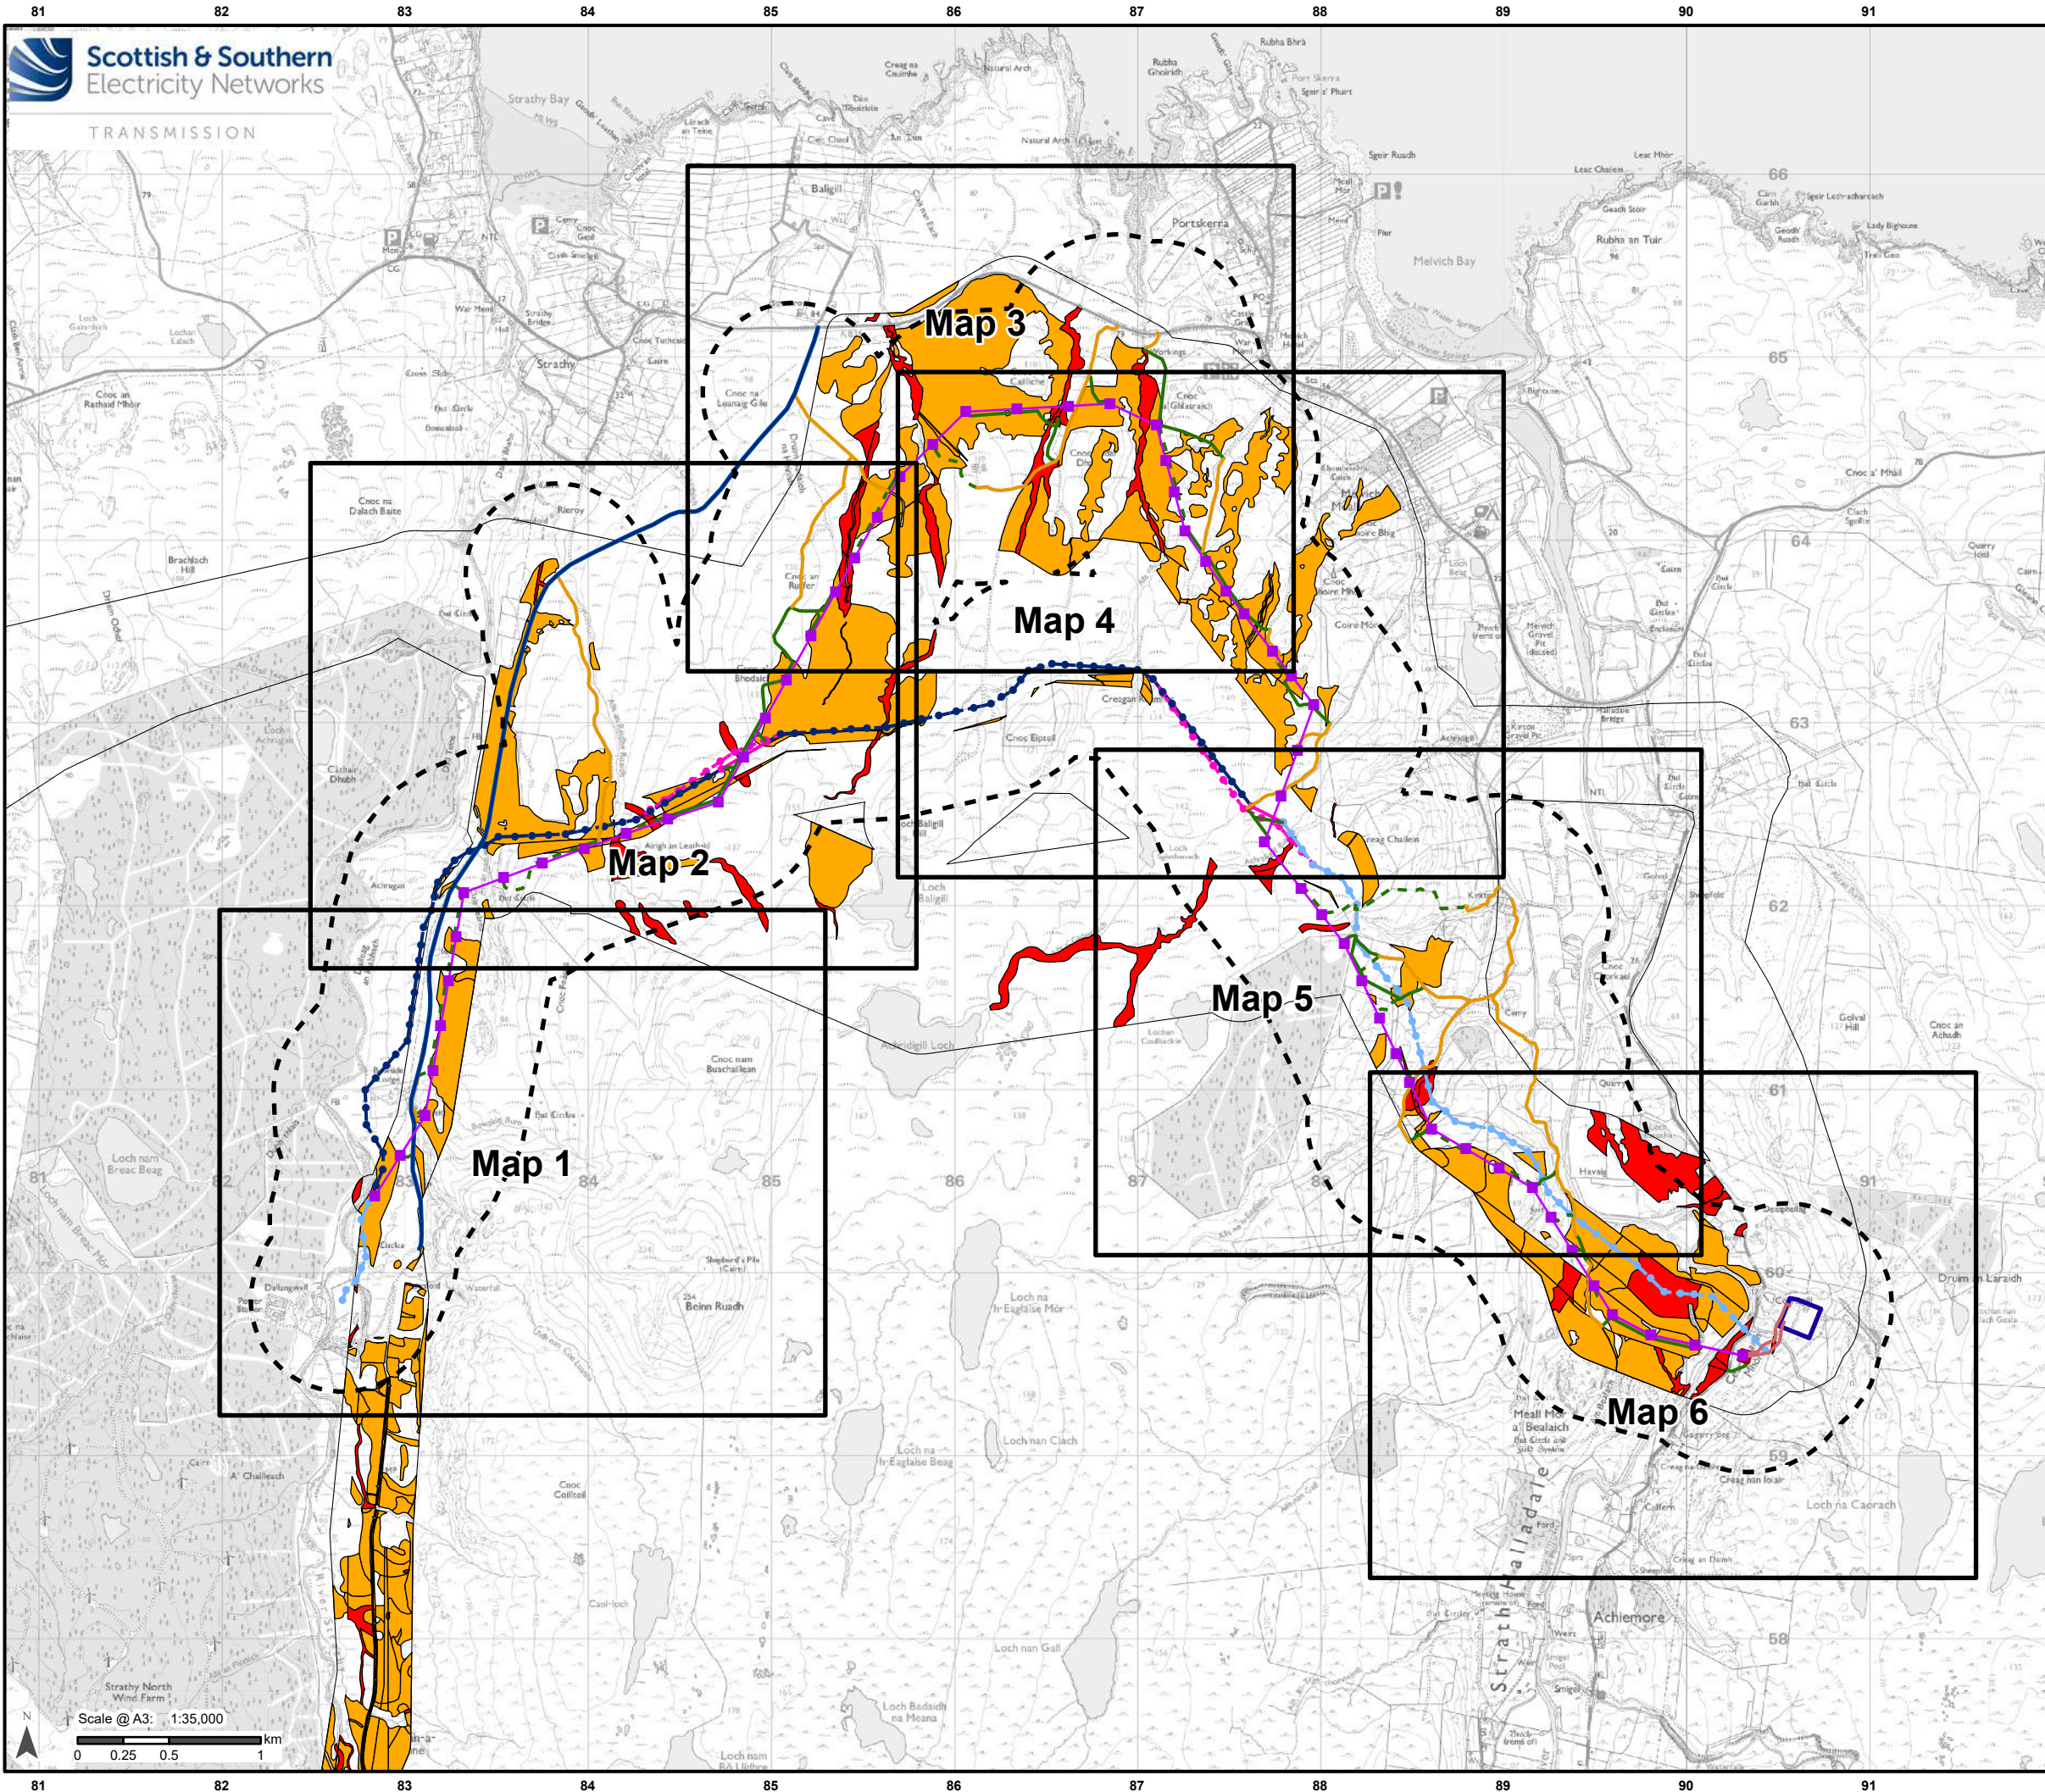

Legend

- Study Area
- Alternative Steel Lattice Tower
- Alternative OHL Alignment
- Proposed Underground Cable (UGC)
- Proposed Cable Sealing End (CSE) Compound
- Existing Access Track
- Existing Access Track (to be upgraded)
- Proposed Permanent Access Track
- Proposed Temporary Access Track
- Existing Wood Pole (H pole) (to be retained)
- Existing OHL (to be retained)
- Existing Wood Pole (H pole) (to be dismantled)
- Temporary Wood Pole (H pole)
- Proposed Temporary OHL
- Temporary UGC Alignment
- Existing Wood Pole (H pole) (to be dismantled)
- Connagill 275/132 kV Substation

GWDTE

- Potentially Highly Dependent
- Potentially Moderately Dependent

Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number AC0000848283.
Superficial Geology data obtained via BGS WMS.
Contains British Geological Survey materials © UKRI [2024]


Project No: LT560


Project: Strathly South Wind Farm Grid Connection EIA Report

Title: Figure V5-7.8.1: GWDTE Alternative Alignment Overview

Drawn by: AA Date: 24/01/2025

Drawing: 428.013137.00001.00090.0

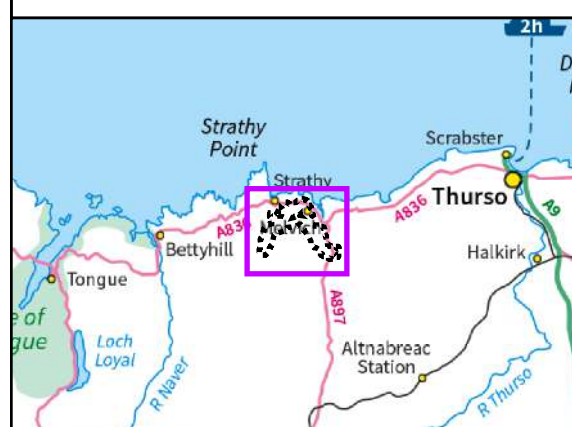

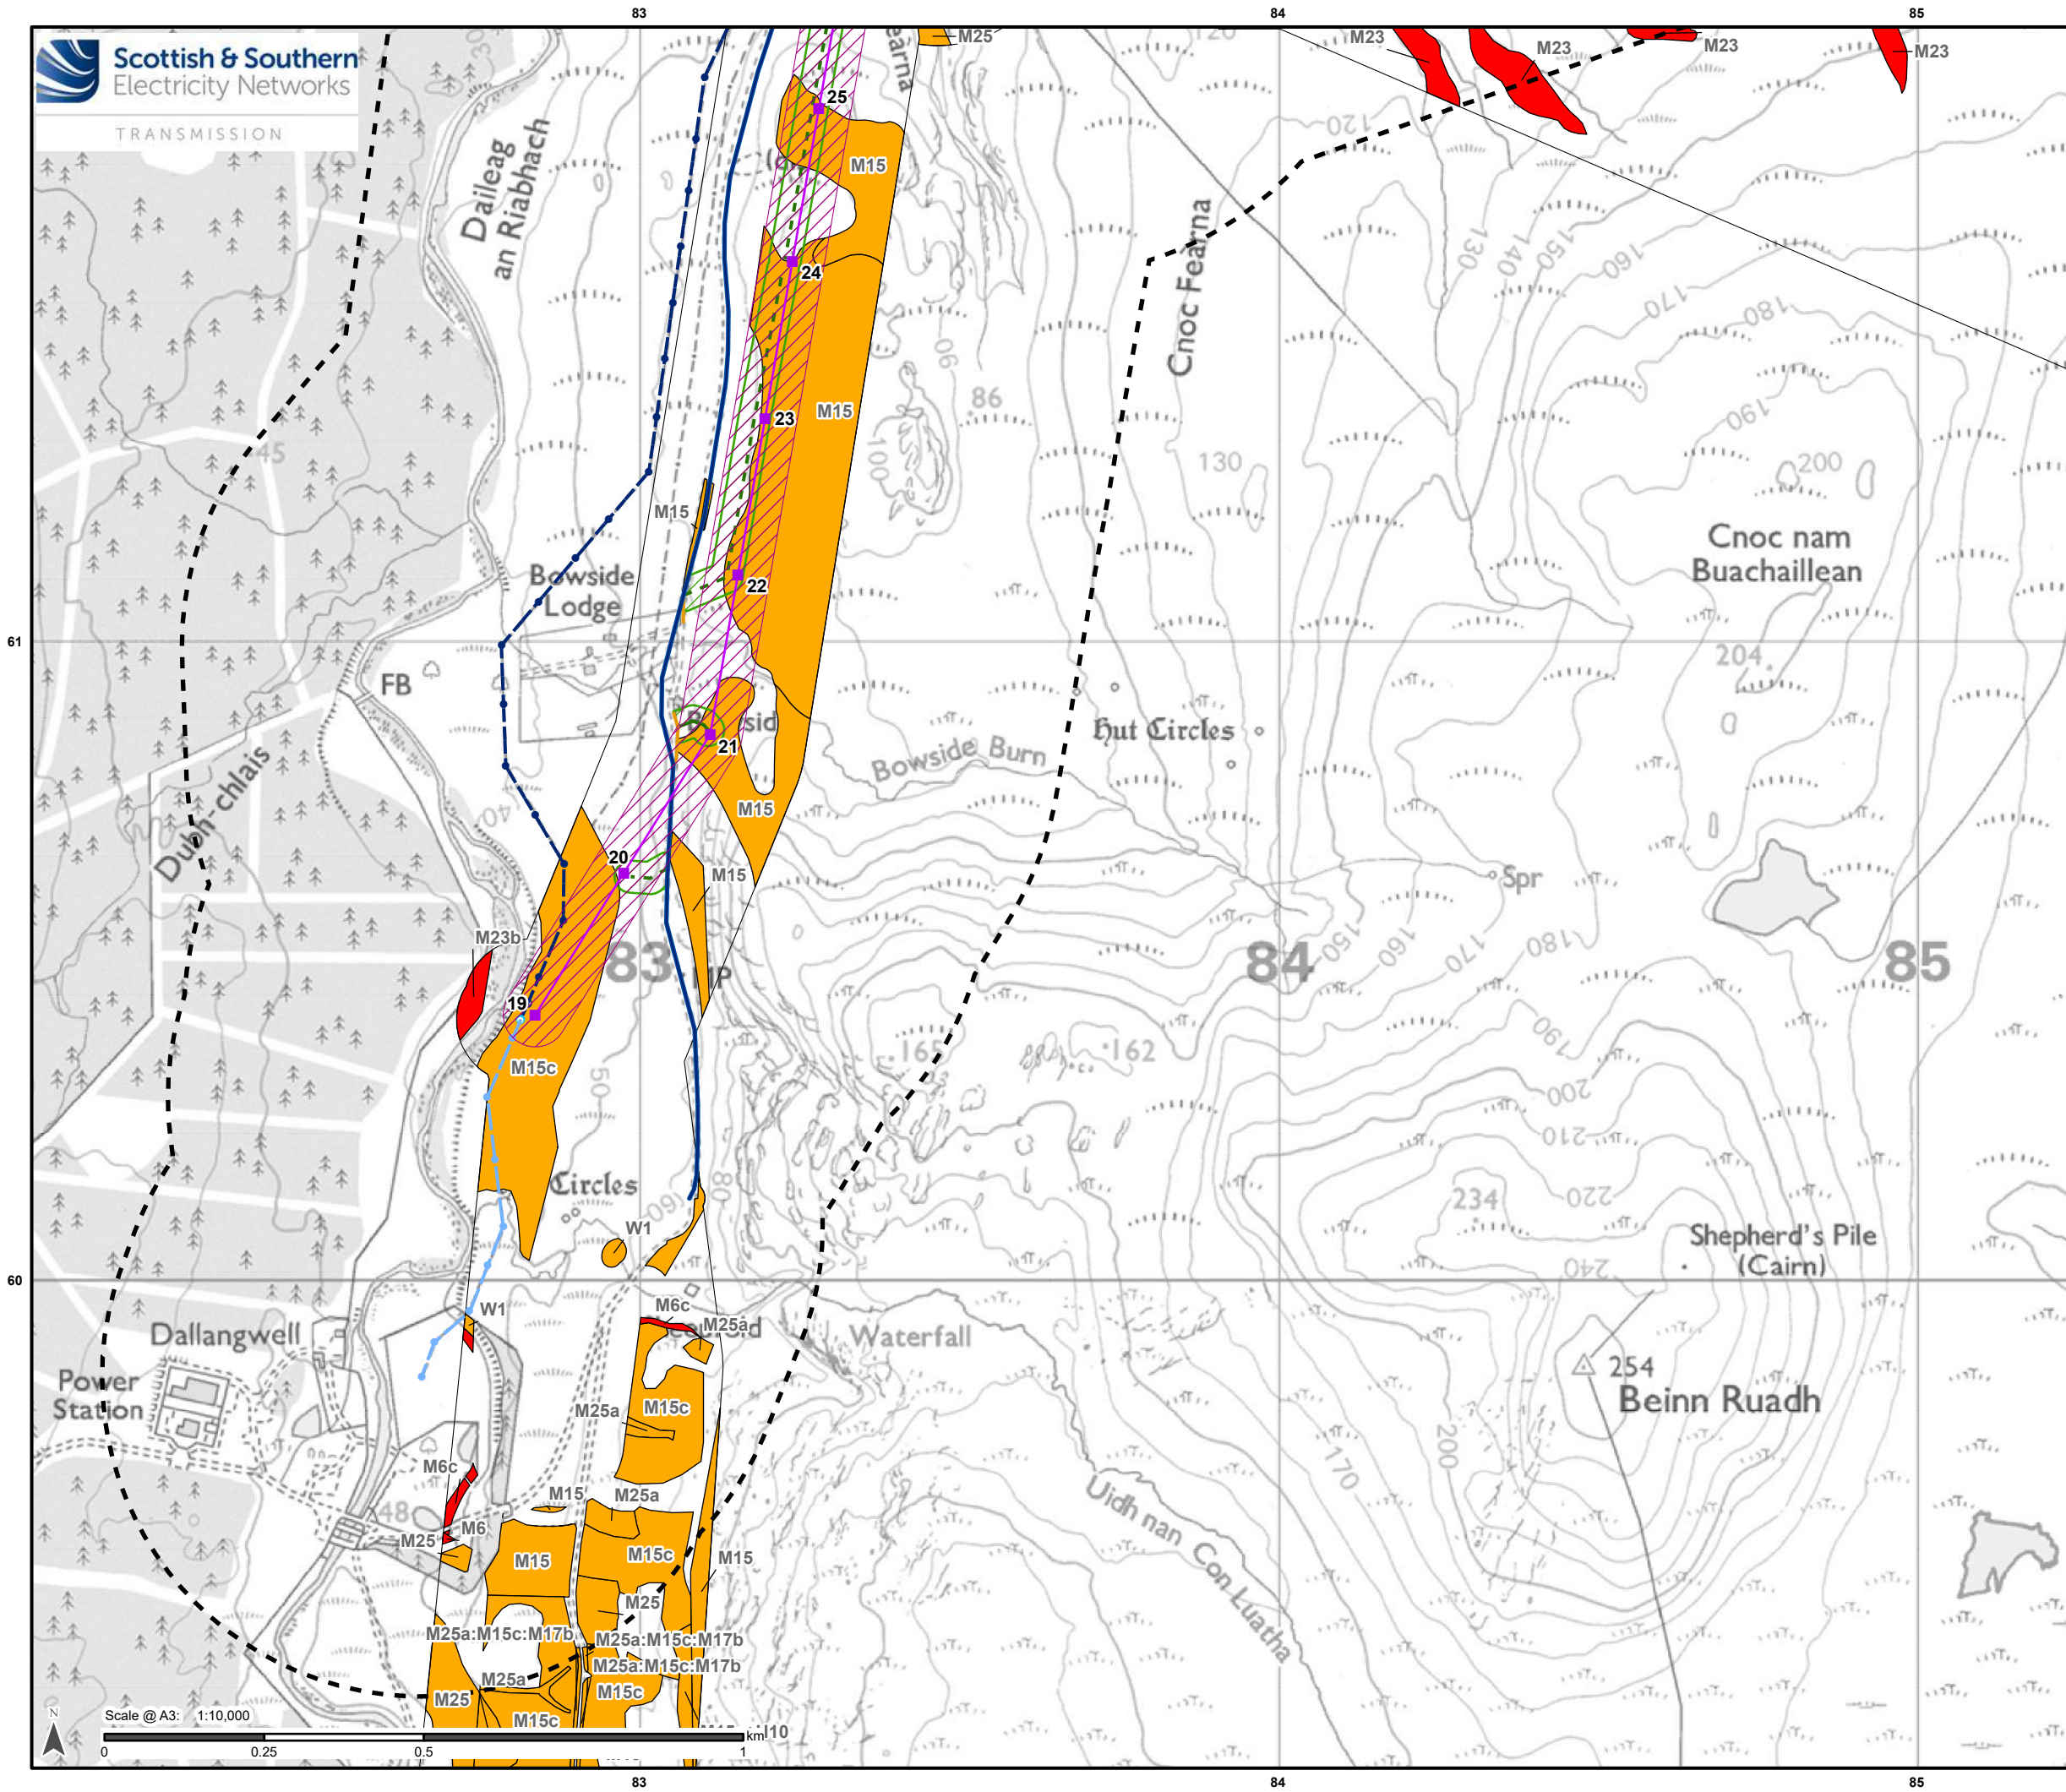


Legend

- Study Area
- Alternative Steel Lattice Tower
- Alternative OHL Alignment
- Limit of Deviation (Alternative OHL)
- Existing Access Track
- Existing Access Track (to be upgraded)
- Proposed Permanent Access Track
- Proposed Temporary Access Track
- Limit of Deviation (Access Track)
- Existing Wood Pole (H pole) (to be retained)
- Existing OHL (to be retained)
- Existing Wood Pole (H pole) (to be dismantled)
- Existing Wood Pole (H pole) (to be dismantled)
- Proposed* Wood Pole (H pole) (to be retained)
- Proposed* Wood Pole (H pole) (to be dismantled)
- *Proposed as part of Strathy Wood Wind Farm Grid Connection


GWDTE

- Potentially Highly Dependent
- Potentially Moderately Dependent

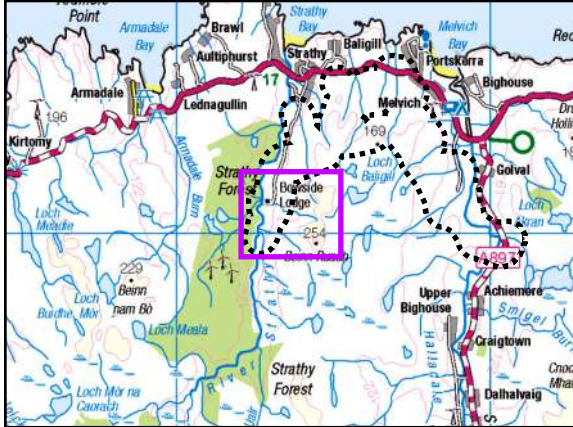


Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number AC0000848283.
Superficial Geology data obtained via BGS WMS.
Contains British Geological Survey materials © UKRI [2024]

Project No:	LT560
Project:	Strathy South Wind Farm Grid Connection EIA Report
Title:	Figure V5-7.8.2: GWDTE Alternative Alignment Map 1
Drawn by:	AA
Date:	24/01/2025
Drawing:	428.013137.00001.00090.0

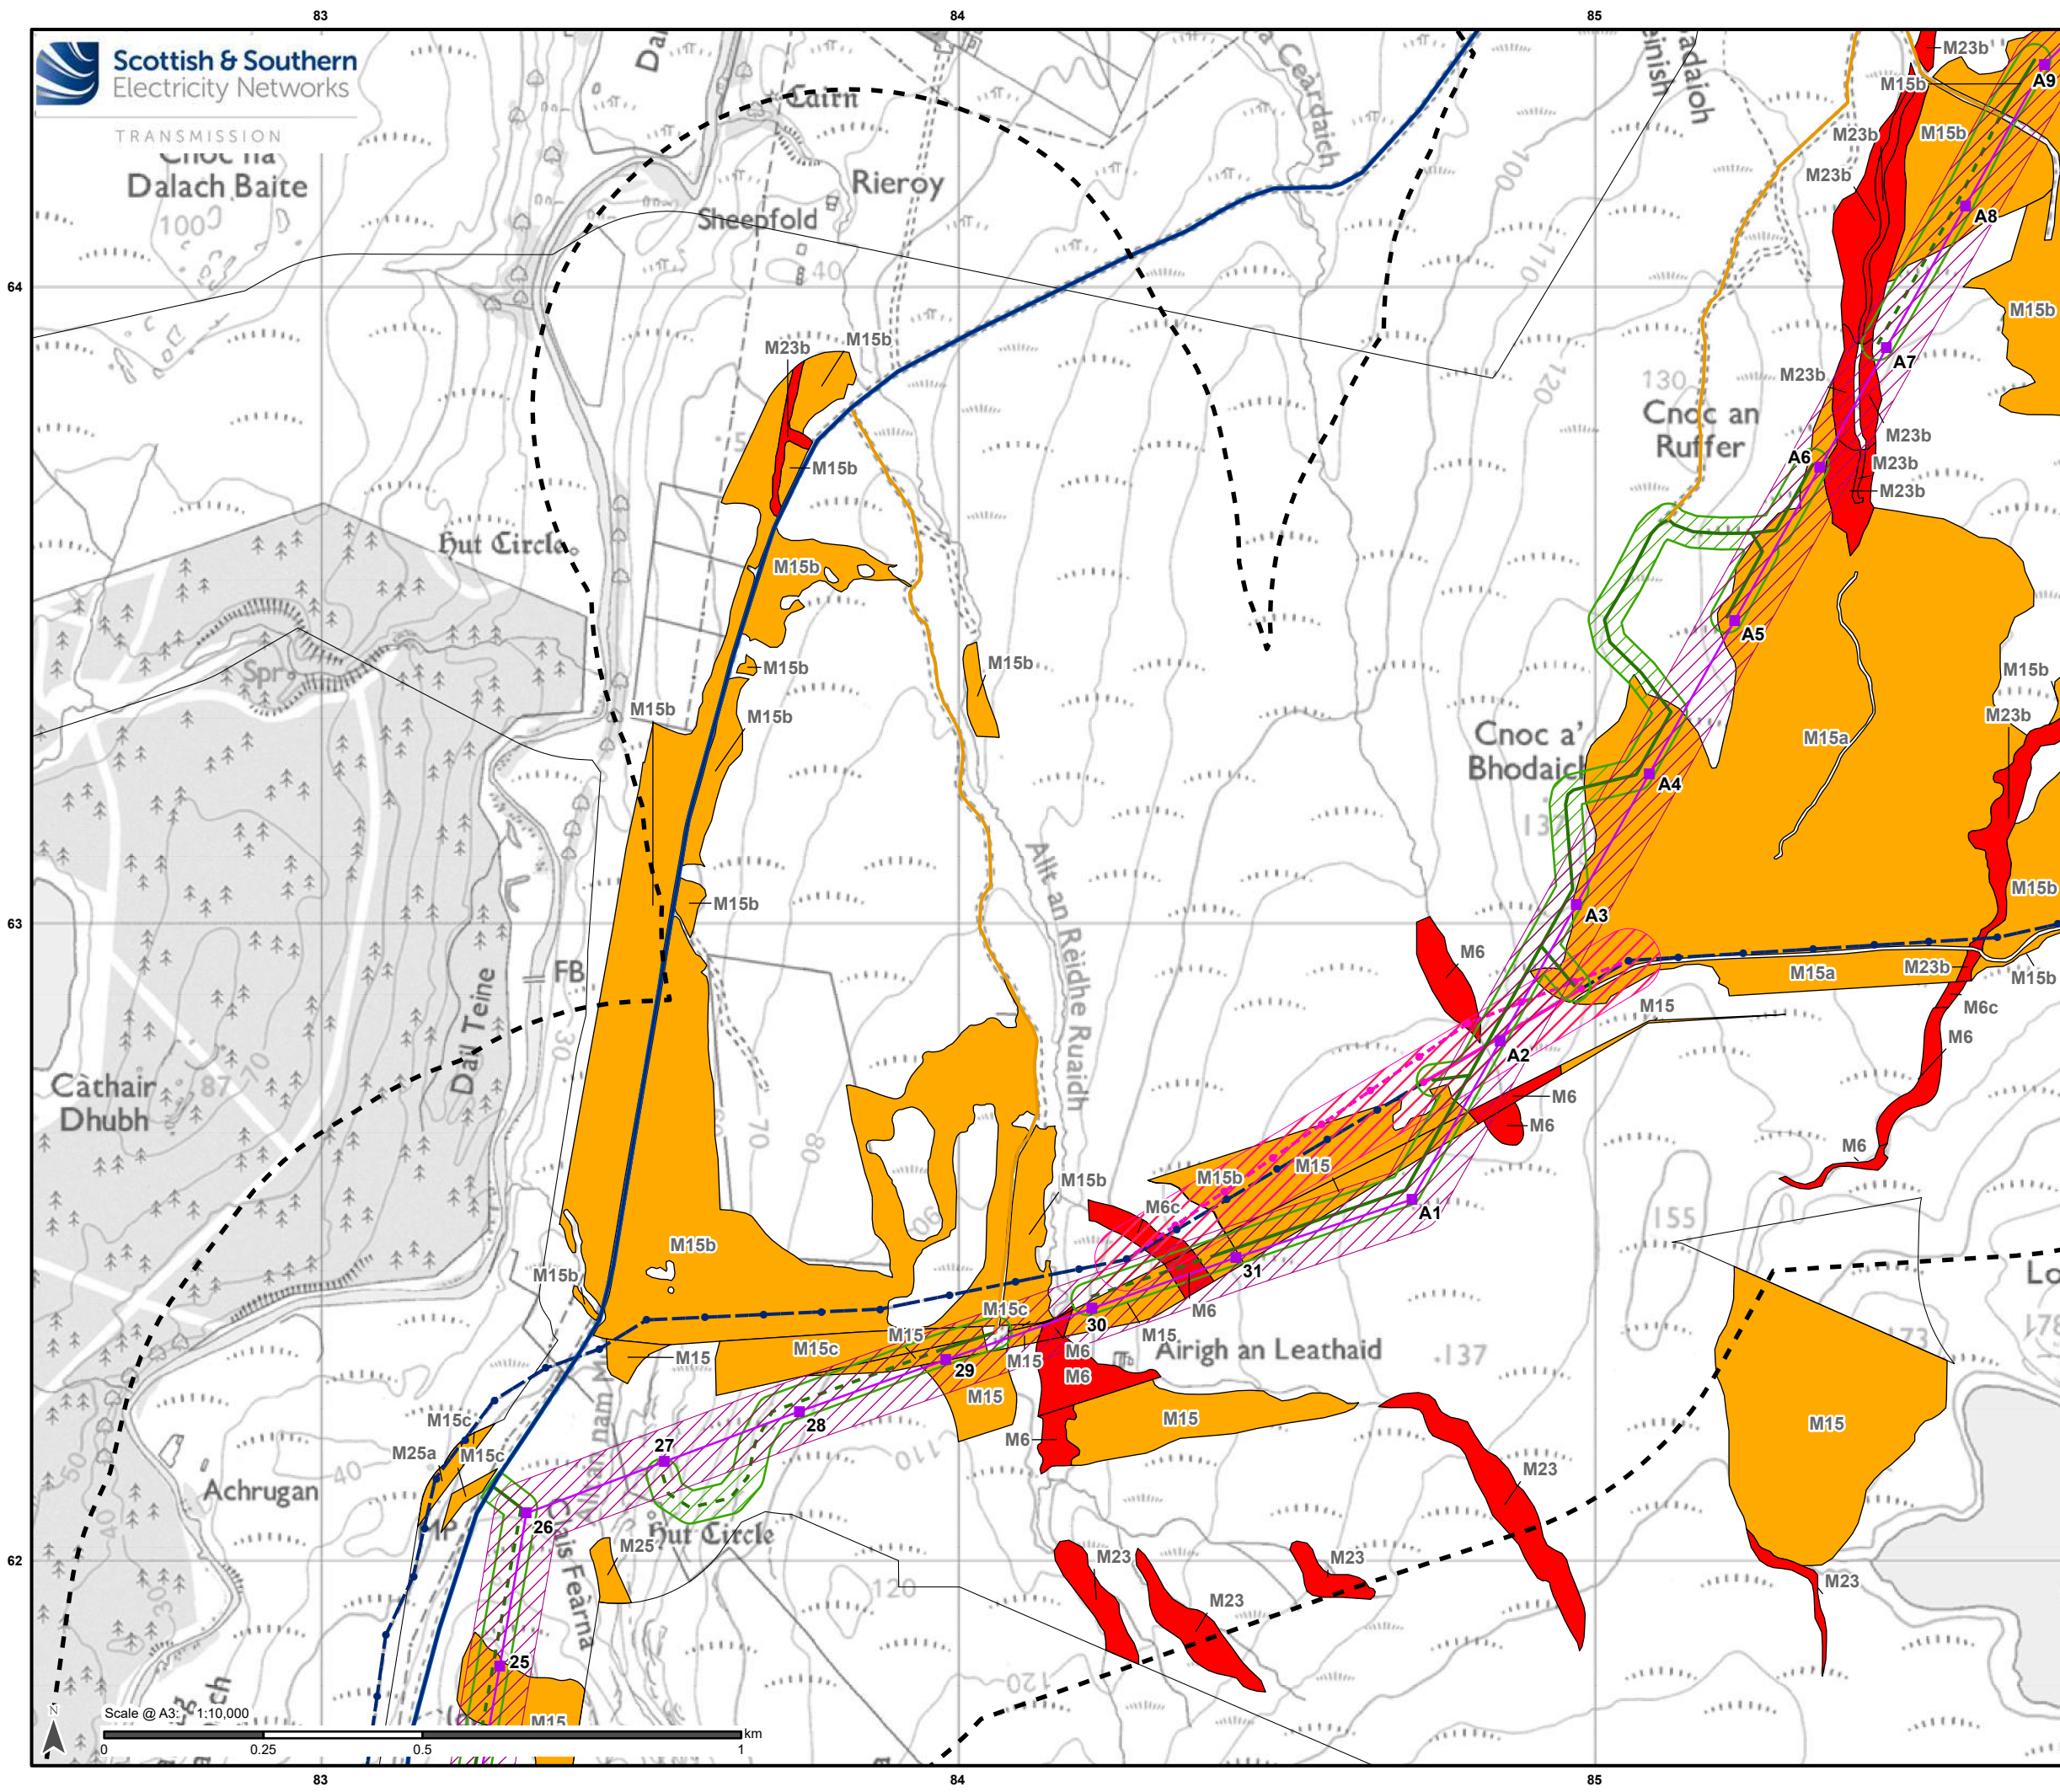


Legend


- Study Area
- Alternative Steel Lattice Tower
- Alternative OHL Alignment
- Limit of Deviation (Alternative OHL)
- Existing Access Track
- Existing Access Track (to be upgraded)
- Proposed Permanent Access Track
- Proposed Temporary Access Track
- Limit of Deviation (Access Track)
- Existing Wood Pole (H pole) (to be dismantled)
- Temporary Wood Pole (H pole)
- Proposed Temporary OHL
- Limit of Deviation (Temporary OHL)
- Temporary UGC Alignment
- Existing Wood Pole (H pole) (to be dismantled)
- GWDTE**
 - Potentially Highly Dependent
 - Potentially Moderately Dependent

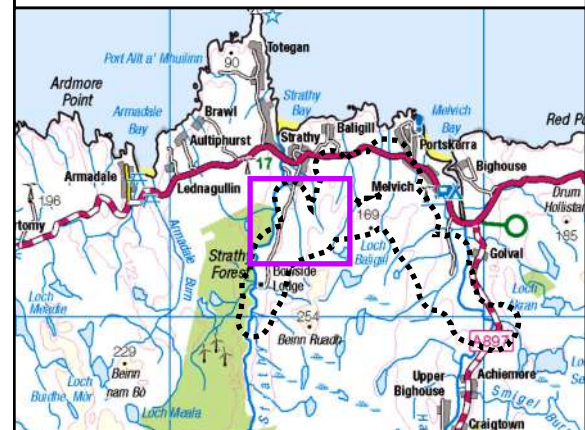

Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number AC0000848283.
Superficial Geology data obtained via BGS WMS.
Contains British Geological Survey materials © UKRI [2024]

Project No:	LT560
Project:	Strathy South Wind Farm Grid Connection EIA Report
Title:	Figure V5-7.8.3: GWDTE Alternative Alignment Map 2
Drawn by:	AA
Date:	24/01/2025
Drawing:	428.013137.00001.00090.0

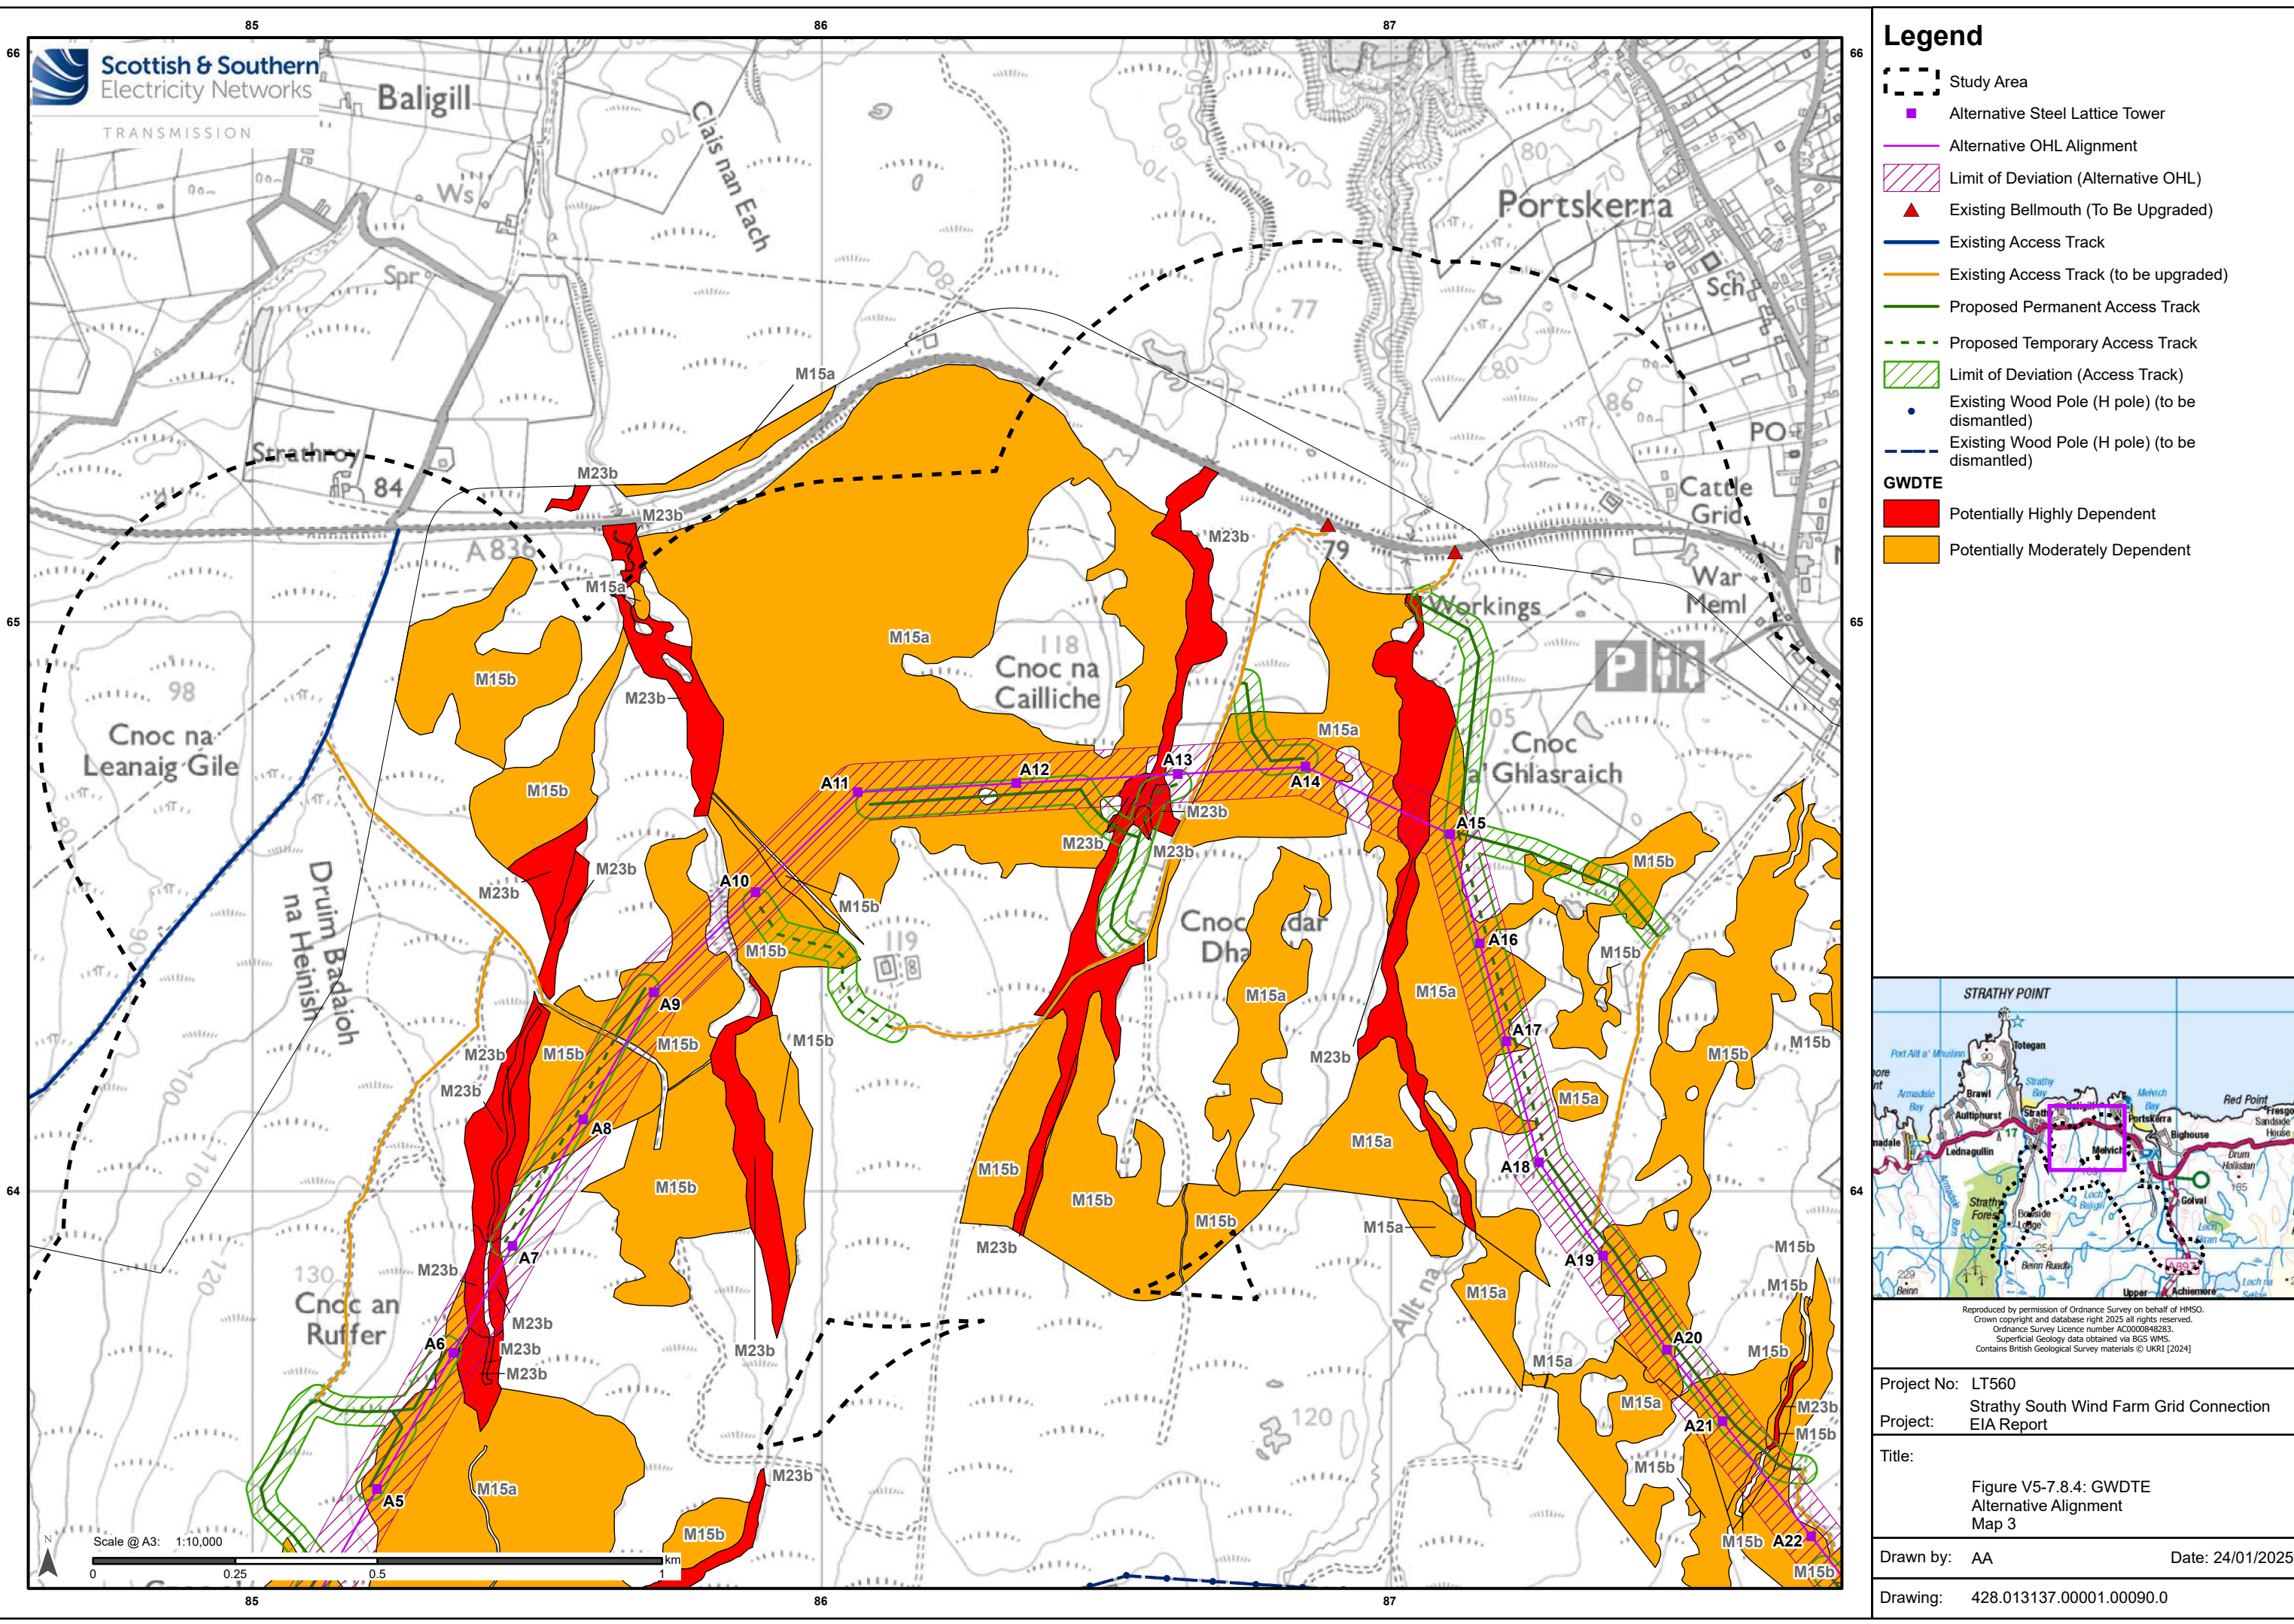

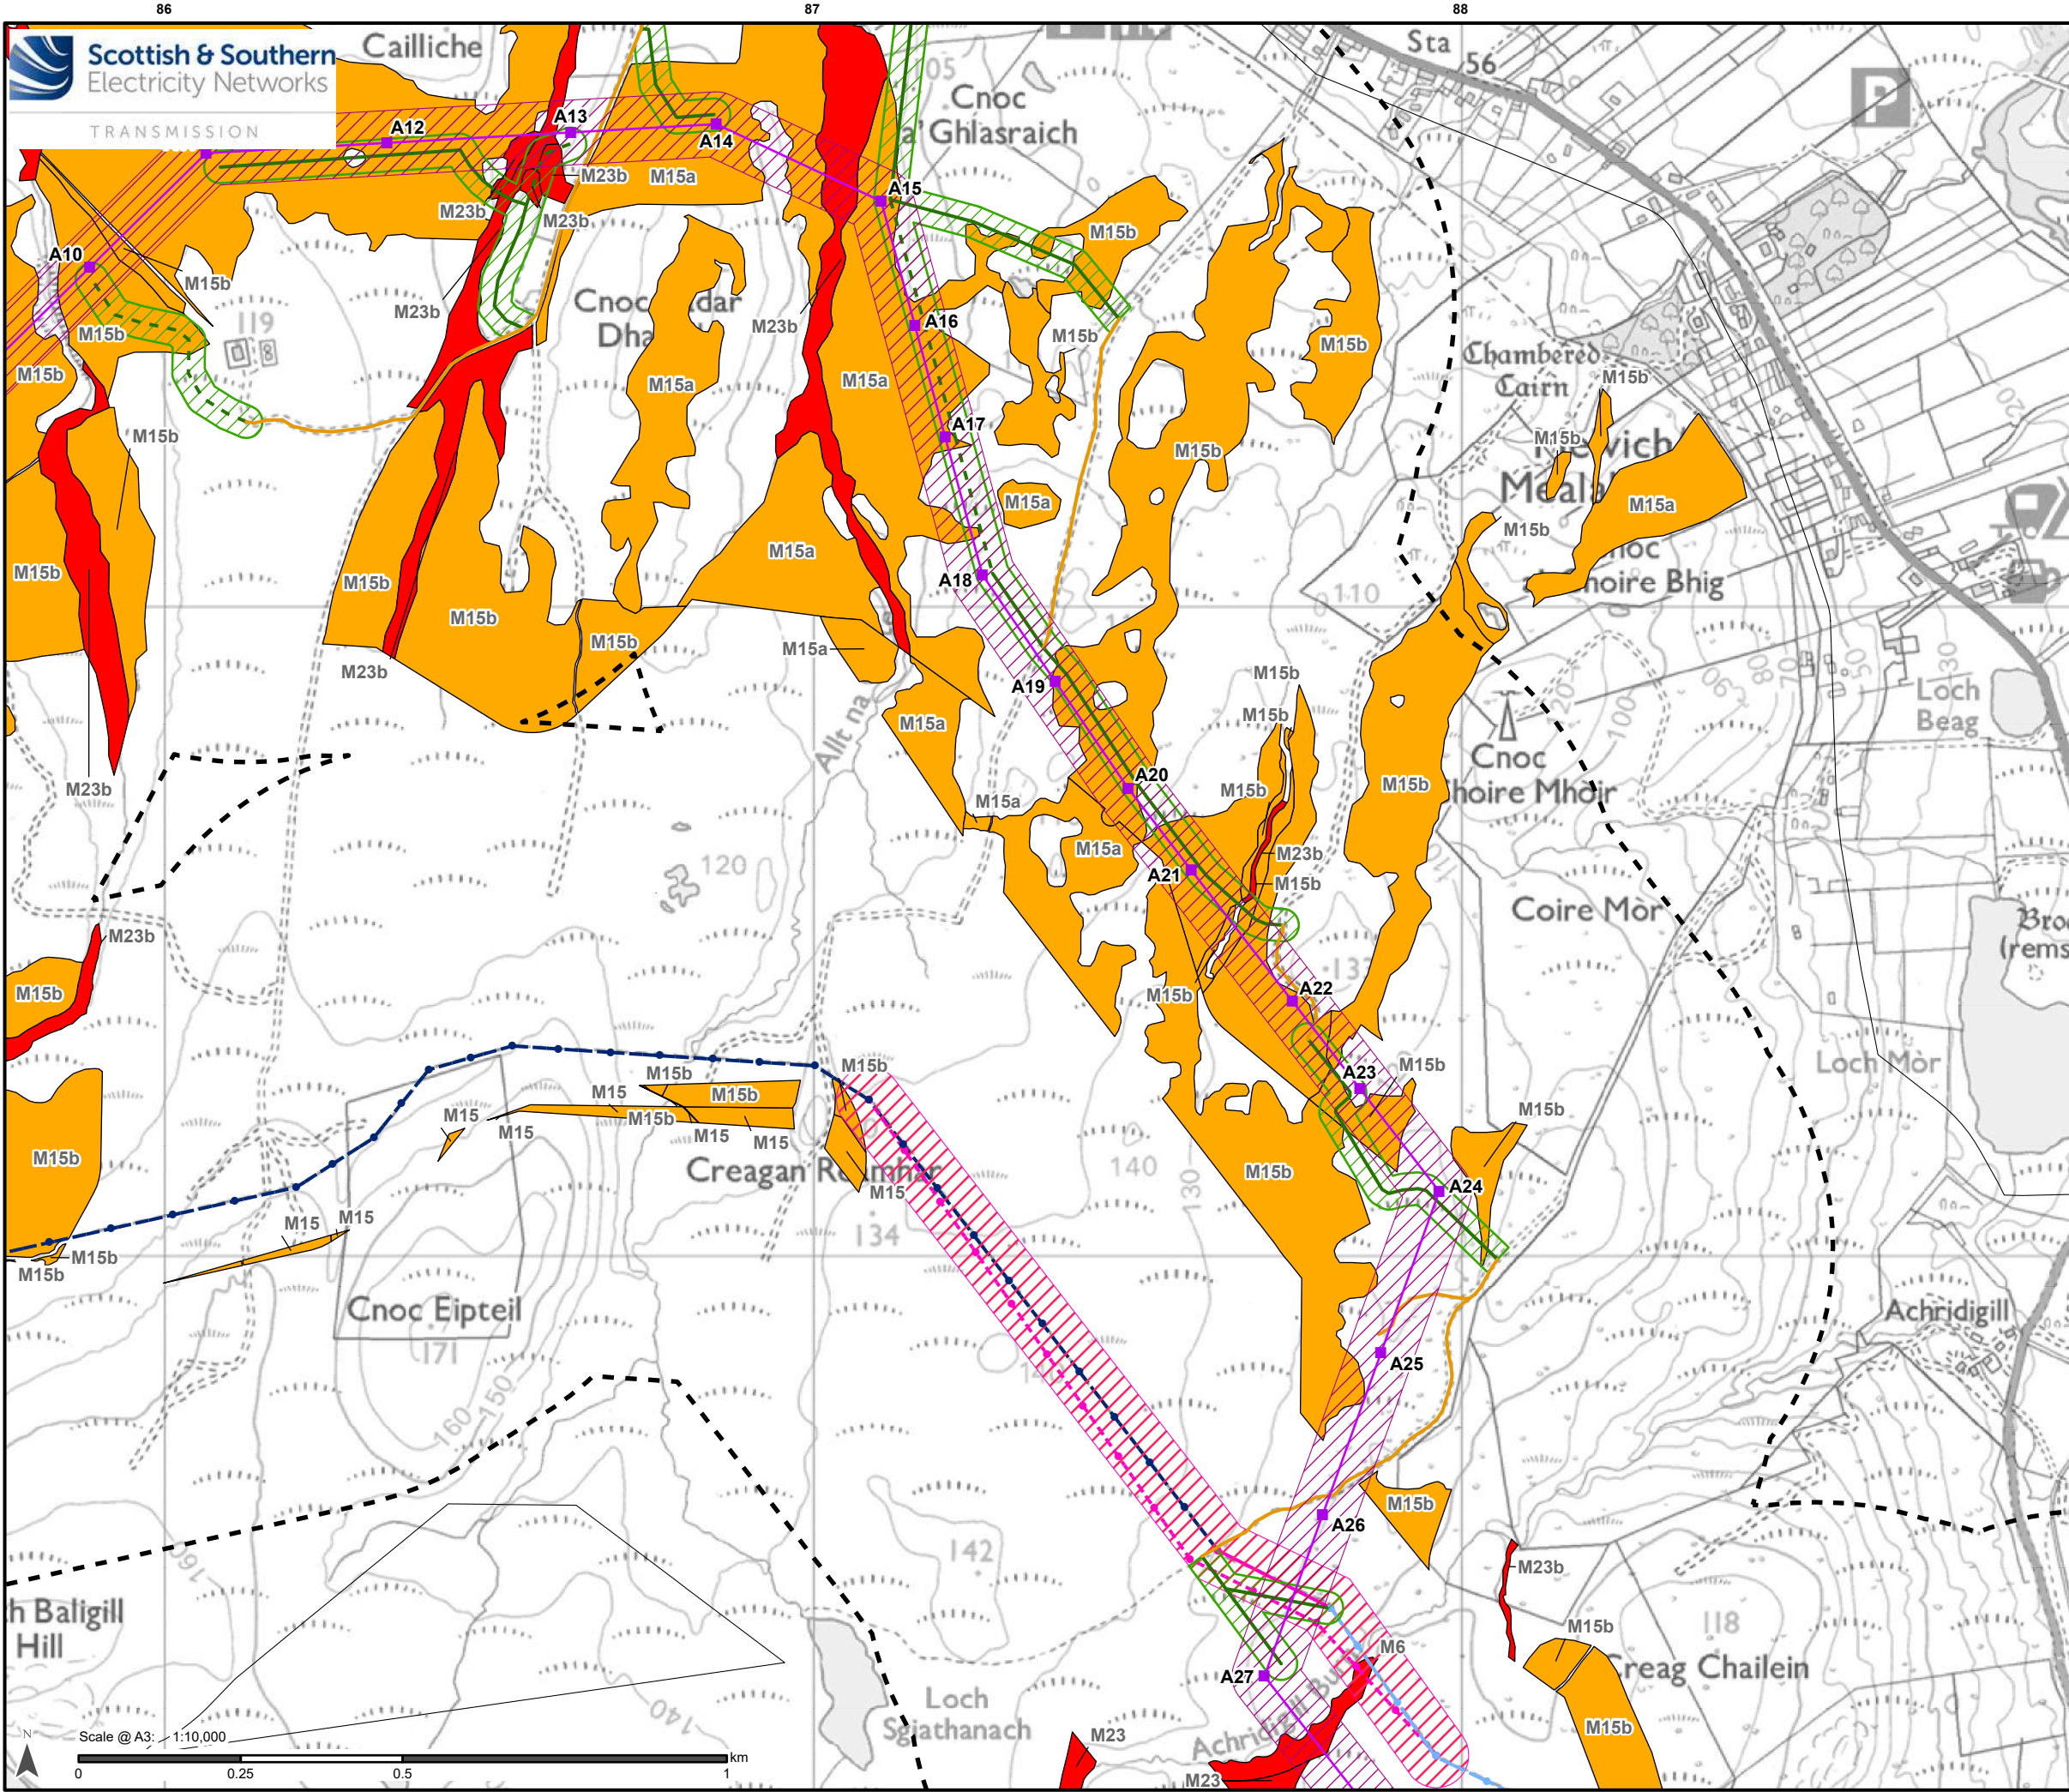

Legend

- Study Area
- Alternative Steel Lattice Tower
- Alternative OHL Alignment
- Limit of Deviation (Alternative OHL)
- Existing Access Track (to be upgraded)
- Proposed Permanent Access Track
- Proposed Temporary Access Track
- Limit of Deviation (Access Track)
- Existing Wood Pole (H pole) (to be retained)
- Existing OHL (to be retained)
- Existing Wood Pole (H pole) (to be dismantled)
- Temporary Wood Pole (H pole)
- Proposed Temporary OHL
- Limit of Deviation (Temporary OHL)
- Temporary UGC Alignment
- Existing Wood Pole (H pole) (to be dismantled)

GWDTE

- Potentially Highly Dependent
- Potentially Moderately Dependent


Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number AC0000848283.
Superficial Geology data obtained via BGS WMS.
Contains British Geological Survey materials © UKRI [2024]

Project No: LT560
Project: Strathy South Wind Farm Grid Connection
EIA Report

Title:
Figure V5-7.8.5: GWDTE
Alternative Alignment
Map 4

Drawn by: AA
Date: 24/01/2025

Drawing: 428.013137.00001.00090.0

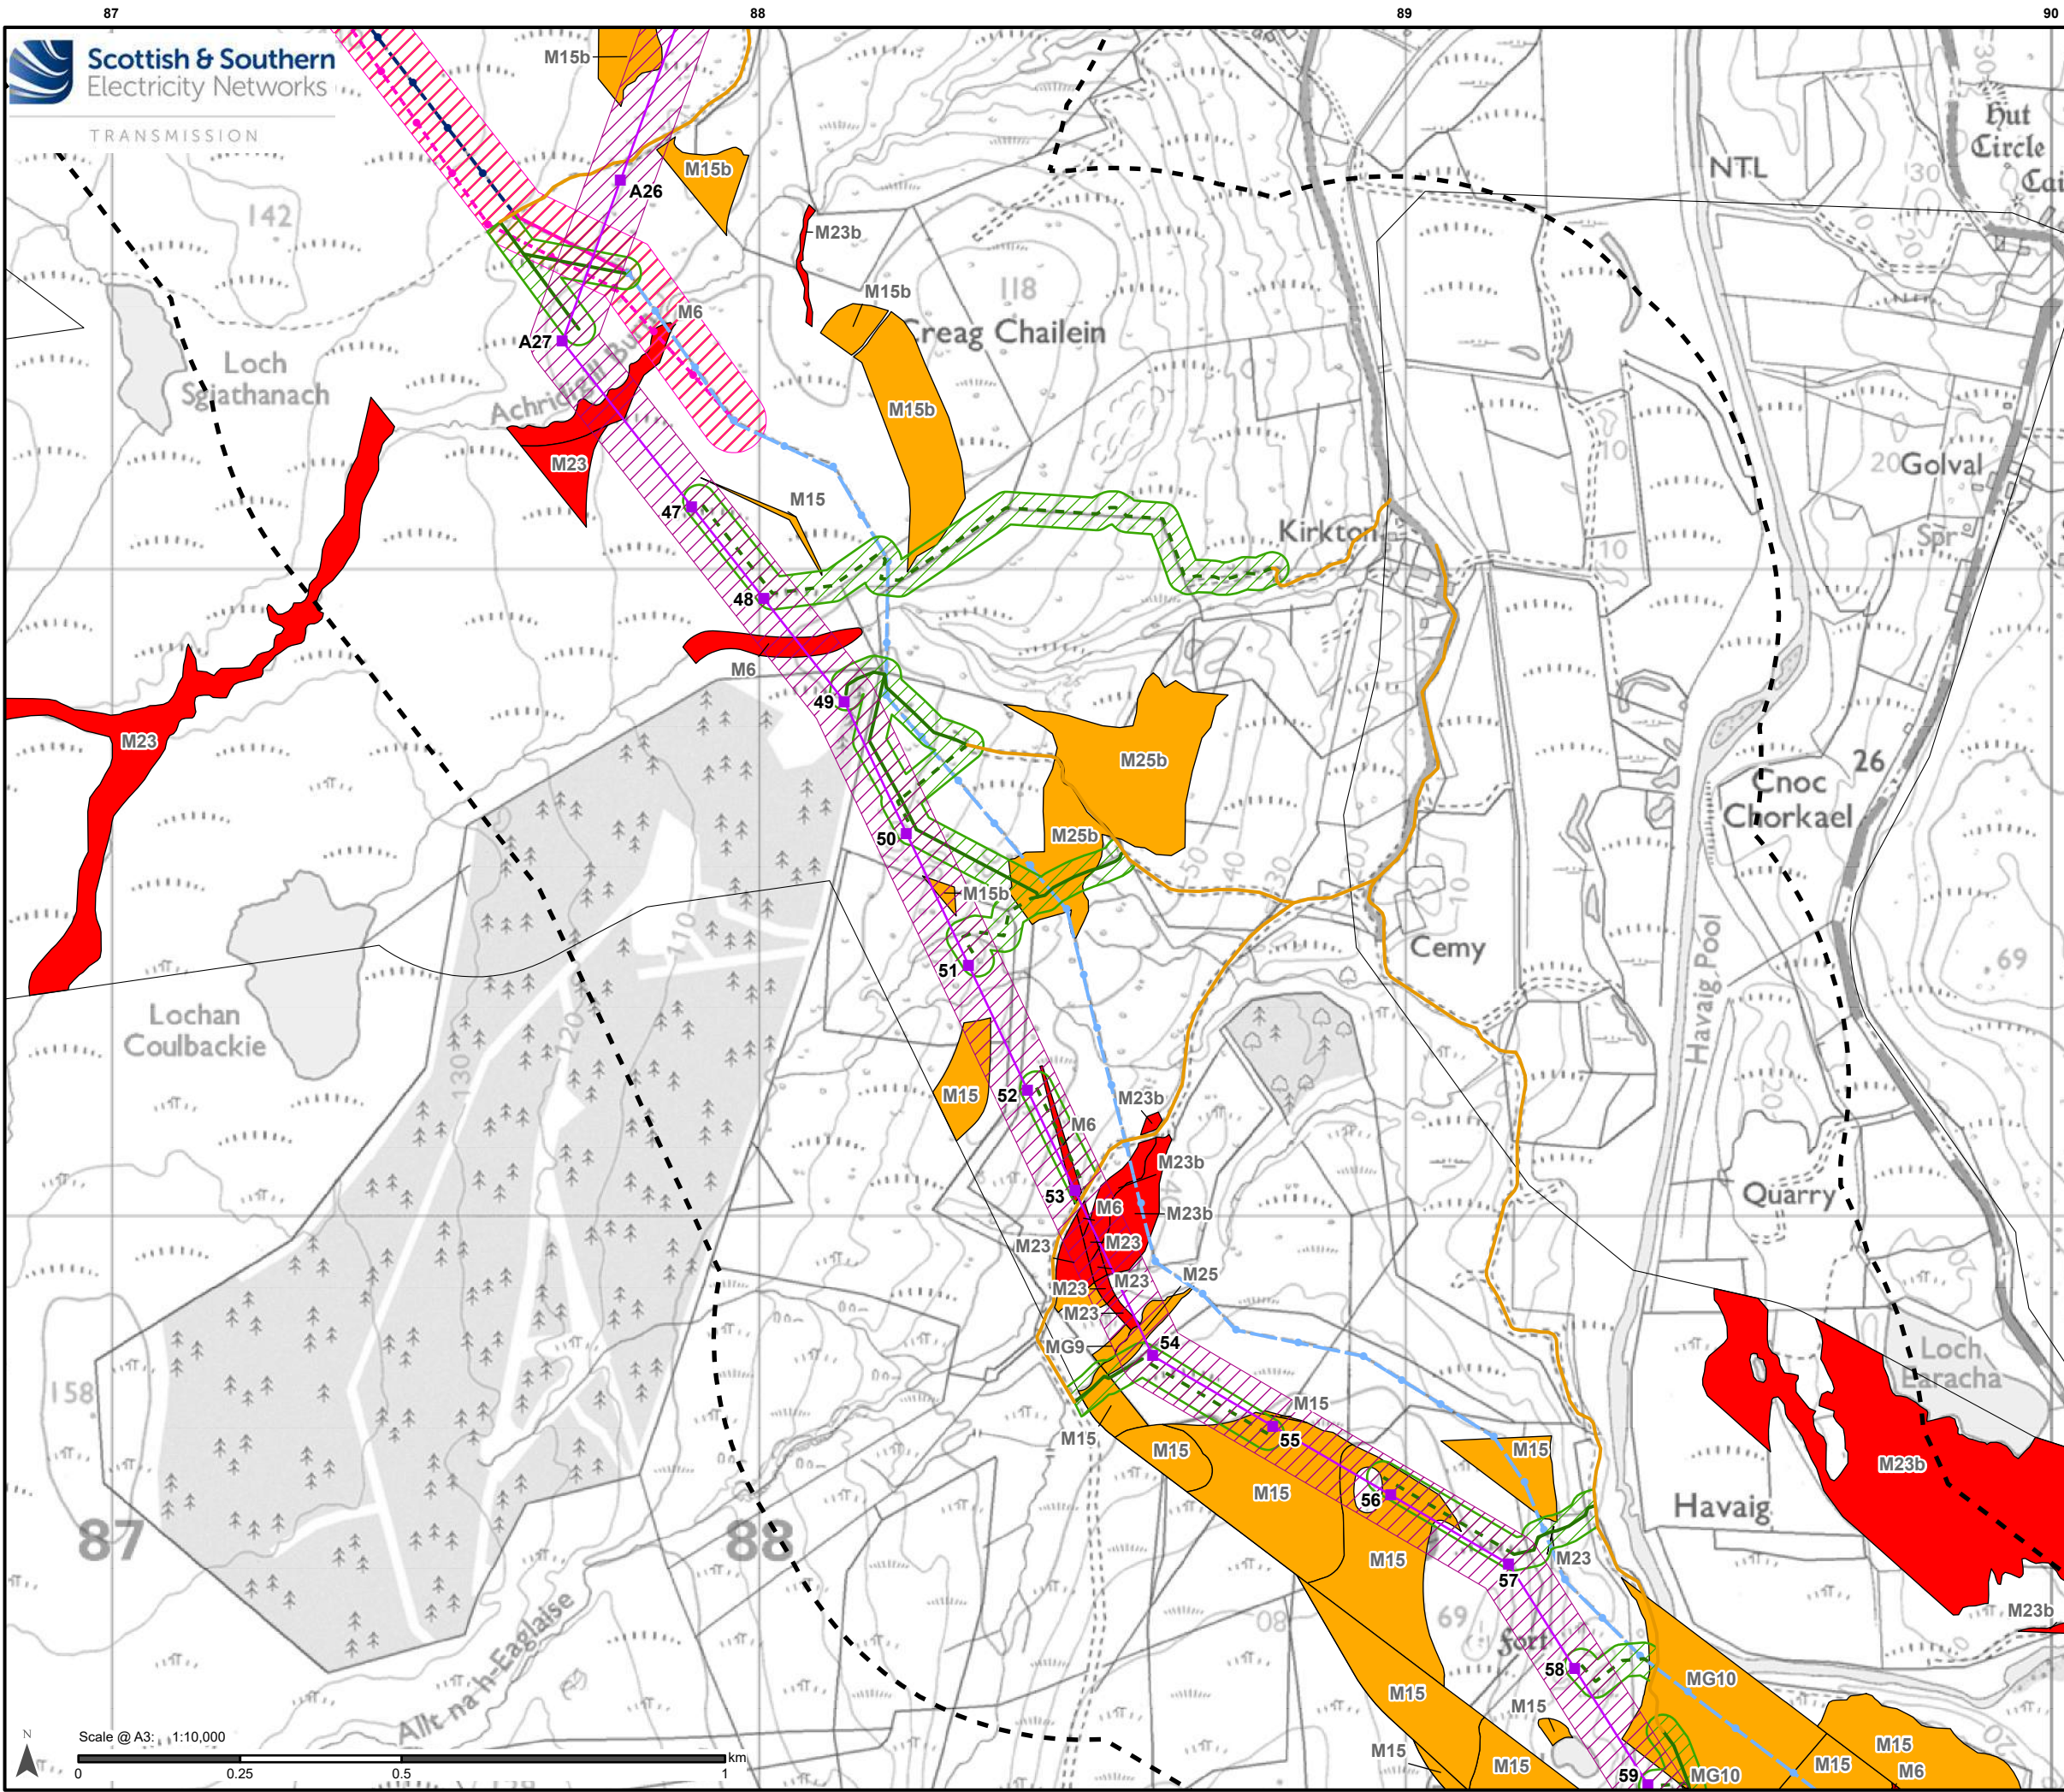

Legend

- Study Area
- Alternative Steel Lattice Tower
- Alternative OHL Alignment
- Limit of Deviation (Alternative OHL)
- Existing Access Track (to be upgraded)
- Proposed Permanent Access Track
- Proposed Temporary Access Track
- Limit of Deviation (Access Track)
- Existing Wood Pole (H pole) (to be retained)
- Existing OHL (to be retained)
- Existing Wood Pole (H pole) (to be dismantled)
- Temporary Wood Pole (H pole)
- Proposed Temporary OHL
- Limit of Deviation (Temporary OHL)
- Temporary UGC Alignment
- Existing Wood Pole (H pole) (to be dismantled)

GWDTE

- Potentially Highly Dependent
- Potentially Moderately Dependent

Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number AC0000848283.
Superficial Geology data obtained via BGS WMS.
Contains British Geological Survey materials © UKRI [2024]


Project No: LT560

Project: Strathly South Wind Farm Grid Connection EIA Report

Title: Figure V5-7.8.6: GWDTE Alternative Alignment Map 5

Drawn by: AA Date: 24/01/2025

Drawing: 428.013137.00001.00090.0

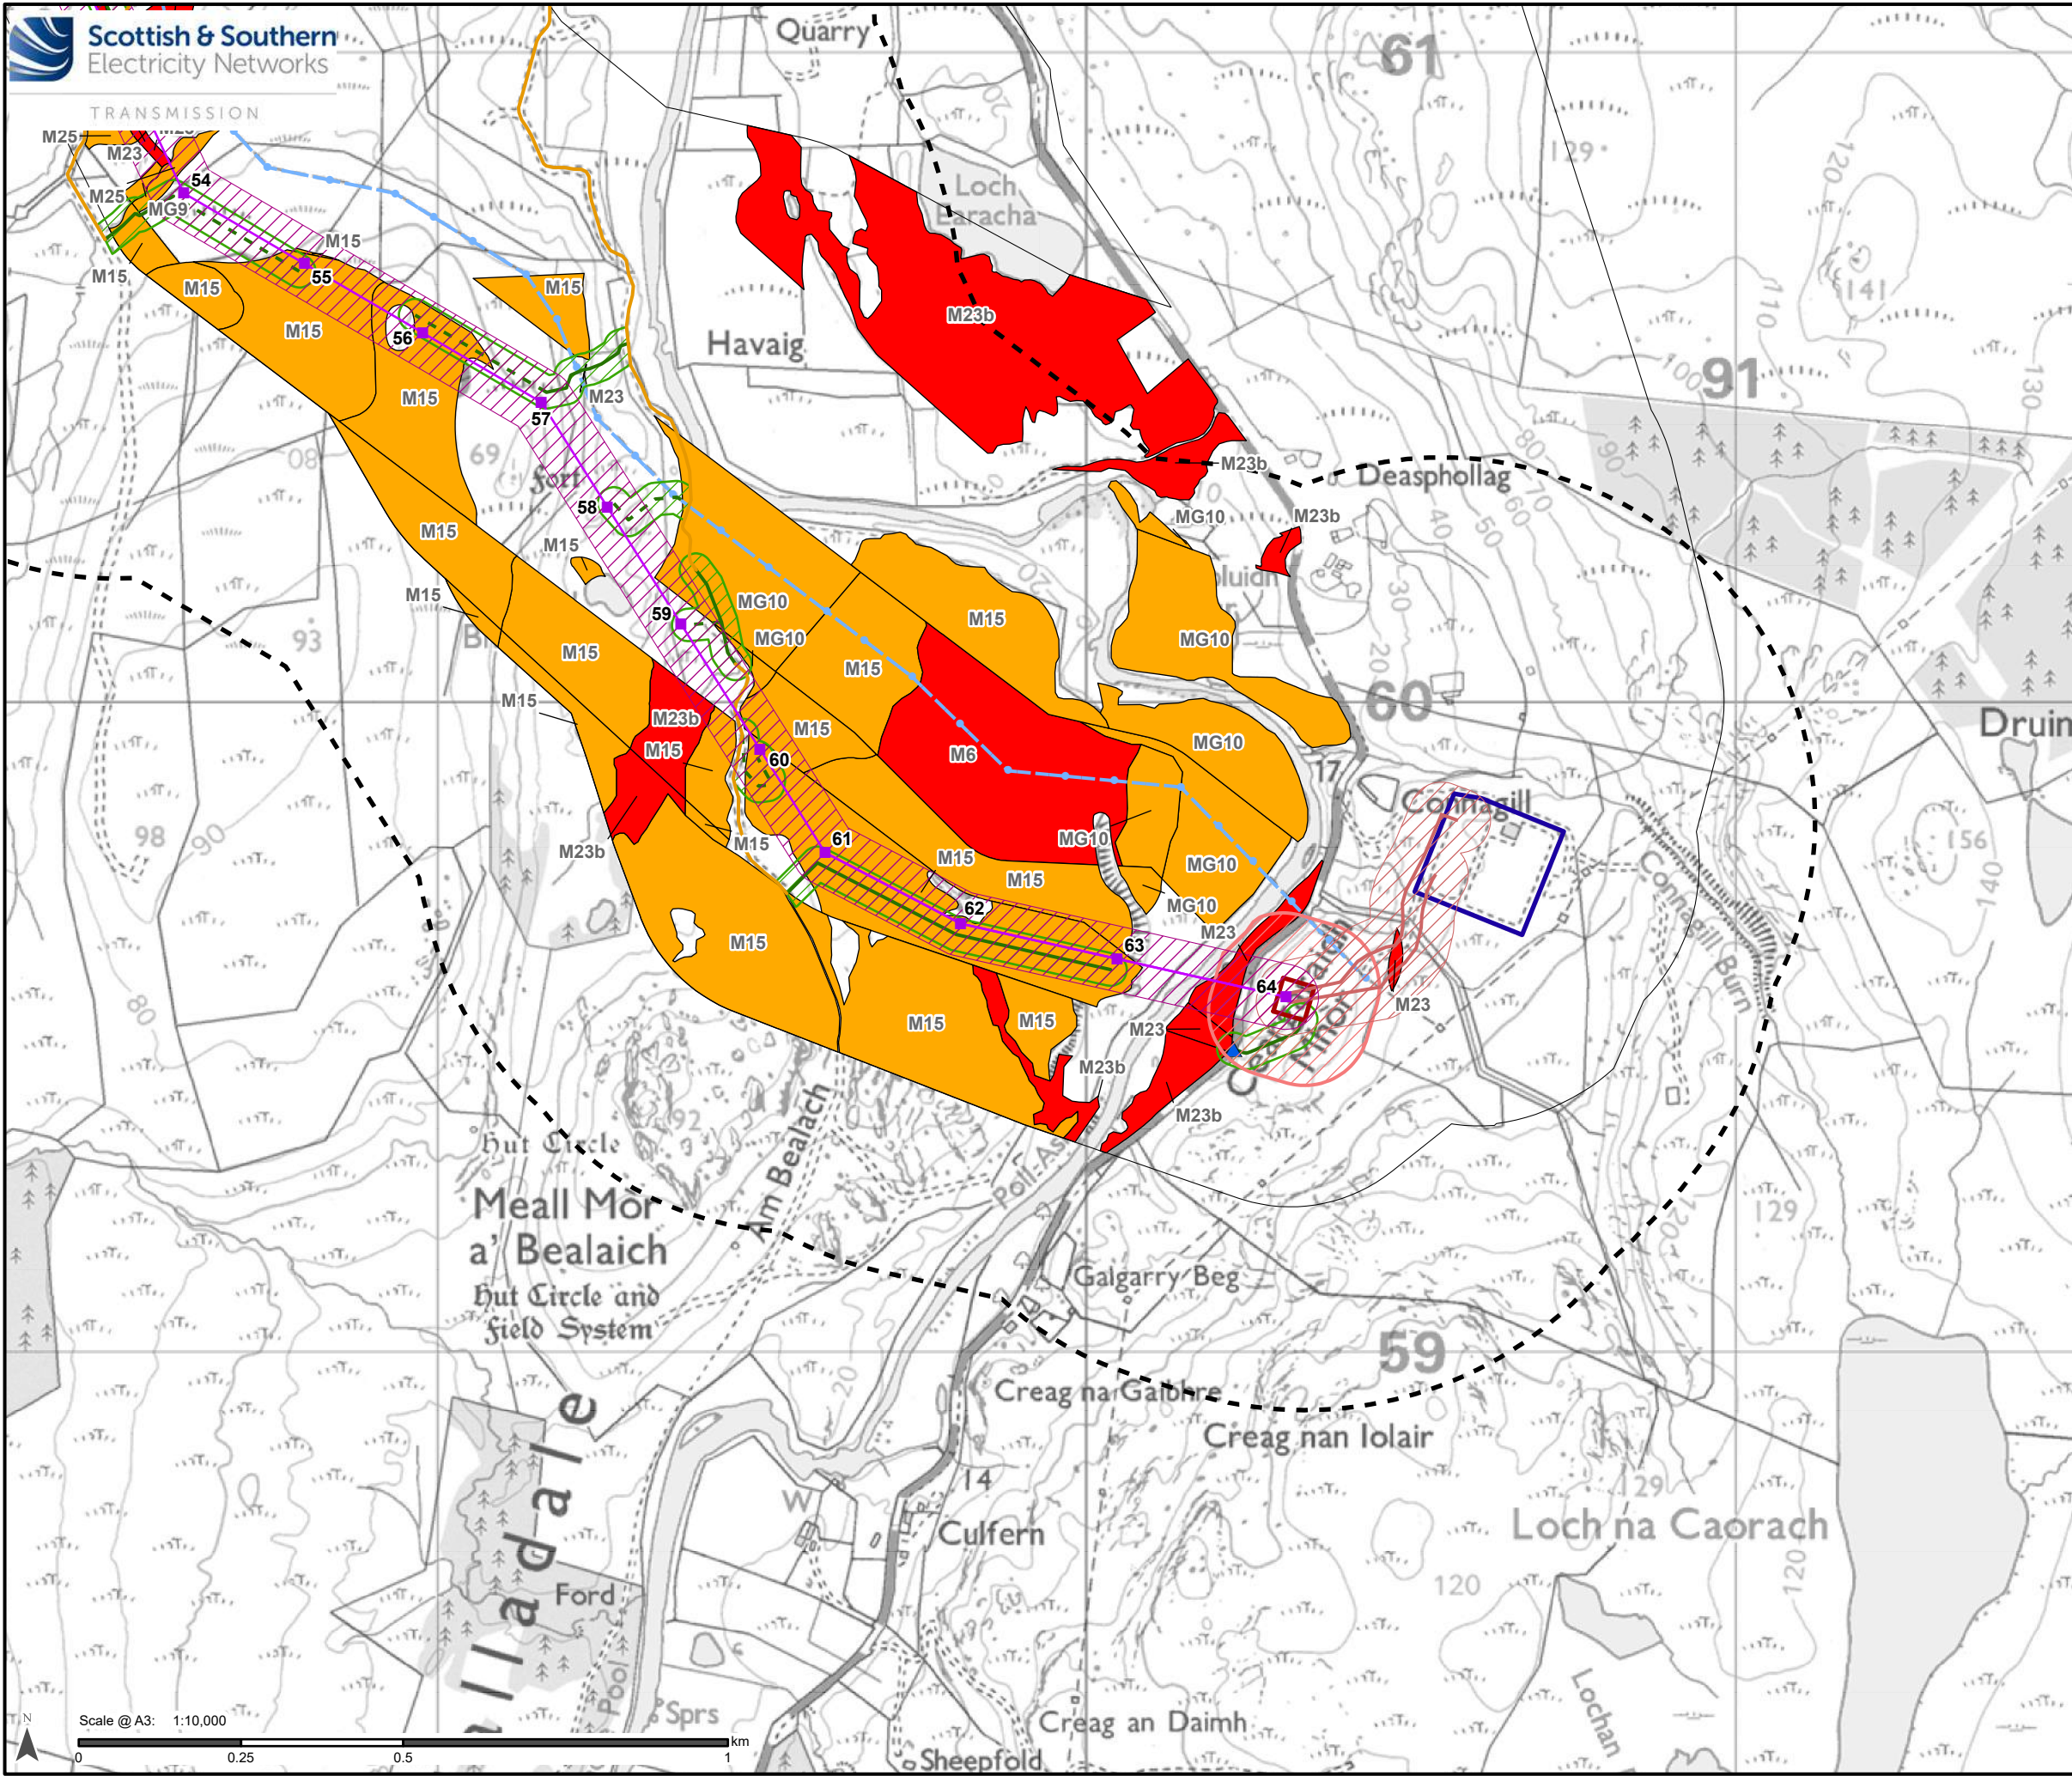

Legend

Study Area

Alternative Steel Lattice Tower

Alternative OHL Alignment

Limit of Deviation (Alternative OHL)

Proposed Underground Cable (UGC)

Limit of Deviation (UGC)

Proposed Cable Sealing End (CSE) Compound

Limit of Deviation (CSE Compound)

New Bellmouth

Existing Access Track (to be upgraded)

Proposed Permanent Access Track

Proposed Temporary Access Track

Limit of Deviation (Access Track)

Existing Wood Pole (H pole) (to be retained)

Existing OHL (to be retained)

Connagill 275/132 kV Substation

GWDE

Potentially Highly Dependent

Potentially Moderately Dependent

Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number AC0000848283.
Superficial Geology data obtained via BGS WMS.
Contains British Geological Survey materials © UKRI [2024]

Project No:	LT560
Project:	Strathy South Wind Farm Grid Connection EIA Report
Title:	Figure V5-7.8.7: GWDE Alternative Alignment Map 6
Drawn by:	AA
Date:	24/01/2025
Drawing:	428.013137.00001.00090.0