

APPENDIX B: OTHER PUBLIC CONSULTATION ADVERTISING

Public Consultation Email, Maildrop Letter, Flyer and Social Media Event 1

From: [REDACTED] on behalf of [TKUP](#)

Bcc: [REDACTED]

Subject: SSEN Transmission Pathway to 2030 project update: Kintore - Tealing 400kV projects

Date: 14 February 2024 15:33:22

Attachments: [image001.jpg](#)

Dear Community Council,

We are pleased to announce that the next round of public events for the Kintore-Tealing 400kV projects will be held in March 2024.

These upcoming events consist of:

- The first round of consultation for the Alyth-Tealing and the Tealing-Westfield 400kV overhead lines (OHL), which will be upgraded from 275kV to 400kV.
- Consultations for the Tealing (Emmock) and Hurlie (Fetteresso Forest) substations. These events are the commencement of the formal pre-application process in terms of the Town and Country Planning process for national planning applications. At this stage feedback received during these events are not submissions to the Planning Authority. There will be a further opportunity to provide feedback to the Planning Authority directly, once applications have been submitted.
- Consultations for newly proposed OHL route options D4, D5, E2, E3 and F1.3:
 - D4 & D5 - Laurencekirk to the Proposed Hurlie Substation (at Fetteresso)
 - E2 & E3 - Proposed Hurlie Substation to Rickarton
 - F1.3 - River Dee to Coldstream, by Drumoak
- An update on all other OHL proposed routes, including refined routes following our consultations in May 2023.

If you are unable to attend any of the planned in-person events, all the material that will be on display can also be downloaded from the project documents section of the dedicated project websites at the start of the consultation period.

Please use the below URLs to access the individual project pages:

- Hurlie 400kV substation <https://bit.ly/3HFQOw1>
- Tealing (Emmock) 400kV substation <https://bit.ly/48W3BX7>
- Kintore-Tealing 400kV OHL <https://bit.ly/3w8o9NB>
- Tealing-Westfield 400kV upgrade <https://bit.ly/48bATR1>
- Alyth-Tealing 400kV upgrade <https://bit.ly/42AUk4C>

All events will run from 2-7pm.

Please find the full event list below:

Tealing-Westfield and Alyth-Tealing 400kV upgrade

4 March 2024 **Errol**, Errol Village Hall, North Bank Dykes, Errol, PH2 7QH

5 March 2024 **Newburgh**, Tayside Institute Community Centre, 90-92 High Street, Newburgh, KY14 6DA

6 March 2024 **Alyth**, Alyth Town Hall, Victoria Street, Alyth, PH11 8AX

7 March 2024 **Tealing**, Tealing Village Hall, Hall Road, Inveraldie, Tealing, DD4 0QW

Tealing (Emmock) substation

7 March 2024 **Tealing**, Tealing Village Hall, Hall Road, Inveraldie, Tealing, DD4 0QW

Kintore-Tealing 400kV OHL update events

5 March **Tannadice**, Memus Community Hall, Memus, DD8 3TY

6 March **Forfar**, Reid Hall, 163 Castle Street, Forfar, DD8 3HX

7 March **Tealing**, Tealing Village Hall, Hall Road, Inveraldie, Tealing, DD4 0QW

12 March **Brechin**, Brechin City Hall, 9 Swan Street, Brechin, DD9 6EE

13 March **Echt**, Echt Hall, Echt, Westhill, AB32 6UL

Hurlie substation

19 March **Drumlithie**, Drumlithie Village Hall, Station Road, Drumlithie, AB39 3YT

Kintore-Tealing 400kV new route consultation

14 March **Laurencekirk**, Dickson Memorial Hall, Station Road, Laurencekirk, AB30 1BE

19 March **Drumlithie**, Drumlithie Village Hall, Station Road, Drumlithie, AB39 3YT

20 March **Drumoak**, Drumoak, Durris & Crathes Bowling Club, Sunnyside Avenue, Drumoak, AB31 5EF

21 March **Auchenblae**, Auchenblae Village Hall, Monboddo Street, Auchenblae, AB30 1XQ

Following the events held in May 2023, many enquiries we received were about the need for the projects, the engagement process, environmental considerations, and what alternative technologies may be available. We have compiled 'Frequently Asked Questions' to address many of these points which can be viewed at the following URL <https://bit.ly/3OulwMx>.

I will be in touch ahead of the events commencing to arrange a pre-consultation call. In the meantime, please do not hesitate to contact us via the dedicated project inbox, tkup@sse.com if you have any questions on the events or the project in general.

With kindest regards,

Rhiannon

Rhiannon Merritt | Community Liaison Manager

SSEN Transmission

10 Henderson Road, Inverness, IV1 1SN

ssen-transmission.co.uk



For information on how we collect and process your data, please see our privacy notice, [Privacy notice - SSEN Transmission \(ssen-transmission.co.uk\)](http://ssen-transmission.co.uk). If you do not have access to our website or would like a hard copy sent, please contact us.

You can unsubscribe at any time from receiving emails by clicking on the link [unsubscribe](#)

19 February 2024

Dear Resident,

SSEN Transmission Kintore to Tealing 400kV Projects

SSEN Transmission are pleased to be hosting a series of public events regarding the Kintore to Tealing 400kV projects, which includes new 400kV substations in Fetteresso Forest (Hurlie) and at Tealing and a new 400kV overhead line (OHL) which will connect both sites to the existing 400kV substation at Kintore.

We previously consulted on these projects in May 2023 and these upcoming events commences the pre-application process in the Town and Country planning process for national planning applications for the substations.

I am contacting you as the substation sites identified and the potential routes to connect them, are within a 10km radius of your address and we wanted to invite you to attend the events to meet the project team and find out more about the proposals.

Please find the details of the in person drop-in public consultation events on the enclosed flyer.

If you are unable to attend any of the planned events all the material that will be on display will be available to be downloaded from the project documents section of the dedicated project websites, which you can access via the following URLs:

Hurlie 400kV substation <https://bit.ly/3HFQOw1>

Tealing 400kV substation <https://bit.ly/48W3BX7>

Following the May 2023 events many inquiries we received were about the need for the projects, the engagement process, environmental considerations, and what alternative technologies may be available. We have compiled 'Frequently Asked Questions' to address many of these points which can be viewed at the following URL <https://bit.ly/3OulwMx>

Please let us know if you require information in an adapted format such as paper copy, large print or braille and we will work with you to accommodate your preferences. We are happy to accommodate all reasonable requests for adapted communications.

Please do not hesitate to contact me directly at TKUP@sse.com if you have any questions or queries pertaining to any of the above information or the project in general.

Yours faithfully,

Rhiannon Merritt

Rhiannon Merritt
Community Liaison Manager

Kintore to Tealing 400kV Projects

Pre-application consultation events

We are holding statutory pre-application consultation events for our proposed substations; Hurlie in Fetteresso Forest and Tealing (Emmock). The pre-application process is a key first step in the Town and Country planning process for national planning applications.

To support the growth in renewable developments across the north of Scotland, which are supporting the country's drive towards net zero, investment in our network infrastructure is needed to connect this power and transport it to areas of demand.

As part of this investment, new 400kV substations are required at Fetteresso Forest and at Tealing, near to both the existing Fetteresso and Tealing substations. These substations will connect into the new proposed Kintore to Tealing 400kV overhead line.

During our drop-in events you will be able to view further information about our proposed substation sites, meet the team, ask questions and share feedback ahead of our second public events.

We will also be consulting on new routes proposed following the publication of our Report on Consultation in December 2023 as well as the sections of existing overhead line that require to be upgraded between Alyth to Tealing and Tealing to Westfield.

[More information overleaf.](#)



Hurlie 400kV:



Tealing 400kV:



Find out more and register for project updates, visit the project website by scanning the QR code, or use the following URLs:

<https://bit.ly/3HFQOw1>

<https://bit.ly/48W3BX7>

This map shows the proposed Kintore - Tealing overhead line, including new 400kV substations at key locations and an upgrade to the existing Alyth - Tealing and Tealing - Westfield overhead lines.



The overhead line reconductor events will be held on:

Monday 4 March, 2–7pm

Errol Village Hall, Errol

Tuesday 5 March, 2–7pm

Tayside Institute Community Centre, Newburgh

Wednesday 6 March, 2–7pm

Alyth Town Hall, Alyth

Thursday 7 March, 2–7pm

Tealing Village Hall, Tealing

If you have any questions, please do not hesitate to contact our Community Liaison Manager:

Rhiannon Merritt

SSEN Transmission, 10 Henderson Road, Inverness, IV1 1SN

Email: tkup@sse.com

 @ssentransmission

 @SSETransmission

The substation and new overhead line events will be held on:

Tuesday 5 March, 2–7pm

Memus Community Hall, Memus

Wednesday 6 March, 2–7pm

Reid Hall, Forfar

Thursday 7 March, 2–7pm

Tealing Village Hall, Tealing

Tuesday 12 March, 2–7pm

Brechin City Hall, Brechin

Wednesday 13 March, 2–7pm

Echt Village Hall, Echt

Thursday 14 March, 2–7pm

Dickson Hall, Laurencekirk

Tuesday 19 March, 2–7pm

Drumlithie Village Hall, Drumlithie

Wednesday 20 March, 2–7pm

Drumoak Bowling Club, Drumoak

Thursday 21 March, 2–7pm

Auchenblae Village Hall, Auchenblae

Public Consultation Social Media Posts Event 1:



- Articles
- People
- Learning
- Jobs
- Games

SSEN Transmission 's Post



Public Consultation Email, Maildrop Letter, Flyer and Social Media Event 2

From: TKUP (tkup@sse.com)
Sent: 20/05/2024 14:07:24
To: Tealing - Westfield CC Distribution List
Subject: June 2024 Public Consultation Events
Body:
Good afternoon,

I am emailing to advise of upcoming public engagement events for our Tealing - Westfield overhead line 400kV upgrade project.

What we're engaging on

We are hosting a second series of public consultation events across the route from 3 June until 6 June 2024, following our initial events in March 2024 and feedback period which closed on 15 April 2024.

We are holding these events to present our proposed design for planning submission, following feedback received from the first events and ongoing design developments. We will also present our responses to feedback received as part of the statutory consultation, which is required for planning applications.

During our face-to-face drop-in events you will be able to view further information, meet the team, and ask questions. The feedback period will remain open until 18 July 2024.

The events will take place on:

Monday 3 June - Errol Village Hall, Errol - 2pm - 7pm
Tuesday 4 June - Tayside Institute, Newburgh - 2pm - 7pm
Wednesday 5 June - Tealing Village Hall, Tealing - 2-7pm
Thursday 6 June - Alyth Town Hall, Alyth - 2-7pm

Please see our attached poster or visit our events page for more details.

Advertising the events

We have issued a mailshot to local properties advising of the events, and we are also advertising in The Courier and Angus County Press. We will be sending out a notification to all stakeholders signed up for updates, advertising on our social media channels and distributing posters locally.

We know local community Facebook pages are a great tool for sharing information regarding upcoming local events and therefore would warmly welcome Community Councillors to share copies of our poster (attached) online or locally.

Finding out more

Our public events are a great opportunity to find out more about our proposals by meeting the team in person, viewing our information materials, and asking any questions you may have. For those unable to attend the events, all of the information we'll be sharing at the events is available to download from the 'Project Documents' section of the project webpage.

You will also find some additional information regarding our most frequently asked questions available from our 'Project FAQs' tab, with additional handouts also available to download from 'Project Documents' and available at the in-person events.

Should you wish to discuss the scope of the consultation event or any of the materials available from the project further in advance of the consultation, please do not hesitate to get in touch with us at tkup@sse.com

Kind regards

Louise Anderson | Lead Community Liaison Manager
SSEN Transmission
200 Dunkeld Road, Perth, PH1 3GH
ssen-transmission.co.uk

For information on how we collect and process your data, please see our privacy notice, www.ssen-transmission.co.uk/privacy If you do not have access to our website or would like a hard copy sent, please contact us.

You can unsubscribe at any time from receiving emails by clicking on the link [unsubscribe](#)

7 May 2024

Dear Resident,

SSEN Transmission Kintore to Tealing 400kV Projects - – Substation and existing overhead line upgrade engagement events

Between 4 to 21 March 2024, we held the first of two statutory pre-application consultation (PAC) events for our proposed 400kV substations in Fetteresso Forest and at Tealing as well as holding the first of two series of public consultation events in relation to the Section 37 consent application for the upgrade of the Alyth to Tealing and Tealing to Westfield overhead line from 275kV to enable operation at 400kV.

I am contacting you to advise that SSEN Transmission will soon be hosting the next series of public consultation events throughout June 2024 for both Emmock and Hurlie substations and the Alyth to Tealing and Tealing to Westfield overhead line upgrade projects.

Please find the details of the in person drop-in public consultation events on the enclosed flyers.

If you are unable to attend any of the planned events all the material that will be on display will be available to be downloaded from the project documents section of the dedicated project websites, which you can access via the following URLs:

Hurlie 400kV substation ssen-transmission.co.uk/hurlie

Emmock substation ssen-transmission.co.uk/emmock

Alyth-Tealing upgrade ssen-transmission.co.uk/alyth-tealing

Tealing-Westfield upgrade ssen-transmission.co.uk/tealing-westfield

New Kintore – Tealing 400kV overhead line:

Following the consultations on the new proposed Kintore-Tealing overhead line 400kV project, we recently confirmed that we are actively considering overhead line alignments proposed by community representatives and landowners around Careston, Drumoak and Echt and as such to ensure all viable alignments are fully assessed, the new overhead line alignment consultation will now take place later in the year.

Our June 2024 consultation events will focus on our new substations and existing overhead line upgrade projects. There will not be further information presented on the Kintore – Tealing overhead line 400kV project at the upcoming June events whilst we explore stakeholder proposed alignments.

Please let us know if you require information in an adapted format such as paper copy, large print or braille and we will work with you to accommodate your preferences. We are happy to accommodate all reasonable requests for adapted communications.

Do not hesitate to contact me directly on tkup@sse.com if you have any questions or queries

pertaining to any of the above information or the projects in general.

Yours faithfully,

Rhiannon Merritt

Rhiannon Merritt
Community Liaison Manager

Alyth–Tealing and Tealing–Westfield 400kV OHL Upgrade

Consultation events

Following on from the public consultation events which we held in early March, we are hosting a second series of public consultation events across the route of each project from 3 June until 6 June 2024. These events form part of the pre-application consultation process for the consent applications that will be submitted under section 37 of the Electricity Act 1989.

To support the growth in renewable developments across the north of Scotland, investment in our network infrastructure is needed to connect this power and transport it to areas of demand.

The overhead line (OHL) upgrade projects involve the upgrade to 400kV of the existing 275kV OHLs from Alyth substation to Tealing substation and from Tealing substation to Westfield (as far as the licence area boundary we share with Scottish Power Energy Networks). The projects include replacing the conductors (wires) and insulators, upgrading tower foundations and steel work and various associated works including the construction of access tracks.

During our drop-in events you will be able to view further information about our proposed substation site, meet the team, and ask questions. The feedback period will remain open until **18 July 2024**.

Any comments made to us as the Applicant are not representations to Scottish Ministers as the decision makers. There will be opportunity to make formal representations to Scottish Ministers via the Energy Consents Unit following the submission of the section 37 applications.



More information overleaf.

The events will be held on:

Monday 3 June, 2–7pm

Errol Village Hall,
Errol, PH2 7QH

Tuesday 4 June, 2–7pm

Tayside Institute,
Newburgh, KY14 6DA

Wednesday 5 June, 2–7pm

Tealing Village Hall,
Tealing, DD4 0QW

Thursday 6 June, 2–7pm

Alyth Town Hall,
Alyth, PH11 8AX

This map shows the proposed 400kV Kintore–Tealing overhead line, new 400kV substations at key locations and the proposed 400kV upgrade to the existing Alyth–Tealing and Tealing–Westfield overhead lines.



If you have any questions, please do not hesitate to contact our Community Liaison Manager:


Rhiannon Merritt

10 Henderson Road, Inverness, IV1 1SN

Email: tkup@sse.com

 @sentransmission

 @SSETransmission



Alyth-Tealing:



Find out more and register for project updates, visit the project website by scanning the QR code, or use the following URL:

ssen-transmission.co.uk/alyth-tealing




Tealing-Westfield



Find out more and register for project updates, visit the project website by scanning the QR code, or use the following URL:

ssen-transmission.co.uk/tealing-westfield

Public Consultation Social Media Posts Event 2:

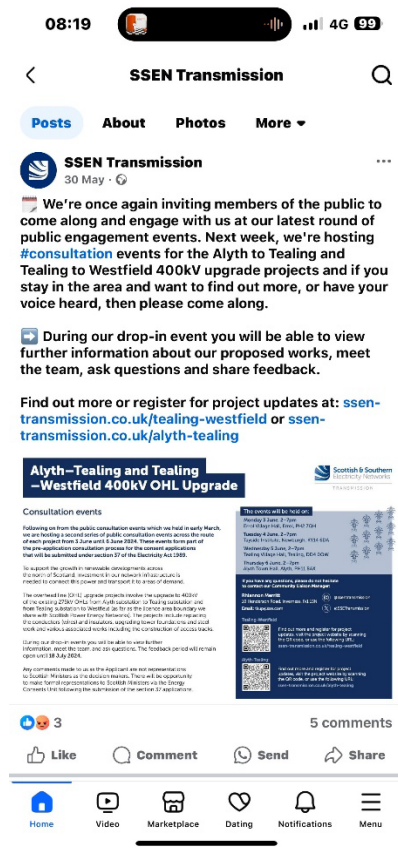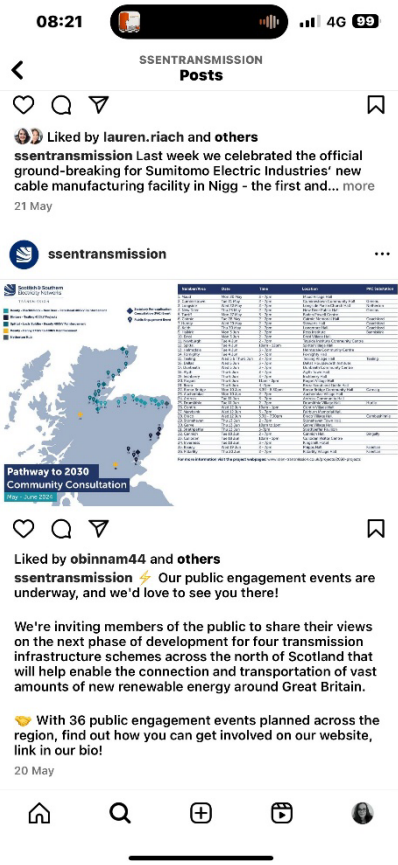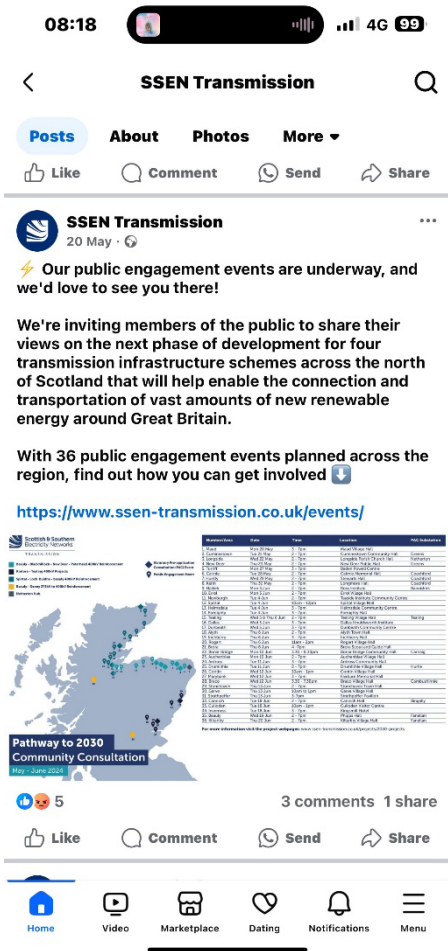

APPENDIX C: CONSULTATION BANNERS EVENT 1

Powering change together

The time has come to further enhance Scotland's energy infrastructure, providing power for future generations as we move towards net zero.

The shift to a cleaner, more sustainable future is about more than climate change. It's about ensuring future generations have the same opportunities to thrive as we have all had.

Countries around the world are investing in their energy infrastructure to support the demands of modern economies and meet net zero targets. The UK is leading the way in building a modern, sustainable energy system for the future.



We all have a part to play

When it comes to net zero, we have to be in it together. The UK and Scottish Governments have ambitious net zero targets, and we're playing our part in meeting them.

We work closely with National Grid Electricity System Operator to connect vast renewable energy resources – harnessed by solar, wind, hydro and marine generation – to areas of demand across the country. Scotland is playing a big role in meeting this demand, exporting two thirds of power generated in our network.

But there's more to be done. By 2050, the north of Scotland is predicted to contribute over 50GW of low carbon energy to help deliver net zero. Today, our region has around 9GW of renewable generation connected to the network.

At SSEN Transmission, it is our role to build the energy system of the future.

We're investing £20 billion into our region's energy infrastructure this decade, powering more than ten million UK homes and 20,000 jobs, 9,000 of which will be here in Scotland.



Find out more

Scan the QR code with your smartphone to find out more about how these policies have been assessed and determined.

Who we are

We're responsible for maintaining and investing in the electricity transmission network in the north of Scotland. We're part of SSE plc, one of the world's leading energy companies with a rich heritage in Scotland that dates back more than 80 years. We are also closely regulated by the GB energy regulator Ofgem, who determines how much revenue we are allowed to earn for constructing, maintaining and renovating our transmission network.

What we do

We manage the electricity network across our region which covers a quarter of the UK's land mass, crossing some of the country's most challenging terrain. We connect renewable energy sources to our network in the north of Scotland and then transport it to where it needs to be. From underground subsea cables and overhead lines (OHL) to electricity substations, our network keeps your lights on all year round.

Working with you

We understand that the work we do can have an impact on our host communities. So we're committed to minimising our impacts and maximising all the benefits that our developments can bring to your area.



We're regularly assessed by global sustainability consultancy AccountAbility for how we engage with communities. That means we provide all the information you need to know about our plans and how they will impact communities like yours.

We want to hear people's views, concerns, or ideas and harness local knowledge so that our work benefits their communities: today and long into the future.

You can share your views with us at:
ssen-transmission.co.uk/talk-to-us/contact-us

 tkup@sse.com

[ssen-transmission.co.uk/projects/
2030-projects/East-Coast/](https://ssen-transmission.co.uk/projects/2030-projects/East-Coast/)

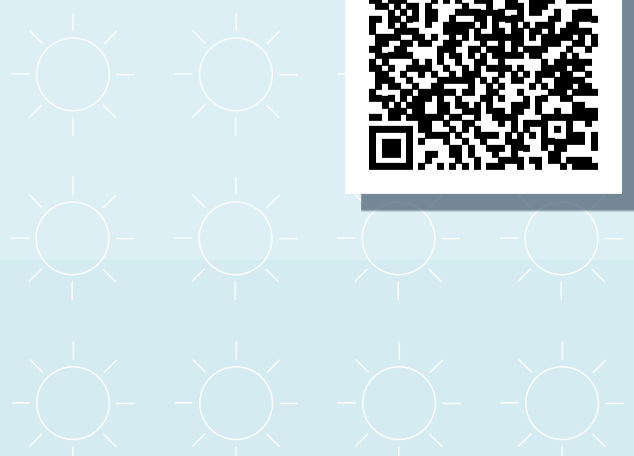

Pathway to 2030

Building the energy system of the future will require delivery of significant infrastructure over the next few years. In partnership with the UK and Scottish governments, we're committed to meeting our obligation of connecting new, renewable energy to where it's needed by 2030.

Achieving net zero

By 2030, both the UK and Scottish governments are targeting a big expansion in offshore wind generation of 50GW and 11GW respectively. The Scottish Government has also set ambitious targets for an additional 12GW of onshore wind by 2030.

Across Great Britain, including the north of Scotland, there needs to be a significant increase in the capacity of the onshore electricity transmission infrastructure to deliver these 2030 targets and a pathway to net zero.

Securing our energy future

And it's not just about net zero. It's also about building a homegrown energy system, so that geopolitical turmoil around the world doesn't severely impact the UK and push up energy prices. The UK Government's British Energy Security Strategy further underlines the need for this infrastructure, setting out plans to accelerate homegrown power for greater energy independence.

The strategy aims to reduce the UK's dependence on and price exposure to global gas wholesale markets through the deployment of homegrown low carbon electricity generation supported by robust electricity network infrastructure.

Meeting our 2030 targets

In July 2022, National Grid, the Electricity System Operator (ESO), published the Pathway to 2030 Holistic Network Design (HND).

This set out the blueprint for the onshore and offshore transmission infrastructure that's required to support the forecasted growth in the UK's renewable electricity.

It's an ambitious plan that will help the UK achieve net zero.

What does this mean for you?

Based on the requirements outlined in the ESO's Pathway to 2030 Holistic Network Design, we have developed proposals to reinforce the onshore corridor between Beaulieu and Peterhead, via Blackhilllock and New Deer.

To facilitate this connection, and others as part of the wider strategy, new additional 400kV substations and associated infrastructure is required at these four locations.




The 400kV substation project forms part of the ScotWind enabling Transmission Owner Reinforcement Instructions (TORIs), enabling renewable energy generation in the North-East to connect to the Transmission network.


Future network investment requirements

Our 2030 targets are the first step on the transition to net zero. The UK Government has a target to decarbonise our electricity system by 2035 and fully decarbonise our economy by becoming net zero by 2050, with the Scottish Government committing to net zero five years earlier, by 2045.

To achieve these targets, further investment in new low carbon electricity generation and the enabling electricity transmission network infrastructure will be required.


The next stage of strategic network planning across Great Britain is underway and we expect the independent Electricity System Operator, National Grid ESO, to publish details of this in March this year. It is expected this will include a combination of new onshore and offshore network requirements.

-  New infrastructure
-  Upgrade/replacement of existing infrastructure
-  Existing network

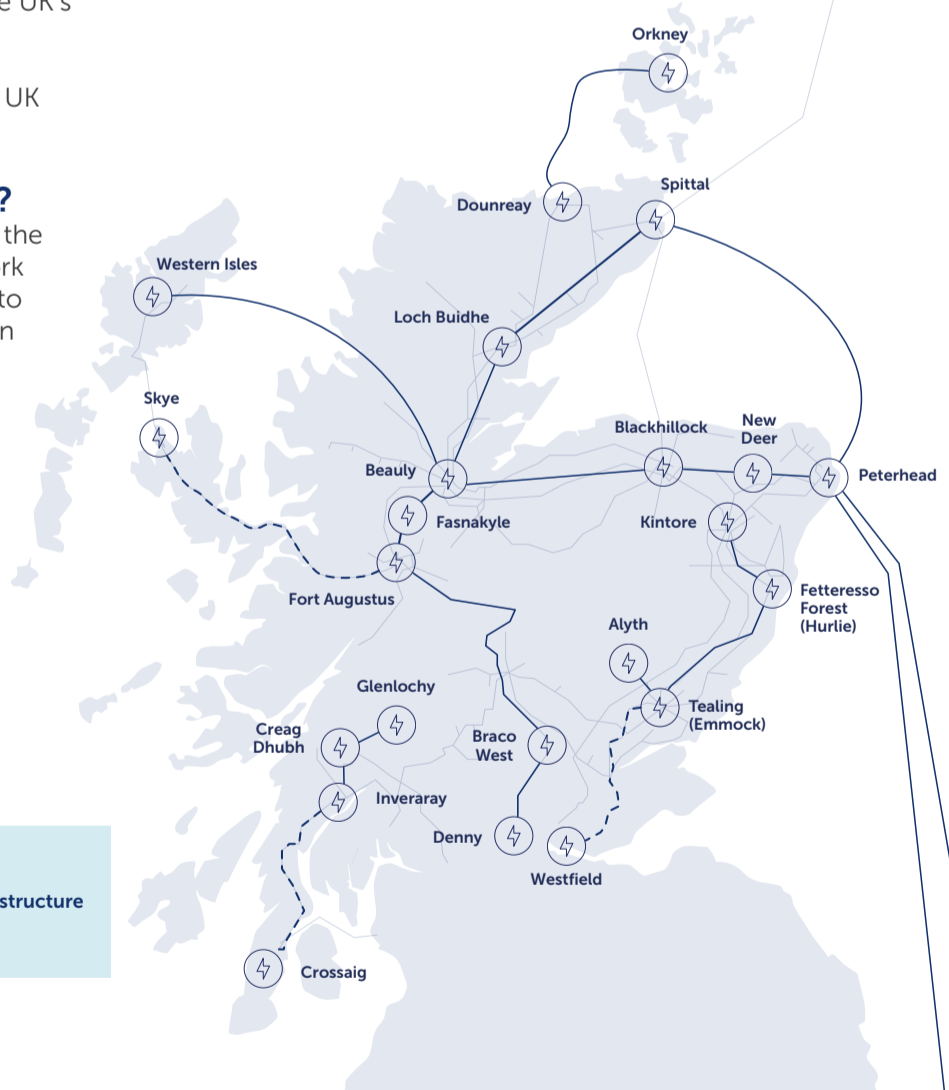

 tkup@sse.com

ssen-transmission.co.uk/projects/2030-projects/East-Coast/

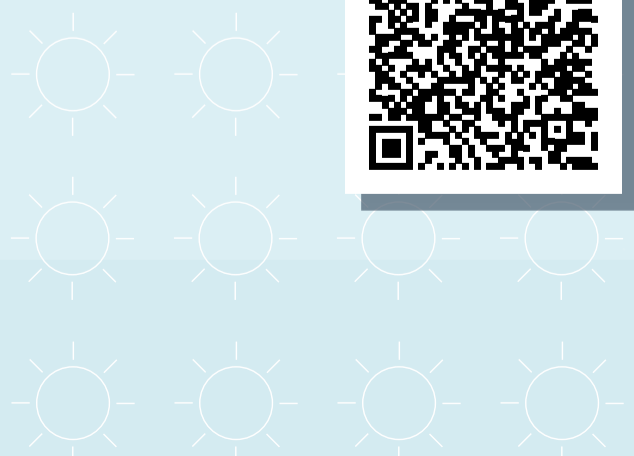

Project overview

As the transmission network owner for the north of Scotland, Scottish and Southern Electricity Networks Transmission (SSEN Transmission) are responsible for the maintenance of the existing transmission network and also ensuring that the current network can facilitate connection requests from developers when necessary.

The reconductoring of the existing Alyth to Tealing OHL has been identified as part of the National Grid ESO's Holistic Network Design (HND).

This project will upgrade the line from 275kV to 400kV to facilitate the transition to net zero in line with the UK and Scottish Government targets of achieving net zero by 2050 and 2045 respectively.

This consultation focuses on the upgrades, required to the OHL between:

- Tealing and Westfield (which crosses the boundary into Scottish Power Transmission's (SPT) License area
- Tealing and Alyth substations.

Approach to consenting

An application for Section 37 consent will be made under the Electricity Act 1989 for the upgrade of the existing OHL to operate at 400kV.

This application is made to the Energy Consents Unit of the Scottish Government.

The S37 will cover all aspects of the OHL works, including replacement of insulators and conductors, tower and foundation repairs, ground reprofiling, all associated works and the provision of access tracks to enable these works. This application is made to the Energy Consents Unit (ECU) of the Scottish Government.

The application will also need to be accompanied by an Environmental Impact Assessment (EIA) Report.


We will be submitting an EIA Scoping Report to ECU soon, which, in collaboration with statutory and non-statutory consultees, will determine the scope of issues to be considered in the EIA Report.

The scope to carry out some of the works, either as permitted development or through separate planning consent, in advance of obtaining S37 consent is currently being explored.




tkup@sse.com

ssen-transmission.co.uk/projects/2030-projects/East-Coast/

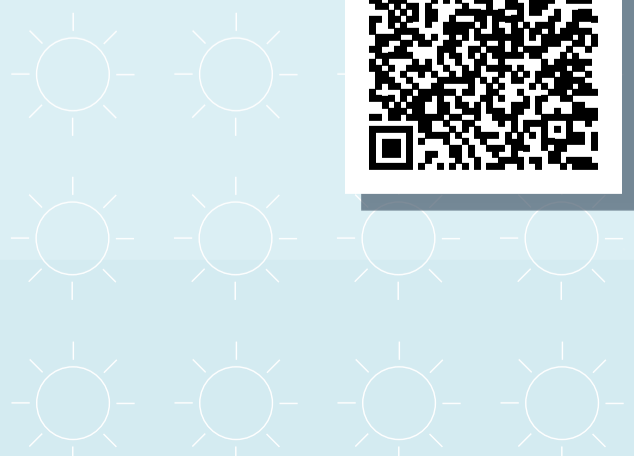

Project overview

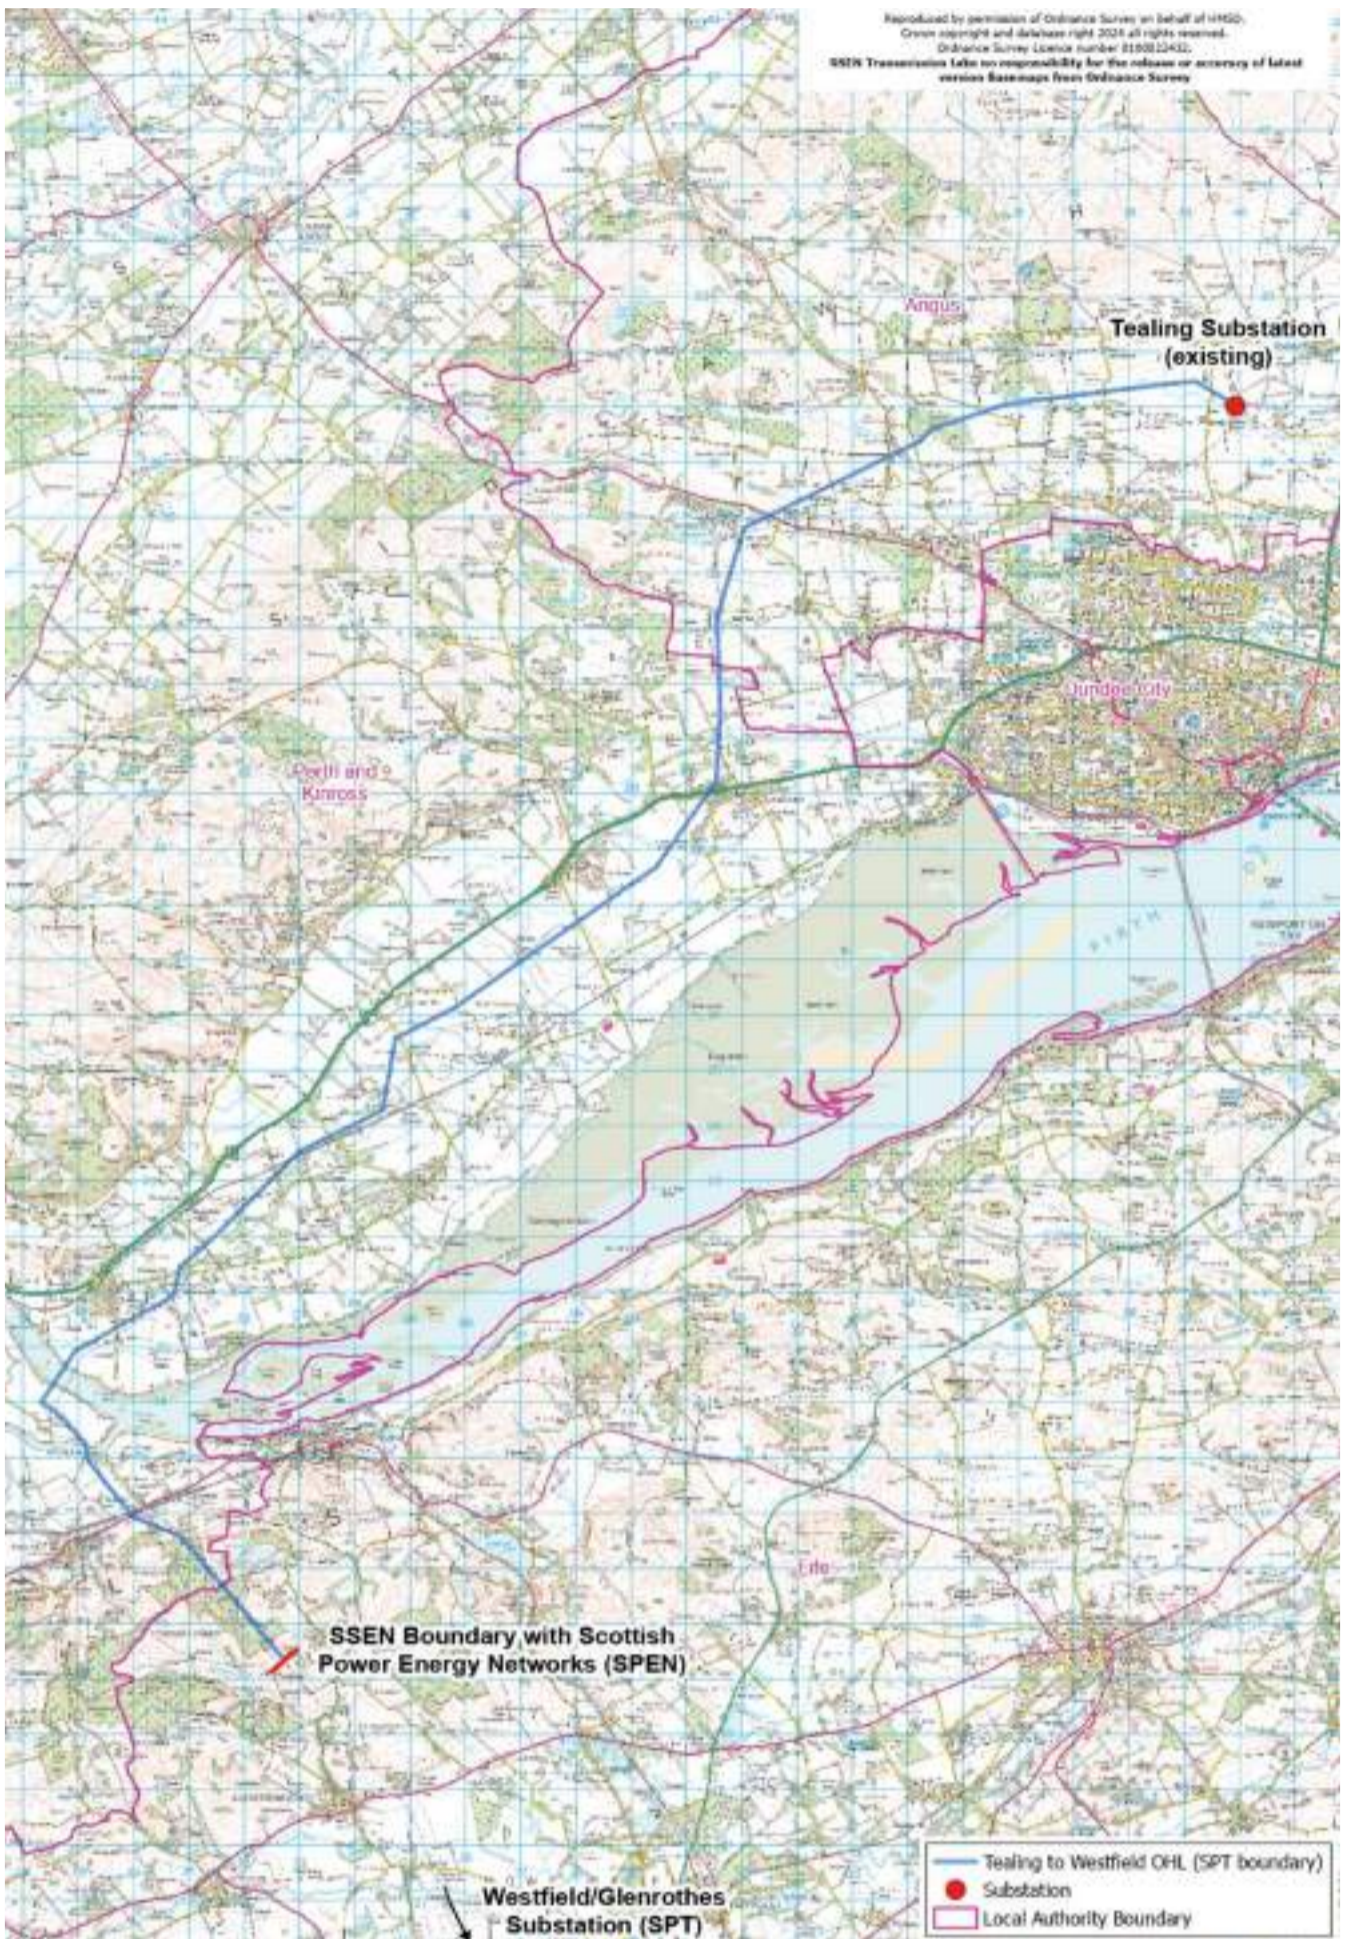

The OHL upgrade works would involve replacing the conductors, insulators and fittings on the existing OHL steel lattice towers between the existing Tealing substation and the SSEN Transmission boundary with Scottish Power Energy Networks (SPEN) licence area. This project would upgrade the line from 275kV to 400kV to facilitate the

transition to net zero inline with the UK and Scottish Government targets. A new substation is being advanced through a planning application process on land to the west of the existing substation. Any tie ins to the new substation from the existing line will be advanced via separate S37 consent.

 tkup@sse.com

ssen-transmission.co.uk/projects/2030-projects/East-Coast/



Project details - overhead lines

Conductor replacement

The existing conductor is Twin Zebra Aluminium Conductor Steel Reinforced (ACSR) Conductor. This conductor has been in place since the OHL was constructed in 1963 and 1973 and is due for replacement.

The replacement conductor that will be used is a Triple bundle and the proposed conductor is still to be determined.

Insulator replacement

The existing 275kV insulators will be replaced with 400kV insulators.

These are slightly longer than the existing insulators as they have more discs.

The insulator and conductor replacement will allow the OHL to transfer a higher capacity of power.

Tower refurbishments

The new conductor is heavier than the existing conductor therefore some of the tower steelwork and foundations will need to be strengthened.

The refurbishments and upgrades to the steelwork and foundations will take place ahead of replacing the conductors.

Access requirements

To access the towers, we will use a variety of methods including the construction of new stone access tracks, use of existing tracks, laying of trackway panels on favourable terrain or by all-terrain vehicle.

We will agree any access requirements with the relevant landowners and secure consent, where required, before commencing works.

Operational corridor requirements

The operational corridor is calculated based on achieving OHL resilience from tree fall. The upgrading from 275kV to 400kV will result in the need for a wider operational corridor which could equate to a potential 89m full operational corridor width from woodland edge to woodland edge. Requirements will be assessed through the detailed design process.



Conductor replacement



Insulator replacement




Tower refurbishments



Access Tracks

 tkup@sse.com

[ssen-transmission.co.uk/projects/
2030-projects/East-Coast/](https://ssen-transmission.co.uk/projects/2030-projects/East-Coast/)

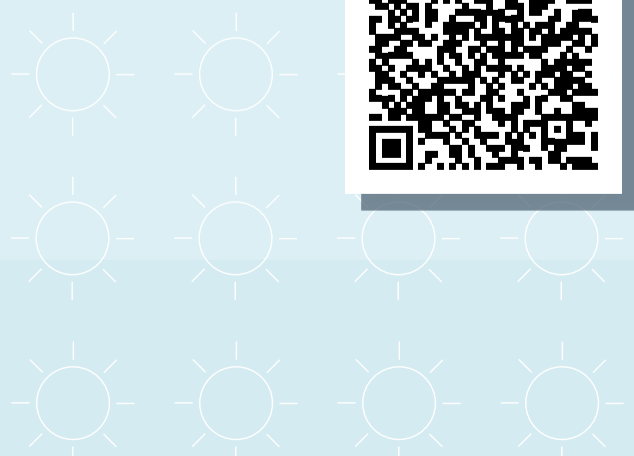


Project interfaces

Tealing substation

We will carry out the works to upgrade the existing OHL from the Scottish Power Energy Networks (SPEN) boundary, south of Abernethy, to our existing Tealing substation. To enable the operation of the OHL at 400kV, it will be connected into the new 400kV substation being developed.


This will be achieved by the construction of a new OHL originating at some point on the existing line between Tower 180 and Tower 182. This will result in a redundant section of OHL between Tower 182 and the existing substation. It is intended that this will be reused to make a connection between the new 400kV site and the existing site.

A separate Section 37 consent for the new build tie-in will be submitted to the Energy Consents Unit.

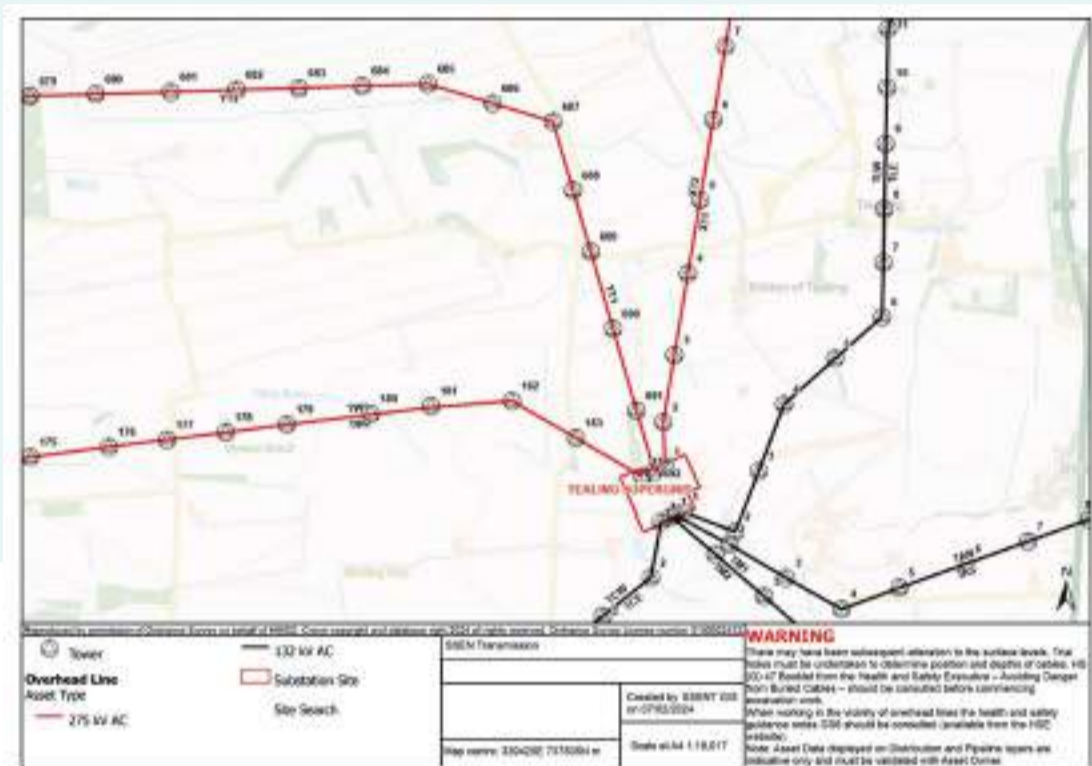


SPEN boundary

We will reconductor down to the licence area border that we share with SPEN. This is mid-span between Tower 66 and Tower 67. SPEN will submit a separate Section 37 notice for the 400kV upgrade works to be carried out to the OHL in their licence area.

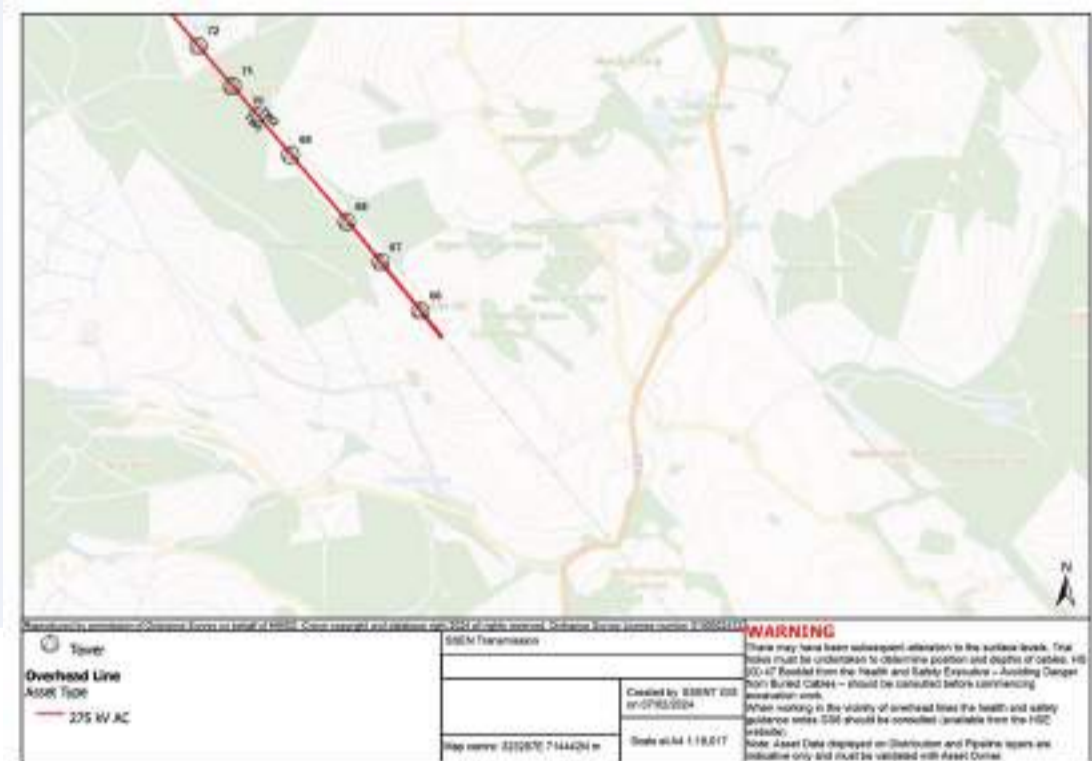

 tkup@sse.com

[ssen-transmission.co.uk/projects/
2030-projects/East-Coast/](https://ssen-transmission.co.uk/projects/2030-projects/East-Coast/)

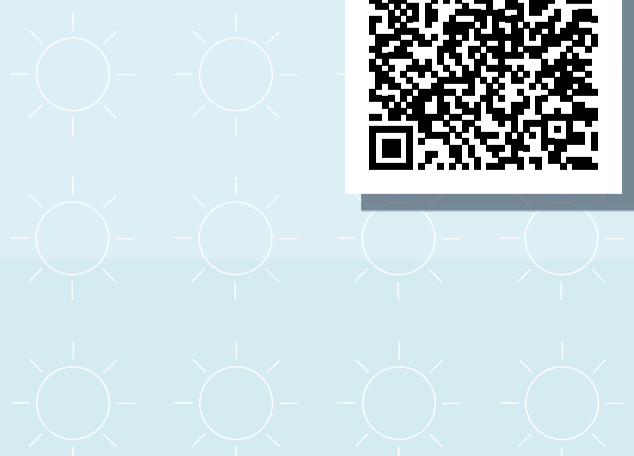

Environmental considerations

This project is required to upgrade to the existing OHL network between Tealing and Westfield substations and does not involve the construction or introduction of any new steel lattice towers. An Environmental Impact Assessment (EIA) is required as part of the Section 37 consent application under the Electricity Act 1989. An EIA Scoping Report will be prepared and submitted to the Energy Consents Unit of the Scottish Government to agree which environmental elements should be taken into consideration as part of the assessment. SSEN are responsible for the EIA for the works proposed in their licence area. SPEN will carry out a similar assessment for the works in their licence area.

Ornithology

The OHL does not pass through any sites designated for ornithological interests. There are however likely to be breeding birds in the vicinity of the existing OHL in particular lekking black grouse, raptors and upland waders. There will also be bird flight activity in proximity to, and across the line.

Mitigation measures will be required to avoid or minimise effects on these birds during the construction phase and a full suite of required bird surveys will be carried out and the scope agreed with NatureScot.

Water environment

The OHL passes over or near to a number of river catchments and watercourses. Several towers are located in areas of potential flood risk but with mitigation measures the project is not anticipated to increase flood risk or have a detrimental impact on water quality.

Private water supplies will be identified and assessed to determine potential risk to any supplies. Where required, measures will be put in place to ensure that the quality and quantity of water from these supplies would not be adversely affected.

Visual effects

There would be limited material change to the appearance of the OHL following the reinforcement works as the associated fittings will be visually similar to those present already, albeit the existing twin conductors would be replaced with triple conductors.

Some visual effects would result during the construction from temporary works as crew and machinery move along the line to replace the conductors and fittings and works and from tree felling associated with the creation of a 400kV operational corridor.

Terrestrial and aquatic ecology

The OHL crosses primarily agricultural land, utilised for arable crops and pasture, as well as areas of woodland, running and standing water. Within the corridor there is a single Special Area of Conservation (SAC) (River Tay SAC) and a short distance upstream is the Firth of Tay and Eden Estuary Special Protection Area (SPA) and Ramsar site.

There are four Ancient Woodland Inventory (AWI) woodlands of Long-Established Plantation Origin (LEPO) which cross the existing line and a further three which are within the vicinity of the line. There are no other designated sites (including locally designated). A single area of lowland raised bog (lowland raised bog inventory) was identified during the desk study.

Surveys identified a number of habitats which are listed on the Scottish Biodiversity List and are therefore considered to be of principal importance for biodiversity conservation in Scotland.

Most are also Tayside Local Priority habitats. Targeted surveys and species protection plans would be put in place to minimise potential effects to protected species during construction.

Cultural heritage

A limited number of non-designated assets have been recorded within 100m of the current OHL, although most are set some distance away from the existing towers.

As a result, physical impacts should be limited to the access tracks and other associated supporting works that might be required.

In addition, there is the potential for physical impacts on designated assets including, Dronley House Mound (SM6535), East Adamston unenclosed settlement and souterrain (SM6465), South Inchmichael unenclosed settlement (SM7199) and Megginch Castle Garden and Designed Landscape (GDL00278). Any works within the vicinity of these assets will require careful consideration and potentially require Scheduled Monument Consent.

Further consultation will be required with Statutory Consultees with regards to any direct impacts and suitable mitigation that may be required.

A programme of archaeological works will be implemented, and recommendations provided to minimise the potential effects on assets during construction will be presented in the Construction Environmental Management Plan (CEMP), identifying known cultural heritage assets within close proximity to existing towers and proposed access routes.

Traffic and transport

A Construction Traffic Management Plan (CTMP) will be developed and used to specify construction traffic routes to suitable roads and appropriately signed diversions, where required during the construction phase of the works. This will be prepared in agreement with Perth and Kinross, Angus and Fife Councils.

Noise


Construction noise is considered to be short term and intermittent and will be controlled through the implementation of a Noise Management Plan. An assessment of operational noise will be undertaken, in discussion with the Environmental Health Departments of Perth and Kinross, Angus and Fife Councils.

Electromagnetic fields


Electromagnetic Fields (EMF) arise from electric charges and current flow. Exceedance of EMF exposure limits are not expected, but an assessment of the change in EMF strengths due to the OHL operating at 400kV will be undertaken and the results will be presented alongside exposure limits.

 tkup@sse.com

[ssen-transmission.co.uk/projects/
2030-projects/East-Coast/](https://ssen-transmission.co.uk/projects/2030-projects/East-Coast/)

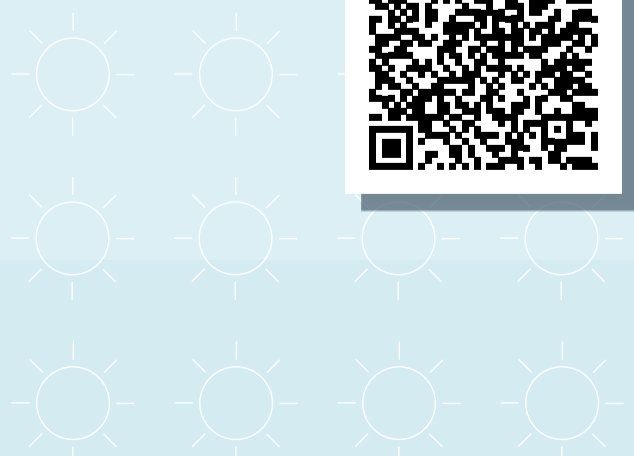


Project timeline

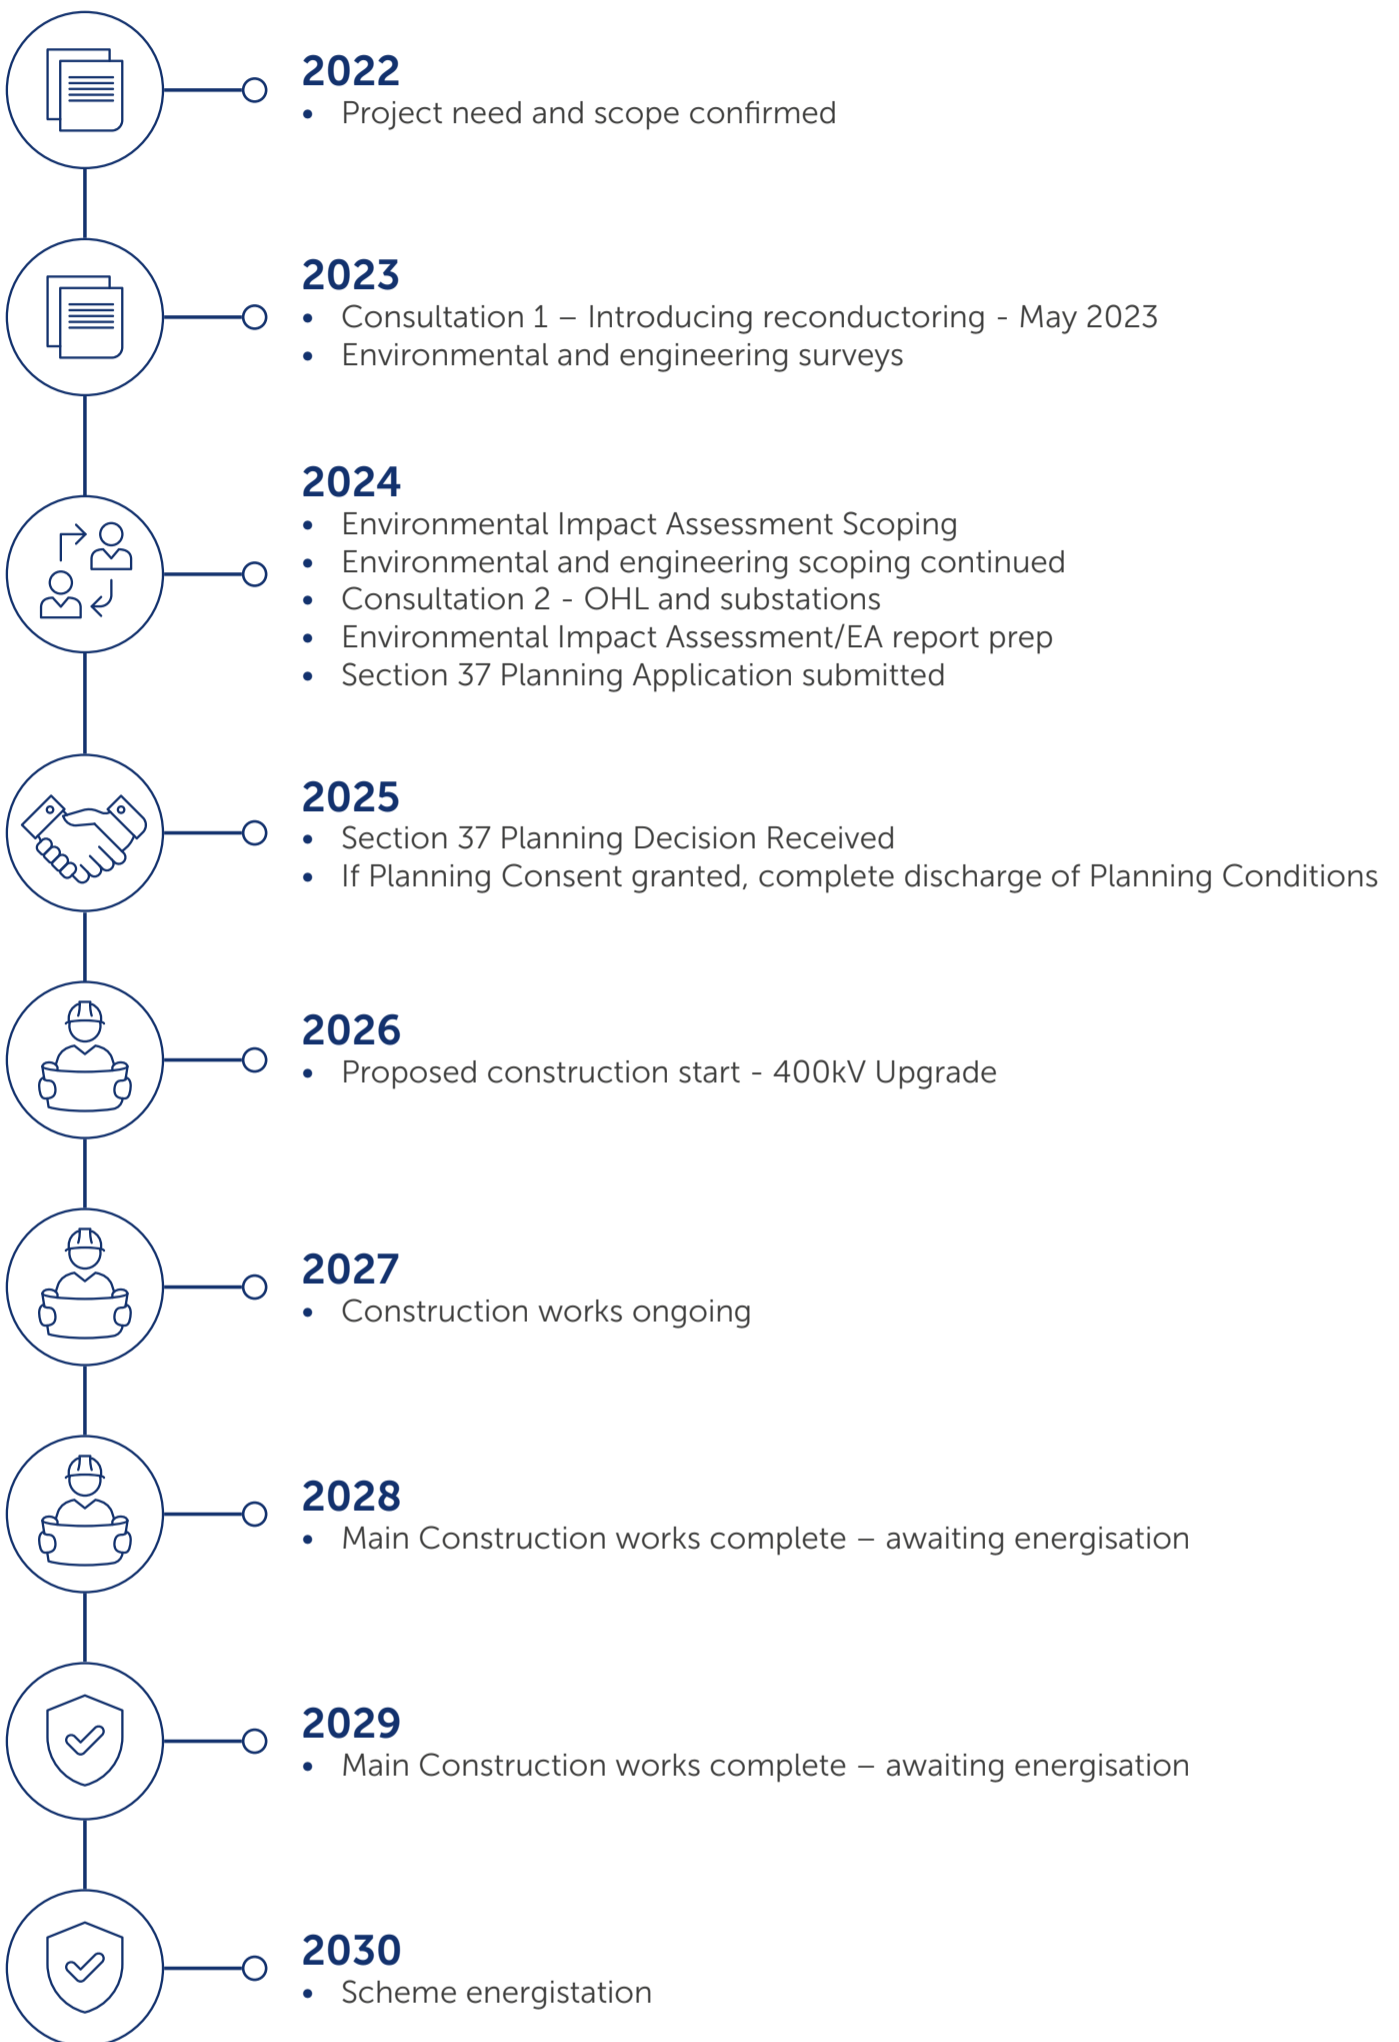

 tkup@sse.com

[ssen-transmission.co.uk/projects/
2030-projects/East-Coast/](https://ssen-transmission.co.uk/projects/2030-projects/East-Coast/)

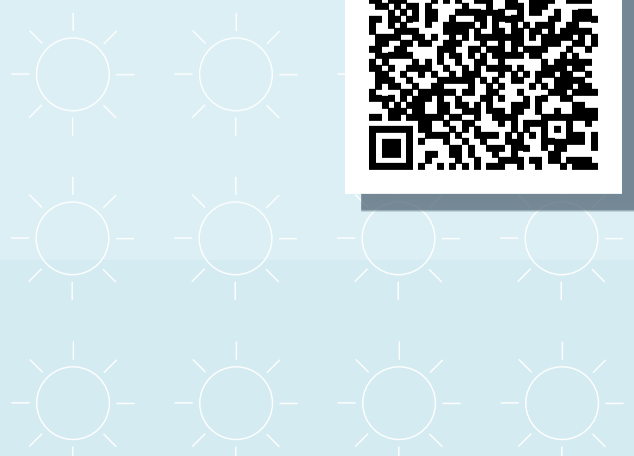

Have your say

We value community and stakeholder feedback. Without this, we would be unable to progress projects and reach a balanced proposal.

The feedback period

Previous consultation highlighted the need for an extended feedback period. In response to this, we will extend our usual 28 days feedback period.

We will accept feedback from now until 15 April 2024.

How to provide feedback

Submit your feedback online by scanning the QR code on this banner or via the form on our project webpages at:

Tealing - Westfield: <https://bit.ly/48bATR1>

Aylth - Tealing: <https://bit.ly/42AUk4C>

Email the feedback form to the Community Liaison Manager or write to us enclosing the feedback form at the back of the consultation booklet.

What we're seeking views on

We'll be actively looking to mitigate the impacts of the site as much as possible over the coming months, but it would be helpful to understand what you believe we should be doing to help minimise these impacts.

We encourage all interested community members to fill in a feedback form when submitting feedback, however if you prefer, you can email us to provide your feedback or ask any questions.



To support everyone online, we provide accessibility and language options on our website through 'Recite Me'. The accessibility and language support options provided by 'Recite Me' include text-to-speech functionality, fully customisable styling features, reading aids, and a translation tool with over 100 languages, including 35 text-to-speech.

Please select "Accessibility" on our website to try out our inclusive toolbar.

Our Community Liaison Team

Each project has a dedicated Community Liaison Manager who works closely with community members to make sure they are well informed of our proposals and that their views, concerns, questions or suggestions are put to our project teams.

Throughout the life of our projects, you will hear from us regularly. We aim to establish strong working relationships by being accessible to key local stakeholders such as community councils, residents' associations and development trusts, and regularly engage with interested individuals.

Community Liaison Manager

Rhiannon Merritt
Community Liaison Manager



SSEN Transmission
10 Henderson Road,
Inverness, IV1 1SN

E: tkup@sse.com

Additional information

The best way to keep up to date is to sign up to project updates via the project webpage:

Tealing - Westfield:
<https://bit.ly/48bATR1>

Aylth - Tealing:
<https://bit.ly/42AUk4C>

You can also follow us on social media

 [SSEN-Transmission](#)

 [SSETransmission](#)



 tkup@sse.com

[ssen-transmission.co.uk/projects/
2030-projects/East-Coast/](https://ssen-transmission.co.uk/projects/2030-projects/East-Coast/)



APPENDIX D: CONSULTATION BOOKLET EVENT 1





Scottish & Southern
Electricity Networks

TRANSMISSION

Tealing - Westfield Overhead Line 400kV Upgrade

Consultation Booklet

March 2024

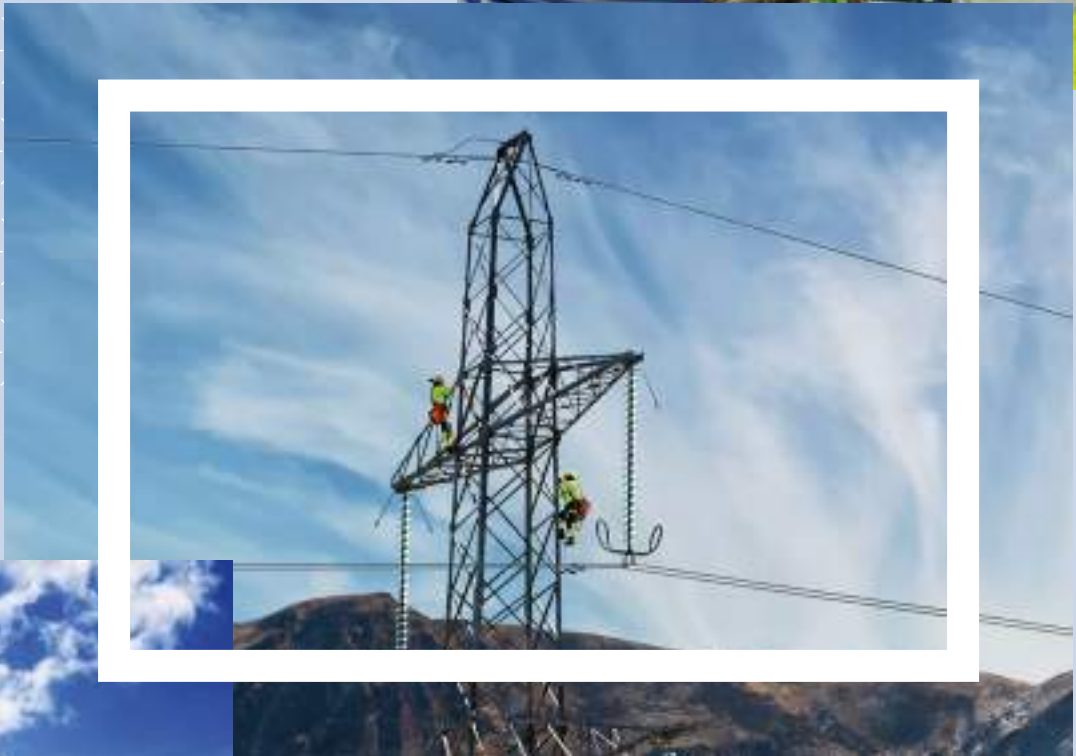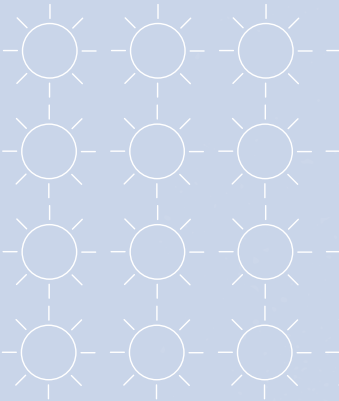

Contents

Powering change together	1	Finding common ground with landowners	11
The Pathway to 2030	2	Leaving things better than we found them	12
Project overview	4	Project timeline	13
Project details - Overhead Lines	6	Notes	14
Project interfaces	7	Have your say	16
Environmental considerations	8	Your feedback	17
Help shape our plans	10		


The consultation events will be taking place on:

4 March 2024 - Errol, Errol Village Hall – 2pm-7pm

5 March 2024 - Newburgh, Tayside Institute Community Centre – 2pm-7pm

6 March 2024 - Alyth, Alyth Town Hall – 2pm-7pm

7 March 2024 - Tealing, Tealing Village Hall – 2pm-7pm



Powering change together



The time has come to further enhance Scotland's energy infrastructure, providing power for future generations as we move towards net zero.

The shift to a cleaner, more sustainable future is about more than climate change. It's about ensuring future generations have the same opportunities to thrive as we have all had.

Countries around the world are investing in their energy infrastructure to support the demands of modern economies and meet net zero targets. The UK is leading the way in building a modern, sustainable energy system for the future.

We all have a part to play

When it comes to net zero, we have to be in it together. The UK and Scottish Governments have ambitious net zero targets, and we're playing our part in meeting them.

We work closely with National Grid Electricity System Operator to connect vast renewable energy resources – harnessed by solar, wind, hydro and marine generation – to areas of demand across the country. Scotland is playing a big role in meeting this demand, exporting two thirds of power generated in our network.

But there's more to be done. By 2050, the north of Scotland is predicted to contribute over 50GW of low carbon energy to help deliver net zero. Today, our region has around 9GW of renewable generation connected to the network.

At SSEN Transmission, it is our role to build the energy system of the future.

We're investing £20 billion into our region's energy infrastructure this decade, powering more than ten million UK homes and 20,000 jobs, 9,000 of which will be here in Scotland.



Find out more

Scan the QR code with your smartphone to find out more about how these policies have been assessed and determined.

Who we are

We're responsible for maintaining and investing in the electricity transmission network in the north of Scotland. We're part of SSE plc, one of the world's leading energy companies with a rich heritage in Scotland that dates back more than 80 years. We are also closely regulated by the GB energy regulator Ofgem, who determines how much revenue we are allowed to earn for constructing, maintaining and renovating our transmission network.

What we do

We manage the electricity transmission network across our region which covers a quarter of the UK's land mass, crossing some of the country's most challenging terrain. We connect renewable energy sources to our network in the north of Scotland and then transport it to where it needs to be. From underground subsea cables and Overhead Lines (OHL) to electricity substations, our network keeps your lights on all year round.

Working with you

We understand that the work we do can have an impact on our host communities. So we're committed to minimising our impacts and maximising all the benefits that our local developments can bring to your area.

We're regularly assessed by global sustainability consultancy AccountAbility for how we engage with communities. That means we provide all the information you need to know about our plans and how they will impact communities like yours. We want to hear people's views, concerns, or ideas and harness local knowledge so that our work benefits their communities: today and long into the future. You can share your views with us at: ssen-transmission.co.uk/talk-to-us/contact-us

The Pathway to 2030

Building the energy system of the future will require a delivery of significant infrastructure over the next few years. In partnership with the UK and Scottish Governments, we're committed to meeting our obligation of connecting new, renewable energy to where it's needed by 2030.

Achieving net zero

By 2030, both the UK and Scottish governments are targeting a big expansion in offshore wind generation of 50GW and 11GW respectively. The Scottish Government has also set ambitious targets for an additional 12GW of onshore wind by 2030.

Across Great Britain, including the north of Scotland, there needs to be a significant increase in the capacity of the onshore electricity transmission infrastructure to deliver these 2030 targets and a pathway to net zero.

Securing our energy future

And it's not just about net zero. It's also about building a homegrown energy system, so that geopolitical turmoil around the world doesn't severely impact the UK and push up energy prices. The UK Government's British Energy Security Strategy further underlines the need for this infrastructure, setting out plans to accelerate homegrown power for greater energy independence.

The strategy aims to reduce the UK's dependence on and price exposure to global gas wholesale markets through the deployment of homegrown low carbon electricity generation supported by robust electricity network infrastructure.

Meeting our 2030 targets

In July 2022, National Grid, the Electricity System Operator (ESO), published the Pathway to 2030 Holistic Network Design (HND).

This set out the blueprint for the onshore and offshore transmission infrastructure that's required to support the forecasted growth in the UK's renewable electricity.

It's an ambitious plan that will help the UK achieve net zero.

What does this mean for you?

The East of Scotland will play a key role in meeting these goals. The extensive studies that informed the ESO's Pathway to 2030 HND confirmed the requirement to increase the power transfer capacity of the onshore corridor from Kintore to Tealing.

This requires a 400kV connection between these sites to enable the significant capability needed to take power from onshore and large scale offshore renewable generation, connecting on the East Coast of Scotland before transporting power to areas of demand.

As part of these plans, we're proposing to build a new 400kV OHL between Kintore and Tealing. This also requires two new 400kV substations to be constructed in Fetteresso Forest and Tealing to enable future connections and export routes to areas of demand.


In addition, two of the existing 275kV OHL out of the existing Tealing substation to Alyth and Westfield require upgrades to 400kV operation and to be connected to the proposed new Tealing 400kV site.




These five projects, collectively are called the Kintore to Tealing 400kV projects, and are seen as critical to enable the delivery of the UK and Scottish Government's targets.

Future network investment requirements

Our 2030 targets are the first step on the transition to net zero. The UK Government has a target to decarbonise our electricity system by 2035 and fully decarbonise our economy by becoming net zero by 2050, with the Scottish Government committing to net zero five years earlier, by 2045.

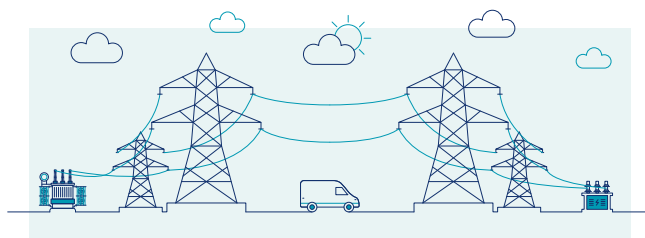To achieve these targets, further investment in new low carbon electricity generation and the enabling electricity transmission network infrastructure will be required. The next stage of strategic network planning across Great Britain is underway and we expect the independent Electricity System Operator, National Grid ESO, to publish details of this in March this year. It is expected this will include a combination of new onshore and offshore network requirements.



-  New infrastructure
-  Upgrade/replacement of existing infrastructure
-  Existing network



Project overview

As the transmission network owner for the north of Scotland, Scottish and Southern Electricity Networks Transmission (SEN Transmission) are responsible for the maintenance of the existing transmission network and also ensuring that the current network can facilitate connection requests from developers when necessary.

The reconductoring of the existing Alyth to Tealing OHL has been identified as part of the National Grid ESO's Holistic Network Design (HND).

This project will upgrade the line from 275kV to 400kV to facilitate the transition to net zero in line with the UK and Scottish Government targets of achieving net zero by 2050 and 2045 respectively.

This booklet focuses on the upgrades, required to the OHL between Tealing and Westfield substations which crosses the boundary into Scottish Power Transmission's (SPT) Licence area.

Approach to consenting

An application for Section 37 consent will be made under the Electricity Act 1989 for the upgrade of the existing OHL to operate at 400kV.

This application is made to the Energy Consents Unit of the Scottish Government.

The S37 will cover all aspects of the OHL works, including replacement of insulators and conductors, tower and foundation repairs, ground reprofiling, all associated works and the provision of access tracks to enable these works. This application is made to the Energy Consents Unit (ECU) of the Scottish Government.

The application will also need to be accompanied by an Environmental Impact Assessment (EIA) Report.

We will be submitting an EIA Scoping Report to ECU soon, which, in collaboration with statutory and non-statutory consultees, will determine the scope of issues to be considered in the EIA Report.


The scope to carry out some of the works, either as permitted development or through separate planning consent, in advance of obtaining S37 consent is currently being explored.



The OHL upgrade works would involve replacing the conductors, insulators and fittings on the existing OHL steel lattice towers between the existing Tealing substation and the SSEN Transmission boundary with Scottish Power Energy Networks (SPEN) licence area.

This project would upgrade the line from 275kV to 400kV to facilitate the transition to Net Zero inline with the UK and Scottish Government targets.

A new substation is being advanced through a planning application process on land to the west of the existing substation. Any tie ins to the new substation from the existing line will be advanced via separate S37 consent.

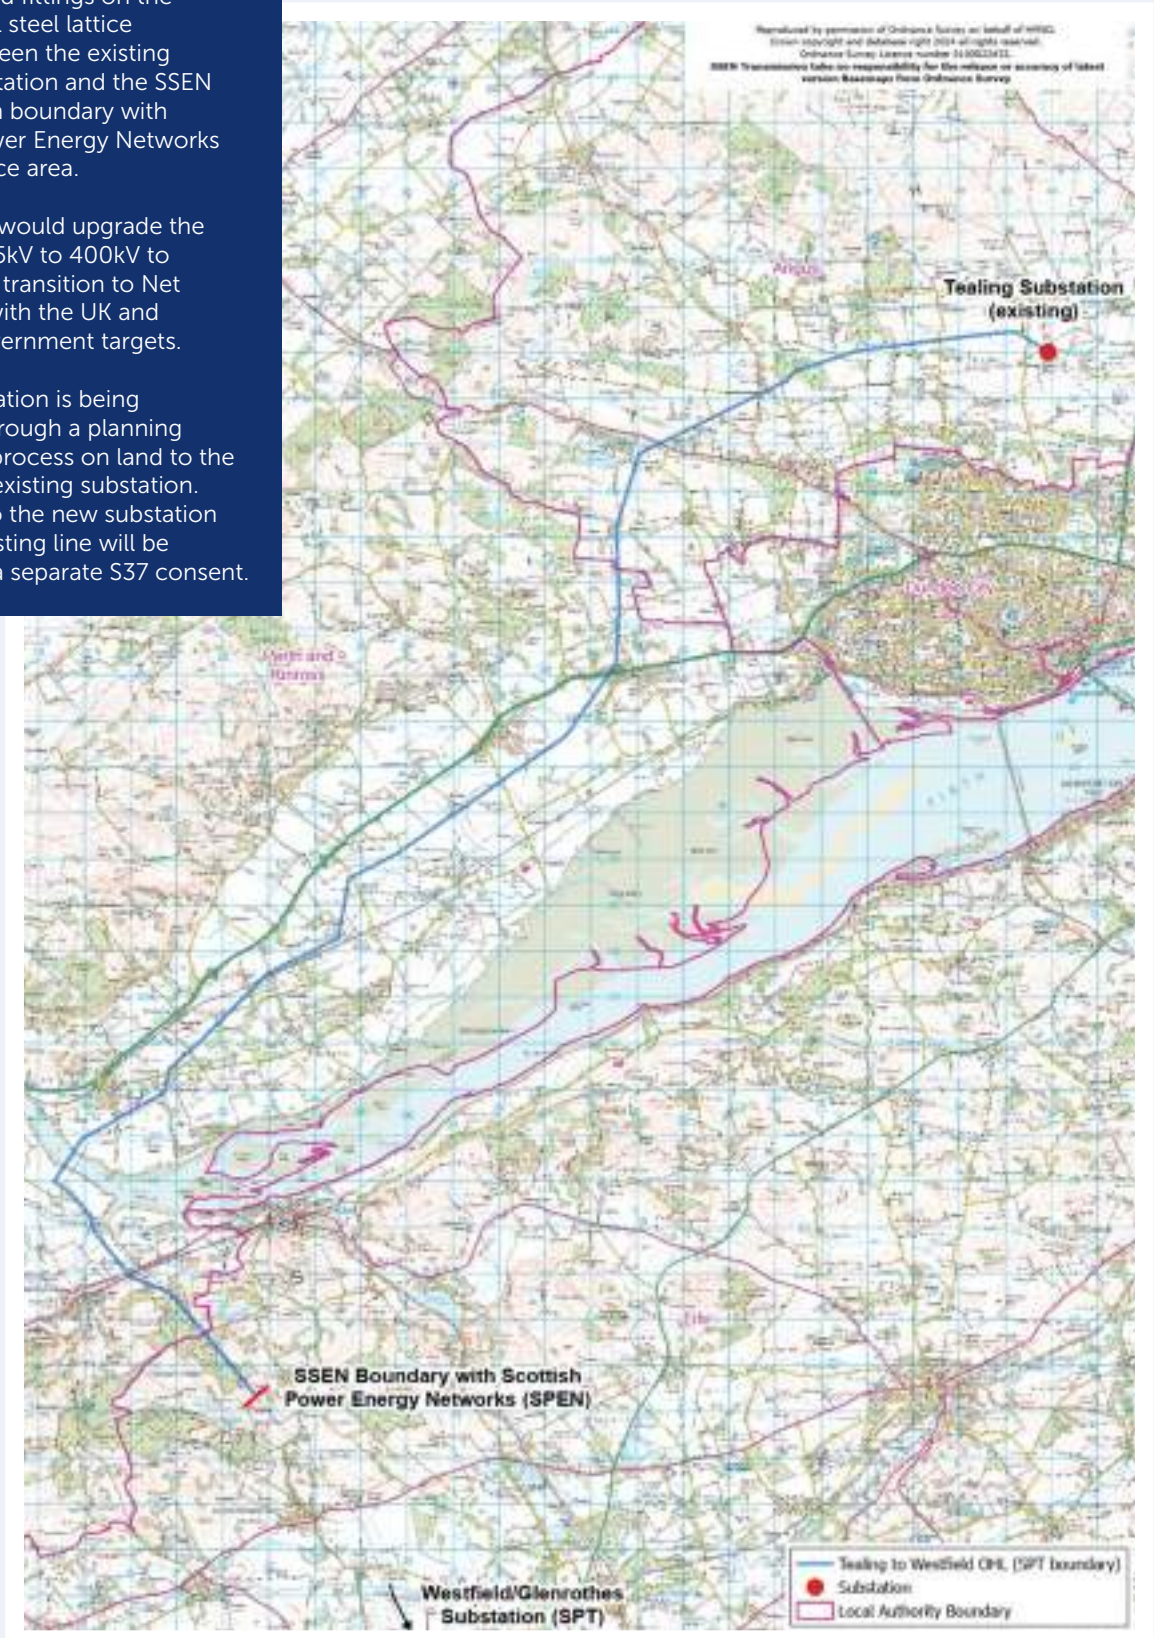

Project details - Overhead Lines

Conductor replacement

The existing conductor is Twin Zebra Aluminium Conductor Steel Reinforced (ACSR) Conductor. This conductor has been in place since the OHL was constructed in 1963 and 1973 and is due for replacement.

The replacement conductor that will be used is a Triple bundle and the proposed conductor is still to be determined.

Insulator replacement

The existing 275kV insulators will be replaced with 400kV insulators.

These are slightly longer than the existing insulators as they have more discs. The insulator and conductor replacement will allow the OHL to transfer a higher capacity of power.

Tower refurbishments

The new conductor is heavier than the existing conductor therefore some of the tower steelwork and foundations will need to be strengthened.

The refurbishments and upgrades to the steelwork and foundations will take place ahead of replacing the conductors.

Access requirements

To access the towers, we will use a variety of methods including the construction of new stone access tracks, use of existing tracks, laying of trackway panels on favourable terrain or by all-terrain vehicle.

We will agree any access requirements with the relevant landowners and secure consent, where required, before commencing works.

Operational corridor requirements

The operational corridor is calculated based on achieving OHL resilience from tree fall. The upgrading from 275kV to 400kV will result in the need for a wider operational corridor which could equate to a potential 89m full operational corridor width from woodland edge to woodland edge. Requirements will be assessed through the detailed design process.



Conductor replacement



Insulator replacement



Tower refurbishments




Access Tracks

Project interfaces

Tealing substation

We will carry out the works to upgrade the existing OHL from the Scottish Power Energy Networks (SPEN) boundary, south of Abernethy, to our existing Tealing substation. To enable the operation of the OHL at 400kV, it will be connected into the new 400kV substation being developed. This will be achieved by the construction of a new OHL originating at some point on the existing line between Tower 180 and Tower 182. This will result in a redundant section of OHL between Tower 182 and the existing substation. It is intended that this will be reused to make a connection between the new 400kV site and the existing site.


A separate Section 37 consent for the new build tie-in will be submitted to the Energy Consents Unit.

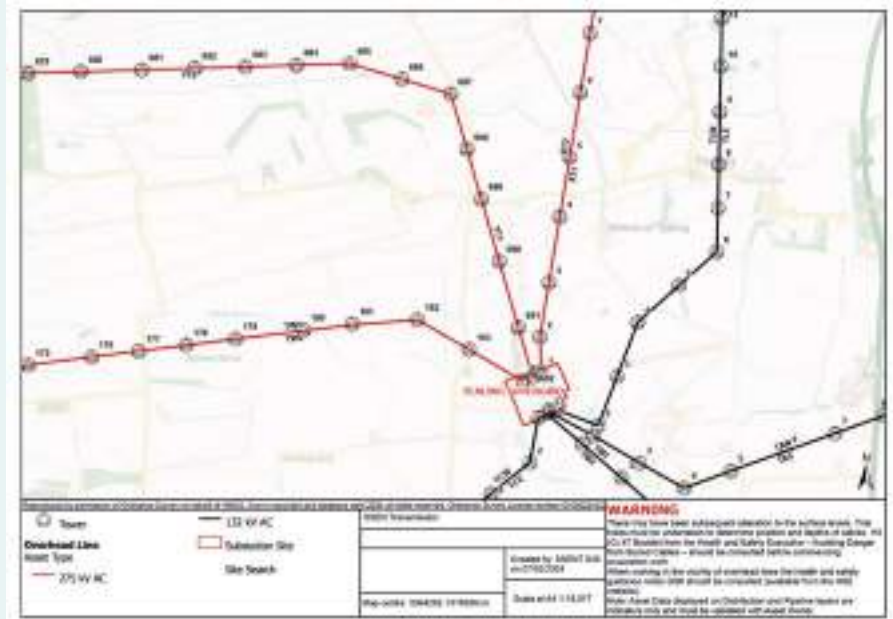

SPEN boundary

We will reconductor down to the licence area border that we share with SPEN. This is mid-span between Tower 66 and Tower 67.

SPEN will submit a separate Section 37 notice for the 400kV upgrade works to be carried out to the OHL in their licence area.

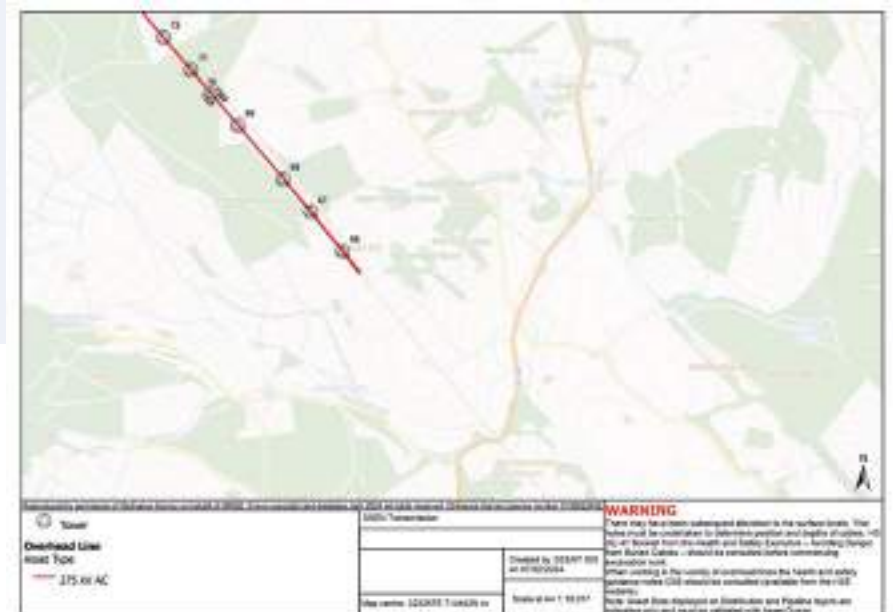

Environmental considerations

This project is required to upgrade to the existing OHL network between Tealing and Westfield substations and does not involve the construction or introduction of any new steel lattice towers. An Environmental Impact Assessment (EIA) is required as part of the Section 37 consent application under the Electricity Act 1989. An EIA Scoping Report will be prepared and submitted to the Energy Consents Unit of the Scottish Government to agree which environmental elements should be taken into consideration as part of the assessment. SSEN are responsible for the EIA for the works proposed in their licence area. SPEN will carry out a similar assessment for the works in their licence area.

Ornithology

The OHL does not pass through any sites designated for ornithological interests. There are however likely to be breeding birds in the vicinity of the existing OHL in particular lekking black grouse, raptors and upland waders. There will also be bird flight activity in proximity to, and across the line.

Mitigation measures will be required to avoid or minimise effects on these birds during the construction phase and a full suite of required bird surveys will be carried out and the scope agreed with NatureScot.

Water environment

The OHL passes over or near to a number of river catchments and watercourses. Several towers are located in areas of potential flood risk but with mitigation measures the project is not anticipated to increase flood risk or have a detrimental impact on water quality.

Private water supplies will be identified and assessed to determine potential risk to any supplies. Where required, measures will be put in place to ensure that the quality and quantity of water from these supplies would not be adversely affected.

Visual effects

There would be limited material change to the appearance of the OHL following the reinforcement works as the associated fittings will be visually similar to those present already, albeit the existing twin conductors would be replaced with triple conductors.

Some visual effects would result during the construction from temporary works as crew and machinery move along the line to replace the conductors and fittings and works and from tree felling associated with the creation of a 400kV operational corridor.

Terrestrial and aquatic ecology

The OHL crosses primarily agricultural land, utilised for arable crops and pasture, as well as areas of woodland, running and standing water. Within the corridor there is a single Special Area of Conservation (SAC) (River Tay SAC) and a short distance upstream is the Firth of Tay and Eden Estuary Special Protection Area (SPA) and Ramsar site.

There are four Ancient Woodland Inventory (AWI) woodlands of Long-Established Plantation Origin (LEPO) which cross the existing line and a further three which are within the vicinity of the line. There are no other designated sites (including locally designated). A single area of lowland raised bog (lowland raised bog inventory) was identified during the desk study.

Surveys identified a number of habitats which are listed on the Scottish Biodiversity List and are therefore considered to be of principal importance for biodiversity conservation in Scotland. Most are also Tayside Local Priority habitats. Targeted surveys and species protection plans would be put in place to minimise potential effects to protected species during construction.





Cultural heritage

A limited number of non-designated assets have been recorded within 100m of the current OHL, although most are set some distance away from the existing towers.

As a result, physical impacts should be limited to the access tracks and other associated supporting works that might be required.

In addition, there is the potential for physical impacts on designated assets including, Dronley House Mound (SM6535), East Adamston unenclosed settlement and souterrain (SM6465), South Inchmichael unenclosed settlement (SM7199) and Megginch Castle Garden and Designed Landscape (GDL00278). Any works within the vicinity of these assets will require careful consideration and potentially require Scheduled Monument Consent.

Further consultation will be required with Statutory Consultees with regards to any direct impacts and suitable mitigation that may be required.

A programme of archaeological works will be implemented, and recommendations provided to minimise the potential effects on assets during construction will be presented in the Construction Environmental Management Plan (CEMP), identifying known cultural heritage assets within close proximity to existing towers and proposed access routes.

Traffic and transport

A Construction Traffic Management Plan (CTMP) will be developed and used to specify construction traffic routes to suitable roads and appropriately signed diversions, where required during the construction phase of the works. This will be prepared in agreement with Perth and Kinross, Angus and Fife Councils.

Noise

Construction noise is considered to be short term and intermittent and will be controlled through the implementation of a Noise Management Plan. An assessment of operational noise will be undertaken, in discussion with the Environmental Health Departments of Perth and Kinross, Angus and Fife Councils.

Electromagnetic fields

Electromagnetic Fields (EMF) arise from electric charges and current flow. Exceedance of EMF exposure limits are not expected, but an assessment of the change in EMF strengths due to the OHL operating at 400kV will be undertaken and the results will be presented alongside exposure limits.

Help shape our plans

The work we have planned is significant and has the potential to deliver massive benefits in your community, Scotland, and beyond. Yet we know that achieving our goals will require a lot of work that will impact your lives. That's why we want to work with you every step of the way throughout the planning and delivery stages of these essential and ambitious works.

We're committed to delivering a meaningful consultation process that actively seeks the views of everyone affected by our plans. That means making our plans clear and easily accessible, so that you can give us input throughout each stage of the development process.

Throughout the consultation, we'll present our approach to developing the project, including changes made since we last consulted with you.

We will also provide some visualisations and maps to show you where everything will be located.


We want you to share your thoughts and opinions on our plans, where you think we can make improvements, concerns about the impact of our work and what you think of any changes and refinements we've made.

By telling us what you think, you will help shape our proposals. We want to harness your local knowledge so that we spot any unforeseen challenges early and maximise the potential benefits and opportunities for your communities.

Because, ultimately, we want you to work with us to ensure that the energy infrastructure we build will be the best it can possibly be.

Who we are consulting with

As well as communities, we are keen to hear feedback from a broad range of other stakeholders including but not limited to landowners, businesses, non-statutory consultees and statutory consultees such as local authorities, NatureScot, Scottish Environment Protection Agency (SEPA), Historic Environment Scotland (HES) and Scottish Forestry (SF).

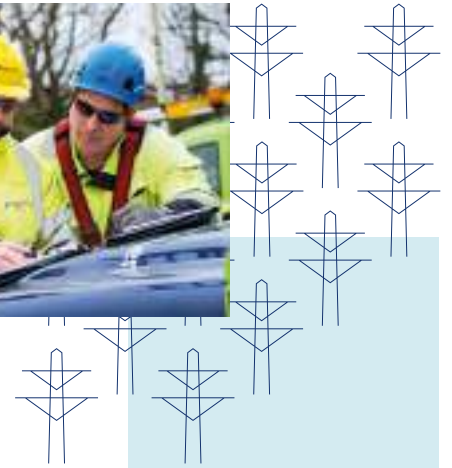

Finding common ground with landowners

We recognise that landowners and occupiers are key stakeholders in the development of our projects. At all levels, we will be transparent about our proposals and keep the conversation open and constructive when it comes to those affected and reaching effective compromise.

From the outset of the project, our land team have been identifying and contacting landowners and occupiers who may be affected by our proposals.

If you are a landowner who is affected by the proposals and have not yet had contact from us, please get in touch via the contact details for the dedicated project land managers found on the relevant webpages: <https://bit.ly/48bATR1>

We work with landowners and occupiers to mitigate the effects of our infrastructure on their properties and our team of Land Managers will be on hand to answer queries and address concerns throughout this process.

As part of this, we need to carry out various engineering and environmental surveys to inform what we design and how we build it.

We will always seek consent from affected landowners and occupiers in advance for these surveys.

Once we have finalised the design, we will be required to secure the appropriate land rights from landowners and occupiers in order to secure planning consent.

Our land managers will endeavour to reach a voluntary agreement with landowners and occupiers, however, as a statutory undertaker, we might need to underpin voluntary discussions with an application to Scottish Ministers for a Necessary Wayleave or Compulsory Purchase Order.

Ultimately this is to ensure nationally significant infrastructure projects are delivered on time and in line with our licence obligations. We also have a duty to protect the interests of the UK bill payer.

Statutory powers are not used lightly as we aim to work with landowners and occupiers to secure the necessary land rights voluntarily.

All potentially affected landowners and occupiers have the opportunity to provide feedback at our in-person consultation events and by submitting a feedback form.

We would encourage all those with an interest to submit their views through this consultation.



Leaving things better than we found them

On every project we deliver, we always need to consider how we impact the environment in that area. As we enhance the transmission network in the East of Scotland, we have a responsibility to design and build our projects to protect and enhance the environment. We will always look to minimise the potential impacts from our activities and achieve Biodiversity Net Gain (BNG).

As the first developer to consult upon and implement an award-winning approach to deliver Biodiversity Net Gain (BNG) on all new sites, we're committed to delivering a "greener grid", focusing on habitat restoration and creating biodiversity growth as we invest in our network. We are committed to delivering 10% Biodiversity Net Gain on all sites gaining consent going forward. This ensures that we don't just restore our natural habitats but actively improve them for the benefit of local communities, wildlife, flora and fauna.

During the development, construction and operation of our projects, we will leave the environment in a measurably

better state than before development started, ensuring a positive environmental legacy at all our sites. As this project progresses through the development process, we will actively seek ways to avoid and minimise impacts on biodiversity, through careful routeing and site design to avoid impacting areas of highest biodiversity value.


Where avoidance is not possible, we will offset this by introducing new habitats along with restoration efforts. These can be achieved within the boundary of the development site, or by providing support to local groups involved with habitat restoration or creation projects, within the locale of the development site.

If there are biodiversity improvement projects in your local area that SSEN Transmission could get involved with, please get in touch. Contact details for the Community Liaison Manager can be found on page 16).

Example projects

Argyll Coast and Countryside Trust (ACT)

Argyll's rainforest is a unique and rare habitat of ancient and native woodland. This collaboration with ACT will help deliver our compensatory tree planting and BNG commitments in Argyll. It also aligns with ACT's woodland planting ambitions, supporting its charitable objectives including biodiversity gain, health and wellbeing, improvement for local people, outdoor learning opportunities and climate change workshops.

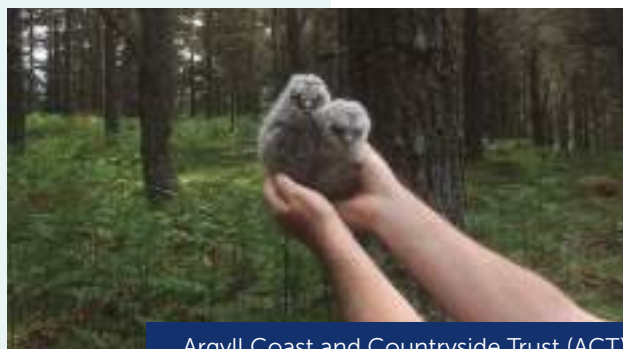

Argyll Coast and Countryside Trust (ACT)

Thurso South substation and The Bumblebee Conservation Trust


We created approximately 10 hectares of bee-friendly habitat to support the pollination of the rare endemic great yellow bumblebee.

This contributed to wider conservation efforts for this bee species. A collaboration with The Bumblebee Conservation Trust facilitated research on food availability for bumblebees, identifying the need for a diverse seed mix containing key flowering species to enhance early, main and late food supply to support the full lifecycle of bumblebees.



Thurso South substation and The Bumblebee Conservation Trust

Project timeline

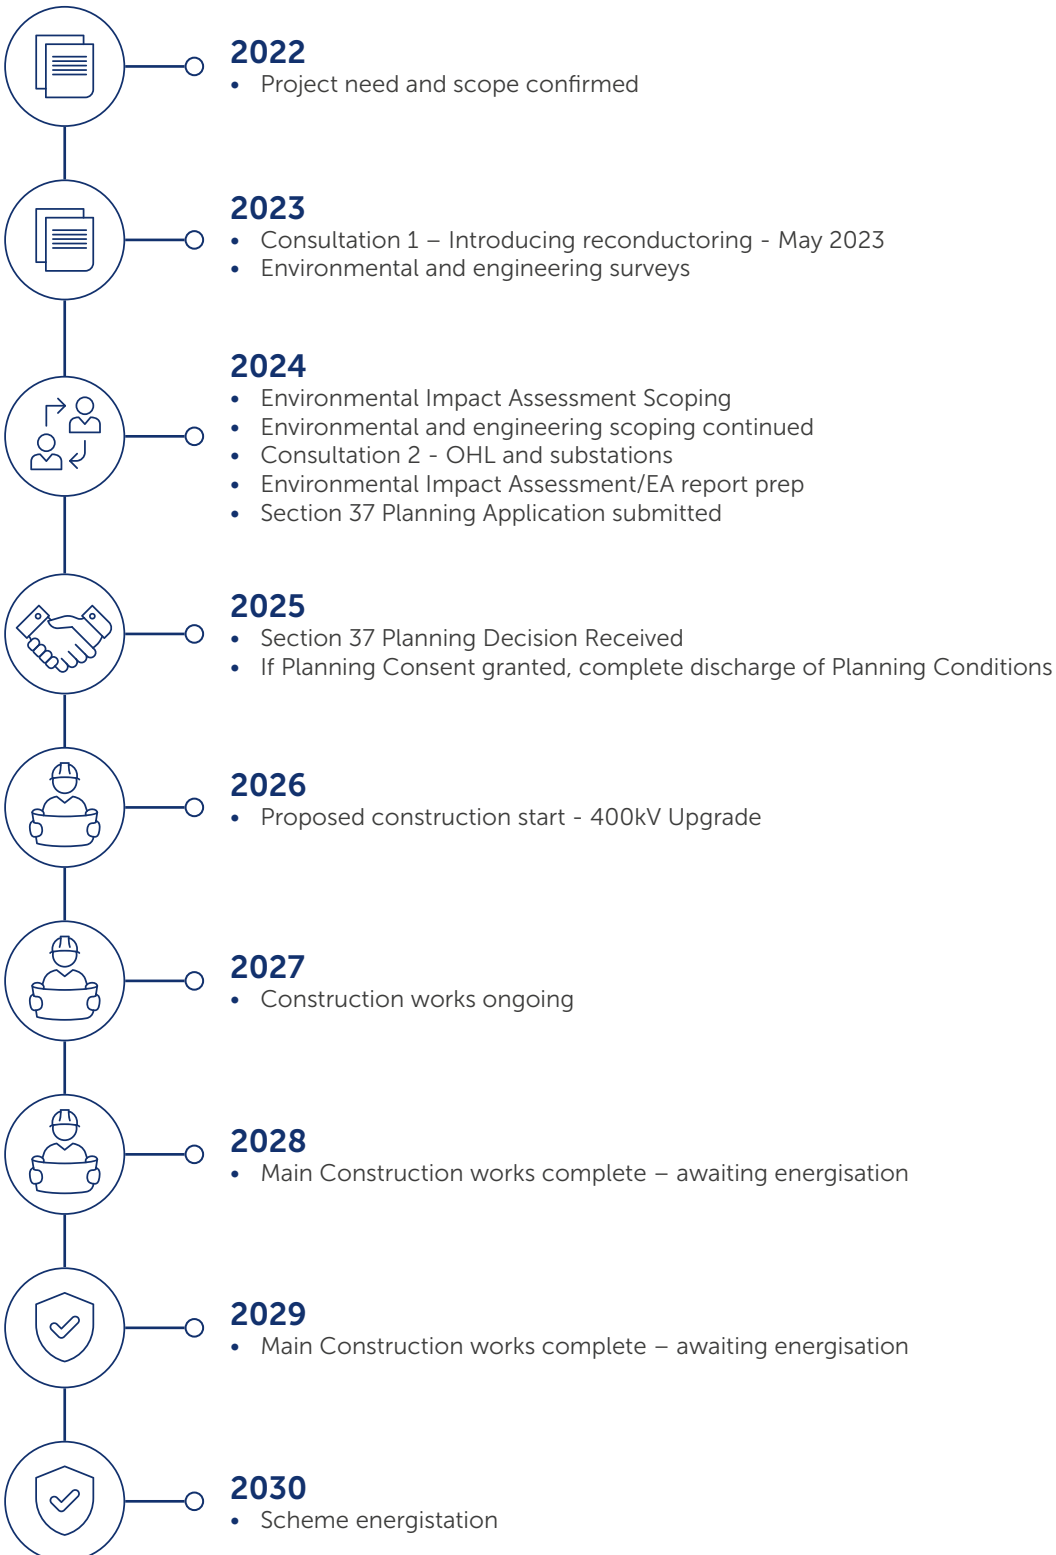

Have your say

We value community and stakeholder feedback. Without this, we would be unable to progress projects and reach a balanced proposal.

The feedback period

Previous consultation highlighted the need for an extended feedback period. In response to this, we will extend our usual 28 days feedback period.

We will accept feedback from now until 15 April 2024.

How to provide feedback

Submit your feedback online by scanning the QR code on this page or via the form on our project webpage at: <https://bit.ly/48bATR1>

Email the feedback form to the Community Liaison Manager or write to us enclosing the feedback form at the back of this booklet.

What we're seeking views on

We'll be actively looking to mitigate the impacts of the site as much as possible over the coming months, but it would be helpful to understand what you believe we should be doing to help minimise these impacts.

We encourage all interested community members to fill in a feedback form when submitting feedback, however if you prefer, you can email us to provide your feedback or ask any questions.



To support everyone online, we provide accessibility and language options on our website through 'Recite Me'. The accessibility and language support options provided by 'Recite Me' include text-to-speech functionality, fully customisable styling features, reading aids, and a translation tool with over 100 languages, including 35 text-to-speech.

Please select "Accessibility" on our website to try out our inclusive toolbar.

Our Community Liaison Team

Each project has a dedicated Community Liaison Manager who works closely with community members to make sure they are well informed of our proposals and that their views, concerns, questions or suggestions are put to our project teams.

Throughout the life of our projects, you will hear from us regularly. We aim to establish strong working relationships by being accessible to key local stakeholders such as community councils, residents' associations and development trusts, and regularly engage with interested individuals.

Community Liaison Manager

Rhiannon Merritt
Community Liaison Manager

SSEN Transmission
10 Henderson Road,
Inverness, IV1 1SN

E: tkup@sse.com



Additional information

The best way to keep up to date is to sign up to project updates via the project webpage: <https://bit.ly/48bATR1>

You can also follow us on social media

 [SSEN-Transmission](#)

 [SSETransmission](#)

Your feedback

Thank you for taking the time to read this consultation booklet. In order to record your views and improve the effectiveness of our consultation, please complete this short feedback form.

Please complete in BLOCK CAPITALS. (Please tick one box per question only)

Q1. Has the project information provided explained the need for the Tealing to Westfield 400kV Overhead Line Upgrade works?

Yes No Unsure

Comments:

Q2. Have we adequately explained the different parts of the overall project clearly?

Yes No Unsure

Comments:

Q3. Do you support our decision to upgrade the Tealing to Westfield Overhead Line?

Yes No Unsure

Comments:

Q4. Do you feel we have given enough consideration to potential impacts on the Environment that this project may have?

Yes No Unsure

Comments:

Q5. Are there any additional factors, issues or concerns which you wish to bring to the attention of the Project Team regarding our proposal?

Yes No Unsure

Comments:

Q6. Following your review of the information displayed today, how would you rate your knowledge of the Tealing to Westfield 400kV Overhead Line Upgrade Works?

Very well informed Know a lot Know a little
 Know very little Know nothing at all

Q7. Do you have ideas for biodiversity improvement projects in your local area that SSEN Transmission could get involved with?

Yes No Unsure

Comments:

Full name

Address

Telephone

Email

If you would like your comments to remain anonymous please tick this box.

We would like to send you relevant communications via email such as invitations to stakeholder events, surveys, updates on projects, services and future developments from the Scottish and Southern Electricity Networks group listed below. If you are happy to receive email updates please opt in by ticking the box below. You can unsubscribe at any time by contacting us at stakeholder.admin@sse.com or by clicking on the unsubscribe link that will be at the end of each of our emails.

For information on how we collect and process your data please see our privacy notice available at today's event. This can also be obtained online at ssen-transmission.co.uk/privacy

If you would like to be kept informed of progress on the project please tick this box.

Thank you for taking the time to complete this feedback form. Please submit your completed form by one of the methods below:

Post: SSEN Transmission, 10 Henderson Road, Inverness, IV1 1SN **Email:** tkup@sse.com

Online: <https://bit.ly/48bATR1>

Download: Comments forms and all the information from today's event will also be available to download from the project website.

The feedback form and all information provided in this booklet can also be downloaded from the dedicated website: <https://bit.ly/48bATR1>

We intend to use Artificial Intelligence (AI) to assist our experienced teams in the analysis of your feedback, so we can categorise key points raised more quickly. You can learn more about how we're utilising AI at ssen-transmission.co.uk/AIFAQ

Any information given on the feedback form can be used and published anonymously as part of Scottish and Southern Electricity Networks consultation report. By completing this feedback form you consent to Scottish and Southern Electricity Networks using feedback for this purpose.

Scottish and Southern Electricity Networks is a trading name of: Scottish and Southern Energy Power Distribution Limited Registered in Scotland No. SC213459; Scottish Hydro Electric Transmission plc Registered in Scotland No. SC213461; Scottish Hydro Electric Power Distribution plc Registered in Scotland No. SC213460; (all having their Registered Offices at Inveralmond House 200 Dunkeld Road Perth PH1 3AQ); and Southern Electric Power Distribution plc Registered in England & Wales No. 04094290 having its Registered Office at Number One Forbury Place, 43 Forbury Road, Reading, Berkshire, RG1 3JH which are members of the SSE Group.

APPENDIX E: CONSULTATION BANNERS EVENT 2

Powering change together

The time has come to further enhance Scotland's energy infrastructure, providing power for future generations as we move towards net zero.

The shift to a cleaner, more sustainable future is about more than climate change. It's about ensuring future generations have the same opportunities to thrive as we have all had.

Countries around the world are investing in their energy infrastructure to support the demands of modern economies and meet net zero targets. The UK is leading the way in building a modern, sustainable energy system for the future.

We all have a part to play

When it comes to net zero, we have to be in it together. The UK and Scottish Governments have ambitious net zero targets, and we're playing our part in meeting them.

We work closely with National Grid Electricity System Operator to connect vast renewable energy resources – harnessed by solar, wind, hydro and marine generation – to areas of demand across the country. Scotland is playing a big role in meeting this demand, exporting two-thirds of power generated in our network.

But there's more to be done. By 2050, the north of Scotland is predicted to contribute over 50GW of low carbon energy to help deliver net zero. Today, our region has around 9GW of renewable generation connected to the network.

At SSEN Transmission, it is our role to build the energy system of the future.

We're investing £20 billion into our region's energy infrastructure this decade, powering more than ten million UK homes and 20,000 jobs, 9,000 of which will be here in Scotland.



Find out more

Scan the QR code with your smartphone to find out more about how these policies have been assessed and determined.

Who we are

We're responsible for maintaining and investing in the electricity transmission network in the north of Scotland. We're part of SSE plc, one of the world's leading energy companies with a rich heritage in Scotland that dates back more than 80 years. We are also closely regulated by the GB energy regulator Ofgem, who determines how much revenue we are allowed to earn for constructing, maintaining and renovating our transmission network.

What we do

We manage the electricity transmission network across our region which covers a quarter of the UK's landmass, crossing some of the country's most challenging terrain. We connect renewable energy sources to our network in the north of Scotland and then transport it to where it needs to be. From underground subsea cables and Overhead Lines (OHL) to electricity substations, our network keeps your lights on all year round.

Working with you

We understand that the work we do can have an impact on our host communities. So we're committed to minimising our impacts and maximising all the benefits that our local developments can bring to your area.

We're regularly assessed by global sustainability consultancy AccountAbility for how we engage with communities. That means we provide all the information you need to know about our plans and how they will impact communities like yours. We want to hear people's views, concerns, or ideas and harness local knowledge so that our work benefits their communities: today and long into the future. You can share your views with us at: ssen-transmission.co.uk/talk-to-us/contact-us



The Pathway to 2030

Building the energy system of the future will require a delivery of significant infrastructure over the next few years. In partnership with the UK and Scottish Governments, we're committed to meeting our obligation of connecting new, renewable energy to where it's needed by 2030.

Achieving net zero

By 2030, both the UK and Scottish governments are targeting a big expansion in offshore wind generation of 50GW and 11GW respectively. The Scottish Government has also set ambitious targets for an additional 12GW of onshore wind by 2030.

Across Great Britain, including the north of Scotland, there needs to be a significant increase in the capacity of the onshore electricity transmission infrastructure to deliver these 2030 targets and a pathway to net zero.

Securing our energy future

And it's not just about net zero. It's also about building a homegrown energy system, so that geopolitical turmoil around the world doesn't severely impact the UK and push up energy prices. The UK Government's British Energy Security Strategy further underlines the need for this infrastructure, setting out plans to accelerate homegrown power for greater energy independence.

The strategy aims to reduce the UK's dependence on and price exposure to global gas wholesale markets through the deployment of homegrown low-carbon electricity generation supported by robust electricity network infrastructure.

Meeting our 2030 targets

In July 2022, National Grid, the Electricity System Operator (ESO), published the Pathway to 2030 Holistic Network Design (HND).

This set out the blueprint for the onshore and offshore transmission infrastructure that's required to support the forecasted growth in the UK's renewable electricity.

It's an ambitious plan that will help the UK achieve net zero.

What does this mean for you?

The east of Scotland will play a key role in meeting these goals. The extensive studies that informed the ESO's Pathway to 2030 HND confirmed the requirement to increase the power transfer capacity of the onshore corridor from Kintore to Tealing.

This requires a 400kV connection between these sites to enable the significant capability needed to take power from onshore and large scale offshore renewable generation, connecting on the east coast of Scotland before transporting power to areas of demand.

- New infrastructure
- - - Upgrade/replacement of existing infrastructure
- Existing network

As part of these plans, we're proposing to build a new 400kV OHL between Kintore and Tealing. This also requires two new 400kV substations to be constructed in Fetteresso Forest and Tealing to enable future connections and export routes to areas of demand.

In addition, two of the existing 275kV OHL out of the existing Tealing substation to Alyth and Westfield require upgrades to 400kV operation and to be connected to the proposed new Tealing 400kV site.


These five projects, collectively are called the Kintore to Tealing 400kV projects, and are seen as critical to enable the delivery of the UK and Scottish Government's targets.

Future network investment requirements

Our 2030 targets are the first step on the transition to net zero. The UK Government has a target to decarbonise our electricity system by 2035 and fully decarbonise our economy by becoming net zero by 2050, with the Scottish Government committing to net zero five years earlier, by 2045. To achieve these targets, further investment in new low carbon electricity generation and the enabling electricity transmission network infrastructure will be required.

The next stage of strategic network planning across Great Britain has now been outlined in the independent Electricity System Operator, National Grid ESO's, 'Beyond 2030' report, published in March this year. For the north of Scotland, the ESO's plan recommends several new and upgraded onshore and offshore reinforcements that the ESO has assessed are required to help deliver net zero targets.

These projects, which will be subject to extensive public consultation, are at the very early stages of development and further details will be set out in due course.

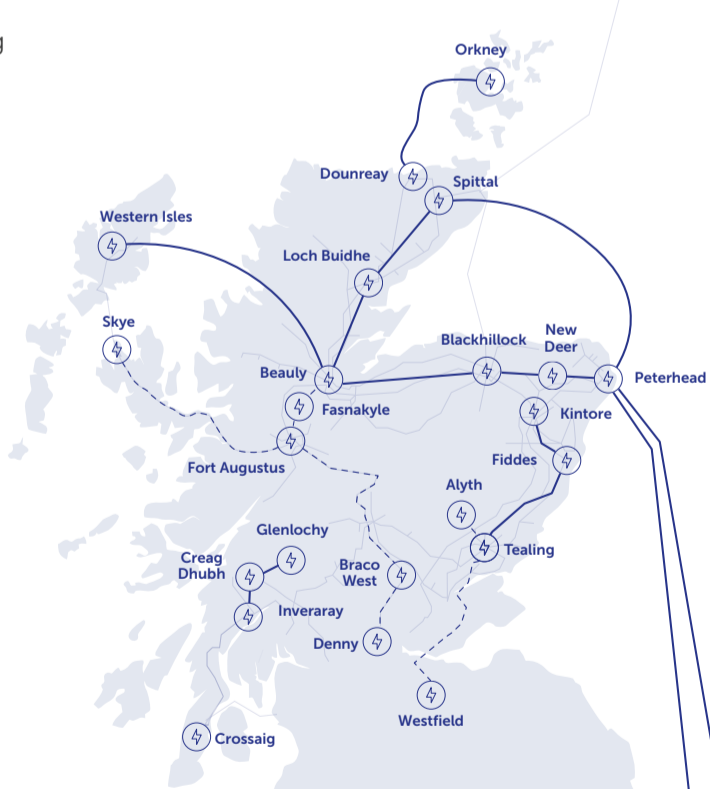

Project overview

As the transmission network owner for the north of Scotland, Scottish and Southern Electricity Networks Transmission (SSEN Transmission) are responsible for the maintenance of the existing transmission network and also ensuring that the current network can facilitate connection requests from developers when necessary.

The reconductoring of the existing Alyth to Tealing and Tealing to Westfield OHL has been identified as part of the National Grid ESO's Holistic Network Design (HND).

These projects will upgrade the lines from 275kV to 400kV to facilitate the transition to net zero in line with the UK Government targets of achieving net zero by 2050.

Approach to consenting

An application for Section 37 (S37) consent will be made under the Electricity Act 1989 for the upgrade of the existing OHL to operate at 400kV.

This application is made to the Energy Consents Unit (ECU) of the Scottish Government.

The S37 will cover all aspects of the OHL works, including replacement of insulators and conductors, tower and foundation repairs, ground reprofiling, all associated works and the provision of access tracks to enable these works.

The application will be accompanied by an Environmental Impact Assessment (EIA) Report.

We will be submitting an EIA Scoping Report to the ECU soon, which, in collaboration with statutory and non-statutory consultees, will determine the scope of issues to be considered in the EIA Report.

The scope to carry out some of the works, either as permitted development or through separate planning consent, in advance of obtaining S37 consent is currently being explored.



 ssen-transmission.co.uk/alyth-tealing

 tkup@sse.com

 ssen-transmission.co.uk/tealing-westfield

Project overview



The OHL upgrade works would involve replacing the conductors, insulators and fittings on the existing OHL steel lattice towers between Alyth substation and the existing Tealing substation

This project would upgrade the capability of the line from 275kV to 400kV to facilitate the transition to net zero in line with the UK and Scottish Government targets.

A new substation is being advanced through a planning application process on land to the west of the existing Tealing substation.

Any tie-ins to the new Tealing substation from the existing line will be advanced via a separate S37 consent.



ssen-transmission.co.uk/alyth-tealing



tkup@sse.com



ssen-transmission.co.uk/tealing-westfield

Project details - Overhead Lines

Conductor replacement

The existing conductor is Twin Zebra Aluminium Conductor Steel Reinforced (ACSR) Conductor. This conductor has been in place since the OHL was constructed in 1963 and 1973 and is due for replacement.

The replacement conductor that will be used is a Triple Upas All Aluminium Alloy Conductor (AAAC) consisting of stranded construction.

Insulator replacement

The existing 275kV insulators will be replaced with 400kV insulators.

These are slightly longer than the existing insulators as they have more discs. The insulator and conductor replacement will allow the OHL to transfer a higher capacity of power.

Tower refurbishments

The new conductor is heavier than the existing conductor therefore some of the tower steelwork and foundations will need to be strengthened.

The refurbishments and upgrades to the steelwork and foundations will take place ahead of replacing the conductors.

Access requirements

To access the towers, we will use a variety of methods including the construction of new stone access tracks, use of existing tracks, laying of trackway panels on favourable terrain or by all-terrain vehicle.

We will agree any access requirements with the relevant landowners and secure consent, where required, before commencing works.

Operational corridor requirements

The operational corridor is calculated based on achieving OHL resilience from tree fall.

The upgrading from 275kV to 400kV will result in the need for a wider operational corridor which could equate to a potential 89m full operational corridor width from woodland edge to woodland edge. Requirements will be assessed through the detailed design process.



Conductor replacement



Insulator replacement



Tower refurbishments



Access Tracks



ssen-transmission.co.uk/alyth-tealing



tkup@sse.com



ssen-transmission.co.uk/tealing-westfield


Project interfaces

Tealing substation

The existing OHL will be upgraded from Alyth substation to Tower 685, north-west of the existing site. To enable the operation of the OHL at 400kV, the existing OHL will be connected into the new 400kV substation being developed.

This will be achieved by the construction of a new OHL originating at some point between the existing line between Tower 680 and Tower 682. This will enable the removal of approximately 1.5km of redundant OHL between tower 682 to the existing substation.

A separate Section 37 consent for the new build tie-in and removal of existing towers will be submitted to the Energy Consents Unit.

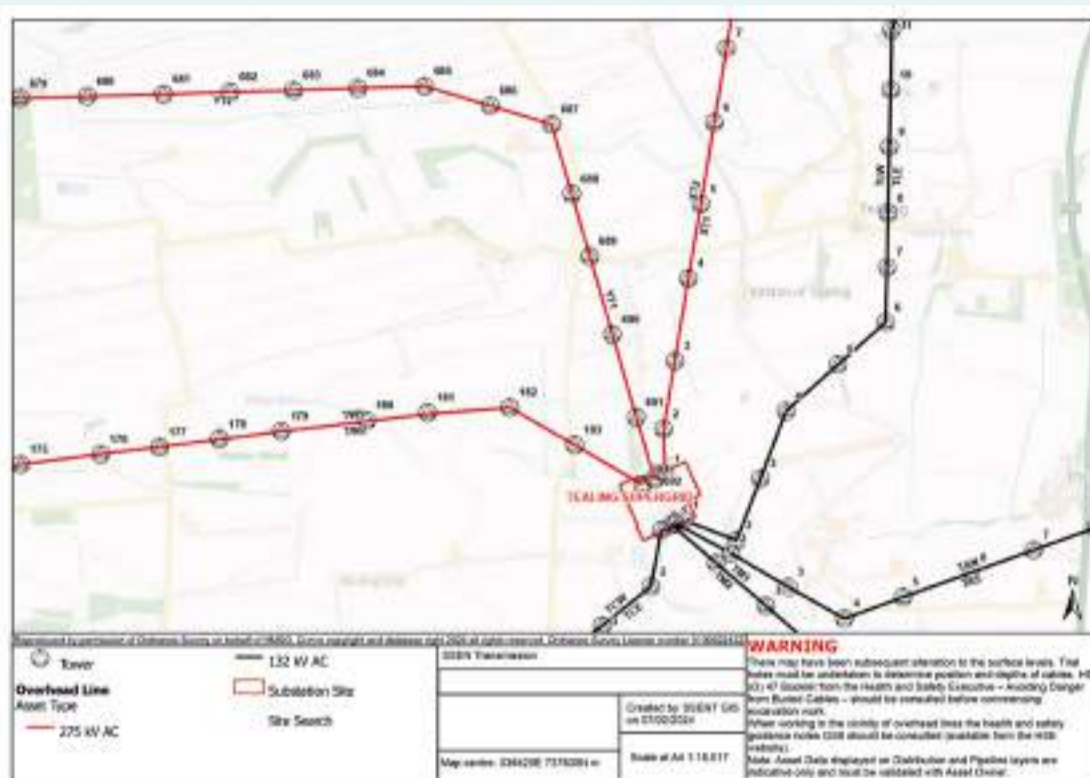


Alyth substation

Alyth substation is currently under construction and will be energised for operation at 400kV in 2026.

A Section 37 consent was granted in March 2020 for a new OHL configuration to connect the substation into the network for 2023.

When the OHL is ready for energisation some additional works will be required within the substation, including the removal of the transformers, to enable operation at 400kV.

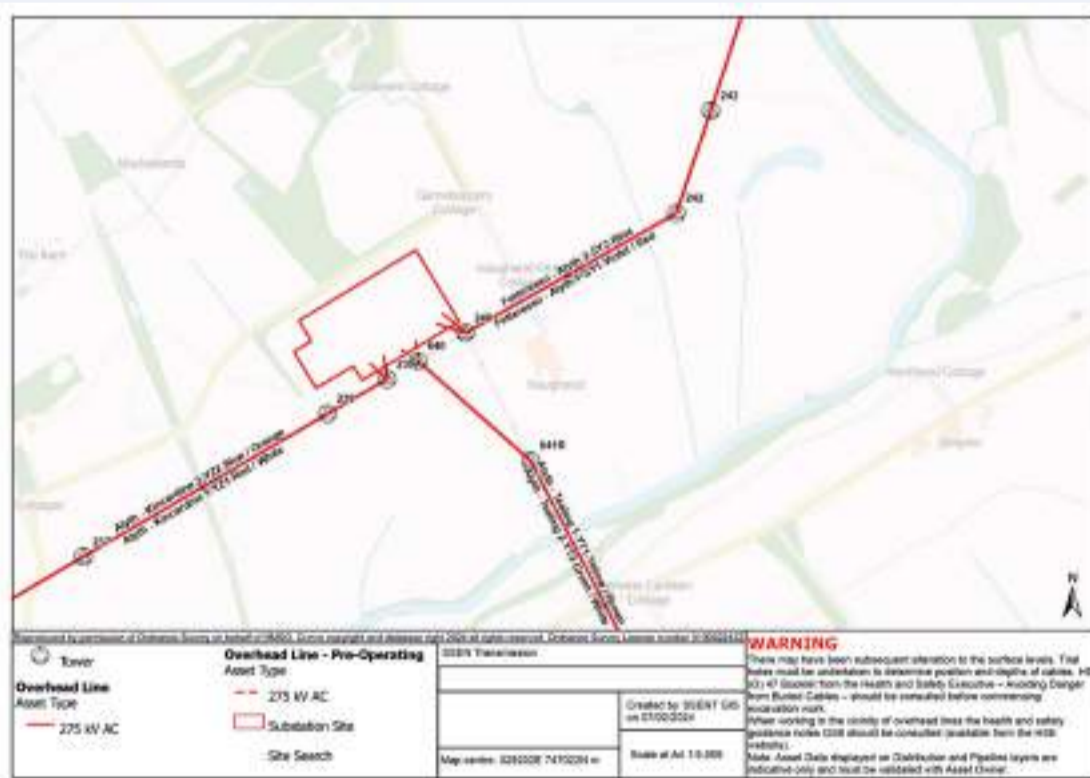

Environmental considerations

These projects are proposed as an upgrade to the existing OHL network between Alyth and Tealing substations as well as Tealing and Westfield substations and does not involve the construction or introduction of any new steel lattice towers. An Environmental Impact Assessment is required as part of the Section 37 consent application under the Electricity Act 1989. An EIA Scoping Report will be prepared and submitted to the Energy Consents Unit of the Scottish Government to agree which environmental elements should be taken into consideration as part of the assessment.

Ornithology

The OHL does not pass through any sites designated for ornithological interests. There are however likely to be breeding birds in the vicinity of the existing OHL, in particular lekking black grouse, raptors and upland waders. There will also be bird flight activity in proximity to, and across the line.

Mitigation measures will be required to avoid or minimise effects on these birds during the construction phase and a full suite of required bird surveys will be carried out and the scope agreed with NatureScot.

Water environment

The OHL passes over or near to a number of river catchments and watercourses. Several towers are located in areas of potential flood risk but with mitigation measures the project is not anticipated to increase flood risk or have a detrimental impact on water quality.

Private water supplies will be identified and assessed to determine the potential risk to any supplies.

Where required, measures will be put in place to ensure that the quality and quantity of water from these supplies would not be adversely affected.

Visual effects

There would be limited material change to the appearance of the OHL following the reinforcement works as the associated fittings will be visually similar to those present already, albeit the existing twin conductors would be replaced with triple conductors.

Some visual effects would result during the construction from temporary works as crew and machinery move along the line to replace the conductors and fittings and works and from tree felling associated with the creation of a 400kV operational corridor.

Terrestrial and aquatic ecology

The OHL crosses primarily agricultural land, utilised for arable crops and pasture, as well as areas of woodland, running and standing water.

Within the corridor for the Alyth to Tealing OHL there is a single Special Area of Conservation (SAC) (River Tay SAC - Dean Water and River Isla), and three Ancient Woodland Inventory (AWI) woodlands of Long-Established Plantation Origin (LEPO). Within the corridor for the Tealing to Westfield OHL there is a single Special Area of Conservation (SAC) (River Tay SAC) and a short distance upstream is the Firth of Tay and Eden Estuary Special Protection Area (SPA) and Ramsar site and four Ancient Woodland Inventory (AWI) woodlands of Long-Established Plantation Origin (LEPO) which cross the existing line and a further three which are within the vicinity of the line.

There are no other designated sites, including Locally Designated Sites. A single area of peat is present for the Alyth to Tealing OHL and a single area of lowland raised bog (lowland raised bog inventory) was identified during the desk study for the Tealing to Westfield OHL. Surveys identified a number of habitats that are listed on the Scottish Biodiversity List and are therefore considered to be of principal importance for biodiversity conservation in Scotland.

Most are also Tayside Local Priority habitats. Targeted surveys and species protection plans would be put in place to minimise potential effects on protected species during construction.

Cultural heritage

A limited number of non-designated assets have been recorded within 100m of the current OHL, although most are set some distance away from the existing towers.

As a result, physical impacts should be limited to the access tracks and other associated supporting works that might be required.

In addition, there is the potential for physical impacts for the Alyth to Tealing OHL on Cardean Roman Camp at the north end of the Scheme (SM4337) as one of the existing towers fall within the scheduled monument, for the Tealing to Westfield OHL there is the potential for physical impacts on designated assets including, Dronley House Mound (SM6535), East Adamston unenclosed settlement and souterrain (SM6465), South Inchmichael unenclosed settlement (SM7199) and Megginch Castle Garden and Designed Landscape (GDL00278). Any works in these areas will require careful consideration and potentially require Scheduled Monument Consent.

Further consultation will be required with Statutory Consultees with regard to any direct impacts and suitable mitigation that may be required.

A programme of archaeological works will be implemented, and recommendations provided to minimise the potential effects on assets during construction will be presented in the Construction Environmental Management Plan (CEMP), identifying known cultural heritage assets within close proximity to existing towers and proposed access routes.

Traffic and transport

A Construction Traffic Management Plan (CTMP) will be developed and used to specify construction traffic routes to suitable roads and appropriately signed diversions, where required during the construction phase of the works. This will be prepared in agreement with Perth and Kinross and Angus Councils.

Noise

Construction noise is considered to be short-term and intermittent and will be controlled through the implementation of a Noise Management Plan. An assessment of operational noise will be undertaken, in discussion with the Environmental Health Departments of Perth and Kinross and Angus Councils.

Electromagnetic fields

Electromagnetic Fields (EMF) arise from electric charges and current flow. Exceedance of EMF exposure limits are not expected, but an assessment of the change in EMF strengths due to the OHL operating at 400kV will be undertaken and the results will be presented alongside exposure limits.



ssen-transmission.co.uk/alyth-tealing



tkup@sse.com



ssen-transmission.co.uk/tealing-westfield

Feedback


The following feedback was received during the first of two series of public consultation events held between 4 – 7 March 2024 in relation to the Section 37 consent applications for the upgrade of the Alyth to Tealing and Tealing to Westfield overhead lines from 275kV to enable operation at 400kV. A total of 163 people attended the events.

During the 6 week feedback period which closed on 15 April 2024, 15 responses were received and these are set out using a theme based approach below. We have included both event feedback and statutory stakeholder feedback received through the consultation process.

Theme	Response
<p>Electro Magnetic Field (EMF) Concerns regarding people living close to the Overhead Lines (OHL) and the health risk associated with the increase in voltage.</p>	<p>We would like to reassure the public and communities that we develop, build and operate our infrastructure to meet all health and safety legislation and guidance set by relevant bodies - including the UK Government, Scottish Government, the Health and Safety Executive and our regulator, Ofgem – including that associated with Electro Magnetic Fields (EMFs).</p> <p>In respect of EMFs, we strictly follow the guidance as set by the UK Government, which in turn is informed by international guidance.</p> <p>As well as setting exposure limits that protect against known, established effects of EMF; the UK Government’s guidance also includes precautionary measures to protect against possible effects below the exposure limits that have not been established by science.</p> <p>In addition to this, the UK Health Security Agency and Department of Health have a remit to review new research in this area and ensure that current guidelines and policies are reflective of that research.</p> <p>Furthermore, the UK Government’s latest policy on EMF is set out in National Policy Statement EN-5, (NPS EN-5) which was reissued in November 2023 and came into force on 17 January 2024. This latest policy is reflective of that review process and in line with the NPS EN-5, the current UK Government guidance, informed by relevant international guidance, is therefore still considered appropriate by the UK Government and their public health experts. Whilst electricity consenting decisions are devolved to Scottish Ministers and the NPS EN-5 is therefore not all relevant in Scotland, we can confirm compliance with all EMF guidance as set out in the NPS EN-5.</p> <p>There have been over four decades of research looking into whether EMF can cause health effects and there are no established effects below the exposure limits. When we design our overhead lines, substations and cables we do so to ensure they will not exceed those exposure limits, even when operating at 100% capacity. We also ensure that precautionary measures are also applied to the design where required. We will provide information on compliance as part of the consenting process, which will be publicly available.</p> <p>In summary, the guidance we follow, which remains subject to ongoing review as required, ensures that safety measures will be applied to our 400kV overhead line infrastructure protecting us all against EMF exposure, keeping our network safe for the public.</p>
<p>OHL noise Concerns regarding noise from operation of OHLs.</p>	<p>A Noise Impact Assessment is currently being prepared and will be submitted as part of the forthcoming S37 consent application.</p> <p>This will identify any adverse noise impacts that may result from construction activities and will propose appropriate mitigation in response that will be finalised in agreement with the relevant Planning Authorities and the Energy Consents Unit (ECU).</p>

Feedback

Theme	Response
<p>Benefit to local population Queries regarding how the local population might benefit from the proposals i.e. cleaner, cheaper energy.</p>	<p>The proposed development forms part of the Pathway to 2030, a series of projects to increase the capacity of the transmission network in northern Scotland. It is part of the national effort to upgrade power lines across Great Britain to connect and transport renewable electricity to communities around Scotland and beyond, especially from offshore wind farms.</p> <p>In terms of Community Benefit, we have consulted on a Community Benefit Fund for projects until 2026, a first for a transmission operator in Scotland. This fund lets us work directly with local communities to support initiatives in northern Scotland.</p> <p>We want to give back to the communities hosting our transmission network and to help fund projects that can leave a lasting, positive legacy in those areas. We're encouraging the UK Government and Ofgem to recognise the crucial role the north of Scotland plays in energy targets in any upcoming guidance, ensuring that community benefits will reflect this significance.</p> <p>Additionally, our projects will boost the economy, supporting local jobs and businesses. Recent studies show our Pathway to 2030 programme could contribute over £6bn to the UK's economy, support 20,000 jobs across the UK, and benefit Scotland by around £2.5bn, supporting 9,000 jobs.</p>
<p>Consultation events It was raised that consultations should occur over a number of weeks to give more people the chance to attend.</p>	<p>In March 2024, a series of consultation events were held at four locations along the project routes Alyth to Tealing OHL and Tealing to Westfield OHL. Information was displayed at each of those events and staff were on hand to answer queries. All information is also available to view on the SSEN Transmission project webpage and each consultation period is open for six weeks. Additional consultation is due to take place in early June 2024 with an additional six week consultation period open for people to view material and provide feedback.</p>
<p>Consultation with landowners Concern raised that there hasn't been direct communication with all those closely affected.</p>	<p>In addition to the series of public consultation events taking place in March and June 2024, specific to the proposed development, the SSEN Transmission's team of Land Managers are in the process of identifying and contacting all potentially affected landowners.</p>
<p>Energy at the point of need Concern raised that the work being carried out will ultimately not be for Scotland's benefit noting that projects should be located where energy is required.</p>	<p>SSEN Transmission is responsible for where and how the high voltage transmission network operates in the north of Scotland. However, we don't determine where energy is generated – nor where it is needed.</p> <p>We have a legal obligation to provide electricity generators access to our network, so that the electricity they generate can be transported across the GB to meet the energy demand of homes and businesses.</p> <p>The north of Scotland is rich in renewable energy, especially wind, water, and marine sources meaning this region is vital for the UK and Scotland's climate goals. Our area covers a quarter of the UK landmass and will be crucial in the move towards a low carbon future.</p>
<p>Undergrounding of OHLs A query raised regarding the potential undergrounding of OHLs to reduce impact.</p>	<p>Whilst we are committed to exploring the possibility of undergrounding at sensitive locations where there is clear evidence to justify it, this presents significant challenges due to a range of technical, operational, environmental and economic factors and may not always be the best option from an environmental perspective. In particular, it may not represent the best solution for landowners due to the greater footprint and associated impact on agricultural land as well as the requirement for additional above ground infrastructure to manage system requirements. Further information on the challenges and costs involved can be found in our undergrounding briefing note: 2030 challenges (ssen-transmission.co.uk/globalassets/projects/2030-projects/2030-project-documents/2030-challenges-doc.pdf)</p>



ssen-transmission.co.uk/alyth-tealing




tkup@sse.com



ssen-transmission.co.uk/tealing-westfield

Feedback

Theme	Response
<p>Wildlife and biodiversity Concerns that there will be a detrimental impact on wildlife and biodiversity.</p>	<p>We prioritise environmental protection in our infrastructure projects, strictly adhering to environmental policies and regulations. We follow a mitigation hierarchy strategy of “avoid, minimise, mitigate and restore” to safeguard local, national and internationally designated environmentally protected areas.</p> <p>We also acknowledge that minimising impacts is not enough on its own, and we have therefore committed to delivering a Biodiversity Net Gain (BNG) on all our projects; as well as compensatory planting for any trees felled during the construction phase, where possible with native species.</p> <p>During our assessments, comprehensive surveys identify potentially affected wildlife, guiding mitigation efforts. Ecology survey work is ongoing.</p> <p>We also assess habitats and other species along our routes. Our consultation process to date has highlighted sensitive areas, and we continue to work with environmental experts and seek community feedback to refine our approach.</p>
<p>Cultural heritage Concern regarding impact on Scheduled Monuments.</p>	<p>When planning our overhead line projects, we consider environmental, cultural, and built heritage impact.</p> <p>We make use of national archives and data sources as well as gathering data from Local Authorities and detailed site surveys to identify and assess the potential impact on archaeological sites, listed buildings, and other heritage assets.</p> <p>Environmental Impact Assessment Reports (EIARs) detail these findings and recommend ways to lessen any potential adverse effects. We’ve received feedback about sensitive archaeological and cultural sites from a range of stakeholders all of which our environmental experts have considered. Where there is the potential for direct impact on a Scheduled Monument, we will discuss this with Historic Environment Scotland and seek Scheduled Monument Consent where required.</p>
<p>Construction Concerns about impact on the local area.</p>	<p>Construction working hours will typically be restricted to 0700 hours to 1900 hours Monday to Friday and 0700 hours to 1300 hours on Saturday, with only some continuous activities carried out by exception.</p> <p>The Contractor will prepare and adopt a Construction Environmental Management Plan (CEMP) to minimise any potential impacts during construction. These documents will be approved by the Planning Authority and ECU in advance of construction starting and will include contact details for the Construction Site Manager, who will be the main point of contact with the local community during construction.</p> <p>In addition the Contractor will prepare and adopt a Construction Traffic Management Plan (CTMP) to ensure that appropriate mitigation and management strategies are identified and implemented. This will include the identification of any road widening, junction improvements or repairs that will be required. Condition surveys of the public highway will be carried out before works start on site, and again upon completion, with any defects repaired to ensure the public highway is left in no worse state once the works are complete.</p>
<p>Other statutory and non-statutory consultees</p>	<p>Additional feedback was also received from statutory and non statutory consultees which will be taken into account as the projects progress. Discussion with consultees and others will continue as required at the pre application stage and thereafter.</p>



ssen-transmission.co.uk/alyth-tealing





tkup@sse.com



ssen-transmission.co.uk/tealing-westfield

Project timeline

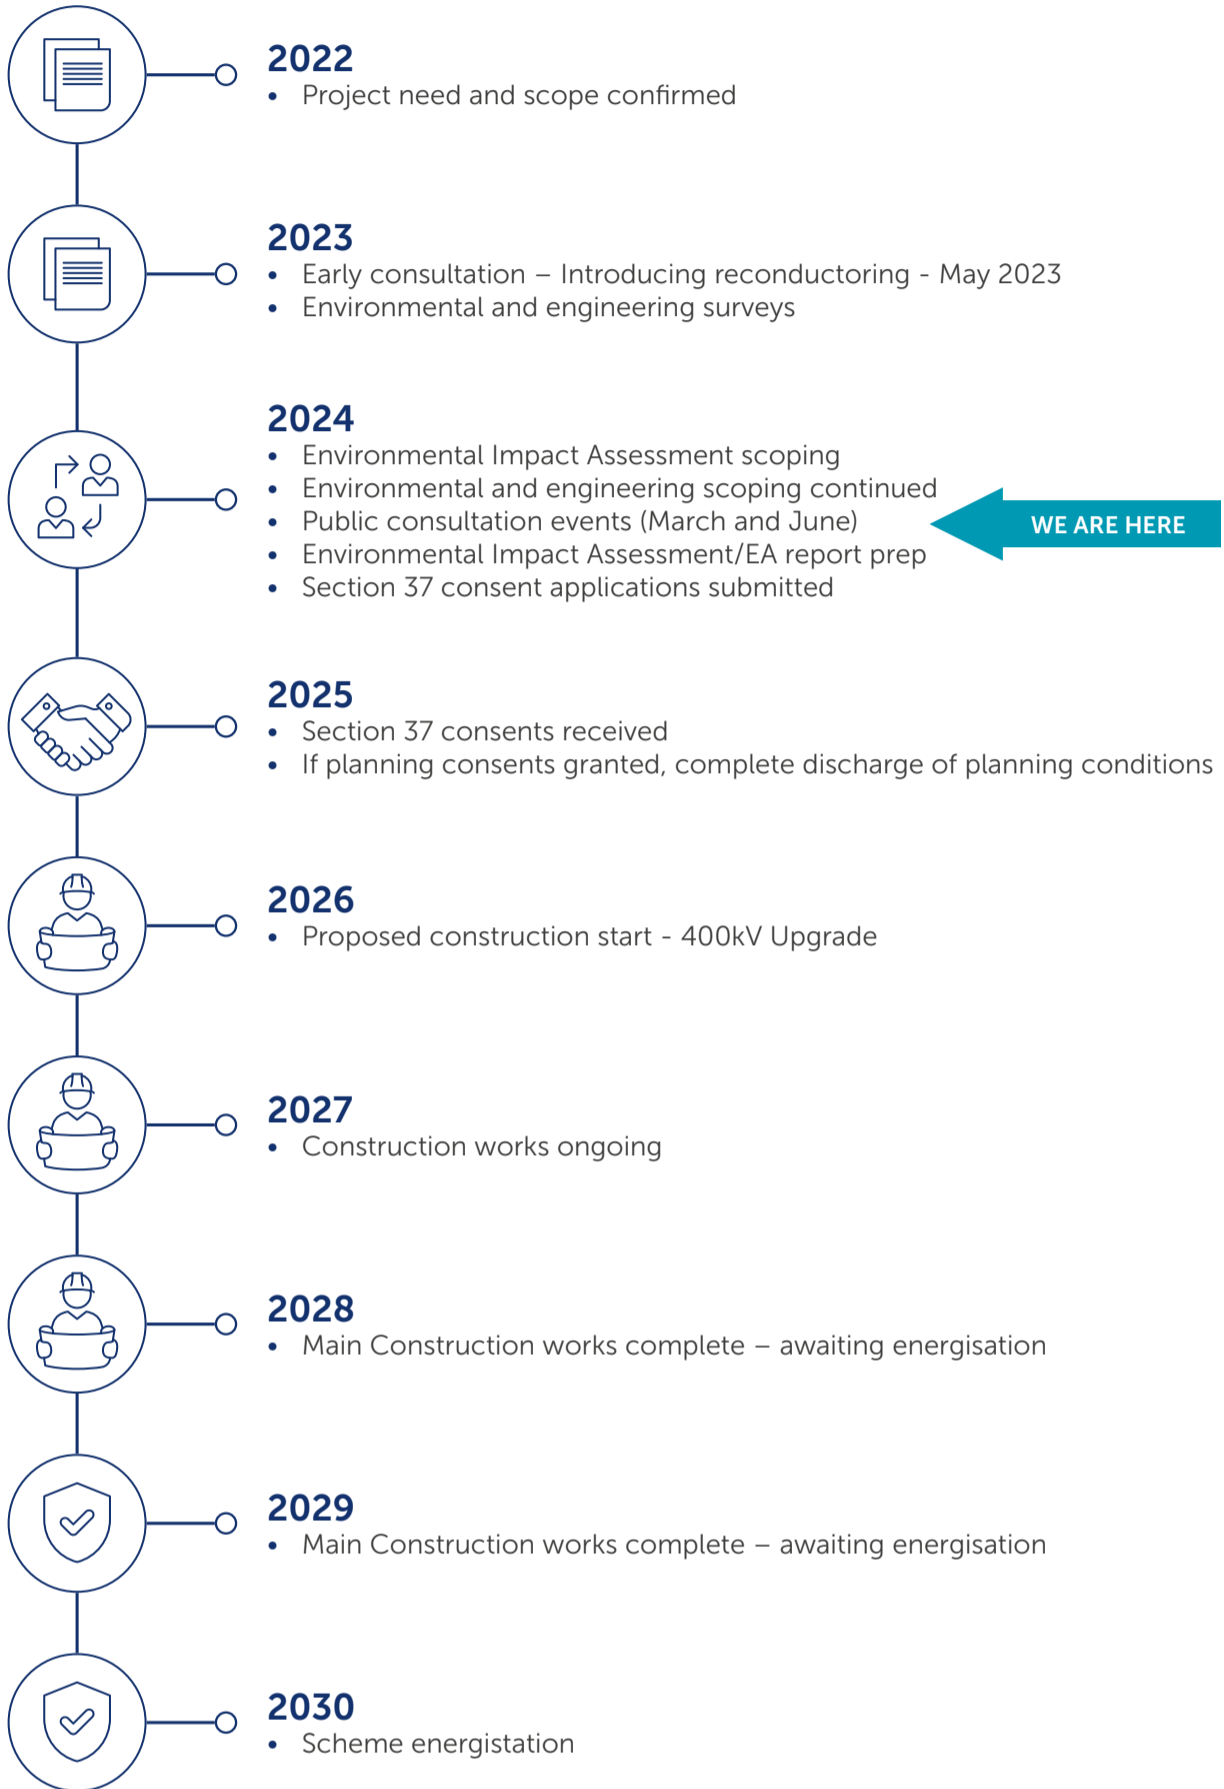

Have your say

We value community and stakeholder feedback. Without this, we would be unable to progress projects and reach a balanced proposal.

The feedback period

We will accept feedback from now until 18 July 2024.

How to provide feedback

Submit your comments and feedback by emailing or writing to your Community Liaison Manager

Any comments made to us as the Applicant are not representations to Scottish Ministers as the decision makers. There will be an opportunity to make formal representations to Scottish Ministers via the Energy Consents Unit following the submission of the section 37 applications.

What we're seeking views on

During our last public consultation events in March 2024, we wanted to know your thoughts on our project plans, where you thought we could make improvements, and any changes and refinements we'd made.

We are now asking for any final comments or feedback ahead of submitting planning applications for the Alyth - Tealing and Tealing - Westfield OHL 400kV upgrade projects.

Our Community Liaison Team

Each project has a dedicated Community Liaison Manager who works closely with community members to make sure they are well informed of our proposals and that their views, concerns, questions or suggestions are put to our project teams.

Throughout the life of our projects, you will hear from us regularly. We aim to establish strong working relationships by being accessible to key local stakeholders such as community councils, residents' associations and development trusts, and regularly engage with interested individuals.

Community Liaison Manager

Rhiannon Merritt
Community Liaison Manager

SSEN Transmission
10 Henderson Road,
Inverness, IV1 1SN

E: tkup@sse.com



Additional information

The best way to keep up to date is to sign up to project updates via the project webpages: ssen-transmission.co.uk/alyth-tealing or ssen-transmission.co.uk/tealing-westfield

You can also follow us on social media

 [SSEN-Transmission](#)

 [SSETransmission](#)



To support everyone online, we provide accessibility and language options on our website through 'Recite Me'. The accessibility and language support options provided by 'Recite Me' include text-to-speech functionality, fully customisable styling features, reading aids, and a translation tool with over 100 languages, including 35 text-to-speech.

Please select "Accessibility" on our website to try out our inclusive toolbar.

 ssen-transmission.co.uk/alyth-tealing

 tkup@sse.com

 ssen-transmission.co.uk/tealing-westfield

APPENDIX F: CONSULTATION FEEDBACK BOOKLET EVENT 2



Scottish & Southern
Electricity Networks

TRANSMISSION

Tealing - Westfield Overhead Line 400kV Upgrade

Consultation Booklet

June 2024



ssen-transmission.co.uk/tealing-westfield

Contents

Powering change together	1	Help shape our plans	10
The Pathway to 2030	2	Feedback	11
Project overview	4	Project timeline	14
Project details - Overhead Lines	6	Have your say	15
Project interfaces	7	Notes	16
Environmental considerations	8		


The consultation events will be taking place on:

Monday 3 June, 2–7pm, Errol Village Hall, Errol

Tuesday 4 June, 2–7pm, Tayside Institute, Newburgh

Wednesday 5 June, 2–7pm, Tealing Village Hall, Tealing

Thursday 6 June, 2–7pm, Alyth Town Hall, Alyth

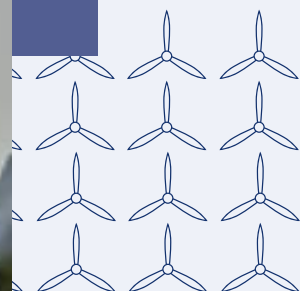

Powering change together



The time has come to further enhance Scotland's energy infrastructure, providing power for future generations as we move towards net zero.

The shift to a cleaner, more sustainable future is about more than climate change. It's about ensuring future generations have the same opportunities to thrive as we have all had.

Countries around the world are investing in their energy infrastructure to support the demands of modern economies and meet net zero targets. The UK is leading the way in building a modern, sustainable energy system for the future.

We all have a part to play

When it comes to net zero, we have to be in it together. The UK and Scottish Governments have ambitious net zero targets, and we're playing our part in meeting them.

We work closely with National Grid Electricity System Operator to connect vast renewable energy resources – harnessed by solar, wind, hydro and marine generation – to areas of demand across the country. Scotland is playing a big role in meeting this demand, exporting two-thirds of power generated in our network.

But there's more to be done. By 2050, the north of Scotland is predicted to contribute over 50GW of low carbon energy to help deliver net zero. Today, our region has around 9GW of renewable generation connected to the network.

At SSEN Transmission, it is our role to build the energy system of the future.

We're investing £20 billion into our region's energy infrastructure this decade, powering more than ten million UK homes and 20,000 jobs, 9,000 of which will be here in Scotland.



Find out more

Scan the QR code with your smartphone to find out more about how these policies have been assessed and determined.

Who we are

We're responsible for maintaining and investing in the electricity transmission network in the north of Scotland. We're part of SSE plc, one of the world's leading energy companies with a rich heritage in Scotland that dates back more than 80 years. We are also closely regulated by the GB energy regulator Ofgem, who determines how much revenue we are allowed to earn for constructing, maintaining and renovating our transmission network.

What we do

We manage the electricity transmission network across our region which covers a quarter of the UK's landmass, crossing some of the country's most challenging terrain. We connect renewable energy sources to our network in the north of Scotland and then transport it to where it needs to be. From underground subsea cables and Overhead Lines (OHL) to electricity substations, our network keeps your lights on all year round.

Working with you

We understand that the work we do can have an impact on our host communities. So we're committed to minimising our impacts and maximising all the benefits that our local developments can bring to your area.

We're regularly assessed by global sustainability consultancy AccountAbility for how we engage with communities. That means we provide all the information you need to know about our plans and how they will impact communities like yours. We want to hear people's views, concerns, or ideas and harness local knowledge so that our work benefits their communities: today and long into the future. You can share your views with us at: ssen-transmission.co.uk/talk-to-us/contact-us

The Pathway to 2030

Building the energy system of the future will require a delivery of significant infrastructure over the next few years. In partnership with the UK and Scottish Governments, we're committed to meeting our obligation of connecting new, renewable energy to where it's needed by 2030.

Achieving net zero

By 2030, both the UK and Scottish governments are targeting a big expansion in offshore wind generation of 50GW and 11GW respectively. The Scottish Government has also set ambitious targets for an additional 12GW of onshore wind by 2030.

Across Great Britain, including the north of Scotland, there needs to be a significant increase in the capacity of the onshore electricity transmission infrastructure to deliver these 2030 targets and a pathway to net zero.

Securing our energy future

And it's not just about net zero. It's also about building a homegrown energy system, so that geopolitical turmoil around the world doesn't severely impact the UK and push up energy prices. The UK Government's British Energy Security Strategy further underlines the need for this infrastructure, setting out plans to accelerate homegrown power for greater energy independence.

The strategy aims to reduce the UK's dependence on and price exposure to global gas wholesale markets through the deployment of homegrown low-carbon electricity generation supported by robust electricity network infrastructure.

Meeting our 2030 targets

In July 2022, National Grid, the Electricity System Operator (ESO), published the Pathway to 2030 Holistic Network Design (HND).

This set out the blueprint for the onshore and offshore transmission infrastructure that's required to support the forecasted growth in the UK's renewable electricity.

It's an ambitious plan that will help the UK achieve net zero.

What does this mean for you?

The east of Scotland will play a key role in meeting these goals. The extensive studies that informed the ESO's Pathway to 2030 HND confirmed the requirement to increase the power transfer capacity of the onshore corridor from Kintore to Tealing.

This requires a 400kV connection between these sites to enable the significant capability needed to take power from onshore and large scale offshore renewable generation, connecting on the east coast of Scotland before transporting power to areas of demand.

As part of these plans, we're proposing to build a new 400kV OHL between Kintore and Tealing. This also requires two new 400kV substations to be constructed in Fetteresso Forest and Tealing to enable future connections and export routes to areas of demand.

In addition, two of the existing 275kV OHL out of the existing Tealing substation to Alyth and Westfield require upgrades to 400kV operation and to be connected to the proposed new Tealing 400kV site.

These five projects, collectively are called the Kintore to Tealing 400kV projects, and are seen as critical to enable the delivery of the UK and Scottish Government's targets.


Future network investment requirements

Our 2030 targets are the first step on the transition to net zero. The UK Government has a target to decarbonise our electricity system by 2035 and fully decarbonise our economy by becoming net zero by 2050, with the Scottish Government committing to net zero five years earlier, by 2045. To achieve these targets, further investment in new low carbon electricity generation and the enabling electricity transmission network infrastructure will be required.

The next stage of strategic network planning across Great Britain has now been outlined in the independent Electricity System Operator, National Grid ESO's, 'Beyond 2030' report, published in March this year. For the north of Scotland, the ESO's plan recommends several new and upgraded onshore and offshore reinforcements that the ESO has assessed are required to help deliver net zero targets.

These projects, which will be subject to extensive public consultation, are at the very early stages of development and further details will be set out in due course.

- New infrastructure
- - -** Upgrade/replacement of existing infrastructure
- Existing network

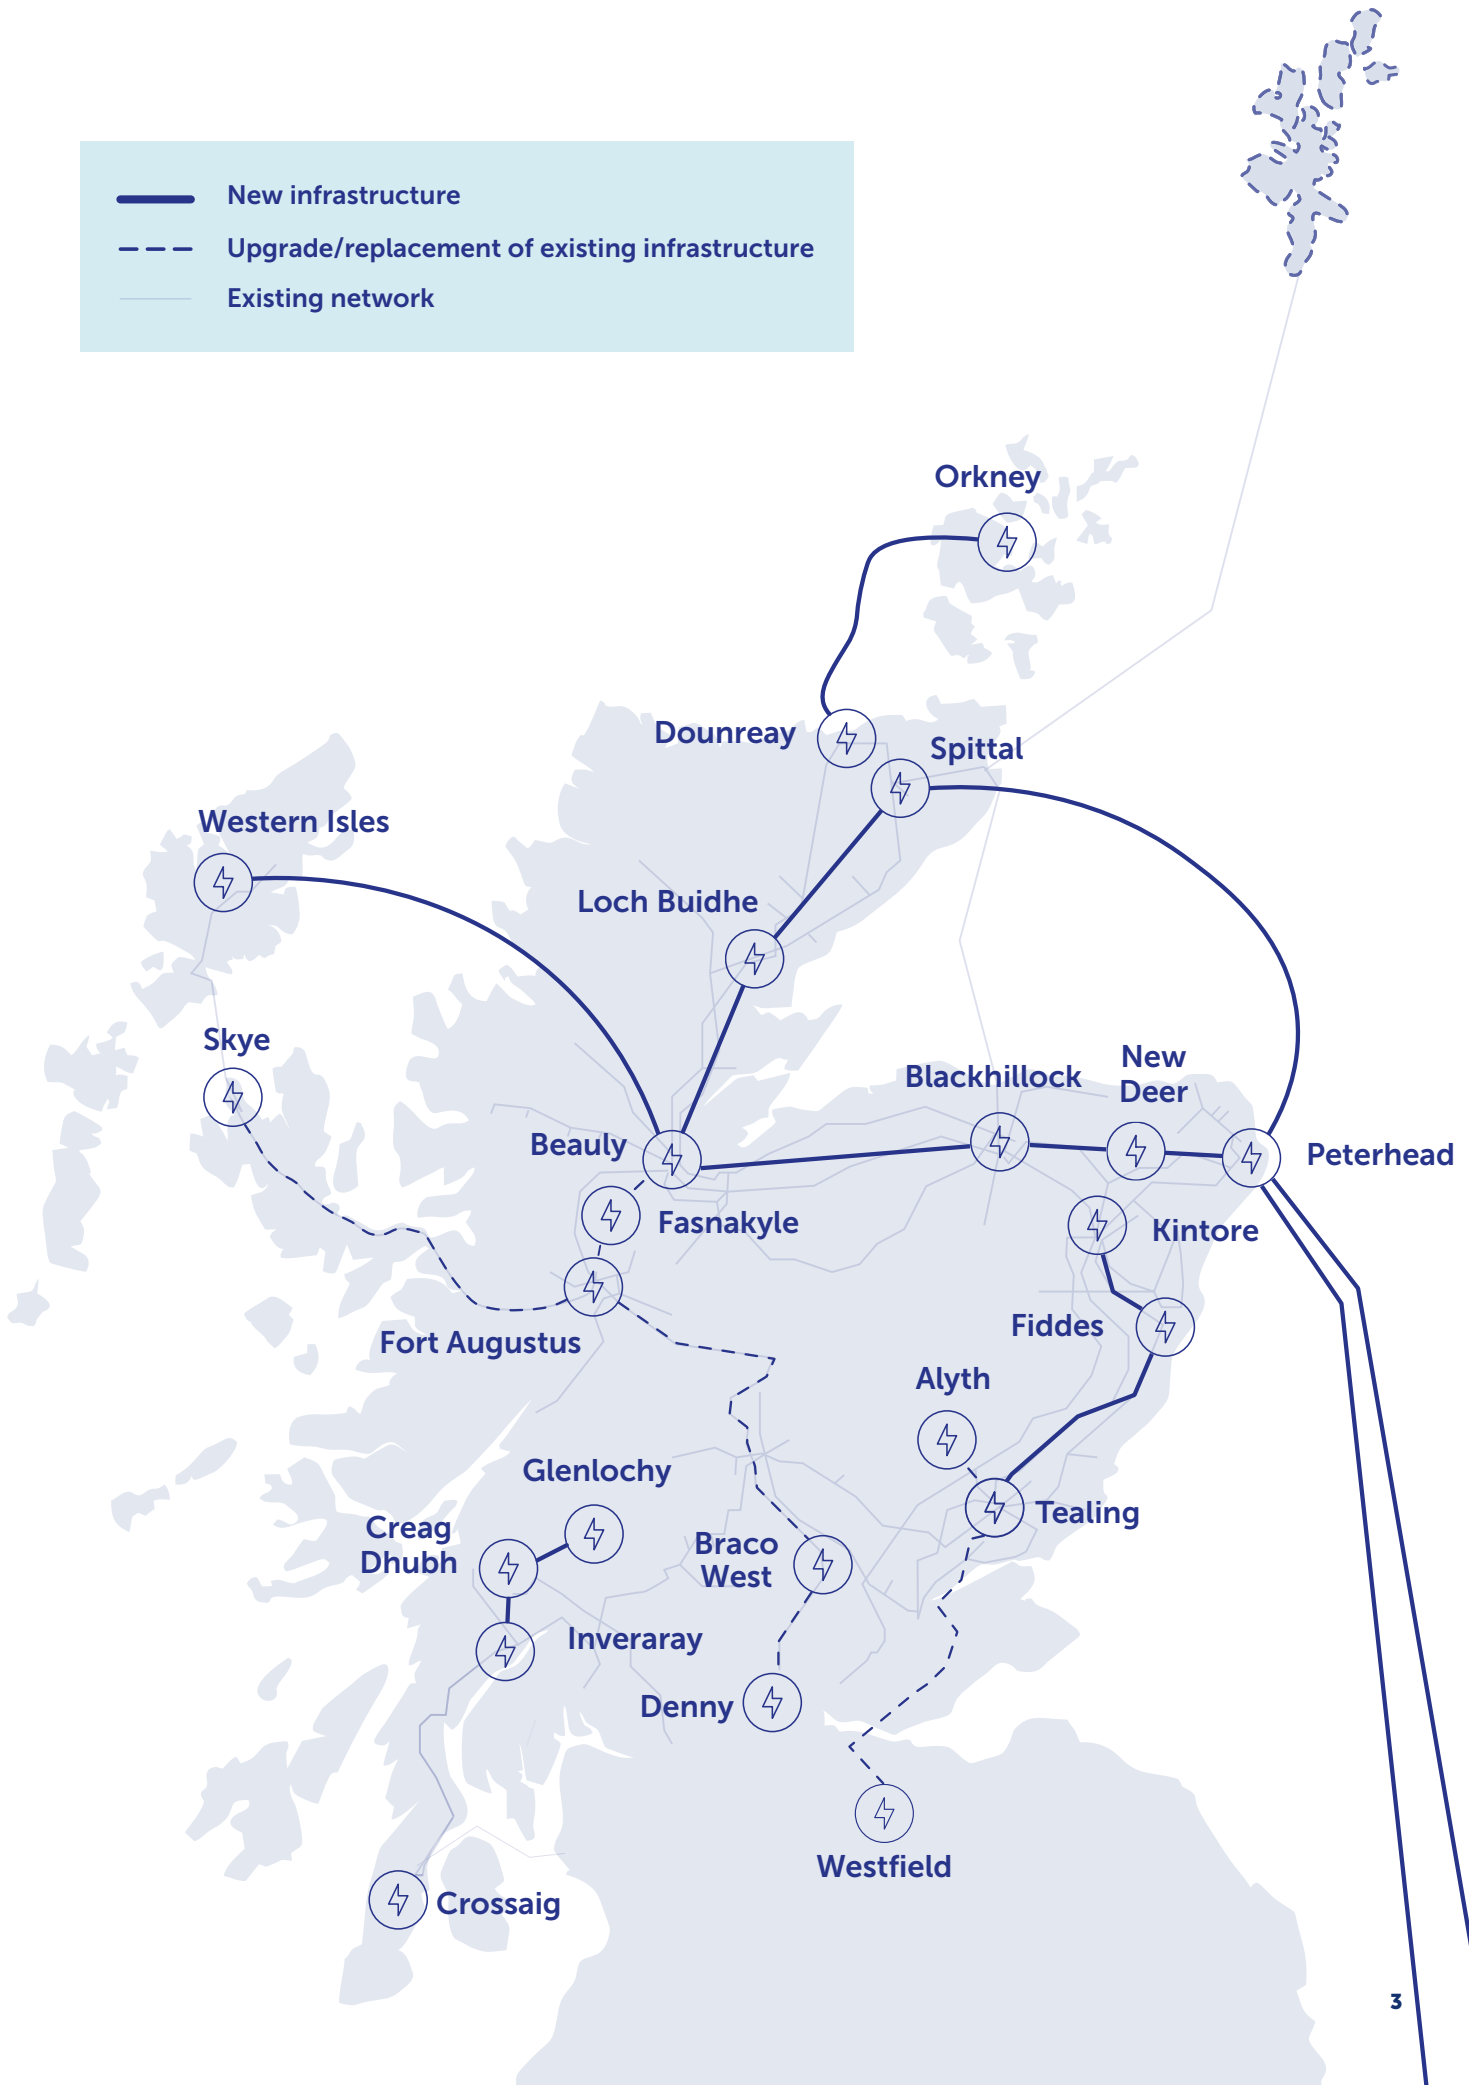

Project overview

As the transmission network owner for the north of Scotland, Scottish and Southern Electricity Networks Transmission (SEN Transmission) are responsible for the maintenance of the existing transmission network and also ensuring that the current network can facilitate connection requests from developers when necessary.

The reconductoring of the existing Tealing to Westfield OHL has been identified as part of the National Grid ESO's Holistic Network Design (HND).

This project will upgrade the line from 275kV to 400kV to facilitate the transition to net zero in line with the UK Government target of achieving net zero by 2050.

This booklet focuses on the upgrades, required to the OHL between Tealing and Westfield substations which crosses the boundary into Scottish Power Transmission's (SPT) Licence area.

Approach to consenting

An application for Section 37 (S37) consent will be made under the Electricity Act 1989 for the upgrade of the existing OHL to operate at 400kV.

This application is made to the Energy Consents Unit (ECU) of the Scottish Government.

The S37 will cover all aspects of the OHL works, including replacement of insulators and conductors, tower and foundation repairs, ground reprofiling, all associated works and the provision of access tracks to enable these works.

The application will be accompanied by an Environmental Impact Assessment (EIA) Report.

We will be submitting an EIA Scoping Report to the ECU soon, which, in collaboration with statutory and non-statutory consultees, will determine the scope of issues to be considered in the EIA Report.


The scope to carry out some of the works, either as permitted development or through separate planning consent, in advance of obtaining S37 consent is currently being explored.



The OHL upgrade works would involve replacing the conductors, insulators and fittings on the existing OHL steel lattice towers between the existing Tealing substation and the SSEN Transmission boundary with Scottish Power Energy Networks (SPEN) licence area.

This project would upgrade the capability of the line from 275kV to 400kV to facilitate the transition to net zero inline with the UK and Scottish Government targets.

A new substation is being advanced through a planning application process on land to the west of the existing substation. Any tie-ins to the new substation from the existing line will be advanced via a separate S37 consent.

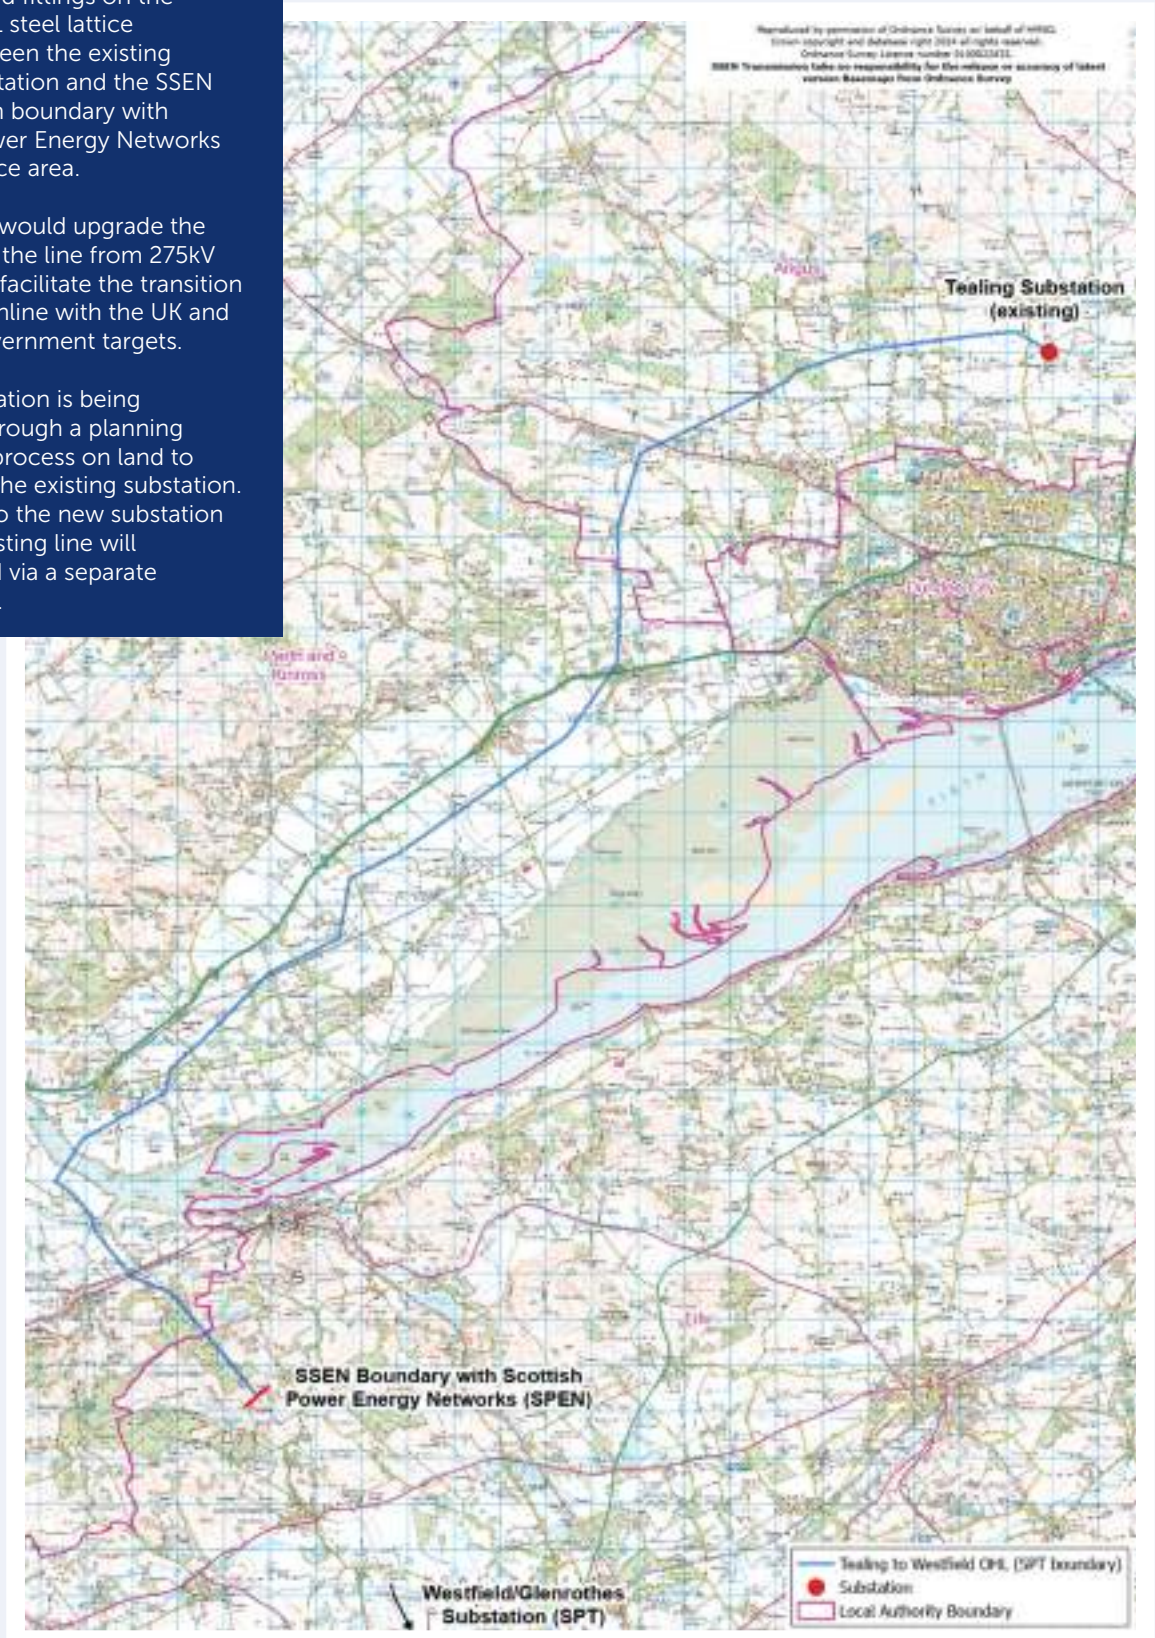

Project details - Overhead Lines

Conductor replacement

The existing conductor is Twin Zebra Aluminium Conductor Steel Reinforced (ACSR) Conductor. This conductor has been in place since the OHL was constructed in 1963 and 1973 and is due for replacement.

The replacement conductor that will be used is a Triple bundle and the proposed conductor is still to be determined.

Insulator replacement

The existing 275kV insulators will be replaced with 400kV insulators.

These are slightly longer than the existing insulators as they have more discs. The insulator and conductor replacement will allow the OHL to transfer a higher capacity of power.

Tower refurbishments

The new conductor is heavier than the existing conductor therefore some of the tower steelwork and foundations will need to be strengthened.

The refurbishments and upgrades to the steelwork and foundations will take place ahead of replacing the conductors.

Access requirements

To access the towers, we will use a variety of methods including the construction of new stone access tracks, use of existing tracks, laying of trackway panels on favourable terrain or by all-terrain vehicle.

We will agree any access requirements with the relevant landowners and secure consent, where required, before commencing works.

Operational corridor requirements

The operational corridor is calculated based on achieving OHL resilience from tree fall. The upgrading from 275kV to 400kV will result in the need for a wider operational corridor which could equate to a potential 89m full operational corridor width from woodland edge to woodland edge. Requirements will be assessed through the detailed design process.



Conductor replacement



Insulator replacement



Tower refurbishments




Access Tracks

Project interfaces

Tealing substation

We will carry out the works to upgrade the existing OHL from the Scottish Power Energy Networks (SPEN) boundary, south of Abernethy, to our existing Tealing substation. To enable the operation of the OHL at 400kV, it will be connected into the new 400kV substation being developed. This will be achieved by the construction of a new OHL originating at some point on the existing line between Tower 180 and Tower 182. This will result in a redundant section of OHL between Tower 182 and the existing substation. It is intended that this will be reused to make a connection between the new 400kV site and the existing site.


A separate Section 37 consent for the new build tie-in and removal of existing towers will be submitted to the Energy Consents Unit.

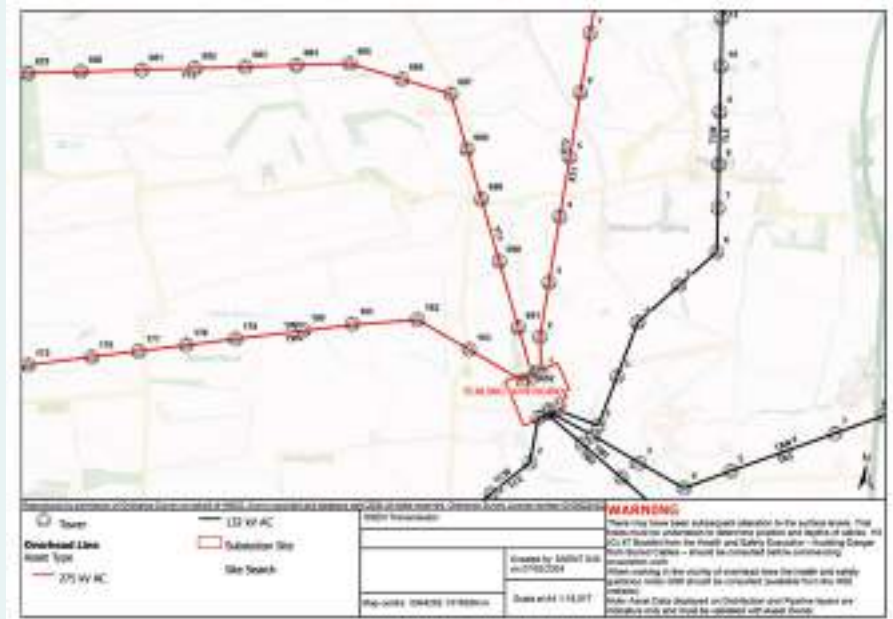

SPEN boundary

We will reconductor down to the licence area border that we share with SPEN. This is mid-span between Tower 66 and Tower 65.

SPEN will submit a separate Section 37 notice for the 400kV upgrade works to be carried out to the OHL in their licence area.

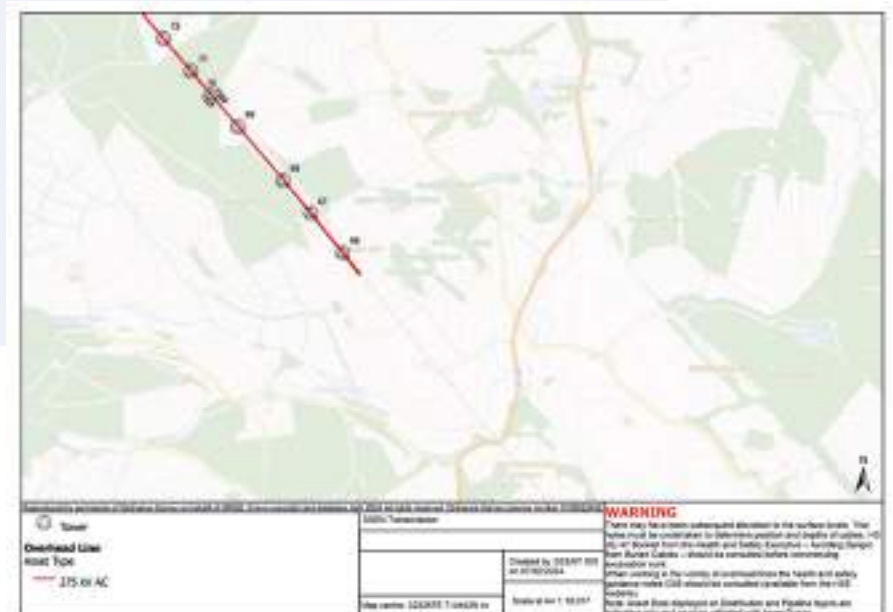

Environmental considerations

This project is required to upgrade to the existing OHL network between Tealing and Westfield substations and does not involve the construction or introduction of any new steel lattice towers. An Environmental Impact Assessment (EIA) is required as part of the Section 37 consent application under the Electricity Act 1989. An EIA Scoping Report will be prepared and submitted to the Energy Consents Unit of the Scottish Government to agree which environmental elements should be taken into consideration as part of the assessment. SSEN Transmission are responsible for the EIA for the works proposed in their licence area. SPEN will carry out a similar assessment for the works in their licence area.

Ornithology

The OHL does not pass through any sites designated for ornithological interests. There are however likely to be breeding birds in the vicinity of the existing OHL in particular lekking black grouse, raptors and upland waders. There will also be bird flight activity in proximity to, and across the line.

Mitigation measures will be required to avoid or minimise effects on these birds during the construction phase and a full suite of required bird surveys will be carried out and the scope agreed with NatureScot.

Water environment

The OHL passes over or near to a number of river catchments and watercourses. Several towers are located in areas of potential flood risk but with mitigation measures the project is not anticipated to increase flood risk or have a detrimental impact on water quality.

Private water supplies will be identified and assessed to determine potential risk to any supplies. Where required, measures will be put in place to ensure that the quality and quantity of water from these supplies would not be adversely affected.

Visual effects

There would be limited material change to the appearance of the OHL following the reinforcement works as the associated fittings will be visually similar to those present already, albeit the existing twin conductors would be replaced with triple conductors.

Some visual effects would result during the construction from temporary works as crew and machinery move along the line to replace the conductors and fittings and works and from tree felling associated with the creation of a 400kV operational corridor.

Terrestrial and aquatic ecology

The OHL crosses primarily agricultural land, utilised for arable crops and pasture, as well as areas of woodland, running and standing water. Within the corridor there is a single Special Area of Conservation (SAC) (River Tay SAC) and a short distance upstream is the Firth of Tay and Eden Estuary Special Protection Area (SPA) and Ramsar site.

There are four Ancient Woodland Inventory (AWI) woodlands of Long-Established Plantation Origin (LEPO) which cross the existing line and a further three which are within the vicinity of the line. There are no other designated sites (including locally designated). A single area of lowland raised bog (lowland raised bog inventory) was identified during the desk study.

Surveys identified a number of habitats that are listed on the Scottish Biodiversity List and are therefore considered to be of principal importance for biodiversity conservation in Scotland. Most are also Tayside Local Priority habitats. Targeted surveys and species protection plans would be put in place to minimise potential effects on protected species during construction.





Cultural heritage

A limited number of non-designated assets have been recorded within 100m of the current OHL, although most are set some distance away from the existing towers.

As a result, physical impacts should be limited to the access tracks and other associated supporting works that might be required.

In addition, there is the potential for physical impacts on designated assets including, Dronley House Mound (SM6535), East Adamston unenclosed settlement and souterrain (SM6465), South Inchmichael unenclosed settlement (SM7199) and Megginch Castle Garden and Designed Landscape (GDL00278). Any works within the vicinity of these assets will require careful consideration and potentially require Scheduled Monument Consent.

Further consultation will be required with Statutory Consultees with regard to any direct impacts and suitable mitigation that may be required.

A programme of archaeological works will be implemented, and recommendations provided to minimise the potential effects on assets during construction will be presented in the Construction Environmental Management Plan (CEMP), identifying known cultural heritage assets within close proximity to existing towers and proposed access routes.

Traffic and transport

A Construction Traffic Management Plan (CTMP) will be developed and used to specify construction traffic routes to suitable roads and appropriately signed diversions, where required during the construction phase of the works. This will be prepared in agreement with Perth and Kinross, Angus and Fife Councils.

Noise

Construction noise is considered to be short-term and intermittent and will be controlled through the implementation of a Noise Management Plan. An assessment of operational noise will be undertaken, in discussion with the Environmental Health Departments of Perth and Kinross, Angus and Fife Councils.

Electromagnetic fields

Electromagnetic Fields (EMF) arise from electric charges and current flow. Exceedance of EMF exposure limits are not expected, but an assessment of the change in EMF strengths due to the OHL operating at 400kV will be undertaken and the results will be presented alongside exposure limits.

Help shape our plans

The work we have planned is significant and has the potential to deliver massive benefits in your community, Scotland, and beyond. Yet we know that achieving our goals will require a lot of work that will impact your lives. That's why we want to work with you every step of the way throughout the planning and delivery stages of these essential and ambitious works.

We're committed to delivering a meaningful consultation process that actively seeks the views of everyone affected by our plans. That means making our plans clear and easily accessible, so that you can give us input throughout each stage of the development process.

Throughout the consultation, we'll present our approach to developing the project, including changes made since we last consulted with you.

We will also provide some visualisations and maps to show you where everything will be located.


We want you to share your thoughts and opinions on our plans, where you think we can make improvements, concerns about the impact of our work and what you think of any changes and refinements we've made.

By telling us what you think, you will help shape our proposals. We want to harness your local knowledge so that we spot any unforeseen challenges early and maximise the potential benefits and opportunities for your communities.

Because, ultimately, we want you to work with us to ensure that the energy infrastructure we build will be the best it can possibly be.

Who we are consulting with

As well as communities, we are keen to hear feedback from a broad range of other stakeholders including but not limited to landowners, businesses, non-statutory consultees and statutory consultees such as local authorities, NatureScot, Scottish Environment Protection Agency (SEPA), Historic Environment Scotland (HES) and Scottish Forestry (SF).

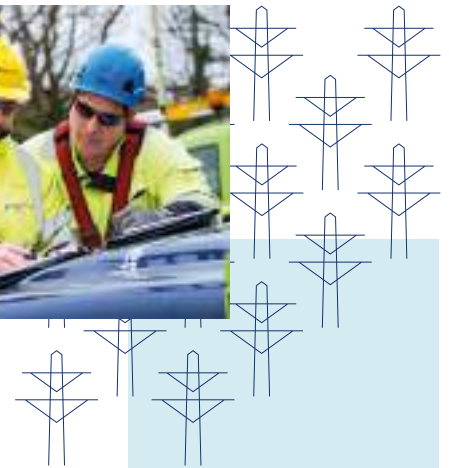

Feedback

The following feedback was received during the first of two series of public consultation events held between 4 – 7 March 2024 in relation to the Section 37 consent applications for the upgrade of the Tealing to Westfield and Alyth to Tealing overhead lines from 275kV to enable operation at 400kV. A total of 163 people attended the events.

During the 6 week feedback period which closed on 15 April 2024, 15 responses were received and these are set out using a theme based approach below. We have included both event feedback and statutory stakeholder feedback received through the consultation process within the next three pages.


Theme	Response
<p>Electro Magnetic Field (EMF) Concerns regarding people living close to the Overhead Lines (OHL) and the health risk associated with the increase in voltage.</p>	<p>We would like to reassure the public and communities that we develop, build and operate our infrastructure to meet all health and safety legislation and guidance set by relevant bodies - including the UK Government, Scottish Government, the Health and Safety Executive and our regulator, Ofgem – including that associated with Electro Magnetic Fields (EMFs).</p> <p>In respect of EMFs, we strictly follow the guidance as set by the UK Government, which in turn is informed by international guidance.</p> <p>As well as setting exposure limits that protect against known, established effects of EMF; the UK Government’s guidance also includes precautionary measures to protect against possible effects below the exposure limits that have not been established by science.</p> <p>In addition to this, the UK Health Security Agency and Department of Health have a remit to review new research in this area and ensure that current guidelines and policies are reflective of that research.</p> <p>Furthermore, the UK Government’s latest policy on EMF is set out in National Policy Statement EN-5, (NPS EN-5) which was reissued in November 2023 and came into force on 17 January 2024. This latest policy is reflective of that review process and in line with the NPS EN-5, the current UK Government guidance, informed by relevant international guidance, is therefore still considered appropriate by the UK Government and their public health experts. Whilst electricity consenting decisions are devolved to Scottish Ministers and the NPS EN-5 is therefore not all relevant in Scotland, we can confirm compliance with all EMF guidance as set out in the NPS EN-5.</p> <p>There have been over four decades of research looking into whether EMF can cause health effects and there are no established effects below the exposure limits. When we design our overhead lines, substations and cables we do so to ensure they will not exceed those exposure limits, even when operating at 100% capacity. We also ensure that precautionary measures are also applied to the design where required. We will provide information on compliance as part of the consenting process, which will be publicly available.</p> <p>In summary, the guidance we follow, which remains subject to ongoing review as required, ensures that safety measures will be applied to our 400kV overhead line infrastructure protecting us all against EMF exposure, keeping our network safe for the public.</p>

Feedback

Theme	Response
<p>OHL noise Concerns regarding noise from operation of OHLs.</p>	<p>A Noise Impact Assessment is currently being prepared and will be submitted as part of the forthcoming S37 consent application.</p> <p>This will identify any adverse noise impacts that may result from construction activities and will propose appropriate mitigation in response that will be finalised in agreement with the relevant Planning Authorities and the Energy Consents Unit (ECU).</p>
<p>Benefit to local population Queries regarding how the local population might benefit from the proposals i.e. cleaner, cheaper energy.</p>	<p>The proposed development forms part of the Pathway to 2030, a series of projects to increase the capacity of the transmission network in northern Scotland. It is part of the national effort to upgrade power lines across Great Britain to connect and transport renewable electricity to communities around Scotland and beyond, especially from offshore wind farms.</p> <p>In terms of Community Benefit, we have consulted on a Community Benefit Fund for projects until 2026, a first for a transmission operator in Scotland. This fund lets us work directly with local communities to support initiatives in northern Scotland.</p> <p>We want to give back to the communities hosting our transmission network and to help fund projects that can leave a lasting, positive legacy in those areas. We're encouraging the UK Government and Ofgem to recognise the crucial role the north of Scotland plays in energy targets in any upcoming guidance, ensuring that community benefits will reflect this significance.</p> <p>Additionally, our projects will boost the economy, supporting local jobs and businesses. Recent studies show our Pathway to 2030 programme could contribute over £6bn to the UK's economy, support 20,000 jobs across the UK, and benefit Scotland by around £2.5bn, supporting 9,000 jobs.</p>
<p>Consultation events It was raised that consultations should occur over a number of weeks to give more people the chance to attend.</p>	<p>In March 2024, a series of consultation events were held at four locations along the project routes Alyth to Tealing OHL and Tealing to Westfield OHL. Information was displayed at each of those events and staff were on hand to answer queries. All information is also available to view on the SSEN Transmission project webpage and each consultation period is open for six weeks. Additional consultation is due to take place in early June 2024 with an additional six week consultation period open for people to view material and provide feedback.</p>
<p>Consultation with landowners Concern raised that there hasn't been direct communication with all those closely affected.</p>	<p>In addition to the series of public consultation events taking place in March and June 2024, specific to the proposed development, the SSEN Transmission's team of Land Managers are in the process of identifying and contacting all potentially affected landowners.</p>
<p>Energy at the point of need Concern raised that the work being carried out will ultimately not be for Scotland's benefit noting that projects should be located where energy is required.</p>	<p>SSEN Transmission is responsible for where and how the high voltage transmission network operates in the north of Scotland. However, we don't determine where energy is generated – nor where it is needed.</p> <p>We have a legal obligation to provide electricity generators access to our network, so that the electricity they generate can be transported across the GB to meet the energy demand of homes and businesses.</p> <p>The north of Scotland is rich in renewable energy, especially wind, water, and marine sources meaning this region is vital for the UK and Scotland's climate goals. Our area covers a quarter of the UK landmass and will be crucial in the move towards a low carbon future.</p>

Theme	Response
<p>Undergrounding of OHLs A query raised regarding the potential undergrounding of OHLs to reduce impact.</p>	<p>Whilst we are committed to exploring the possibility of undergrounding at sensitive locations where there is clear evidence to justify it, this presents significant challenges due to a range of technical, operational, environmental and economic factors and may not always be the best option from an environmental perspective. In particular, it may not represent the best solution for landowners due to the greater footprint and associated impact on agricultural land as well as the requirement for additional above ground infrastructure to manage system requirements. Further information on the challenges and costs involved can be found in our undergrounding briefing note: 2030 challenges (ssen-transmission.co.uk/globalassets/projects/2030-projects/2030-project-documents/2030-challenges-doc.pdf)</p>
<p>Wildlife and biodiversity Concerns that there will be a detrimental impact on wildlife and biodiversity.</p>	<p>We prioritise environmental protection in our infrastructure projects, strictly adhering to environmental policies and regulations. We follow a mitigation hierarchy strategy of “avoid, minimise, mitigate and restore” to safeguard local, national and internationally designated environmentally protected areas.</p> <p>We also acknowledge that minimising impacts is not enough on its own, and we have therefore committed to delivering a Biodiversity Net Gain (BNG) on all our projects; as well as compensatory planting for any trees felled during the construction phase, where possible with native species.</p> <p>During our assessments, comprehensive surveys identify potentially affected wildlife, guiding mitigation efforts. Ecology survey work is ongoing.</p> <p>We also assess habitats and other species along our routes. Our consultation process to date has highlighted sensitive areas, and we continue to work with environmental experts and seek community feedback to refine our approach.</p>
<p>Cultural heritage Concern regarding impact on Scheduled Monuments.</p>	<p>When planning our overhead line projects, we consider environmental, cultural, and built heritage impact.</p> <p>We make use of national archives and data sources as well as gathering data from Local Authorities and detailed site surveys to identify and assess the potential impact on archaeological sites, listed buildings, and other heritage assets.</p> <p>Environmental Impact Assessment Reports (EIARs) detail these findings and recommend ways to lessen any potential adverse effects. We’ve received feedback about sensitive archaeological and cultural sites from a range of stakeholders all of which our environmental experts have considered. Where there is the potential for direct impact on a Scheduled Monument, we will discuss this with Historic Environment Scotland and seek Scheduled Monument Consent where required.</p>
<p>Construction Concerns about impact on the local area.</p>	<p>Construction working hours will typically be restricted to 0700 hours to 1900 hours Monday to Friday and 0700 hours to 1300 hours on Saturday, with only some continuous activities carried out by exception.</p> <p>The Contractor will prepare and adopt a Construction Environmental Management Plan (CEMP) to minimise any potential impacts during construction. These documents will be approved by the Planning Authority and ECU in advance of construction starting and will include contact details for the Construction Site Manager, who will be the main point of contact with the local community during construction.</p> <p>In addition the Contractor will prepare and adopt a Construction Traffic Management Plan (CTMP) to ensure that appropriate mitigation and management strategies are identified and implemented. This will include the identification of any road widening, junction improvements or repairs that will be required. Condition surveys of the public highway will be carried out before works start on site, and again upon completion, with any defects repaired to ensure the public highway is left in no worse state once the works are complete.</p>
<p>Other statutory and non- statutory consultees</p>	<p>Additional feedback was also received from statutory and non statutory consultees which will be taken into account as the projects progress. Discussion with consultees and others will continue as required at the pre application stage and thereafter.</p>

Project timeline

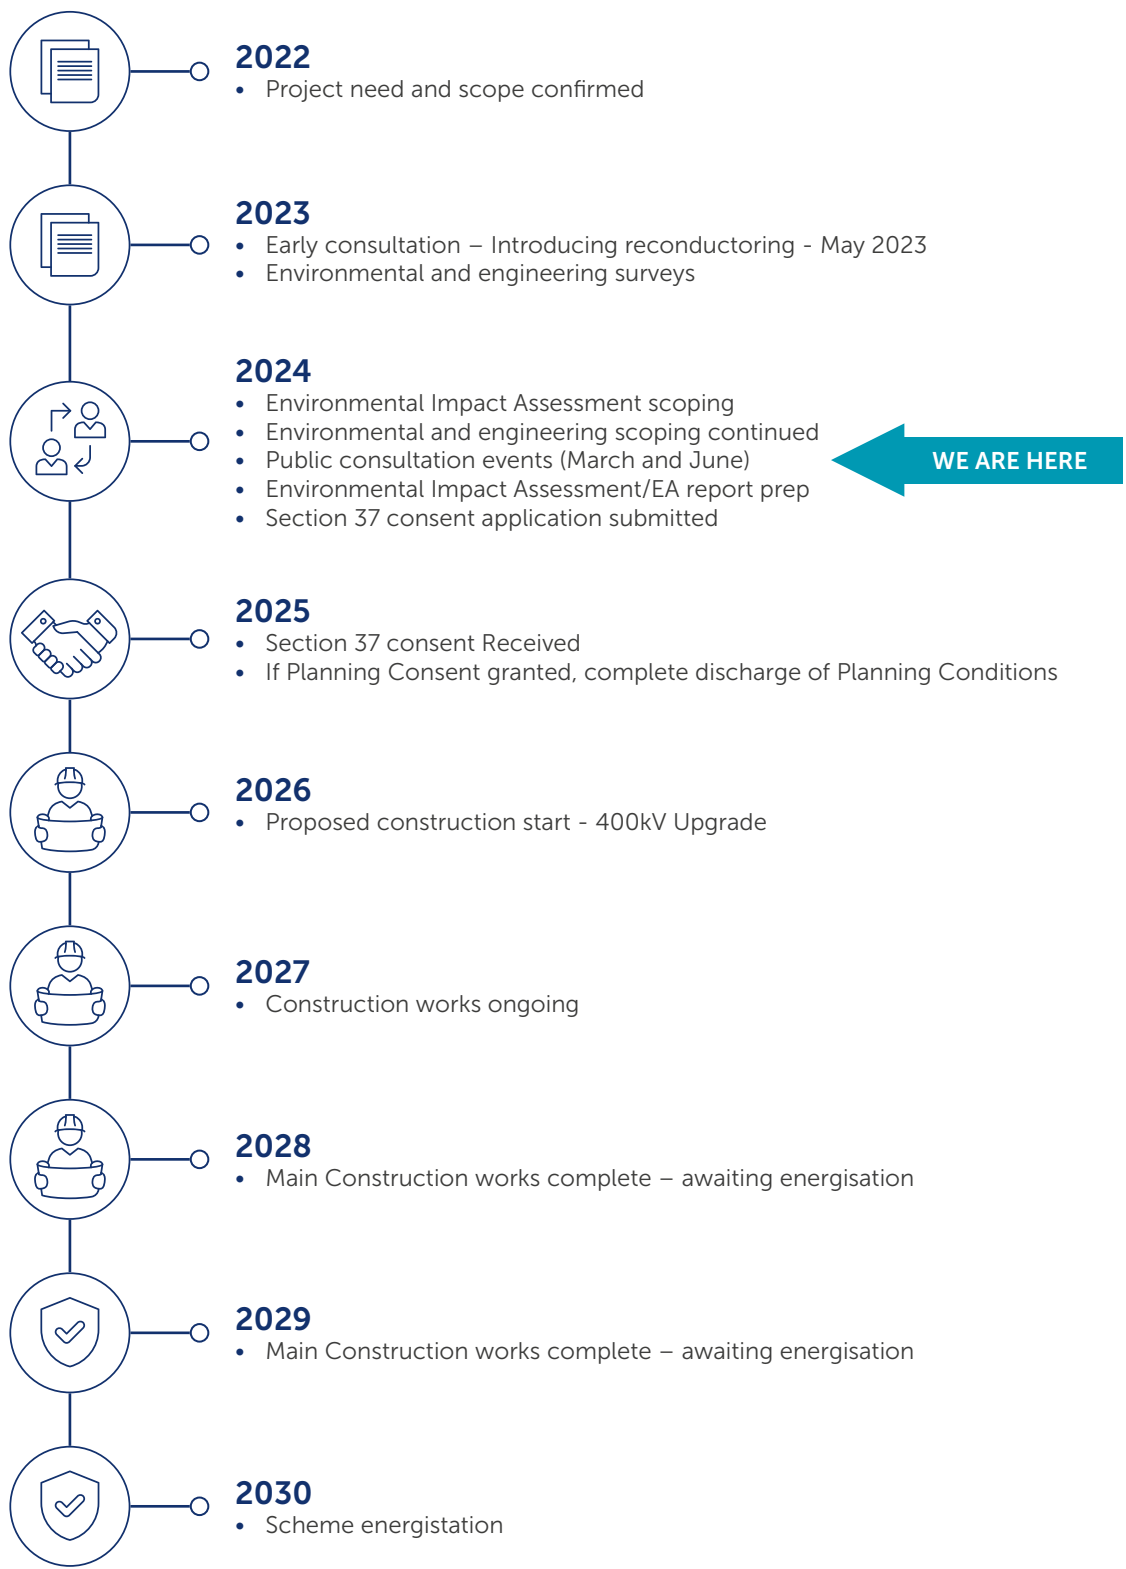

Have your say

We value community and stakeholder feedback. Without this, we would be unable to progress projects and reach a balanced proposal.

The feedback period

We will accept feedback from now until 18 July 2024.

How to provide feedback

Submit your comments and feedback by emailing or writing to your Community Liaison Manager

Any comments made to us as the Applicant are not representations to Scottish Ministers as the decision makers. There will be an opportunity to make formal representations to Scottish Ministers via the Energy Consents Unit following the submission of the section 37 applications.

What we're seeking views on

During our last public consultation events in March 2024, we wanted to know your thoughts on our project plans, where you thought we could make improvements, and any changes and refinements we'd made.

We are now asking for any final comments or feedback ahead of submitting planning applications for the Tealing - Westfield OHL 400kV upgrade project.



To support everyone online, we provide accessibility and language options on our website through 'Recite Me'. The accessibility and language support options provided by 'Recite Me' include text-to-speech functionality, fully customisable styling features, reading aids, and a translation tool with over 100 languages, including 35 text-to-speech.

Please select "Accessibility" on our website to try out our inclusive toolbar.

Our Community Liaison Team

Each project has a dedicated Community Liaison Manager who works closely with community members to make sure they are well informed of our proposals and that their views, concerns, questions or suggestions are put to our project teams.

Throughout the life of our projects, you will hear from us regularly. We aim to establish strong working relationships by being accessible to key local stakeholders such as community councils, residents' associations and development trusts, and regularly engage with interested individuals.

Community Liaison Manager

Rhiannon Merritt

Community Liaison Manager

SSEN Transmission
10 Henderson Road,
Inverness, IV1 1SN

E: tkup@sse.com



Additional information

The best way to keep up to date is to sign up to project updates via the project webpage: ssen-transmission.co.uk/tealing-westfield

You can also follow us on social media

 [SSEN-Transmission](#)

 [SSETransmission](#)



Scottish & Southern
Electricity Networks

TRANSMISSION

APPENDIX G: LIST OF STAKEHOLDERS

<ol style="list-style-type: none"> 1. Angus Council. 2. Perth and Kinross Council 3. Fife Council. 4. SEPA. 5. NatureScot. 6. Historic Environment Scotland. 7. Scottish Forestry. 8. Transport Scotland. 9. Scottish Water. 10. Community Councils. 11. Network Rail. 12. BT. 13. Energy Consents Unit. 14. Civil Aviation Authority – Airspace. 15. Crown Estate Scotland. 16. British Horse Society. 17. Defence Infrastructure Organisation. 18. John Muir Trust. 19. Mountaineering Scotland. 20. National Farmers Union (Policy Advisor). 	<ol style="list-style-type: none"> 21. National Grid (Electricity). 22. National Grid (Gas). 23. National Trust Scotland. 24. NATS Safeguarding. 25. Nuclear Safety Directorate (HSE). 26. RSPB Scotland. 27. Scottish Canoe Association. 28. Scottish Rights of Way and Access Society (ScotWays). 29. Scottish Wild Land Group (SWLG). 30. Scottish Wildlife Trust. 31. SUSTrans. 32. Visit Scotland. 33. Fisheries Management Scotland. 34. Tay DDSFB (Salmon Fisheries Board). 35. Tay Foundation (Fisheries Trust). 36. Forth & Tay Navigation Service (FTNS). 37. Joint Radio Company.
---	---

APPENDIX H: EVENT PHOTOS

Event 1



Event 2

